

IBC 2009 CODE DATA	
FLOOR AREA	5,300 SF
NUMBER OF STORIES	3
USE AND OCCUPANCY CLASSIFICATION - SECTION 304.1	B
TYPE OF CONSTRUCTION - TABLE 601	V-B
FIRE RESISTANT CONSTRUCTION - TABLE 601:	
STRUCTURAL FRAME	0 HOUR
EXTERIOR BEARING WALLS	0 HOUR
INTERIOR BEARING WALLS	0 HOUR
EXTERIOR NONBEARING WALLS	0 HOUR
INTERIOR NONBEARING WALLS	0 HOUR
FLOOR CONSTRUCTION	0 HOUR
ROOF CONSTRUCTION	0 HOUR
FIRE RATING STAIR ENCLOSURES AND SHAFTS - SECTION 708.4	
FIRE ALARM SYSTEM REQUIRED - SECTION 907.2.2	YES
OCCUPANT LOAD - TABLE 1004.1.1	53
MAXIMUM COMMON PATH OF TRAVEL DISTANCE - NFPA 101-2009 TABLE A7.6	100 FEET
MAXIMUM EXIT TRAVEL DISTANCE - TABLE 1016.1	250 FEET
FIRE RATED CORRIDORS - TABLE 1018.1	0
DEAD END CORRIDOR LENGTH - SECTION 1018.4	0
MINIMUM NUMBER OF EXITS - TABLE 1021.1	2
FIRE EXTINGUISHERS	1 AT EACH EXIT 3-A 10-B-C
NOTES	


NFPA 101 2009 CODE DATA	
FLOOR AREA	5,300 SF
NUMBER OF STORIES	3
TYPE OF CONSTRUCTION - NFPA 220	V (000)
FIRE RESISTANT CONSTRUCTION - NFPA 220:	
EXTERIOR BEARING WALLS	0 HOUR
INTERIOR BEARING WALLS	0 HOUR
COLUMNS	0 HOUR
BEAMS, GIRDERS, TRUSSES, AND ARCHES	0 HOUR
FLOOR CONSTRUCTION	0 HOUR
ROOF CONSTRUCTION	0 HOUR
USE GROUP CLASSIFICATION - SECTION 3.3.178.3	
EXIT STAIR ENCLOSURES - SECTION 7.1.3.2.1	1 HOUR
OCCUPANT LOAD - TABLE 7.3.1.2	53
SHAFT ENCLOSURES - SECTION 8.6.5	1 HOUR
MINIMUM NUMBER OF EXITS - SECTION 38.2.4.1	2
DEAD END CORRIDOR LENGTH - SECTION 38.2.5.2.1	50 FEET
MAXIMUM COMMON PATH OF TRAVEL DISTANCE - SECTION 38.2.5.3.1	100 FEET
MAXIMUM EXIT TRAVEL DISTANCE - SECTION 38.2.6.3	300 FEET
FIRE ALARM SYSTEM REQUIRED - SECTION 38.3.4.1	YES
FIRE RATED CORRIDORS - SECTION 38.3.6.1(3)	0
FIRE EXTINGUISHERS	1 AT EACH EXIT 3-A 10-B-C
NOTES	

**1 LIFE SAFETY PLAN**  
 SCALE: 1/8" = 1'-0"  
 2' 4' 8' 16'

AREA NOT IN CONTRACT

**NOTE:**  
 PLAN SHOWS REQUIRED LOCATIONS FOR LIFE SAFETY ELEMENTS.  
 EXISTING LIFE SAFETY ELEMENTS IN LOCATIONS SHOWN MAY BE REUSED  
 IF COMPATIBLE WITH BUILDING FIRE ALARM SYSTEM.

- LIFE SAFETY LEGEND**
- EMERGENCY LIGHT
  - EXIT SIGN
  - FIRE ALARM PULL STATION
  - HORN STROBE - CEILING MOUNT
  - STROBE - CEILING MOUNT
  - HORN STROBE - WALL MOUNT
  - FIRE EXTINGUISHER 10# DRY CHEMICAL TYPE

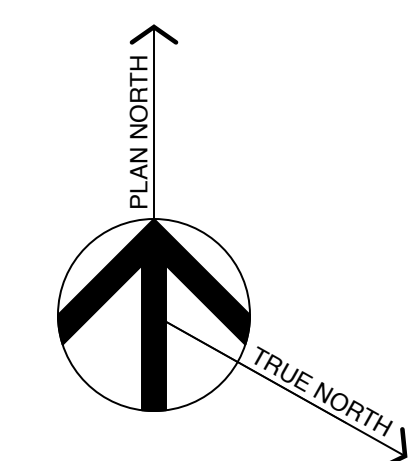

**Michael Charek Architects**  
 25 Hartley Street  
 Portland, Maine 04103  
 (207) 761-0656



**Offices for Stroudwater Associates**  
 1685 Congress Street, 2nd Floor  
 Portland, ME 04102

**Title**  
 LIFE SAFETY PLAN

**Scale:** 1/8"=1'-0"

**Date:** 11/9/16

**Revisions**

**Sheet**  
**A2**