


WALL TYPES SCHEDULE		
MARK	DESCRIPTION	STUD WIDTH
A	N/A	
B	N/A	
C	N/A	
D	METAL STUD TO DECK WITH INSULATION	REFERENCE PARTITION SCHEDULE
E	N/A	
F	METAL STUD TO DECK WITH INSULATION - (RATED)	REFERENCE PARTITION SCHEDULE
G	N/A	
H	N/A	
J	N/A	
K	N/A	
L	N/A	
M	N/A	
N	N/A	
O	N/A	
P	EXISTING STUDS - GYP ONE SIDE WITH BRACING (RATED)	REFERENCE PARTITION SCHEDULE

PARTITION TYPE	PARTITION SCHEDULE	
	GENERAL WALL DESCRIPTION	GENERAL PICTORIAL
STC 48	<p>3 5/8" METAL STUDS @ 16" O.C. FULL HEIGHT TO UNDERSIDE OF DECK. PROVIDE CONTINUOUS ACOUSTICAL INSULATION. BRACE WALL AS REQUIRED.</p> <p>BOTH SIDES: 5/8" TYPE "X" GWB, FULL HEIGHT OF WALL.</p>	
STC 48	<p>1-HOUR FIRE RATE ASSEMBLY EQUAL TO UL DESIGN NO. U-419</p> <p>3 5/8" METAL STUDS @ 16" O.C. EXTEND FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF DECK. PROVIDE CONTINUOUS ACOUSTICAL INSULATION TO UNDERSIDE OF EXISTING ROOF DECK.</p> <p>BOTH SIDES: 5/8" DENS ARMOR PLUS FIREGUARD GWB FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF DECK. FIRE SEAL TOP OF WALL AS REQUIRED TO MAINTAIN 1 HOUR FIRE RATING.</p>	
STC 50	<p>1-HOUR FIRE RATE ASSEMBLY</p> <p>3 5/8" METAL STUDS @ 16" O.C. EXTEND FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF DECK. PROVIDE CONTINUOUS ACOUSTICAL INSULATION TO UNDERSIDE OF EXISTING ROOF DECK.</p> <p>TAGGED SIDE: 5/8" EXTERIOR GRADE PLYWOOD SHEATHING TO 8'-0" AFF.</p> <p>5/8" TYPE "X" FROM TOP OF PLYWOOD SHEATHING TO UNDERSIDE OF EXISTING ROOF DECK.</p> <p>5/8" TYPE "X" GWB FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF DECK. SEAL TOP OF WALL AS REQUIRED TO MAINTAIN 1 HOUR FIRE RATING.</p> <p>OPPOSITE SIDE: 5/8" TYPE "X" GWB FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF DECK.</p>	
STC 50	<p>1-HOUR FIRE RATED ASSEMBLY</p> <p>EXISTING WALL ASSEMBLY TO REMAIN. REPLACE EXISTING FRAMING AS REQUIRED. EXTEND 3-5/8" METAL STUDS FROM TOP OF EXISTING WALL TO UNDERSIDE OF EXISTING ROOF DECK. REMOVE EXISTING GWB WALL FINISH AT TAGGED SIDE OF WALL. PROVIDE CONTINUOUS ACOUSTICAL INSULATION, FULL HEIGHT.</p> <p>TAGGED SIDE: 5/8" EXTERIOR GRADE PLYWOOD SHEATHING FROM FINISH FLOOR TO 12" ABOVE FINISH CEILING.</p> <p>5/8" TYPE "X" GWB FROM TOP OF PLYWOOD SHEATHING TO UNDERSIDE OF EXISTING ROOF DECK. FIRE SEAL TOP OF WALL AS REQUIRED TO MAINTAIN 1 HOUR FIRE RATING.</p> <p>5/8" DENS ARMOR PLUS FIREGUARD GWB FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF DECK. FIRE SEAL TOP OF WALL AS REQUIRED TO MAINTAIN 1 HOUR FIRE RATING.</p> <p>OPPOSITE SIDE: EXIST. GWB TO REMAIN.</p> <p>5/8" TYPE "X" FROM TOP OF EXISTING GWB TO UNDERSIDE OF EXISTING ROOF DECK. FIRE SEAL TOP OF WALL AS REQUIRED TO MAINTAIN 1 HOUR FIRE RATING.</p>	

- PARTITION SCHEDULE NOTES**
- BRACE WALL ASSEMBLIES TO STRUCTURE ABOVE AT ALL DOORS AND ELSEWHERE AS REQUIRED.
 - PROVIDE SOLID BLOCKING AS INDICATED ON DRAWINGS AND AS REQUIRED BY MANUFACTURER'S EQUIPMENT (SUCH AS BUT NOT LIMITED TO CASE WORK, TOILET & BATH ACCESSORIES, CLOSET RODS, SHELVING AND H.C. GRAB BARS.)
 - FIRE SAFING & FIRE STOPPING:** PROVIDE FIRE SAFING SYSTEM/MATERIAL AT ALL PENETRATIONS THRU FIRE RATED ASSEMBLIES. COORDINATE PROPOSED SYSTEMS & MATERIALS FOR APPROPRIATENESS & COMPATIBILITY W/OTHER BUILDING SYSTEMS, TYPE OF SYSTEM PENETRATED, & APPLICATION. REFERENCE SPECIFICATIONS FOR ADDITIONAL INFORMATION.
 - PROVIDE 5/8" DENS GLASS FIREGUARD GYPSUM WALL BOARD FROM FINISH FLOOR TO 4'-0" ABOVE FINISH FLOOR AT ALL SINK LOCATIONS. MATCH WIDTH OF CABINET MINIMUM.
 - REFERENCE LS3.0 FOR MORE PARTITION INFORMATION.
 - EXISTING ROOF FRAMING AT APPROXIMATELY 14'-6"± AFF AT LOW POINT AND 15'-6"± AT HIGH POINT. VERIFY EXISTING HEIGHTS AND LIMITATIONS IN FIELD.

PARTITION & WALL TYPES SCHEDULES


SCALE: AS NOTED

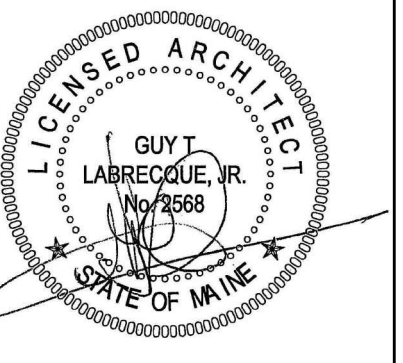

CWS
Architects

434 Cumberland Avenue
Portland, ME 04101
Phone: (207) 774-4441
Fax: (207) 774-4016
www.CW5arch.com

Dialysis Clinic Fit-Up:
SOUTHERN MAINE DIALYSIS
1190
1600 CONGRESS STREET
PORTLAND, MAINE 04102

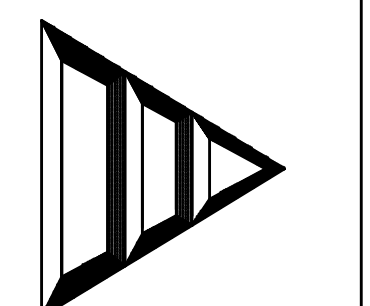

Drafted By: CWS ARCH
Checked By: CWS - GTL
Date Drawn: 03/06/12
Project #: CWS# 11418

REV #	DATE	REVISION DESCRIPTION
1	3/14/2012	ISSUED FOR 100% CONSTRUCTION

LS2.0

Sheet Number