

SPECIFIC REMOVALS NOTES:

- 1 REMOVE DOOR AND DOOR FRAME ASSEMBLIES.
- 2 REMOVE DOOR, DOOR FRAME AND SIDE LIGHT ASSEMBLIES.
- 3 REMOVE DOOR AND DOOR FRAME ASSEMBLIES TO ALLOW FOR NEW DOOR AND DOOR FRAME ASSEMBLIES. REFERENCE NEW WORK PLAN AND DOOR SCHEDULE FOR MORE INFORMATION.
- 4 REMOVE PORTION OF GWB WALL ASSEMBLY, FULL HEIGHT AND TO EXTENTS INDICATED ON PLAN. COORDINATE EXTENTS OF REMOVALS WITH NEW WORK PLAN. REFERENCE NEW WORK PLAN FOR MORE INFORMATION.
- 5 REMOVE PORTION OF GWB WALL ASSEMBLY TO ALLOW FOR NEW SOFFIT ASSEMBLY. COORDINATE EXTENTS OF REMOVALS WITH NEW WORK PLAN. REFERENCE NEW WORK FLOOR PLAN AND REFLECTED CEILING PLAN FOR MORE INFORMATION.
- 6 REMOVE PORTION OF GWB WALL ASSEMBLY TO ALLOW FOR NEW DOOR INSTALLATION. REFERENCE NEW WORK PLAN AND DOOR SCHEDULE FOR MORE INFORMATION.
- 7 REMOVE SUSPENDED CEILING TILE AND GRID SYSTEM WITHIN ENTIRE SPACE.
- 8 REMOVE A PORTION OF SUSPENDED CEILING TILE AND GRID SYSTEM TO EXTENTS INDICATED ON PLAN. REFERENCE NEW WORK REFLECTED CEILING PLAN FOR MORE INFORMATION.
- 9 REMOVE AND SALVAGE EXIT LIGHT FIXTURE FOR RELOCATION. EXTEND/MODIFY WIRING AS REQUIRED FOR COMPLETION OF SCOPE OF WORK. REPLACE DAMAGED FIXTURE COMPONENTS AS REQUIRED. REFERENCE REFLECTED CEILING PLAN FOR NEW LOCATIONS. REFERENCE ELECTRICAL DOCUMENTS FOR MORE INFORMATION.
- 10 REMOVE AND SALVAGE LIGHT FIXTURE. EXTEND/MODIFY WIRING AS REQUIRED TO RELOCATE TO NEW POSITION. REPLACE DAMAGED FIXTURE COMPONENTS AS REQUIRED. REFERENCE REFLECTED CEILING PLAN FOR NEW LOCATIONS. REFERENCE ELECTRICAL DOCUMENTS FOR MORE INFORMATION.
- 11 REMOVE AND SALVAGE MECHANICAL VENTILATION GRILLE. EXTEND/MODIFY DUCT WORK AS REQUIRED TO RELOCATE TO NEW POSITION. REPLACE DAMAGED COMPONENTS AS REQUIRED. REFERENCE REFLECTED CEILING PLAN FOR NEW LOCATION. REFERENCE MECHANICAL DOCUMENTS FOR MORE INFORMATION.
- 12 MODIFY/TRIM A PORTION OF EXISTING CEILING TILE AND GRID ASSEMBLY AS REQUIRED FOR NEW WALL ASSEMBLY. FIX/REPAIR/REPLACE SUSPENDED CEILING TILE AND GRID COMPONENTS THAT ARE DAMAGED AND/OR IMPACTED FROM THE CONSTRUCTION PROCESS.

GENERAL REMOVALS NOTES:

1. COORDINATE ALL REMOVALS WORK WITH ALL TRADES PRIOR TO COMMENCING THE WORK.
2. CONTRACTOR IS TO COORDINATE WITH BUILDING OWNER ANY EXISTING BUILDING COMPONENTS TO BE SALVAGED PRIOR TO COMMENCING ANY WORK.
3. SAFELY STORE ALL ITEMS INDICATED TO BE SALVAGED AND REINSTALLED. REPLACE ANY DAMAGED ITEMS OR COMPONENTS AS REQUIRED.
4. PATCH AND REPAIR ALL ADJACENT SURFACES TO REMAIN WHICH ARE DAMAGED DURING THE REMOVALS PROCESS.
5. PATCH AND REPAIR ALL REMAINING INTERIOR WALL SURFACES. PREPARE WALL SURFACES FOR NEW FINISHES PER FINISH MANUFACTURER'S RECOMMENDATIONS. REFERENCE PARTITION & ROOM FINISH SCHEDULES FOR MORE INFORMATION.
6. THE CONTRACTOR SHALL PROVIDE TEMPORARY SUPPORT, BRACING AND SHORING AS REQUIRED FOR ANY AND ALL REMOVALS. TEMPORARY BRACING, SUPPORT AND SHORING SHALL BE IN PLACE PRIOR TO ANY AND ALL REMOVALS.
7. REFERENCE THE MECHANICAL, PLUMBING AND ELECTRICAL DRAWINGS FOR ALL REMOVALS RELATED TO THE BUILDINGS UTILITIES, CLIMATE CONTROL EQUIPMENT AND OTHER RELATED ITEMS.
8. THE CONTRACTOR SHALL CUT, PATCH, AND REPAIR ANY AND ALL WALL SURFACES AS REQUIRED FOR INSTALLATION OF BLOCKING THAT IS REQUIRED BY THE INSTALLATION OF CABINETS, WALL CABINETS AND COUNTERTOPS.
9. THE CONTRACTOR SHALL CUT, PATCH, AND REPAIR CONCRETE FLOOR SLAB AS REQUIRED FOR COMPLETE STRUCTURAL, MECHANICAL, PLUMBING AND ELECTRICAL INSTALLATIONS. COORDINATE THE EXTENT OF CONCRETE REMOVALS WITH ALL SCOPES OF WORK. REFERENCE ALL CONSTRUCTION DOCUMENTS FOR ADDITIONAL INFORMATION.

A5 REMOVALS NOTES

REFERENCED FROM: SCALE: NOT TO SCALE

PARTITION SCHEDULE

PARTITION TYPE	PARTITION SCHEDULE	
	GENERAL WALL DESCRIPTION	GENERAL PICTORIAL
1	3 5/8" METAL STUDS @ 16" O.C. FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING. PROVIDE CONTINUOUS, FULL HEIGHT ACOUSTICAL INSULATION. TAGGED SIDE: 5/8" TYPE "X" GWB FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING AND SEALED TIGHT. OPPOSITE SIDE: NO FINISHES.	
2	INFILL WALL ASSEMBLY: 3 5/8" OR 6" METAL STUDS @ 16" O.C. FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING. PROVIDE CONTINUOUS, FULL HEIGHT ACOUSTICAL INSULATION. BOTH SIDES: 5/8" TYPE "X" GWB FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING AND SEALED TIGHT. ALIGN FINISH WITH EXISTING FINISH. PATCH AND REPAIR ADJACENT FINISHES AS REQUIRED.	
3	PARTIAL HEIGHT WALL ASSEMBLY: 3 5/8" METAL STUDS @ 16" O.C. FROM FINISH FLOOR TO HEIGHT AS INDICATED ON PLAN. PROVIDE DIAGONAL BRACING AS REQUIRED. PROVIDE CONTINUOUS, FULL HEIGHT ACOUSTICAL INSULATION. BOTH SIDES: 5/8" TYPE "X" GWB FROM FINISH FLOOR TO TOP OF WALL AS INDICATED ON PLAN. TOP OF WALL: WALL CAP - REFERENCE TOP OF WALL DETAIL A2/A7.04 FOR MORE INFORMATION.	
4A	3 5/8" METAL STUDS @ 16" O.C. FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING. PROVIDE CONTINUOUS, FULL HEIGHT ACOUSTICAL INSULATION. BOTH SIDES: 5/8" TYPE "X" GWB FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING AND SEALED TIGHT.	
4B	3 5/8" METAL STUDS @ 16" O.C. FROM FINISH FLOOR TO 12" ABOVE CEILING. BRACE TOP OF WALL AS REQUIRED. PROVIDE CONTINUOUS, FULL HEIGHT ACOUSTICAL INSULATION. BOTH SIDES: 5/8" TYPE "X" GWB FULL HEIGHT OF WALL.	
4C	3 5/8" METAL STUDS @ 16" O.C. FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING. PROVIDE CONTINUOUS, FULL HEIGHT ACOUSTICAL INSULATION. TAGGED SIDE: 5/8" TYPE "MRX" GWB FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING AND SEALED TIGHT. OPPOSITE SIDE: 5/8" TYPE "X" GWB SEALED TIGHT TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING.	
4D	1 HOUR FIRE RATED WALL ASSEMBLY: 3 5/8" METAL STUDS @ 16" O.C. FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING. PROVIDE CONTINUOUS, FULL HEIGHT ACOUSTICAL INSULATION. BOTH SIDES: 5/8" TYPE "X" GWB FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING AND SEALED TIGHT.	
4E	3 5/8" METAL STUDS @ 16" O.C. FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING. PROVIDE CONTINUOUS, FULL HEIGHT ACOUSTICAL INSULATION. TAGGED SIDE: 5/8" TYPE "X" GWB FROM FINISH FLOOR TO 8'-0" AFF. 5/8" PLYWOOD FROM FINISH FLOOR TO 8'-0" AFF. 5/8" TYPE "X" GWB FROM 8'-0" AFF TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING AND SEALED TIGHT. OPPOSITE SIDE: 5/8" TYPE "X" GWB FROM FINISH FLOOR TO UNDERSIDE EXISTING ROOF FRAMING/DECKING AND SEALED TIGHT.	
5	6" METAL STUDS @ 16" O.C. FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING. PROVIDE CONTINUOUS, FULL HEIGHT ACOUSTICAL INSULATION. TAGGED SIDE: 5/8" TYPE "X" GWB FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING AND SEALED TIGHT. OPPOSITE SIDE: NO FINISHES.	
6A	6" METAL STUDS @ 16" O.C. FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING. PROVIDE CONTINUOUS, FULL HEIGHT ACOUSTICAL INSULATION. BOTH SIDES: 5/8" TYPE "X" GWB FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING AND SEALED TIGHT.	
6B	6" METAL STUDS @ 16" O.C. FROM FINISH FLOOR TO 12" ABOVE CEILING. BRACE TOP OF WALL AS REQUIRED. PROVIDE CONTINUOUS, FULL HEIGHT ACOUSTICAL INSULATION. BOTH SIDES: 5/8" TYPE "X" GWB FULL HEIGHT OF WALL.	

C5 PARTITION SCHEDULE


REFERENCED FROM: SCALE: NOT TO SCALE

PARTITION SCHEDULE

PARTITION TYPE	PARTITION SCHEDULE	
	GENERAL WALL DESCRIPTION	GENERAL PICTORIAL
6E	6" METAL STUDS @ 16" O.C. FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING. PROVIDE CONTINUOUS, FULL HEIGHT ACOUSTICAL INSULATION. TAGGED SIDE: 5/8" TYPE "MRX" GWB FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING AND SEALED TIGHT. OPPOSITE SIDE: 5/8" TYPE "X" GWB FROM FINISH FLOOR TO UNDERSIDE EXISTING ROOF FRAMING/DECKING AND SEALED TIGHT.	
6D	6" METAL STUDS @ 16" O.C. FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING. PROVIDE CONTINUOUS, FULL HEIGHT ACOUSTICAL INSULATION. BOTH SIDES: 5/8" TYPE "MRX" GWB FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING AND SEALED TIGHT.	
6E	6" METAL STUDS @ 16" O.C. FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING. PROVIDE CONTINUOUS, FULL HEIGHT ACOUSTICAL INSULATION. TAGGED SIDE: 5/8" TYPE "X" GWB FROM FINISH FLOOR TO 8'-0" AFF. 5/8" PLYWOOD FROM FINISH FLOOR TO 8'-0" AFF. 5/8" TYPE "X" GWB FROM 8'-0" AFF TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING AND SEALED TIGHT. OPPOSITE SIDE: 5/8" TYPE "X" GWB FROM FINISH FLOOR TO UNDERSIDE EXISTING ROOF FRAMING/DECKING AND SEALED TIGHT.	
6E	6" METAL STUDS @ 16" O.C. FROM FINISH FLOOR TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING. PROVIDE CONTINUOUS, FULL HEIGHT ACOUSTICAL INSULATION. TAGGED SIDE: 5/8" TYPE "X" GWB FROM FINISH FLOOR TO 8'-0" AFF. 5/8" PLYWOOD FROM FINISH FLOOR TO 8'-0" AFF. 5/8" TYPE "X" GWB FROM 8'-0" AFF TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING AND SEALED TIGHT. OPPOSITE SIDE: 5/8" TYPE "X" GWB FROM FINISH FLOOR TO 8'-0" AFF. 5/8" PLYWOOD FROM FINISH FLOOR TO 8'-0" AFF. 5/8" TYPE "X" GWB FROM 8'-0" AFF TO UNDERSIDE OF EXISTING ROOF FRAMING/DECKING AND SEALED TIGHT.	
6E	PARTIAL HEIGHT WALL ASSEMBLY: 6" METAL STUDS @ 16" O.C. FROM FINISH FLOOR TO HEIGHT AS INDICATED ON PLAN. PROVIDE DIAGONAL BRACING AS REQUIRED. PROVIDE CONTINUOUS, FULL HEIGHT ACOUSTICAL INSULATION. BOTH SIDES: 5/8" TYPE "X" GWB FROM FINISH FLOOR TO TOP OF WALL AS INDICATED ON PLAN. TOP OF WALL: WALL CAP - REFERENCE TOP OF WALL DETAIL A2/A7.04 FOR MORE INFORMATION.	

PARTITION SCHEDULE NOTES

1. BRACE WALL ASSEMBLIES TO STRUCTURE ABOVE AT ALL DOORS AND ELSEWHERE AS REQUIRED.
2. PROVIDE SOLID BLOCKING AS INDICATED ON DRAWINGS AND AS REQUIRED BY MANUFACTURER'S EQUIPMENT (SUCH AS BUT NOT LIMITED TO CASE WORK, TOILET & BATH ACCESSORIES, CLOSET RODS, SHELVEING AND H.C. GRAB BARS.)
2. FIRE SAFING & FIRE STOPPING:
 - 2.1. PROVIDE FIRE SAFING SYSTEM/MATERIAL AT ALL PENETRATIONS THRU FIRE RATED ASSEMBLIES. COORDINATE PROPOSED UL APPROVED SYSTEMS & MATERIALS FOR APPROPRIATENESS & COMPATIBILITY W/OTHER BLDG. SYSTEMS, TYPE OF SYSTEM PENETRATED, & APPLICATION.
 - 2.2. ALL PARTITIONING EXTENDING TO UNDERSIDE OF DECK OR CEILING SHALL BE INSTALLED UTILIZING A SLIP TRACK ALLOWING FOR 3/4" OF STRUCTURAL DEFLECTION. PROVIDE FIRE SAFING SYSTEM/MATERIAL AT TOP OF FIRE RATE PARTITIONS AS REQUIRED TO MAINTAIN THE FIRE RATED CLOSURE OF FIRE RATED PARTITION.
3. FIRE DAMPERS: PROVIDE APPROPRIATELY RATED FIRE DAMPERS AT ALL LOCATIONS WHERE MECHANICAL VENTILATION DUCTS PENETRATE RATED ASSEMBLIES.
4. PROVIDE 5/8" TYPE "MRX" GYPSUM WALL BOARD FROM FINISH FLOOR TO 4'-0" ABOVE FINISH FLOOR AT ALL SINK LOCATIONS. MATCH FULL WIDTH OF CABINETS MINIMUM.

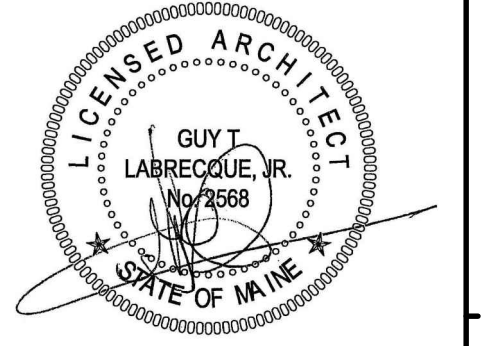

OWNER / DEVELOPER
164 REALTY, LLC
100 SILVER STREET
PORTLAND, ME 04101

PROJECT TITLE
NEPHROLOGY ASSOCIATES RENOVATIONS
1600 CONGRESS STREET
PORTLAND, MAINE 04101

DRAWING TITLE
REMOVALS NOTES AND PARTITION SCHEDULE
CWS PROJ. NO.: 11422

REVISION DESCRIPTION	DATE

DRAWING NUMBER
A0.00

SCALE: NOT TO SCALE
DATE: 12/22/11