



Portland, Maine Yes. Life's good here.



Permitting and Inspections Department

### Fire Alarm Permit Application

<b>Construction Address:</b> 1601 Congress St. 2nd Floor		
<b>Total Square Footage of Proposed Structure:</b> (tenant space only) 2400 sq ft		
<b>Tax Assessor's Chart, Block &amp; Lot</b>	<b>Applicant Name:</b> Norris Inc.	
Chart#	Block#	Lot#
<b>Address:</b> 2257 West Broadway South Portland, ME. 04106		
<b>Phone:</b> 207-883-3473		
<b>Email:</b> melissap@norrisinc.com		
<b>Cost of Work:</b> \$ 2,910.00	<b>Contractor Name (if different):</b>	
	Deblois Electric	
<b>Lessee/Owner Name (if different):</b>	<b>Address:</b> 1033 Sabattus St. Lewiston, ME. 04240	
Dr. Jo Anna Yu		
<b>Address:</b> 1601 Congress St.	<b>Phone:</b> 207-783-6512	
<b>Phone:</b> 207-775-3456	<b>Email:</b> smorin@debloiselectric.com	
<b>Email:</b> joanna.jing.yu@hotmail.com		
<b>Current use (i.e. single family):</b> vacant		
If vacant, what was the previous use?		
<b>Proposed specific use:</b> Orthodontist		
Is property part of a subdivision? If yes, name: No		
<b>Project description:</b> add, remove and relocate fire alarm devices as needed for tenant fit up		
<b>Life Safety Code Occupancy Classification:</b> business		
Is this new work or a renovation to an existing system? reno		
Is the top occupiable floor of the building greater than 75 feet above the lowest level of Fire Department access (high-rise)? No		
<b>Name of company providing programming and certification of system*:</b> Norris Inc.		
<b>Electrical permit #:</b> ELE2019-02097		
<b>Will a master box be installed?</b> <input type="radio"/> Yes <input checked="" type="radio"/> No <b>If yes, complete all items for approval):</b>		
<b>AES approved installing contractor:</b>		
<b>Documentation of AES approval:</b>		
<b>Property Owner:</b>		
<b>Property Owner Billing Address:</b>		
<b>Property common name:</b>		
<b>E-911 address for protected premises:</b>		
<b>Emergency contact phone:</b>		<b>Additional emergency contact phone:</b>
<b>Number of stories protected:</b> 2		
Is the building protected by a supervised, automatic sprinkler system? <input checked="" type="radio"/> Yes <input type="radio"/> No		
<b>Name of person to contact when the permit is ready:</b> Melissa Peters-- Norris Inc.		
<b>Address:</b> same as above		
<b>City, State &amp; Zip:</b>		
<b>Email Address:</b> melissap@norrisinc.com		<b>Phone:</b>

\*For a list of approved fire alarm companies, see [www.portlandmaine.gov/1406/Approved-Fire-Alarm-Companies](http://www.portlandmaine.gov/1406/Approved-Fire-Alarm-Companies)  
389 Congress Street, Room 315/Portland Maine 04101/[www.portlandmaine.gov](http://www.portlandmaine.gov)/tel: 207-874-8703/fax: 207-874-8716





Permitting and Inspections Department

### Fire Alarm Permit Application

<b>Construction Address:</b> 1601 Congress St. 2nd Floor		
<b>Total Square Footage of Proposed Structure:</b> (tenant space only) 2400 SQ FT		
<b>Tax Assessor's Chart, Block &amp; Lot</b>		<b>Applicant Name:</b> Norris Inc.
Chart#	Block#	Lot#
<b>Cost of Work:</b> \$ 117,855.00		<b>Address:</b> 2257 West Broadway South Portland, ME. 04106
		<b>Phone:</b> 207-883-3473
		<b>Email:</b> melissap@norrisinc.com
<b>Lessee/Owner Name (if different):</b>		<b>Contractor Name (if different):</b>
Dr. JO Anna YU		Deblois Electric
<b>Address:</b> 1601 Congress St.		<b>Address:</b> 1033 Sabattus St. Lewiston, ME. 04240
<b>Phone:</b> 207-775 3456		<b>Phone:</b> 207-783-6512
<b>Email:</b> joanna.jingyu@hotmail.com		<b>Email:</b> smbrin@debloiselectric.com
<b>Current use (i.e. single family):</b> vacant		
If vacant, what was the previous use?		
<b>Proposed specific use:</b> Orthodontist		
Is property part of a subdivision? If yes, name: No		
<b>Project description:</b> add, remove and relocate fire alarm devices as needed for tenant fit up		
<b>Life Safety Code Occupancy Classification:</b> business		
Is this new work or a renovation to an existing system? reno		
Is the top occupiable floor of the building greater than 75 feet above the lowest level of Fire Department access (high-rise)? No		
<b>Name of company providing programming and certification of system*:</b> Norris Inc.		
<b>Electrical permit #:</b> ELEC2019-02097		
<b>Will a master box be installed?</b> <input type="radio"/> Yes <input checked="" type="radio"/> No <b>If yes, complete all items for approval):</b>		
<b>AES approved installing contractor:</b>		
<b>Documentation of AES approval:</b>		
<b>Property Owner:</b>		
<b>Property Owner Billing Address:</b>		
<b>Property common name:</b>		
<b>E-911 address for protected premises:</b>		
<b>Emergency contact phone:</b> <b>Additional emergency contact phone:</b>		
<b>Number of stories protected:</b> 2		
Is the building protected by a supervised, automatic sprinkler system? <input checked="" type="radio"/> Yes <input type="radio"/> No		
<b>Name of person to contact when the permit is ready:</b> Melissa Peters-- Norris Inc.		
<b>Address:</b> same as above		
<b>City, State &amp; Zip:</b>		
<b>Email Address:</b> melissap@norrisinc.com		<b>Phone:</b>

\*For a list of approved fire alarm companies, see [www.portlandmaine.gov/1486/Approved-Fire-Alarm-Companies](http://www.portlandmaine.gov/1486/Approved-Fire-Alarm-Companies)



# Norris Inc.

PO Box 2551  
2257 West Broadway  
South Portland, ME 04106

1-800-370-3473  
Fax 207-879-0540



Please complete this form and return to Norris Inc.

## Building Owner Information Form

**Job Name:**

**Project #**

**Electrical Contractor:**

# NFPA requires this information for proper documentation.

**The contractor must provide all of the requested information below before ANY equipment can be released.**

**Electrical Contractor Contact:**

**Estimated Date Equip. Needed:**

**Estimated Finals Date:**

**Building Owner:**

**Job Site Address:**

**City:**

**State:**

**Zip:**

**Customer Contact:**

**Phone:**



# Norris Inc.

PO Box 2551  
2257 West Broadway  
South Portland, ME 04106

1-800-370-3473  
Fax 207-879-0540

[www.norrisinc.com](http://www.norrisinc.com)



Reviewed for Code Compliance  
Permitting and Inspections  
Department  
Approved  
12/31/2019

**Thank you for your cooperation.**

**Please advise the building owners that if this system is equipped with a digital communicator,  
then they MUST also make monitoring arrangements prior to a certificate of occupancy.**

**Norris Inc will attempt to contact the building owners.**



# STOP!

**THIS COPY IS FOR YOUR ELECTRICIAN  
ON THE JOBSITE**

**PLEASE BE SURE THIS COPY IS FORWARDED**

- 1.) A riser diagram is enclosed. **DO NOT USE THE ENGINEER'S RISER SHOWN ON THE PLANS.** If there is any information that you question, call us immediately.
- 2.) **YOU MUST CALL AT LEAST FIVE DAYS IN ADVANCE TO SCHEDULE FINAL CONNECTION ASSISTANCE.**
- 3.) All wires must be labeled and clear of any grounds, shorts or opens, and must maintain polarity throughout. Meter out all circuits before calling for final connection assistance. If applicable verify End of Line resistors are in place.
- 4.) If using shielded cable, the drain wires must be connected and fully insulated, so that neither the shield or the drain wire touches the backbox.
- 5.) Unless special arrangements are made, we will make one final job site visit. If a special visit is required for an elevator inspection or partial occupancy, then additional charges may if prior arrangements were not made. Call your customer service representative if needed.
- 6.) If you have any defective or left over parts, **DO NOT WRITE ON THEM OR THE BOXES.** Save the original box, all mounting hardware and instructions. Returns that do not conform to this practice will not be accepted for credit.
- 7.) If the system is being monitored through a digital communicator, please see information on the next page.

**IMPORTANT INFORMATION FOR THE BUILDING OWNERS  
SPECIAL NOTE REGARDING ALARM MONITORING SERVICES**

**Included with your alarm system package is a digital communicator, which sends coded messages to a private 24 hour central station if your alarm system is activated. This is a code requirement for most fire alarm systems. As a service to our customer, we offer central station monitoring services from our local UL Listed central station at extremely competitive rates.**

**If the central station monitoring contract is purchased through Norris Inc. prior to our scheduled start up; we will connect, program, and test the communicator at no additional charge.**

**Should the building owners decide to obtain monitoring services from another company, then the cost for programming and testing the communicator will be the sole responsibility of the firm they have contracted with. Furthermore, if programming changes are made to the system by persons other than Norris Inc. technicians, then the company performing the changes shall be solely liable for any personal injury or loss of life or damage to, or loss of property arising out of the use of or inability to use the system and it shall result in a waiver of any system warranties.**

**We appreciate that you understand the delicate nature of this life safety and/or security system and realize that serious problems may arise when modifications to the system are made, including very simple programming changes.**

**Call Norris Inc. at 1-800-370-FIRE (3473) to make arrangements for central station monitoring services.**



**Norris Inc.**

PO Box 2551  
2257 West Broadway  
South Portland, ME 04106

1-800-370-3473  
Fax 207-879-0540



# **SUBMITTAL PACKAGE**

**Project:** Dr. Yu (1601 Congress Second Floor)

**System:** Fire Alarm

**Submitted by:** **Norris Inc.**

**2257 West Broadway**

**South Portland, Maine 04106**

**Telephone: 1-800-370-3473**

**Submittal Date:** 12/12/2019





# Norris Inc.

PO Box 2551  
2257 West Broadway  
South Portland, ME 04106

1-800-370-3473  
Fax 207-879-0540

www.norrisinc.com



Reviewed for Code Compliance  
Permitting and Inspections  
Department  
Approved 12/31/2019

## **Company Profile**

**“We are extremely proud to represent the highest quality manufacturers integrating life safety, alarm, and communication systems throughout northern New England.”**

**—Bradford Norris, President—**

## **Mission Statement**

**Provide quality engineered systems, exceptional service.**

## **Goal**

**Learn...Continually Improve...Exceed Expectations**

**Founded in 1979, Norris Inc. has grown to become northern New England’s leading integrated system contracting and supply company. Norris Inc. is an innovated proactive organization with extensive experience in integration interdisciplinary building management systems. Our local and national affiliations assure that your project will be done properly regardless of size. Representing leading manufacturers, our comprehensive projects provide outstanding quality, reliability, and performance... Surpassing customer application requirements and exceeding the stringent requirements of Underwriters Laboratories, National Fire Protection Association and other codes.**

**We maintain an exceptional level of quality and provide the highest levels of customer service. Our knowledgeable technical support will insure the great service you deserve.**

**Whether your needs involve industrial, commercial, institutional, or educational applications, you can trust that Norris Inc. has the complete resources it takes to provide the right solution, right away.**



## **LIMITED WARRANTY**

**Norris Inc. warrants that the products of its manufacturers shall be free from defects in materials or workmanship as warranted by the manufacturer which is typically for a one (1) year period from the completed installation date, but not always. The completed installation date will be the date when the end-user was able to begin using or started using the product(s) or the system, whether partially or in its entirety. For projects that have a specification or bid instructions to follow which contains specific warranty requirements, Norris Inc. will always honor the warranty terms exactly as specified in the project's specifications or bid documents, which may be more or less in coverage and duration than the manufacturer's warranty. In performing hundreds of projects per year with thousands of different products it is impossible for Norris Inc. to track the terms and details of specified or individual product warranties. Therefore, Norris Inc. will request that the owner's representative provide these special warranty details when the warranty work is requested; otherwise a standard one (1) year warranty on the equipment will be honored. The manufacturer's warranty is for equipment only and does not include any labor and/or shipping costs. All warranties provided by Norris Inc. are limited with the same limitations included with the manufacturer's warranty which is included in the manuals of the products being provided.**

**The warranty will apply only if such goods have been properly installed, are subject to normal proper use and have not been modified in any manner whatsoever. Upon return of the defective product, Norris Inc. will, at its sole discretion, either repair or replace, at no cost, such goods determined to have a defect in materials or workmanship. In cases of a warranty repair, Norris Inc. will use its sole discretion to determine if a suitable replacement part can be provided on loan while the repairs are being performed.**

**All warranty work is performed during regular business hours. If emergency warranty work is required, the customer will pay the difference between the emergency service bill and our normal hourly charges.**

**Norris Inc.'s limited warranty does not apply to those products that are damaged due to misuse, abuse, negligence, exposure to adverse environmental conditions, acts of God, or have been modified in any manner whatsoever.**

**Norris Inc.'s standard terms and conditions are provided with our invoices. Those Terms and Conditions shall be provided upon request.**

**NORRIS INC. SHALL NOT UNDER ANY CIRCUMSTANCES BE LIABLE FOR ANY INCIDENTAL OR CONSEQUENTIAL DAMAGES ARISING FROM LOSS OF LIFE AND/OR PROPERTY OR OTHER DAMAGE OR LOSSES OWING TO THE FAILURE OF NORRIS INC. PRODUCTS BEYOND THE COST OF REPAIR OR REPLACEMENT OF ANY DEFECTIVE PRODUCTS.**

**NORRIS INC. MAKES NO WARRANTY OF FITNESS OR MERCHANTABILITY AND NO OTHER WARRANTY, ORAL OR WRITTEN, EXPRESS OR IMPLIED AS ALLOWED TO THE FULLEST EXTENT OF THE LAW.**

## **OUR CONTINUOUS COMMITMENT TO OUR ENVIRONMENT**

**At Norris Inc, we are proudly committed to continuous environmental improvement for a sustainable future and to develop strong partnerships within our community.**

**Our mission while running our operations is to do everything within our power to improve the environmental quality of our world and to work together to create a clean and safe place to live in and work in for future generations.**

**We will incorporate and promote green practices within our operations with policies to support it, a system of rewarding those that fully embrace it and then will regularly review our practices for continuous improvement.**

**We will establish policies, make investments in technologies and set the example in our own operations to include our ongoing commitment to go paperless and making it a requirement to Reuse, Reduce, & Recycle, to turn off unneeded lights, to not allow our vehicles to idle, to encourage carpooling and to utilize practical energy efficient transportation.**

**We will always be 100% compliant with all applicable environmental laws and regulations and will report any violations.**

**We will remain committed to working locally and whenever possible to sell and use locally manufactured products.**

**We will insist that every purchase we make will include a review of its environmental impact with a very high priority to selecting the greenest products and services available.**

**We will remain committed to selling low energy products. This includes promoting wireless technologies, using existing wire infrastructure in our installations, promoting solar powered devices, using our Remote Services in lieu of on-site service calls and performing calculations to minimize power supply and battery needs.**

**We will educate our employees and customers to illustrate that green practices and purchases are almost always less costly in the long run.**

**We will support and give priority to organizations that show the strongest commitment to the environment.**

**We will actively encourage and promote the same responsible green practices that we utilize in the work place to our employees for use in their everyday personal lives.**

## **REMOTE INTERNET CONNECTIONS**

**As an added service to our customers and in order to facilitate the commissioning of the system(s) being provided within this submittal and then later to provide warranty support Norris Inc. may (at Norris Inc's option) use internet connections to gain access to the system(s) being provided. Many methods can be used, but the most popular is utilizing software named LogMeIn. This software or any other method used to connect to the customer's network will allow Norris Inc's technicians the ability to get onto the programming and diagnostic levels of the system(s) being provided via the building owner's or tenant's data network and program, diagnose or make needed changes to the operation of the system(s). This will provide a better working atmosphere to perform programming from a controlled environment without the disruptions of a construction job-site and allow fast and efficient trouble shooting and/or servicing if problems should occur later. Acceptance of this submittal by those approving it shall constitute an acceptance and approval to perform the work necessary to install and/or enable these network connections if Norris Inc. chooses to do so. It is the sole responsibility of the submittal approvers to advise the building owners and/or tenants that Norris Inc. has the ability to gain access to their network. At the specific request of those approving this submittal or the contractor that Norris Inc. is working for the building owners or tenants that own the network, Norris Inc. can remove or disable the ability to connect to the building's network. However, leaving it in place will allow for quicker and more cost effective service when it is needed. Under absolutely no circumstances shall Norris Inc, its principals, employees, or heirs to be held responsible for any losses incurred as a result of this network connection or the inability for the network connection to operate as expected.**



Reviewed for Code Compliance  
Permitting and Inspections  
Department  
Approved for Applications  
12/31/2019

*This is to certify that*

**NORRIS, INC.**

*is an authorized Engineered Systems Distributor for NOTIFIER*

*During the year of 2019*

Richard Bauer  
Vice President Sales

*ESD Since 1987*



Dr. Joanna YuReviewed for Code Compliance  
Permitting and Inspections  
Department  
Approved for Code Compliance  
12/31/2019**Date:**

12/12/2019

**Project #:**

1452

**Contractor:**Deblois Electric  
(207) 783-6512**Equipment List**

<u>Quantity</u>	<u>Manufacturer</u>	<u>Part Number</u>	<u>Description</u>
2	WHEELOCK	HSR	HORN STROBES, WALL, RED
7	WHEELOCK	STR	STROBE, WALL, RED



## Strobe, Horn Strobe, and Horn Notification Appliances



### Description:

The Wheelock® Exceder™ Series of notification appliances feature a sleek modern design that will please building owners with reduced total cost of ownership. Installers will benefit from its comprehensive feature list, including the most candela options in one appliance, low current draw, no tools needed for setting changes, voltage test points, 12/24 VDC operation, universal mounting base and multiple mounting options for both new and retrofit construction.

The Wheelock® Exceder™ Series incorporates high reliability and high efficiency optics to minimize current draw allowing for a greater number of appliances on the notification appliance circuit. All strobe models feature an industry first of 8 candela settings on a single appliance. Models with an audible feature 3 sound settings (90, 95, 99 dB). All switches to change settings, can be set without the use of a tool and are located behind the appliance to prevent tampering. Wall models feature voltage test points to take readings with a voltage meter for troubleshooting and AHJ inspection.

The Wheelock® Exceder™ Series of wall and ceiling notification appliances feature a Universal Mounting Base (UMB) designed to simplify the installation and testing of horns, strobes, and combination horn strobes. The separate universal mounting base can be pre-wired to allow full testing of circuit wiring before the appliance is installed and the surface is finished. It comes complete with a Contact Cover for protection against dirt, dust, paint and damage to the contacts. The Contact Cover also acts as a shunting device to allow pre-wire testing for common wiring issues. The Contact Cover is polarized to prevent it from being installed incorrectly and prevents the appliance from being installed while it is on the UMB. When the Contact Cover is removed the circuit will show an open until the appliance is installed. The UMB allows for consistent installation and easy replacement of appliances if required. Wall models provide an optional locking screw for extra secure installation, while the ceiling models provide a captivated screw to prevent the screw from falling during installation.

- Save up to **48%** in current draw\*
- Up to **9** models now in **1** appliance
- Save up to **14%** cost of installation\*\*

- Sleek Modern Aesthetics
- Finger Slide Switches
- Voltage Test Points
- Multiple Voltages
- 3 Audible Settings  
90, 95, 99 dB
- 8 Candela Settings \*\*\*  
Wall - 15/1575/30/75/95/110/135/185  
Ceiling - 15/30/60/75/95/115/150/177
- Universal Mounting Base \*\*\*  
Ceiling and Wall  
Mounts to 5 Backbox Types
- Environmentally Friendly  
Low Current Draw



### Compatibility and Requirements

- Synchronize using the Wheelock® Sync Modules or panels with built-in Wheelock® Patented Sync Protocol
- Compatible with UL "Regulated Voltage" using filtered VDC or unfiltered VRMS input voltage
- Strobes produce 1 flash per second over the "Regulated Voltage" range

\* Compared to competitive models  
\*\* Compared to previous models

\*\*\* Patented

**NOTE: All CAUTIONS and WARNINGS are identified by the symbol ▲. All warnings are printed in bold capital letters.**

**▲ WARNING: PLEASE READ THESE SPECIFICATIONS AND ASSOCIATED INSTALLATION INSTRUCTIONS CAREFULLY BEFORE USING, SPECIFYING OR APPLYING THIS PRODUCT. VISIT [WWW.COOPERNOTIFICATION.COM](http://WWW.COOPERNOTIFICATION.COM) OR CONTACT COOPER NOTIFICATION FOR THE CURRENT INSTALLATION INSTRUCTIONS. FAILURE TO COMPLY WITH ANY OF THESE INSTRUCTIONS, CAUTIONS OR WARNINGS COULD RESULT IN IMPROPER APPLICATION, INSTALLATION AND/OR OPERATION OF THESE PRODUCTS IN AN EMERGENCY SITUATION, WHICH COULD RESULT IN PROPERTY DAMAGE, AND SERIOUS INJURY OR DEATH TO YOU AND/OR OTHERS.**

## General Notes:

General Notes:

- Strobes are designed to flash at 1 flash per second minimum over their "Regulated Voltage Range".
- All candela ratings represent minimum effective strobe intensity based on UL Standard 1971.
- Series Exceder Strobe products are Listed under UL Standards 1971 and 464 for indoor use with a temperature range of 32°F to 120°F (0°C to 49°C) and maximum humidity of 93% (± 2%) UL 464 (85% UL 1971).
- Series Exceder horns are under UL Standard 464 for audible signal appliances (Indoor use only).



Reviewed for Code Compliance  
Permitting and Inspections  
Department  
Approved: 2/23/2019

## Low Current Draw = Fewer Power Supplies

Strobe Ratings per UL Standard 1971

		UL Max Current*													
		24 VDC / 24 FWR												12 VDC	
Model	Regulated Voltage Range VDC	15	15/75	30	60	75	95	110	115	135	150	177	185	15	15/75
ST	8.0-33.0	0.057	0.070	0.085		0.135	0.163	0.182		0.205			0.253	0.110	0.140
STC	8.0-33.0	0.061		0.085	0.103	0.135	0.163		0.182		0.205	0.253		0.110	

Horn Strobe Ratings per UL 1971 & Anechoic at 24 VDC

		UL Max Current* at Anechoic 99 dBA													
		24 VDC												12 VDC	
Model	Regulated Voltage Range VDC	15	15/75	30	60	75	95	110	115	135	150	177	185	15	15/75
HS	8.0-33.0	0.082	0.095	0.102		0.148	0.176	0.197		0.242			0.282	0.125	0.159
HSC	8.0-33.0	0.082		0.102	0.141	0.148	0.176		0.197		0.242	0.282		0.125	

		UL Max Current* at Anechoic 95 dBA													
		24 VDC												12 VDC	
Model	Regulated Voltage Range VDC	15	15/75	30	60	75	95	110	115	135	150	177	185	15	15/75
HS	8.0-33.0	0.073	0.083	0.087		0.139	0.163	0.186		0.230			0.272	0.122	0.153
HSC	8.0-33.0	0.073		0.087	0.128	0.139	0.163		0.186		0.230	0.272		0.122	

		UL Max Current* at Anechoic 90 dBA													
		24 VDC												12 VDC	
Model	Regulated Voltage Range VDC	15	15/75	30	60	75	95	110	115	135	150	177	185	15	15/75
HS	8.0-33.0	0.065	0.075	0.084		0.136	0.157	0.184		0.226			0.267	0.120	0.148
HSC	8.0-33.0	0.065		0.084	0.120	0.136	0.157		0.184		0.226	0.267		0.120	

Horn Ratings per UL Anechoic

Model	Regulated Voltage Range VDC	99 dB	95 dB	90 dB
HN	16-33.0	0.064	0.044	0.022
HNC	16-33.0	0.084	0.044	0.022
HN	8.0-17.5	0.047	0.026	0.017
HNC	8.0-17.5	0.047	0.026	0.017



\* UL max current rating is the maximum RMS current within the listed voltage range (16-33 VDC for 24 VDC units). For strobes the UL max current is usually at the minimum listed voltage (16 VDC for 24 VDC units). For audibles the max current is usually at the maximum listed voltage (33 VDC for 24 VDC units). For unfiltered ratings, see installation instructions.

# Specification & Ordering Information

Model	Strobe Candela	Sync w/ DSM or Wheelock Power Supplies	12/24 VDC*	Mounting Options
<b>Horn Strobes</b>				
<b>HSR</b>	15/1575/30/75/95/110/135/185	X	X	UMB**
HSW	15/1575/30/75/95/110/135/185	X	X	UMB**
HSRC	15/30/60/75/95/115/150/177	X	X	UMB**
HSWC	15/30/60/75/95/115/150/177	X	X	UMB**
<b>Strobes</b>				
<b>STR</b>	15/1575/30/75/95/110/135/185	X	X	UMB**
STW	15/1575/30/75/95/110/135/185	X	X	UMB**
STRC	15/30/60/75/95/115/150/177	X	X	UMB**
STWC	15/30/60/75/95/115/150/177	X	X	UMB**
<b>Horn</b>				
HNR		X	X	UMB**
HNW		X	X	UMB**
HNRC		X	X	UMB**
HNWC		X	X	UMB**

Easy to remember model codes

8 candelas on 1 device

1 gang, 2 gang, 4" sq, 3.5" octal & 4" octal boxes


\*12 VDC models feature 15 & 15/75 settings

\*\*UMB = Universal Mounting Base

**Model Legend**

HN = Horn	A = Agent Lettering (Strobes only)
ST = Strobe	AL = Alert Lettering (Strobes only)
HS = Horn Strobe	C = Ceiling Mount
C = Ceiling Mount	N = No Lettering (Strobes only)
W = White	
R = Red	


Example 1: STRC = Strobe, Red, Ceiling Mount  
 Example 2: HSR = Horn Strobe, Red, Wall Mount  
 Example 3: HSW = Horn Strobe, White, Wall Mount  
 Example 4: STW-AL = Strobe, White, Wall Mount, Alert Lettering

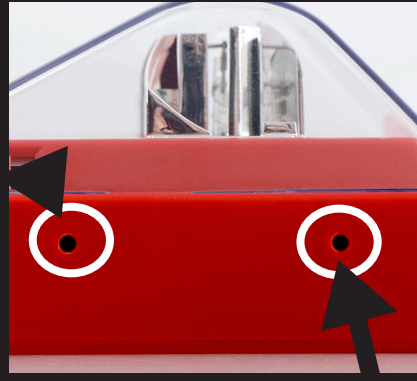


Voltage test points for quick troubleshooting and easy spot checking (wall models only)



8 candela settings

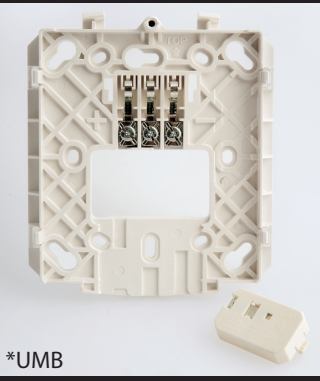

Common base for wall and ceiling with 5 mounting options

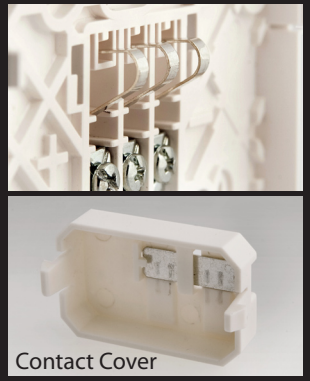

**NOTE:** Due to continuous development of our products, specifications and offerings are subject to change without notice in accordance with Cooper Wheelock Inc., dba Cooper Notification standard terms and conditions.





## Architects and Engineers Specifications

The notification appliances shall be Wheelock® Exceder™ Series HS Audible Strobe appliances, Series ST Visual Strobe appliances and Series HN Audible appliances or approved equals. The Series HS and ST Strobes shall be listed for UL Standard 1971 (Emergency Devices for the Hearing-Impaired) for Indoor Fire Protection Service. The Series HS and HN Audibles shall be UL Listed under Standard 464 (Fire Protective Signaling). All Series shall meet the requirements of FCC Part 15 Class B. All inputs shall be compatible with standard reverse polarity supervision of circuit wiring by a Fire Alarm Control Panel (FACP) with the ability to operate from 8 to 33 VDC. Indoor wall models shall incorporate voltage test points for easy voltage inspection.

The Series HS Audible Strobe and ST Strobe appliances shall produce a flash rate of one (1) flash per second over the Regulated Voltage Range and shall incorporate a Xenon flashtube enclosed in a rugged Lexan® lens. The Series shall be of low current design. Where Multi-Candela appliances are specified, the strobe intensity shall have 8 field selectable settings at 15, 15/75, 30, 75, 95, 110, 135, 185 candela for wall mount and 15, 30, 60, 75, 95, 115, 150, 177 candela for ceiling mount. The selector switch for selecting the candela shall be tamper resistant. The 15/75 candela strobe shall be specified when 15 candela UL Standard 1971 Listing with 75 candela on-axis is required (e.g. ADA compliance). Appliances with candela settings shall show the candela selection in a visible location at all times when installed.

The audible shall have a minimum of three (3) field selectable settings for dBA levels and shall have a choice of continuous or temporal (Code 3) audible outputs.

The Series HS Audible Strobe, ST Strobe and Series HN Audible shall incorporate a patented Universal Mounting Base that shall allow mounting to a single-gang, double-gang, 4-inch square, 3.5-inch octal, 4-inch octal or 100mm European type back boxes. Two wire appliance wiring shall be capable of directly connecting to the mounting base. Continuity checking of the entire NAC circuit prior to attaching any notification appliances shall be allowed. Product shall come with Contact Cover to protect contact springs. Removal of an appliance shall result in a supervision fault condition by the Fire Alarm Control Panel (FACP). The mounting base shall be the same base among all horn, strobe, horn strobe, wall and ceiling models. All notification appliances shall be backwards compatible.

The Series HS and ST wall models shall have a low profile measuring 5.24" H x 4.58" W x 2.19" D. Series HN wall shall measure 5.24" H x 4.58" W x 1.6" D. The Series HSC and STC shall be round and have a low profile with a diameter of 6.68" x 2.63" D. Series HNC ceiling shall have a diameter of 6.68" x 1.50" D.

When synchronization is required, the appliance shall be compatible with Wheelock®'s DSM Sync Modules, Wheelock® Power Supplies or other manufacturer's panels with built-in Wheelock® Patented Sync Protocol. The strobes shall not drift out of synchronization at any time during operation. If the sync protocol fails to operate, the strobe shall revert to a non-synchronized flash-rate and still maintain (1) flash per second over its Regulated Voltage Range. The appliance shall also be designed so that the audible signal may be silenced while maintaining strobe activation when used with Wheelock® synchronization protocol.

**Wall Appliances** – UL Standard 1971, UL Standard 464, California State Fire Marshal (CSFM), ULC, FM

**Ceiling Appliances** – UL Standard 1971, UL Standard 464, California State Fire Marshal (CSFM), ULC, FM



Reviewed for Code Compliance  
Permitting and Inspections  
Department  
Approved for Conditions  
2/3/2019



WE ENCOURAGE AND SUPPORT NICET CERTIFICATION  
3 YEAR WARRANTY

**Exceder - Spec Sheet 6/11**

NJ Location  
273 Branchport Ave.  
Long Branch, NJ 07740  
P: 800-631-2148  
F: 732-222-8707  
www.coopernotification.com

Cooper Notification is

Wheelock®



SAFEPATH®



**COOPER** Notification




FIRE ALARM ADDITION MATRIX


SYSTEM INPUTS	CONTROL UNIT ACTIVATION								SYSTEM OUTPUTS											
	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S	T
1 INDICATING CIRCUIT ZONE	●	●							●											
2 FIRE ALARM AC POWER FAILURE					●	●	●	●												
3 FIRE ALARM SYSTEM LOW BATTERY					●	●	●	●												
4 OPEN CIRCUIT					●	●	●	●												
5 GROUND FAULT					●	●	●	●												
6 NOTIFICATION APPLIANCE CIRCUIT SHORT					●	●	●	●												

NOTIFICATION APPLIANCE CIRCUIT VOLTAGE DROPS									
Dr. Yu Portland, Maine									
PANEL	CIRCUIT	WIRE GAUGE	LENGTH	CURRENT DRAW	VOLTAGE DROP	VOLTAGE LOSS	END VOLTAGE @ 24.0VDC	END VOLTAGE @ 20.4VDC	CIRCUIT LOAD
FCPS	NAC	14	315FT	0.649A	1.03 VDC	4.30%	22.97 VDC	19.37 VDC	22%
Calculated @ Maximum Distance/Current									

SYMBOL LEGEND

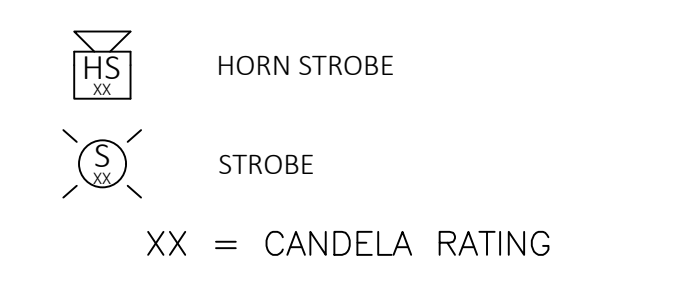

WIRE LEGEND



DEVICE ADDRESSES:




EACH DEVICE MUST BE LABELED WITH THE NODE, LOOP AND SLC ADDRESS.  
 DEVICE EXAMPLE: N1L1D001 MODULE EXAMPLE: N1L1M001  
 CARBON MONOXIDE DETECTORS MUST BE LABELED WITH THE MANUFACTURES REPLACEMENT DATE.  
 IMPORTANT! DUPLICATE ADDRESSES BETWEEN DEVICES AND MODULES ARE NOT AN ERROR. NOTE: PULL STATIONS ARE IDENTIFIED AS MODULES BY THE FIRE ALARM CONTROL PANEL.

INSTALLATION NOTES:

FIELD WIRING SHALL BE INSTALLED FOLLOWING THE CURRENT EDITION OF NFPA 70, NATIONAL ELECTRIC CODE(2017), ALL APPLICABLE MUNICIPAL, COUNTY, & STATE CODES, REQUIREMENTS, AND REGULATIONS, AS WELL AS ALL MANUFACTURER GUIDELINES FOR INSTALLATION.  
 CONTROL PANELS, DEVICES, AND ALL OTHER SYSTEM COMPONENTS SHALL BE INSTALLED FOLLOWING THE CURRENT EDITION OF NFPA 72: NATIONAL FIRE ALARM AND SIGNALING CODE(2019), ALL APPLICABLE MUNICIPAL, COUNTY, & STATE CODES, REQUIREMENTS, AND REGULATIONS, AS WELL AS ALL MANUFACTURER GUIDELINES FOR INSTALLATION.  
 THE INSTALLER SHALL FOLLOW CORRECT CONDUCTOR POLARITY, INDICATED CIRCUIT DIVISIONS, PROPER GROUNDING AND SHIELDING WITHOUT EXCEPTION. IMPROPER INSTALLATION CAN RESULT IN INTERFERENCE, TRANSIENT VOLTAGE, OR SHORT CIRCUITS CAUSING UNDESIRABLE OPERATION OR DAMAGE TO THE CONTROL PANEL, DEVICES AND ANY OTHER INTEGRATED COMPONENTS.  
 IF EXCEEDING 4500 FEET, THE GAUGE OF WIRE USED FOR THE SLC LOOP (IDENTIFIED AS "A" IF APPLICABLE), SHALL BE DETERMINED BY THE INSTALLER FOLLOWING GUIDELINES AND LIMITATIONS SET FORTH BY THE MANUFACTURER (NOTIFIER DOCUMENT #51253, INTELLIGENT CONTROL PANEL SLC WIRING MANUAL). THE SLC WIRING RISER IS SHOWN DIAGRAMMATICALLY ONLY TO ALLOW FOR VARIANCES IN ACTUAL WIRE DISTANCE, DEVICE PLACEMENT AND STRUCTURAL OR ENVIRONMENTAL REQUIREMENTS.  
 WIRE FOR THE NOTIFICATION APPLIANCE CIRCUITS (IDENTIFIED AS "B" ON THIS PRINT), SHALL FOLLOW THE SPECIFIC REQUIREMENTS OF THE WIRING LEGEND.  
 THIS SYSTEM MEETS NFPA REQUIREMENTS FOR OPERATION AT 32-120°F AND A RELATIVE HUMIDITY OF 91-95% AT 87-93°F. HOWEVER, THE USEFUL LIFE OF THE SYSTEMS STANDBY BATTERIES AND THE ELECTRONIC COMPONENTS MAY BE ADVERSELY AFFECTED BY EXTREME TEMPERATURE RANGES AND HUMIDITY. THEREFORE, IT IS RECOMMENDED THAT THIS SYSTEM AND ITS PERIPHERALS BE INSTALLED IN AN ENVIRONMENT WITH A NORMAL ROOM TEMPERATURE OF 60-80°F.

DESIGN NOTES:

SYSTEM DESIGN PERFORMANCE AND COMPLIANCE WITH ALL APPLICABLE CODES AND REQUIREMENTS IS THE RESPONSIBILITY OF THE DESIGNING ENGINEER. PROPER INSTALLATION OF THIS SYSTEM AND ITS COMPONENTS IS THE RESPONSIBILITY OF THE INSTALLING CONTRACTOR. ANY ALTERATIONS, CHANGES, OR DEFICIENCIES MUST BE BROUGHT TO THE ATTENTION OF THE DESIGNING ENGINEER.  
 NORRIS INC. ASSUMES NO RESPONSIBILITY FOR ERRORS IN SYSTEM DESIGN OR INSTALLATION, AS WELL AS ANY COSTS ASSOCIATED WITH CORRECTING THESE ERRORS, IF ANY EXIST, UNLESS SYSTEM DESIGN OR INSTALLATION WAS PERFORMED BY NORRIS INC.

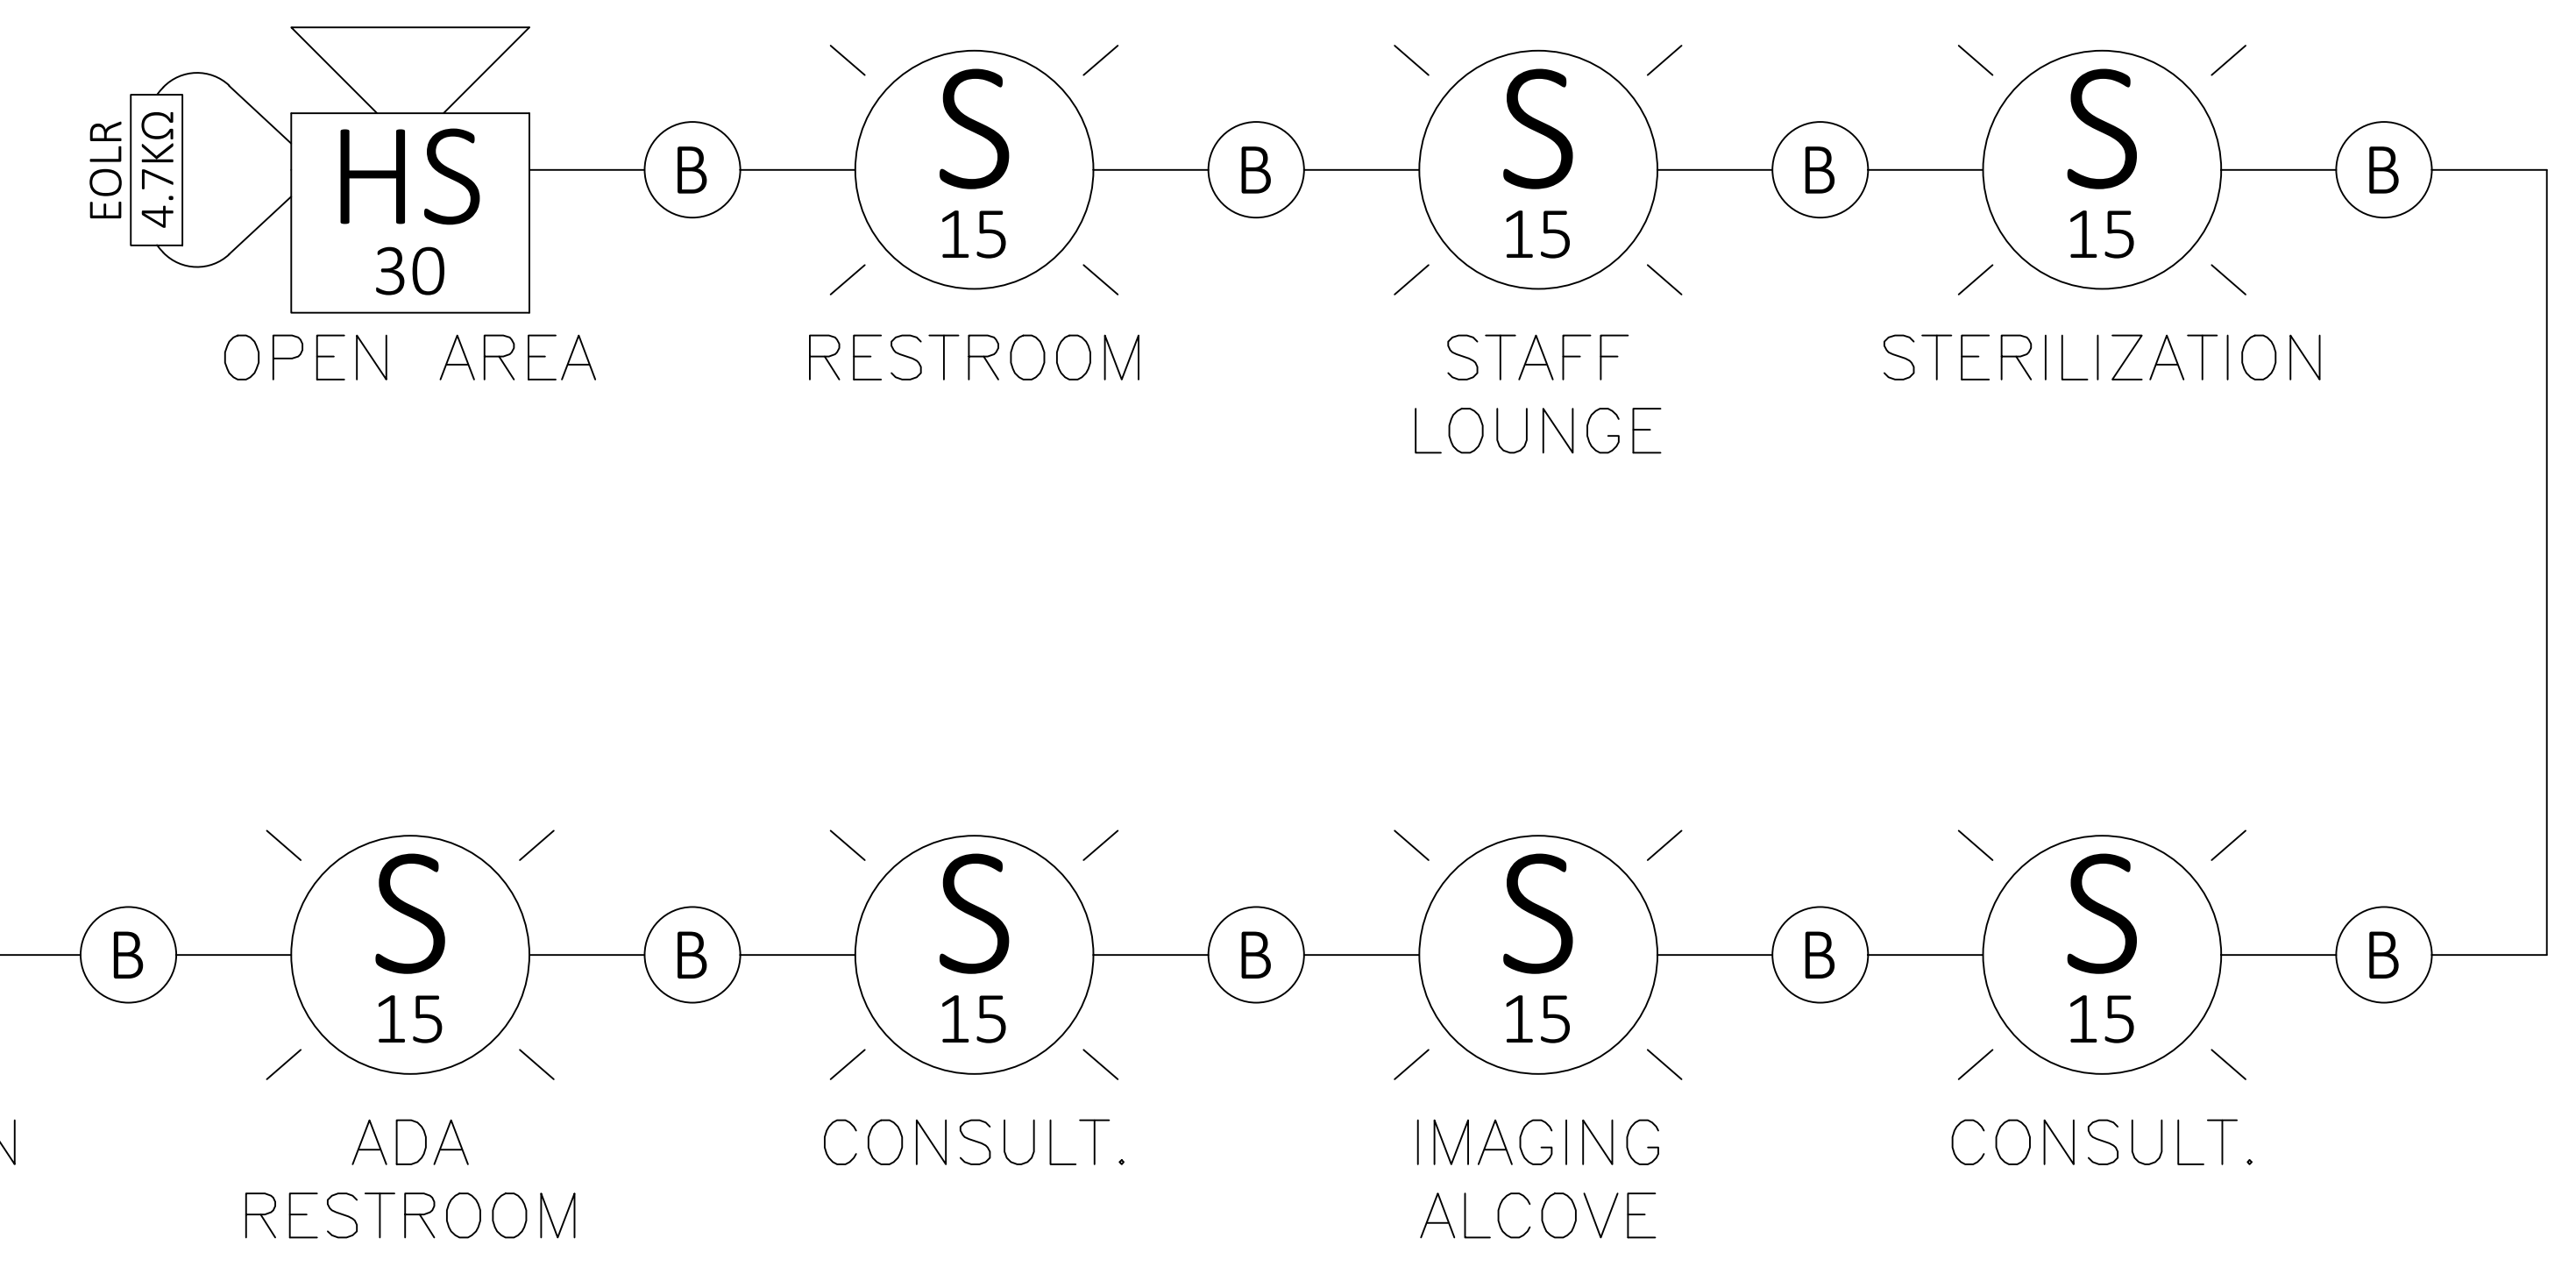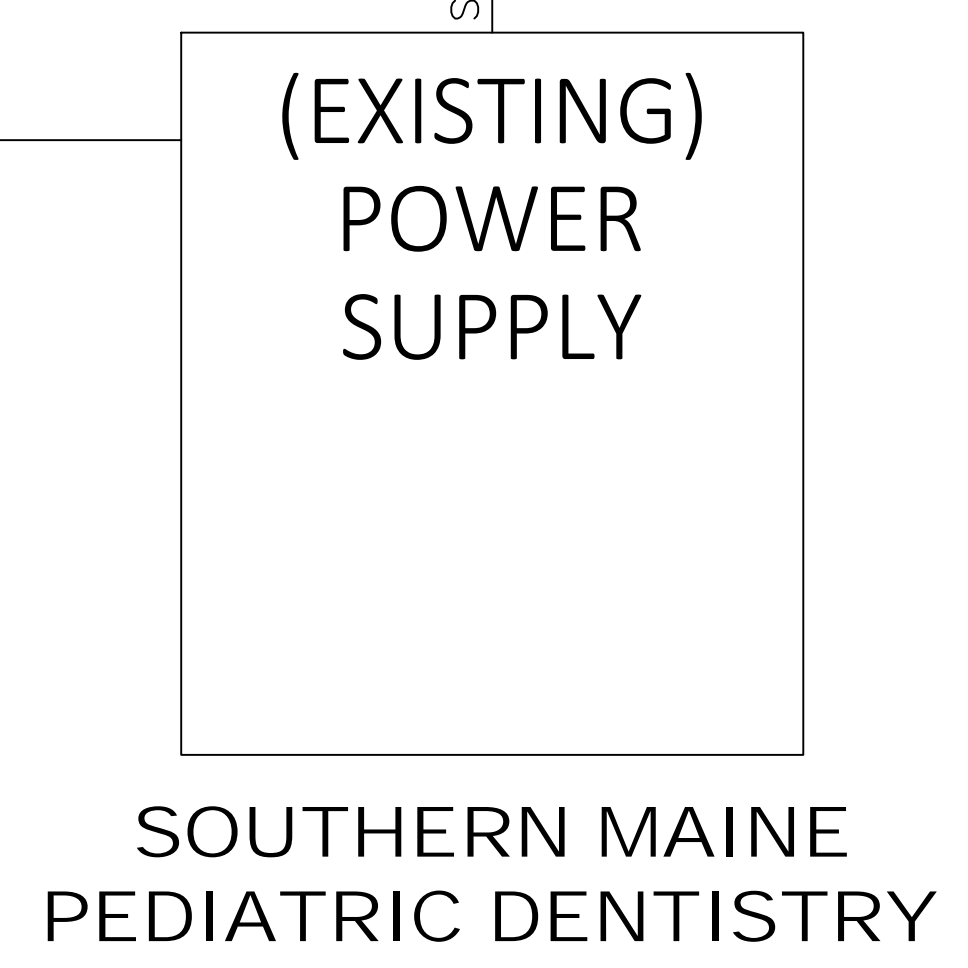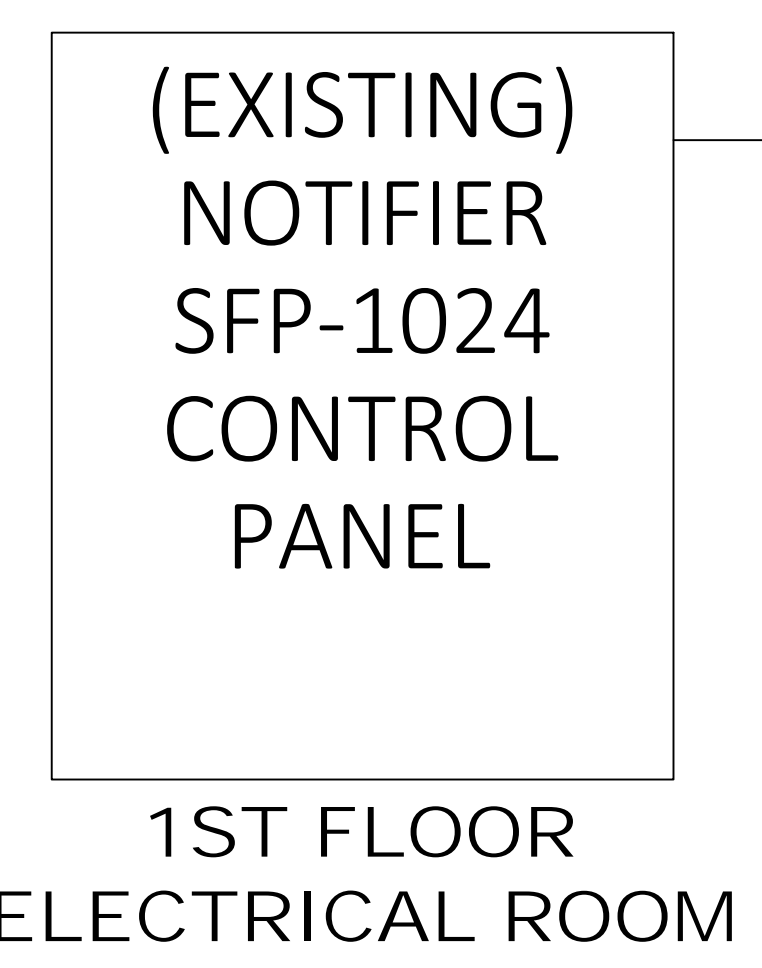

REVISION 0: SUBMITTAL	12/12/2019
FIRE ALARM WIRING RISER	
PROJECT NUMBER: 1452	SCALE: NONE
PROJECT: DR. YU (2ND FLOOR) 1601 CONGRESS ST. PORTLAND, MAINE 04102	DRAWN BY: JAB CHECKED BY: MP
SHEET: FA-01	