

TYPICAL ENGINEERED FLOOR TRUSS DIAGRAM


- NOTES:**
- OP = DENOTES OPENING TYPE, SEE WINDOW/DOOR HEADER, JAMB, AND SILL SCHEDULE THIS DWG.
 - TOP OF STEEL BEAM ELEVATION 71'-2 1/2" U.N.O.
 - SEE S1.2 & S1.4 FOR SHEAR WALL LOCATIONS AND INFORMATION.
 - ENGINEERED FLOOR JOISTS SHALL BE DESIGNED BY TRUSS FABRICATOR FOR LOADS INDICATED TYP. ENGINEERED FLOOR TRUSS DIAGRAM THIS DWG.

- COLUMN DOWN TO BELOW
- COLUMN FROM ABOVE

WINDOW & DOOR HEADER, JAMB, AND SILL SCHEDULE				
TYPE	HEADER	JAMB	SILL	NOTES
OP1	#10 TEK SCREWS (2) 600T137-43 (2) 600S162-54	JS (2) 600S137-43 & (1) 600T137-43 #10 TEK SCREWS @ 1'-0"	(1) 600S137-43 & (1) 600T137-43 #10 TEK SCREWS @ EACH VERT. STUD	ATTACH HEADER TO JAMB WITH (8) #10 TEK SCREWS
OP2	#10 TEK SCREWS (2) 600T162-54 (3) 800S200-54	JS (2) 600S250-43 & (1) 600T200-43 #10 TEK SCREWS @ 1'-0"	(1) 600S137-43 & (1) 600T137-43 #10 TEK SCREWS @ EACH VERT. STUD	
OP3	#10 TEK SCREWS (2) 600T137-43 (2) 600S162-54	JS (2) 600S250-43 & (1) 600T200-43 #10 TEK SCREWS @ 1'-0"	(1) 600S137-43 & (1) 600T137-43 #10 TEK SCREWS @ EACH VERT. STUD	
OP4	#10 TEK SCREWS (2) 600T137-54 (3) 1200S137-68	JS (2) 600S250-43 & (1) 600T200-43 #10 TEK SCREWS @ 1'-0"	(1) 600S137-43 & (1) 600T137-43 #10 TEK SCREWS @ EACH VERT. STUD	STIFFENERS REQ'D AT ENDS OF HEADER AND OTHER SUPPORTED POINT LOADS
ST1	#10 TEK SCREWS (2) 600T137-54 (1) 600S250-54 (1) 600S300-54			

NOTES:

- TYPICAL 2ND FLOOR EXTERIOR WALL STUD IS 600S200-43 @ 16" o.c.
- TYPICAL 1ST FLOOR EXTERIOR WALL STUD IS 600S200-54 @ 16" o.c.
- SEE S5/S3.2 FOR TYPICAL WALL ELEVATION.
- JS = JACK STUD, SEE SECTIONS 6/S3.2 & 8/S3.2 FOR TYPICAL HEADER DETAILS.

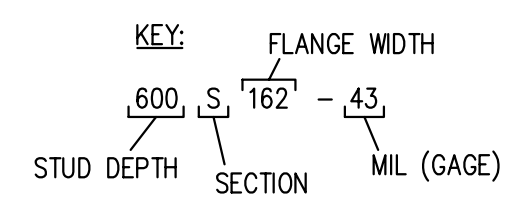

LOWER ROOF FRAMING PLAN

SCALE: 1/8"=1'-0"

WINDOW/DOOR HEADER SCHEDULE & DETAIL

SCALE: NTS

REVISIONS	No.	DATE	ISSUE
FOR PERMIT	A	3-18-07	

SHEET TITLE:
LOWER ROOF FRAMING PLAN

DESIGNED: SM
 DRAWN: PM
 DATE: 2-7-07
 CADD FILE: 7016-S1.DWG
 PROJECT NUMBER: 7016