

City of Portland, Maine – Building or Use Permit Application 389 Congress Street, 04101, Tel: (207) 874-8703, FAX: 874-8716

Location of Construction: 1585 Congress St		Owner: Onex Co.		Phone:		Permit No:	
Owner Address:		Lessee/Buyer's Name: Budget - Westbrook Petroleum		Phone: 1585 Congress St Ptd, ME 04102			Permit Issued:
Contractor Name:		Address:		Phone: 780-1926			
Past Use: Gas Sta		Proposed Use: Same		COST OF WORK: \$ 8888 PERMIT FEE: \$ 37.80 FIRE DEPT. <input type="checkbox"/> Approved <input type="checkbox"/> Denied INSPECTION: Use Group: Type: Signature: Signature:		Zone: CBL: 220-E-001	
Proposed Project Description: Install Signage 64 Sq Ft				PEDESTRIAN ACTIVITIES DISTRICT (P.A.D.) Action: <input type="checkbox"/> Approved <input type="checkbox"/> Approved with Conditions <input type="checkbox"/> Denied Signature: Date:		Zoning Approval: Special Zone or Reviews: <input type="checkbox"/> Shoreland <input type="checkbox"/> Wetland <input type="checkbox"/> Flood Zone <input type="checkbox"/> Subdivision <input type="checkbox"/> Site Plan maj <input type="checkbox"/> minor <input type="checkbox"/> mm <input type="checkbox"/>	
Permit Taken By: Mary Gresik		Date Applied For: 30 May 1997				Zoning Appeal <input type="checkbox"/> Variance <input type="checkbox"/> Miscellaneous <input type="checkbox"/> Conditional Use <input type="checkbox"/> Interpretation <input type="checkbox"/> Approved <input type="checkbox"/> Denied	

1. This permit application does not preclude the Applicant(s) from meeting applicable State and Federal rules.
2. Building permits do not include plumbing, septic or electrical work.
3. Building permits are void if work is not started within six (6) months of the date of issuance. False information may invalidate a building permit and stop all work..

CERTIFICATION

I hereby certify that I am the owner of record of the named property, or that the proposed work is authorized by the owner of record and that I have been authorized by the owner to make this application as his authorized agent and I agree to conform to all applicable laws of this jurisdiction. In addition, if a permit for work described in the application is issued, I certify that the code official's authorized representative shall have the authority to enter all areas covered by such permit at any reasonable hour to enforce the provisions of the code(s) applicable to such permit

Call for when ready

 SIGNATURE OF APPLICANT **Joe Lopes**

30 May 1997

ADDRESS:

DATE:


PHONE:

RESPONSIBLE PERSON IN CHARGE OF WORK, TITLE

PHONE:

White-Permit Desk Green-Assessor's Canary-D.P.W. Pink-Public File Ivory Card-Inspector

CEO DISTRICT



SIGNAGE

PLEASE ANSWER ALL QUESTIONS

ADDRESS: 1585 Congress St. ZONE: RP

OWNER: Onex Company

APPLICANT: Budget - Westbrook Petroleum

ASSESSOR NO.: 220-E-001

SINGLE TENANT LOT? YES X NO

MULTI TENANT LOT? YES NO X

FREESTANDING SIGN? YES X NO DIMENSIONS 5'x3'
(ex. pole sign..)

MORE THAN ONE SIGN? YES X NO DIMENSIONS 6'x4'

BLDG. WALL SIGN? YES NO X DIMENSIONS
(attached to bldg)

MORE THAN ONE SIGN? YES NO DIMENSIONS

LIST ALL EXISTING SIGNAGE AND THEIR DIMENSIONS:

Portable Sign - 2'x3'

LOT FRONTAGE (FEET) 292'

BLDG FRONTAGE (FEET) 22'


AWNING YES NO X IS AWNING BACKLIT? YES NO

HEIGHT OF AWNING:

IS THERE ANY COMMUNICATION, MESSAGE, TRADEMARK OR SYMBOL ON IT?


A SITE SKETCH AND BUILDING SKETCH SHOWING EXACTLY WHERE EXISTING AND NEW

SIGNAGE IS LOCATED MUST BE PROVIDED. SKETCHES AND/OR PICTURES OF THE

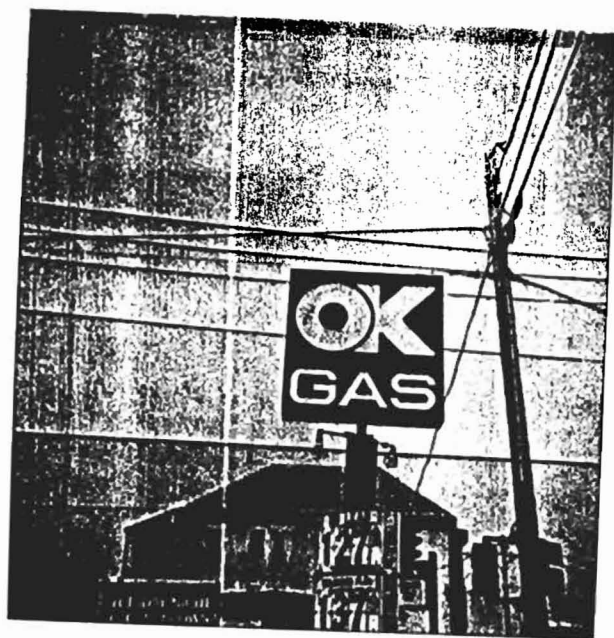

I WILL BE USING A 12' POLE FOR MOUNTING.
BOTH SIGNS WILL BE INTERNALLY ILLUMINATED.

THIS IS THE SIGN THAT
WILL BE MOUNTED ON TOP
OF POLE. (SIGN 1) DIM-5'x8'

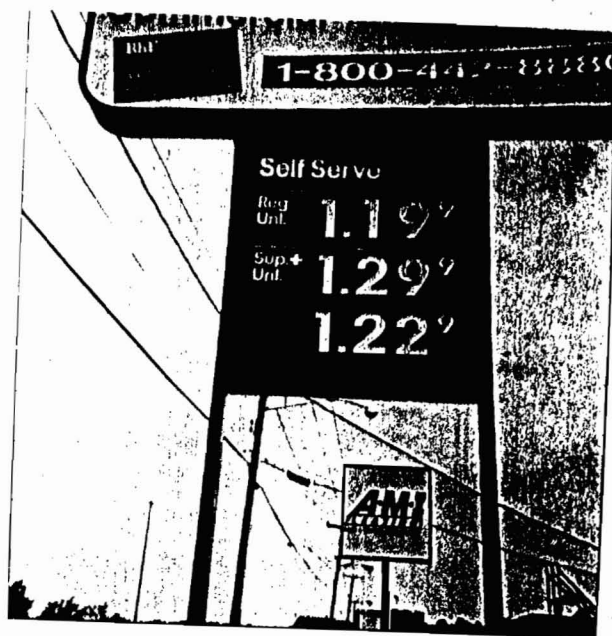

THIS SIGN WILL BE MOUNTED
ON ONE POLE THROUGH MIDDLE
OF SIGN. (SIGN 2) DIM-4'x6'


24

ed

IRVING
MAINWAY
109 regular
119
129 supreme

EXAMPLE
ONLY


B-4	All Other Zones
¹ 60 sq. ft./20 sq. ft./ ² 30 sq. ft. (a)	¹ 40 sq. ft./15 sq. ft./ ² 24 sq. ft. (a)
35 feet	18 feet
5 feet	5 feet

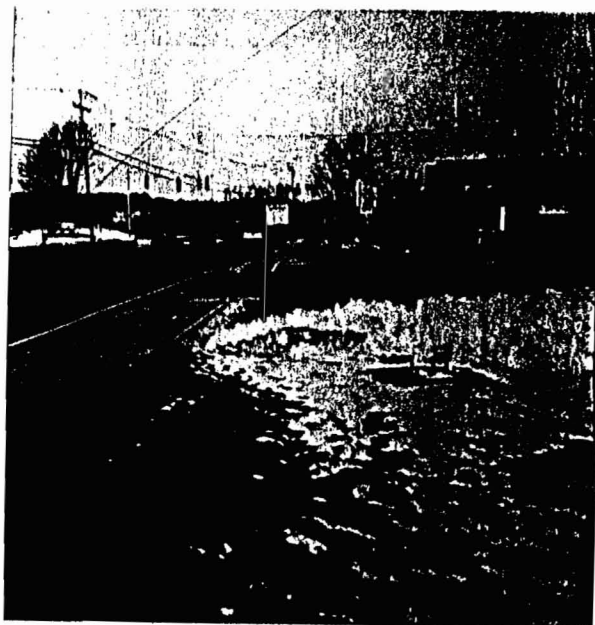

THIS IS THE EXISTING BASE
I WILL BE USING.

1565-1589 CONGRESS STREET

ME CENTRAL R.R.

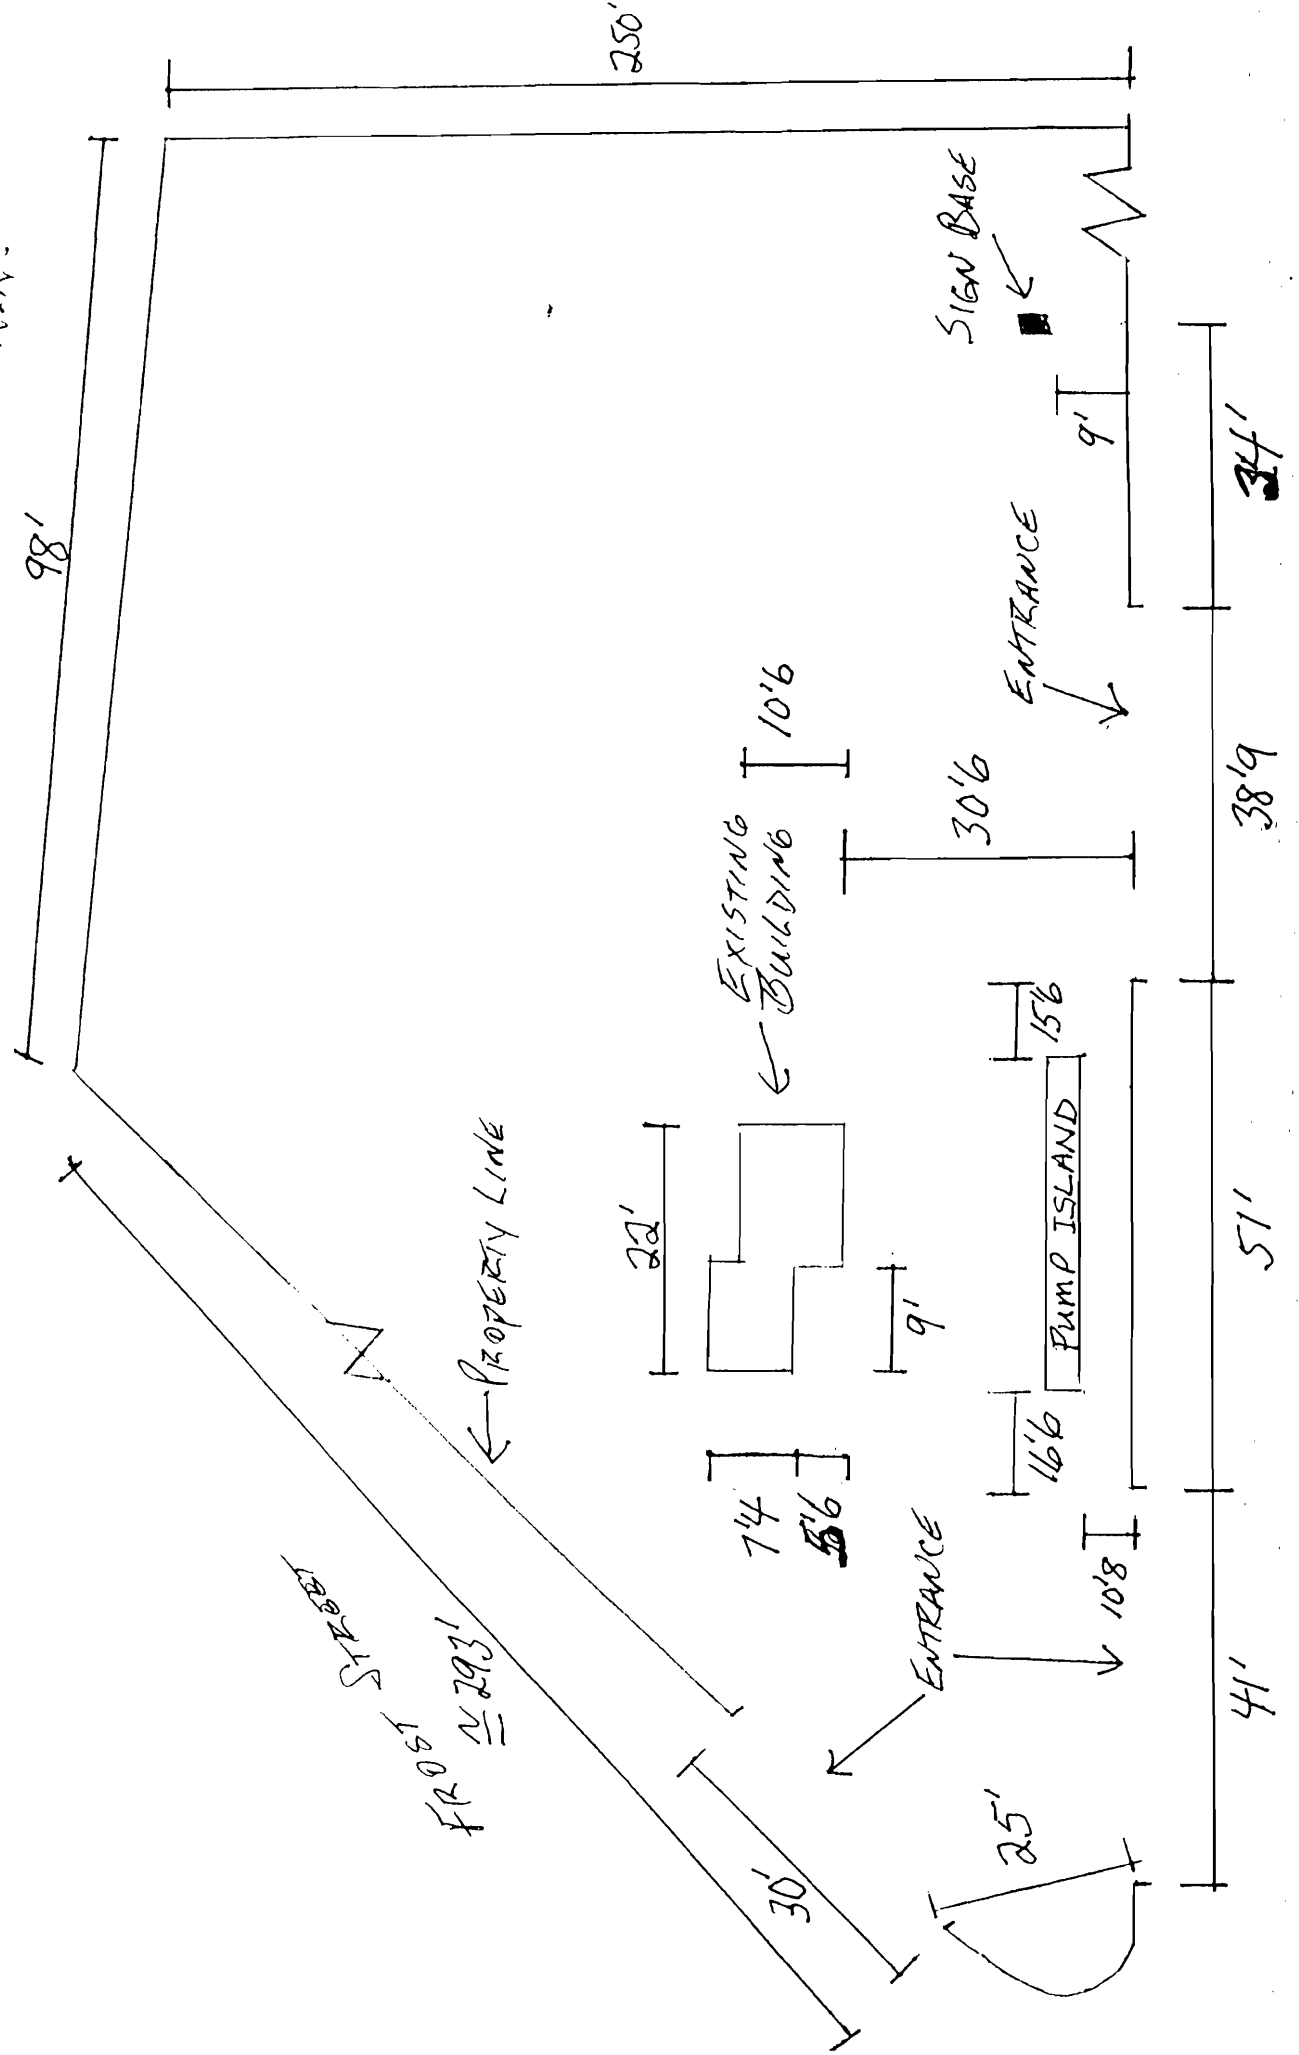

FRONT STREET
N 292'

CONGRESS ST. $\approx 292'$
N 292' 567/97

BUILDING PERMIT REPORT

DATE: 4/June 97 ADDRESS: 1585 Congress ST.
REASON FOR PERMIT: To Erect Signage
BUILDING OWNER: Onex Co.
CONTRACTOR: Budget-Westbrook Petroleum
PERMIT APPLICANT: _____ APPROVAL: x1, x2C **DENIED**

CONDITION(S) OF APPROVAL

- ☒ 1. This permit does not excuse the applicant from meeting applicable State and Federal rules and laws.
2. Before concrete for foundation is placed, approvals from the Development Review Coordinator and Inspection Services must be obtained. (A 24 hour notice is required prior to inspection)
3. Precaution must be taken to protect concrete from freezing.
4. It is strongly recommended that a registered land surveyor check all foundation forms before concrete is placed. This is done to verify that the proper setbacks are maintained.
5. Private garages located beneath habitable rooms in occupancies in Use Group R-1, R-2, R-3 or I-1 shall be separated from adjacent interior spaces by fire partitions and floor/ceiling assembly which are constructed with not less than 1-hour fire resisting rating. Private garages attached side-by-side to rooms in the above occupancies shall be completely separated from the interior spaces and the attic area by means of ½ inch gypsum board or the equivalent applied to the garage means of ½ inch gypsum board or the equivalent applied to the garage side. (Chapter 4 Section 407.0 of the BOCA/1996)
6. All chimneys and vents shall be installed and maintained as per Chapter 12 of the City's Mechanical Code. (The BOCA National Mechanical Code/1993) U.L. 103.
7. Guardrail & Handrails A guardrail system is a system of building components located near the open sides of elevated walking surfaces for the purpose of minimizing the possibility of an accidental fall from the walking surface to the lower level. Minimum height all Use Groups 42", except Use Group R which is 36". In occupancies in Use Group A, B, H-1, I-1, I-2 M and R and public garages and open parking structures, open guards shall have balusters or be of solid material such that a sphere with a diameter of 4" cannot pass through any opening. Guards shall not have an ornamental pattern that would provide a ladder effect.
8. Headroom in habitable space is a minimum of 7'6".
9. Stair construction in Use Group R-3 & R-4 is a minimum of 10" tread and 7 3/4" maximum rise. All other Use group minimum 11" tread, 7" maximum rise.
10. The minimum headroom in all parts of a stairway shall not be less than 80 inches.
11. Every sleeping room below the fourth story in buildings of use Groups R and I-1 shall have at least one operable window or exterior door approved for emergency egress or rescue. The units must be operable from the inside without the use of special knowledge or separate tools. Where windows are provided as means of egress or rescue they shall have a sill height not more than 44 inches (1118mm) above the floor. All egress or rescue windows from sleeping rooms shall have a minimum net clear opening height dimension of 24 inches (610mm). The minimum net clear opening width dimension shall be 20 inches (508mm), and a minimum net clear opening of 5.7 sq. ft.
12. Each apartment shall have access to two (2) separate, remote and approved means of egress. A single exit is acceptable when it exits directly from the apartment to the building exterior with no communications to other apartment units.
13. All vertical openings shall be enclosed with construction having a fire rating of at least one (1) hour, including fire doors with self closer's.
14. The boiler shall be protected by enclosing with (1) hour fire-rated construction including fire doors and ceiling, or by providing automatic extinguishment.
15. All single and multiple station smoke detectors shall be of an approved type and shall be installed in accordance with the provisions of the City's Building Code Chapter 9, Section 19, 920.3.2 (BOCA National Building Code/1996), and NFPA 101 Chapter 18 & 19. (Smoke detectors shall be installed and maintained at the following locations):
 - In the immediate vicinity of bedrooms
 - In all bedrooms
 - In each story within a dwelling unit, including basementsIn addition to the required AC primary power source, required smoke detectors in occupancies in Use Groups R-2, R-3 and I-1 shall receive power from a battery when the AC primary power source is interrupted. (Interconnection is required)