



REV	DESCRIPTION	DATE
0	BIDDING/CONSTRUCTION	7-9-07

GRAPHIC SCALE:
0" = 1"

SCALE: AS NOTED
PROJECT MANAGER: SLB
JC/DRAWN BY: TCM/TCM
A/E OF RECORD: SLB
CAD FILE: AE122-06016
PROJECT NO: 06016
DATE: 7-9-07

SHEET TITLE:
**SECOND FLOOR
REFLECTED
CEILING PLAN**

SHEET No.
AE122

© copyright 2007 SMT Inc.

GENERAL NOTES:

- SEE G1001 FOR PROJECT GENERAL NOTES.

REFLECTED CEILING PLAN NOTES:


- REFERENCE ROOM FINISH SCHEDULE FOR CEILING HEIGHTS AND TYPES
- FIRE SPRINKLERS SHALL BE LOCATED IN ALIGNMENT WITH OTHER CEILING ITEMS, TYPICALLY
- FIRE SPRINKLERS SHALL BE CENTERED IN CEILING TILE
- FIRE SPRINKLERS SHALL BE PLACED TO COORDINATE WITH LIGHT FIXTURE POSITIONS INDICATED.
- ALIGN CEILING ITEMS AS SHOWN, WITH COMMON CENTERLINES, TYPICALLY. CENTER ITEMS IN CEILINGS, OR IN AREA U.N.O
- PROVIDE ACCESS PANELS AS REQUIRED IN GWB CEILINGS FOR ACCESS TO MECHANICAL VALVES/ CONTROLS. RE: MECHANICAL DRAWINGS

SOFFIT HEIGHT SCHEDULE

- ▲ 7'-0" A.F.F.
- ▲ 7'-6" A.F.F.
- ▲ 8'-0" A.F.F.
- ▲ 8'-6" A.F.F.
- ▲ 11'-6" A.F.F.
- ▲ 6'-10" A.F.F.

SYMBOL LEGEND

- AREA INDICATING LIMITS OF HORIZONTAL SHAFT ASSEMBLY ABOVE CEILING
- HANGING BRICK SOFFIT
- ALUMINUM SOFFIT/ CEILING SYSTEM
- 2x4 SUSPENDED CEILING PANEL AND GRID ASSEMBLY.
- 2x2 SUSPENDED CEILING PANEL AND GRID ASSEMBLY.
- GWB CEILING.
- 2x4 LAY-IN LIGHT FIXTURE.
- 1x4 PENDANT LIGHT FIXTURE.
- DOWN LIGHT.
- CEILING MOUNTED EXIT LIGHT.
- RETURN AIR GRILLE.
- SUPPLY AIR GRILLE.
- EXHAUST AIR GRILLE.
- SPRINKLER HEAD.
- CEILING MOUNTED SPEAKER.
- CEILING MOUNTED SMOKE DETECTOR.
- SLOT DIFFUSER.
- CEILING MOUNTED CAMERA (N.I.C.)
- CEILING MOUNTED HEAT DETECTOR
- CEILING MOUNTED OCCUPANCY SENSOR

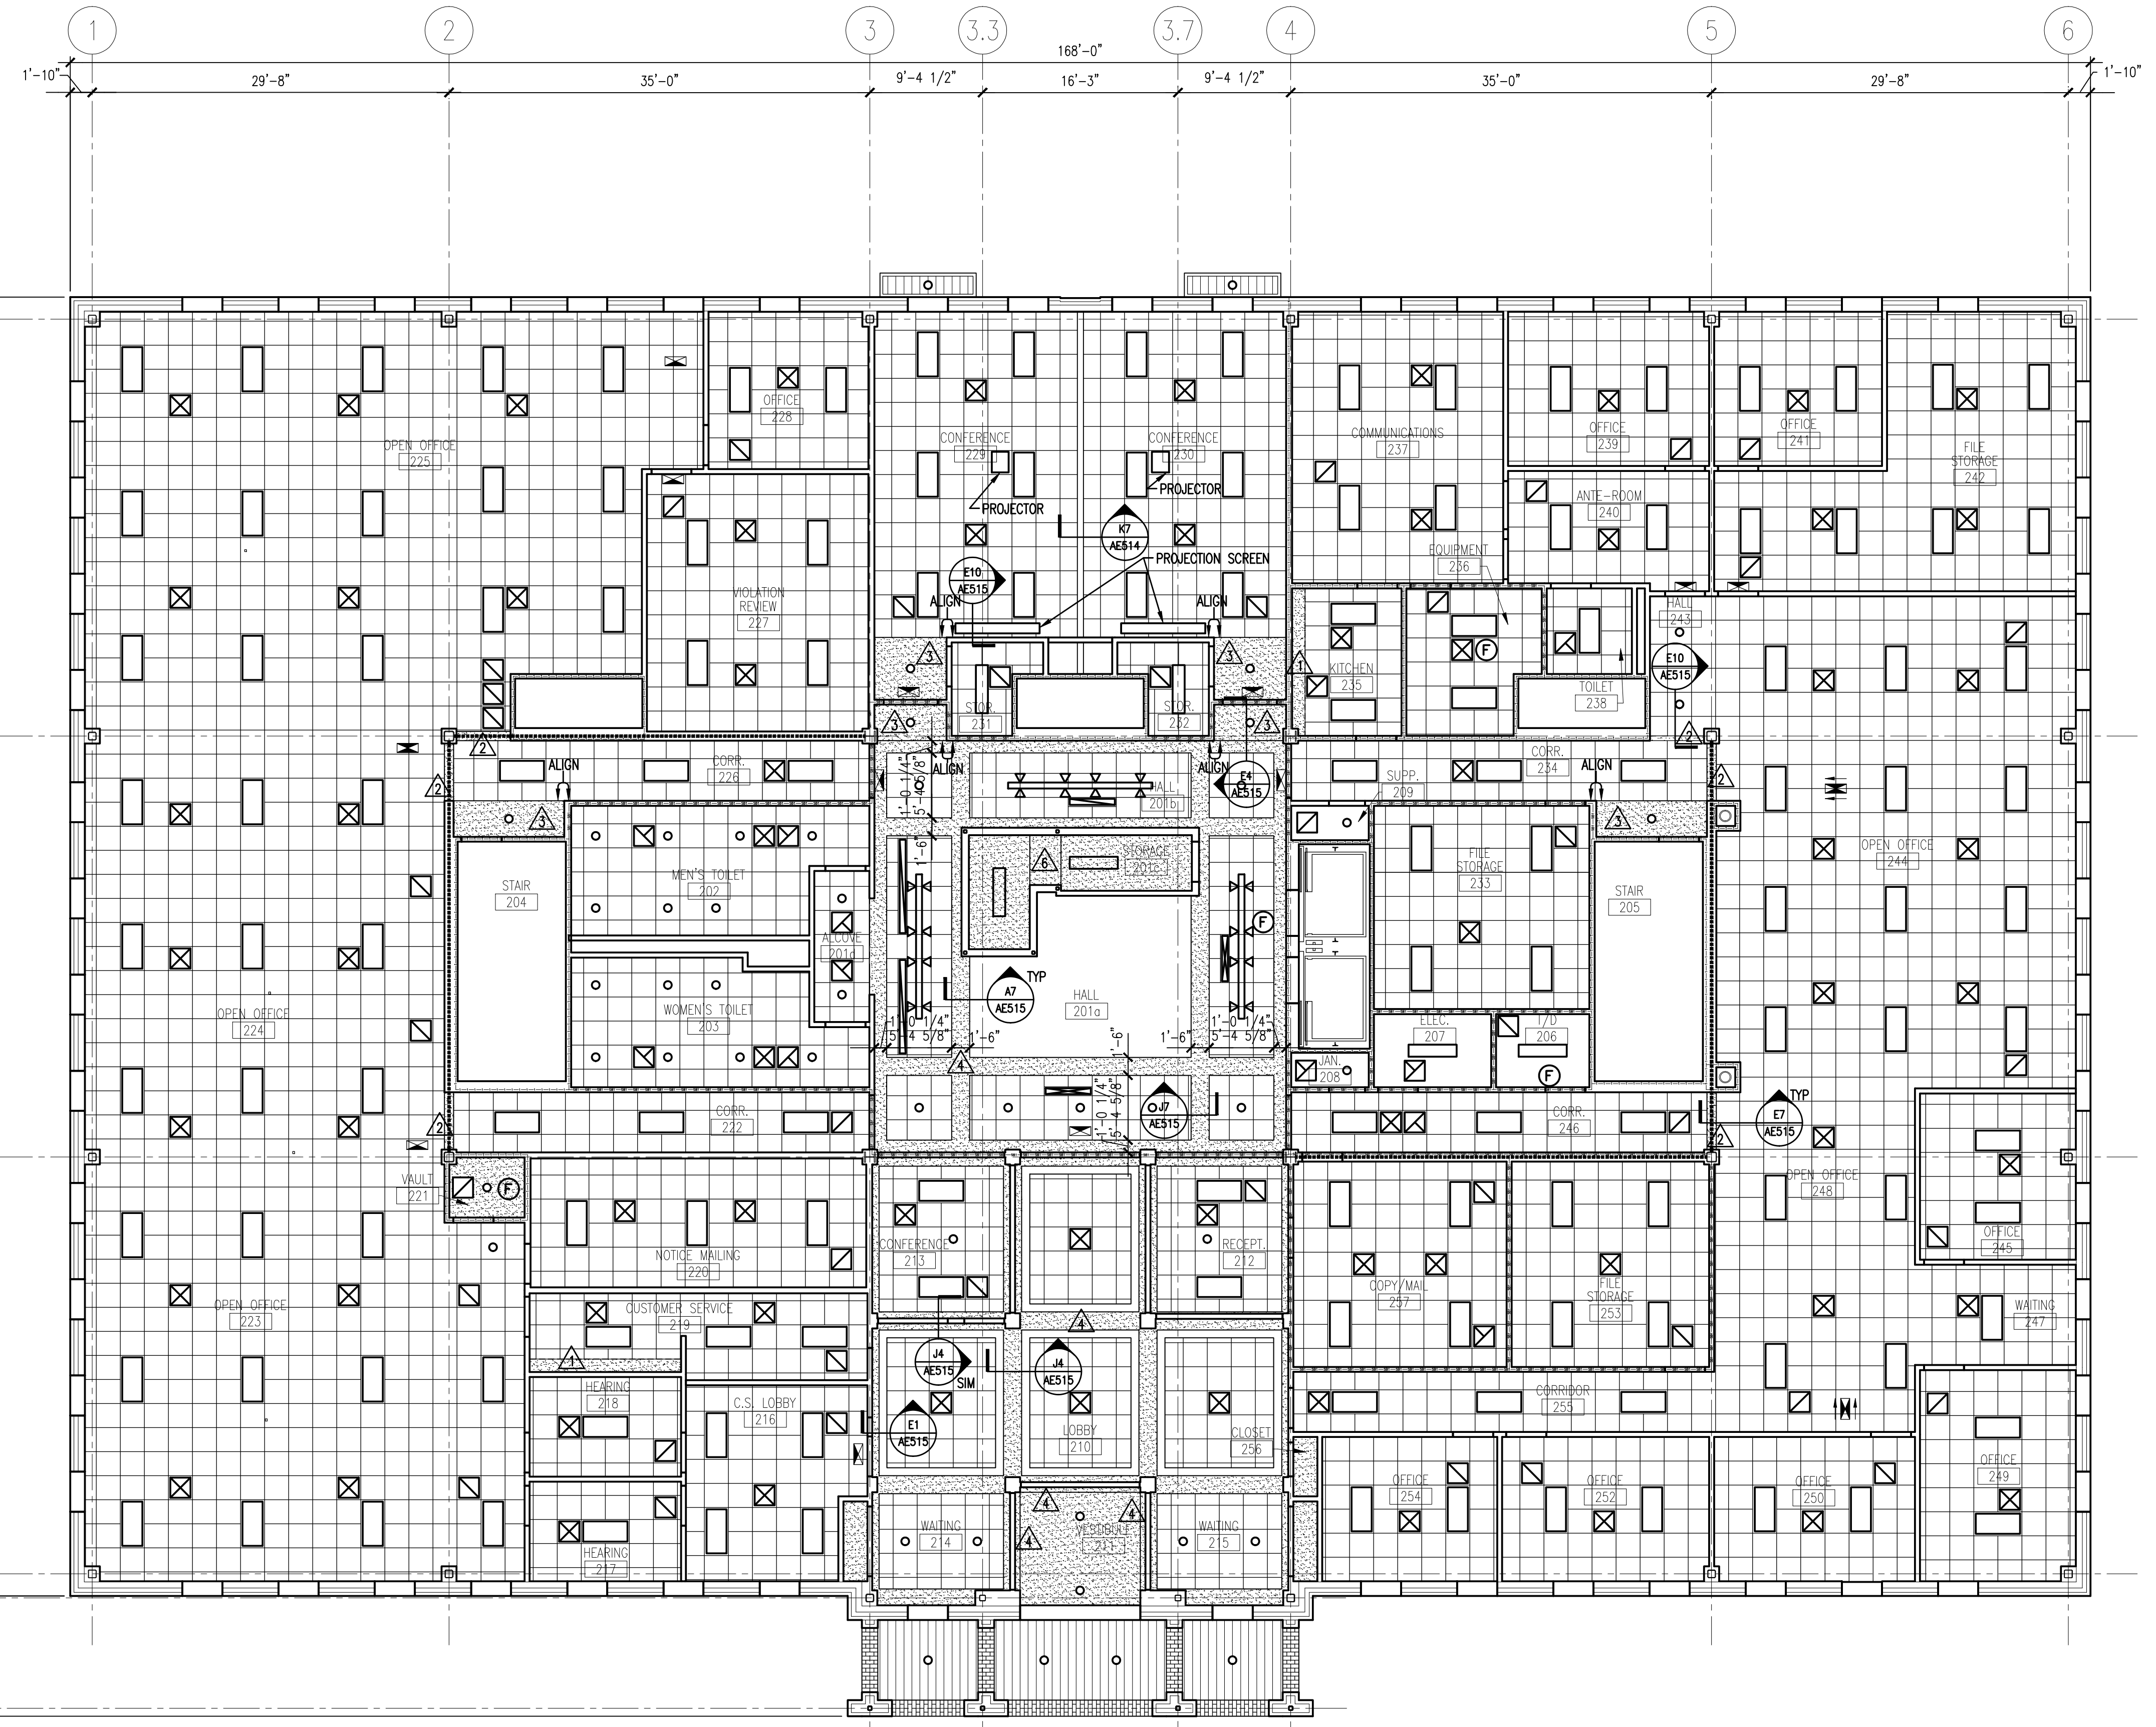

A1 SECOND FLOOR REFLECTED CEILING PLAN

1/8" = 1'-0"