




REV	DESCRIPTION	DATE
0	BIDDING/CONSTRUCTION	7-9-07

GRAPHIC SCALE:



SCALE: 1/8" = 1'-0"
PROJECT MANAGER: SLB
JC/DRAWN BY: TCM/CDS
A/E OF RECORD: JPP
CAD FILE: EP101-06016
PROJECT NO: 06016
DATE: 7-9-07

SHEET TITLE:
FIRST FLOOR
POWER PLAN


SHEET No. EP101

NOTE:

1. SEE SHEET E001 FOR LEGEND AND ABBREVIATIONS.

KEYED NOTES:

- ① MOUNT 45" AFF TO CENTER OF DEVICE.
- ② MOUNT 6" ABOVE COUNTER TO CENTER OF DEVICE.
- ③ PROVIDE 120V HARDWIRED OR RECEPTACLE CONNECTION TO AUTOMATIC FLUSH VALVE AND/OR FAUCET POWER SUPPLIES FURNISHED BY THE PLUMBING CONTRACTOR. COORDINATE LOCATIONS AND REQUIREMENTS W/ ARCHITECT AND PLUMBING CONTRACTOR.
- ④ PROVIDE 120V HARDWIRED CONNECTION TO ELECTRIC WATER COOLER. COORDINATE W/ MECHANICAL CONTRACTOR.
- ⑤ PROVIDE 4" SQUARE JUNCTION BOX FOR 120V CONNECTIONS TO PREWIRED OFFICE FURNITURE. EACH BRANCH CIRCUIT SHALL HAVE A DEDICATED NEUTRAL CONDUCTOR. COMBINE AND BALANCE PREWIRED DEVICE CIRCUITS AS REQUIRED TO CONNECT TO BRANCH CIRCUITS AS INDICATED. MAX. 8 DUPLEX DEVICES OR 3 WORKSTATIONS PER CIRCUIT. COORDINATE EXACT REQUIREMENTS, WIRING AND LOCATIONS W/ OWNER, ARCHITECT, AND OFFICE FURNITURE INSTALLER.
- ⑥ PROVIDE 120V CONNECTION TO ELECTRIC HEAT TRACE FURNISHED BY THE PLUMBING CONTRACTOR. COORDINATE W/ PLUMBING CONTRACTOR.
- ⑦ PROVIDE 120V HARDWIRED OR RECEPTACLE CONNECTION TO IRRIGATION SYSTEM CONTROLLER FURNISHED AND INSTALLED BY OTHERS. PROVIDE 1-2" SCHEDULE 80 PVC CONDUIT ROUTED FROM CONTROLLER TO 10' OUTSIDE BUILDING FOOTPRINT FOR SYSTEM CONTROL WIRING BY OTHERS. COORD. EXACT LOCATIONS AND REQUIREMENTS W/ IRRIGATION INSTALLER PRIOR TO WORK.

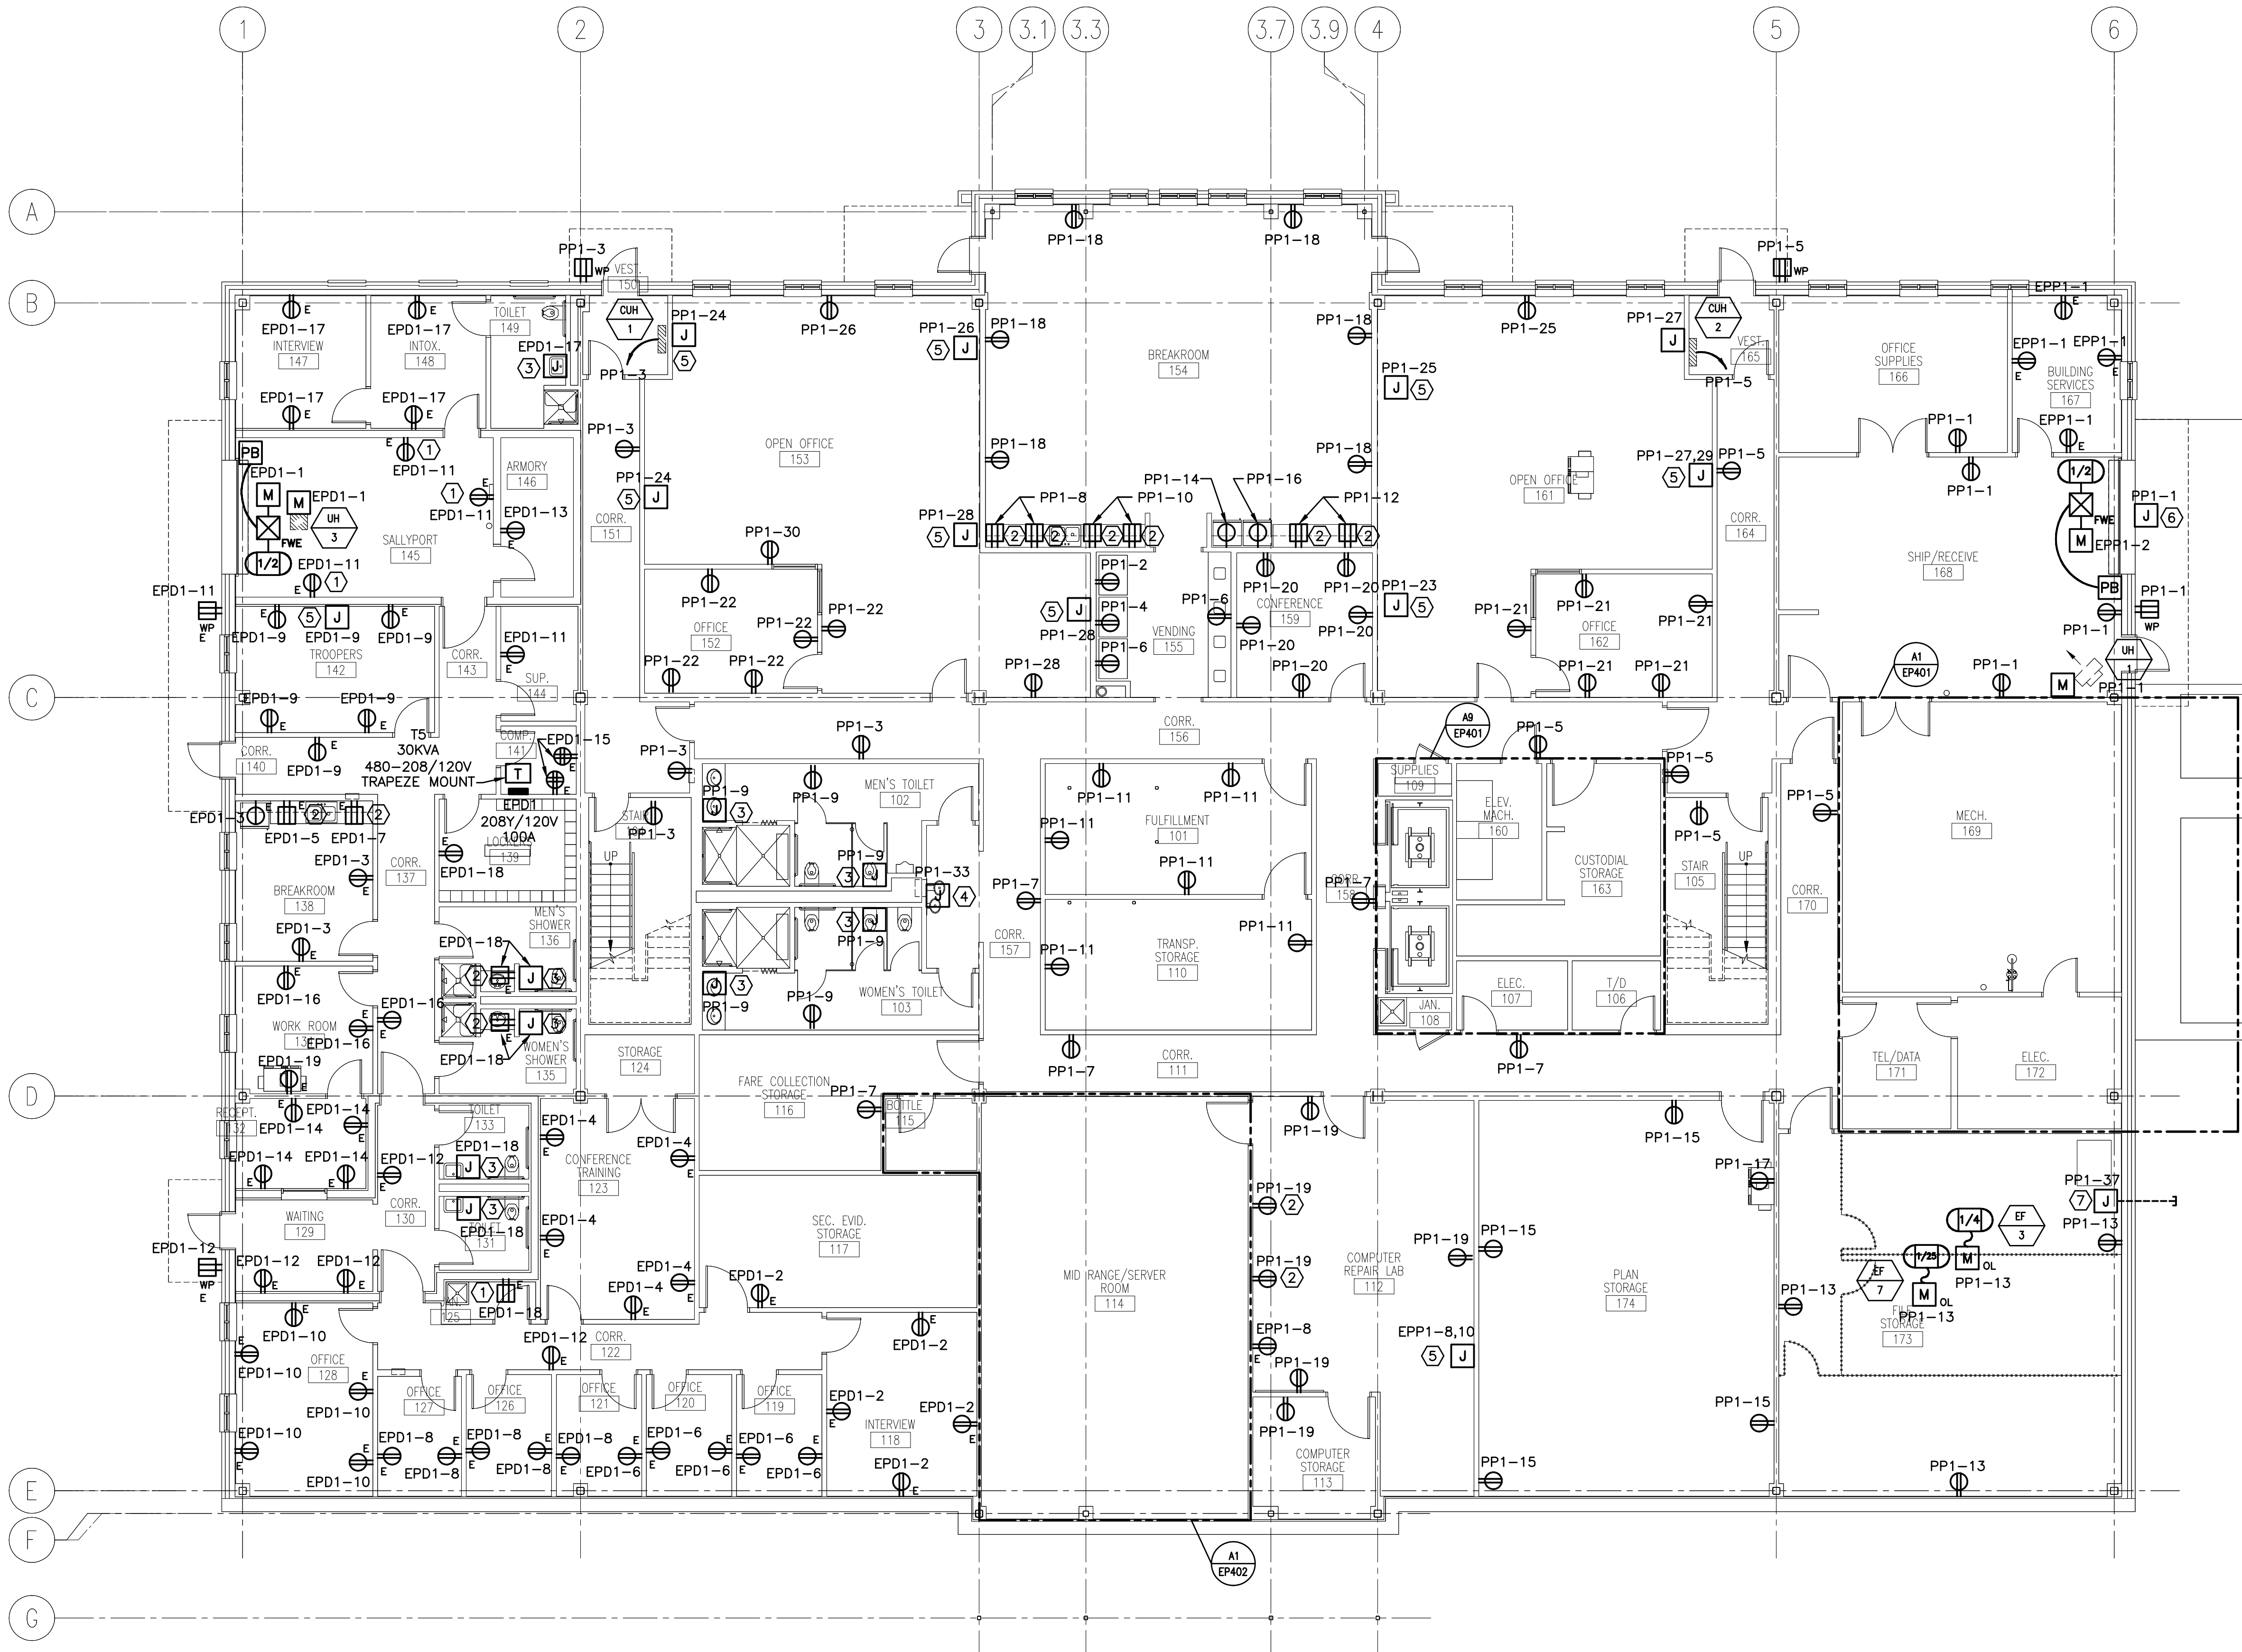

A1 FIRST FLOOR PLAN

1/8" = 1'-0"