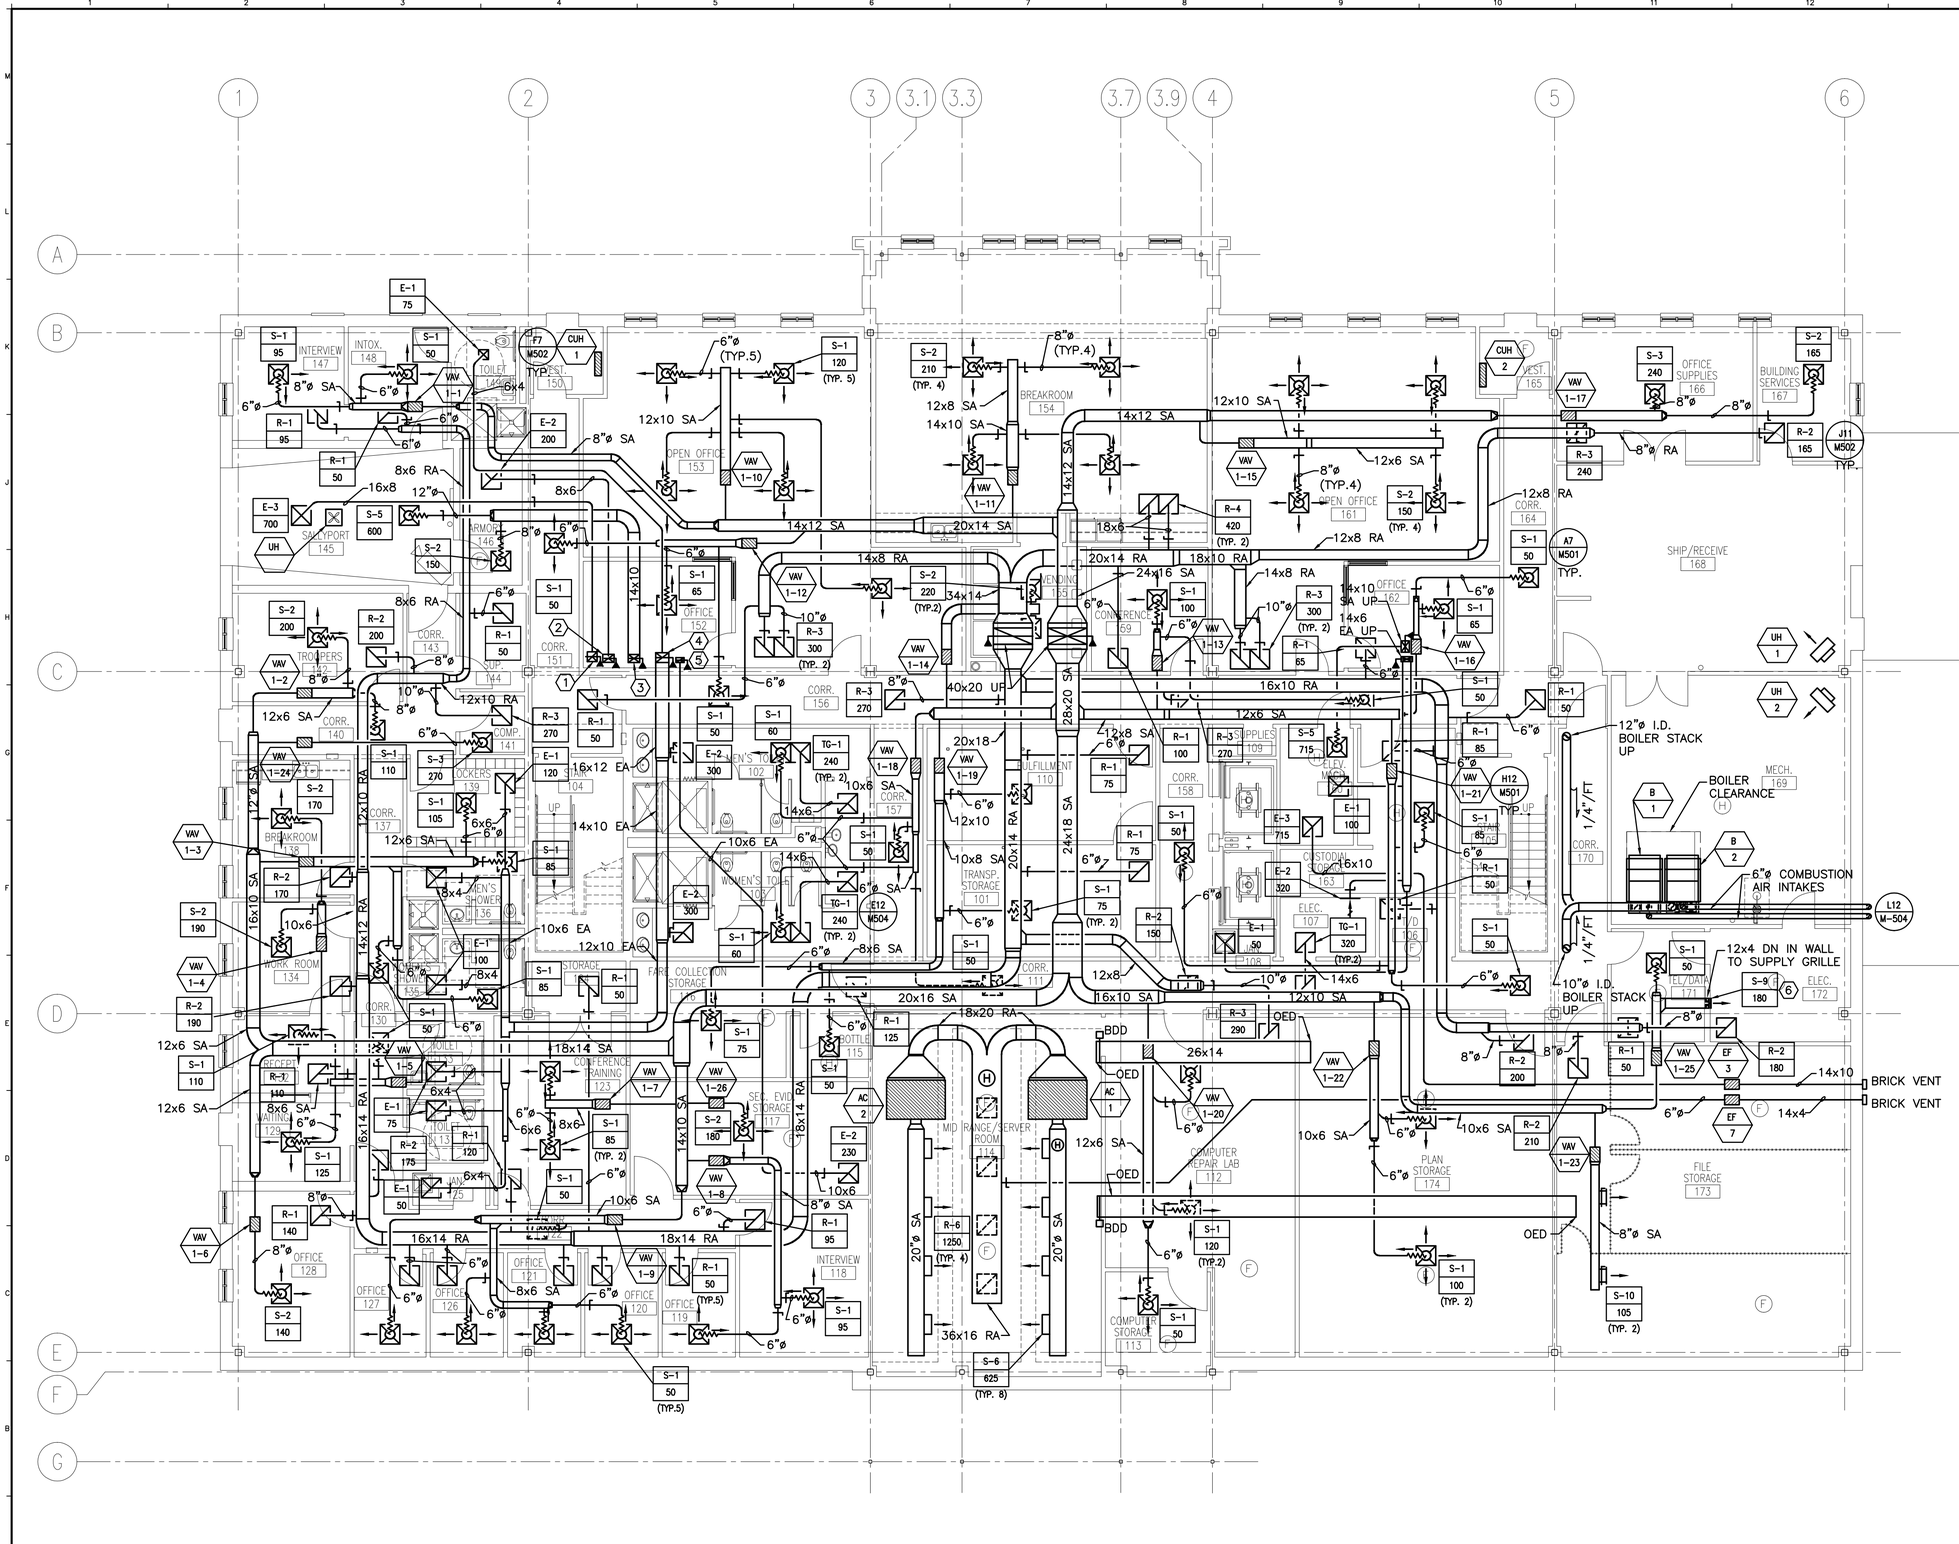

NOTE:

1. SEE SHEET M-001 FOR LEGEND AND ABBREVIATIONS.
2. ALL DUCTWORK ROUTED ACROSS CORRIDORS #151 & #164 MUST BE CONTAINED WITHIN THE LIMITS OF HORIZONTAL FIRE-RATED SHAFT LOCATED ABOVE THE SUSPENDED CEILING. COORDINATE LAYOUT OF DUCTWORK ACCORDINGLY WITH WORK OF OTHER TRADES.

KEYED NOTES:

1. 12x12 EA UP
2. 8x6 EA UP
3. 14x10 SA UP
4. 16x12 EA UP
5. 10x6 EA UP
6. MOUNT DIFFUSER 12" AFF.

A1 | FIRST FLOOR PLAN

1/8" = 1'-0"

SMRT

ARCHITECTURE ENGINEERING PLANNING

SMRT
144 Fore Street/P.O. Box 618
Portland, Maine 04104
tel. (207) 772-3846
fax. (207) 772-1070

PROJECT NORTH

MAG. NORTH

PROJECT TITLE: MAINE TURNPIKE AUTHORITY ADMINISTRATION BUILDING
PORTLAND, MAINE

CURRENT ISSUE STATUS: ISSUED FOR BIDDING/CONSTRUCTION 7-9-07

REV	DESCRIPTION	DATE
0	BIDDING/CONSTRUCTION	7-9-07

GRAPHIC SCALE: 0" 1"

SCALE:	1/8"=1'-0"
PROJECT MANAGER:	SLB
JC/DRAWN BY:	TCM/BGG
A/E OF RECORD:	RMW
CAD FILE:	MH101-06016
PROJECT NO:	06016
DATE:	7-9-07

SHEET TITLE: FIRST FLOOR HVAC DUCTWORK PLAN

SHEET No. MH101

© COPYRIGHT 2007 SMRT INC.