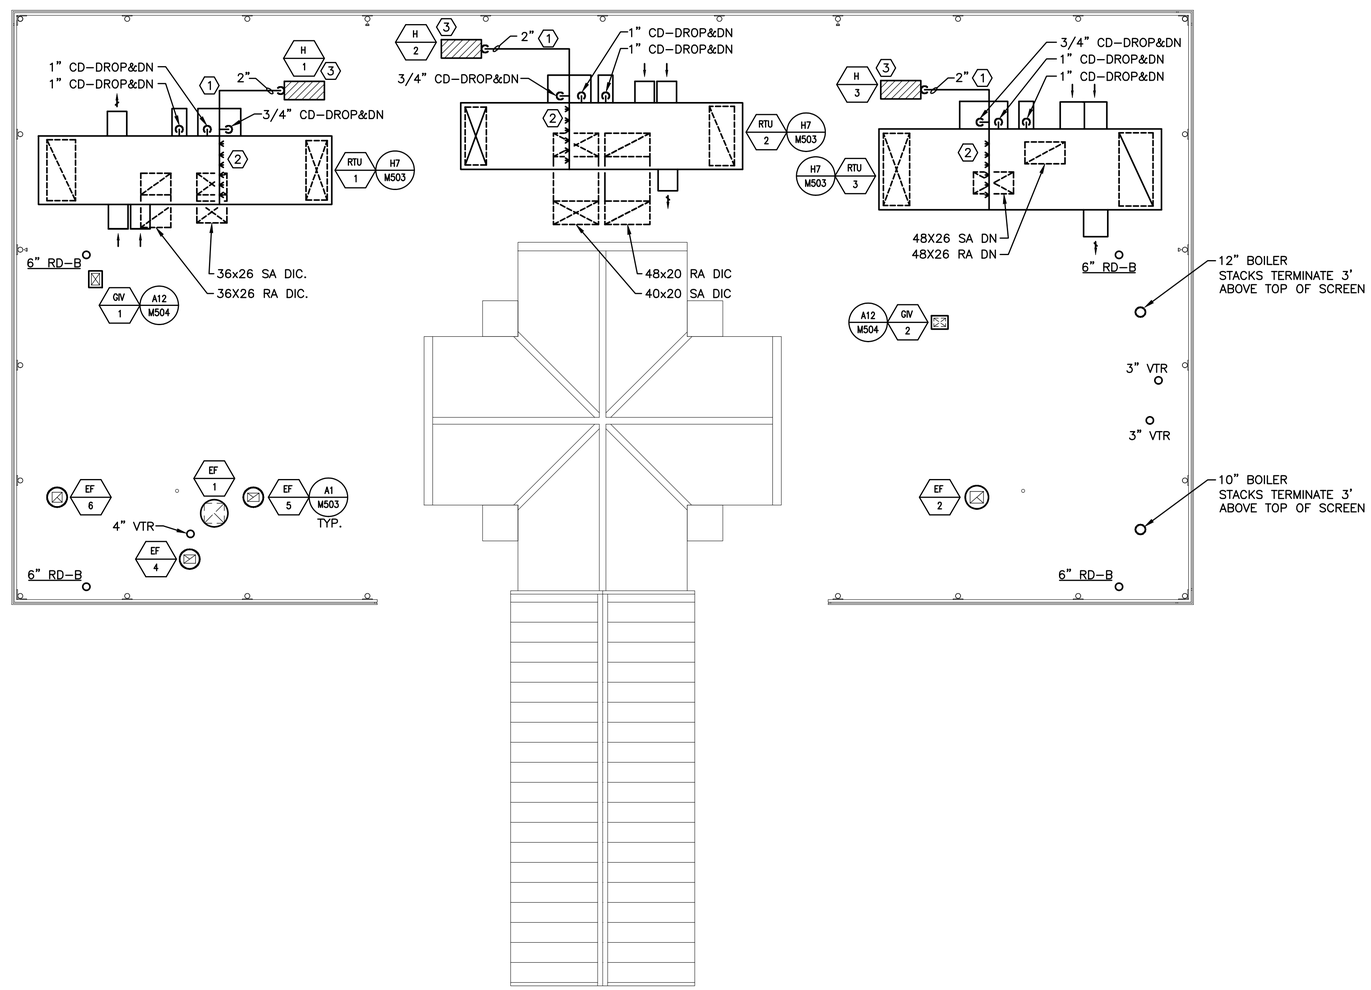

NOTE:

1. SEE SHEET M-001 FOR LEGEND AND ABBREVIATIONS.

KEYED NOTES:

1. INSTALL HUMIDIFIER DISPERSION ASSEMBLY PER MANUFACTURERS WRITTEN INSTRUCTIONS. PIPING CONNECTION FROM HUMIDIFIER TO DIPERSION GRID TO BE HARD PIPED WITH SCH.40 STEEL. PROVIDE 2" THICK FIBERGLASS INSULATION WITH PVC JACKET.
2. PROVIDE SS DRAIN PAN TO EXTEND FULL LENGTH OF HUMIDIFIER MODULE WITHIN AHU.
3. TERMINATE FLUE 5 FT ABOVE HUMIDIFIER.

SMRT
ARCHITECTURE ENGINEERING PLANNING
SMRT
144 Fore Street/P.O. Box 618
Portland, Maine 04104
tel. (207) 772-3846
fax. (207) 772-1070

PROJECT NORTH
MAG. NORTH

PROJECT TITLE:
MAINE TURNPIKE AUTHORITY
ADMINISTRATION BUILDING
PORTLAND, MAINE

CURRENT ISSUE STATUS:
ISSUED FOR BIDDING/CONSTRUCTION
7-9-07

REV	DESCRIPTION	DATE
0	BIDDING/CONSTRUCTION	7-9-07

GRAPHIC SCALE: 0" 1"

SCALE:	AS NOTED
PROJECT MANAGER:	SLB
JC/DRAWN BY:	TCM/BGG
A/E OF RECORD:	RMW
CAD FILE:	MH104-06016
PROJECT NO:	06016
DATE:	7-9-07

SHEET TITLE:
ROOF
HVAC DUCTWORK
PLAN

SHEET No.
MH104

© COPYRIGHT 2007 SMRT INC

A1	ROOF PLAN
1/8" = 1'-0"	–