


- NOTE:**
- SEE SHEET M-001 FOR LEGEND AND ABBREVIATIONS.
- KEYED NOTES:**
- 4" STAND DRAIN FOR FIRE DEPARTMENT EQUIPMENT DRAINS. SEE DETAIL A12/PL501. (RE: FIRE PROTECTION PLANS).
 - PROVIDE CLEAN-OUT AT BASE OF 4" STAND PIPE. STARTING INVERT = 97'-6"
 - (2) 2" V-RISE
4" S-DN
 - 2" V-RISE
(2) 2" V-UP&RISE
1-1/2" V-RISE
4" S-DN
 - 2" V-RISE
1-1/2" V-RISE
4" S-DN
 - ROUTE CONDENSATE DRAIN PIPING TO WITHIN 2" OF FD-A SLOPE ALL HORIZONTAL PIPING AT 1/4"/FT.
 - ELECTRICALLY HEAT TRACE AND INSULATE PIPING. (RAYCHEM #5XL-1, 120V, AND 1" FIBERGLASS INSULATION.) PROVIDE LINE TEMPERATURE SENSING THERMOSTAT AND SENSOR. (AMC-F5) INSTALL PER MANUFACTURERS WRITTEN INSTRUCTIONS.
 - CONNECT 2" WASTE TO EE-C.

SM RT

ARCHITECTURE ENGINEERING PLANNING
SWRT
144 Fore Street/P.O. Box 618
Portland, Maine 04104
tel. (207) 772-3646
fax. (207) 772-1070

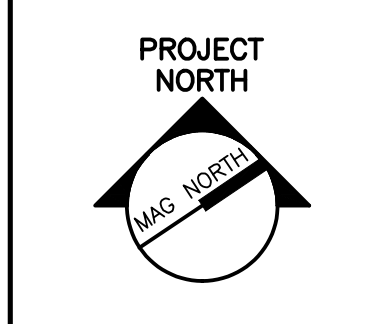

PROJECT TITLE:
**MAINE TURNPIKE AUTHORITY
ADMINISTRATION BUILDING**
PORTLAND, MAINE

CURRENT ISSUE STATUS:
ISSUED FOR BIDDING/CONSTRUCTION
7-9-07

REV	DESCRIPTION	DATE
0	BIDDING/CONSTRUCTION	7-9-07

GRAPHIC SCALE:
0" = 1"

SCALE: 1/8" = 1'-0"

PROJECT MANAGER: SLB
JC/DRAWN BY: TCM/BGG
A/E OF RECORD: RWM
CAD FILE: PL101-06016
PROJECT NO: 06016
DATE: 7-9-07

SHEET TITLE:
**FIRST FLOOR
DWG PIPING PLAN**

A1
1/8" = 1'-0"

FIRST FLOOR PLAN

SHEET No. **PL101**