




COPYRIGHT 2015 © DIRIGO ARCHITECTURAL ENGINEERING LLC. ALL RIGHTS RESERVED. NO REPRODUCTION WITHOUT PRIOR WRITTEN PERMISSION

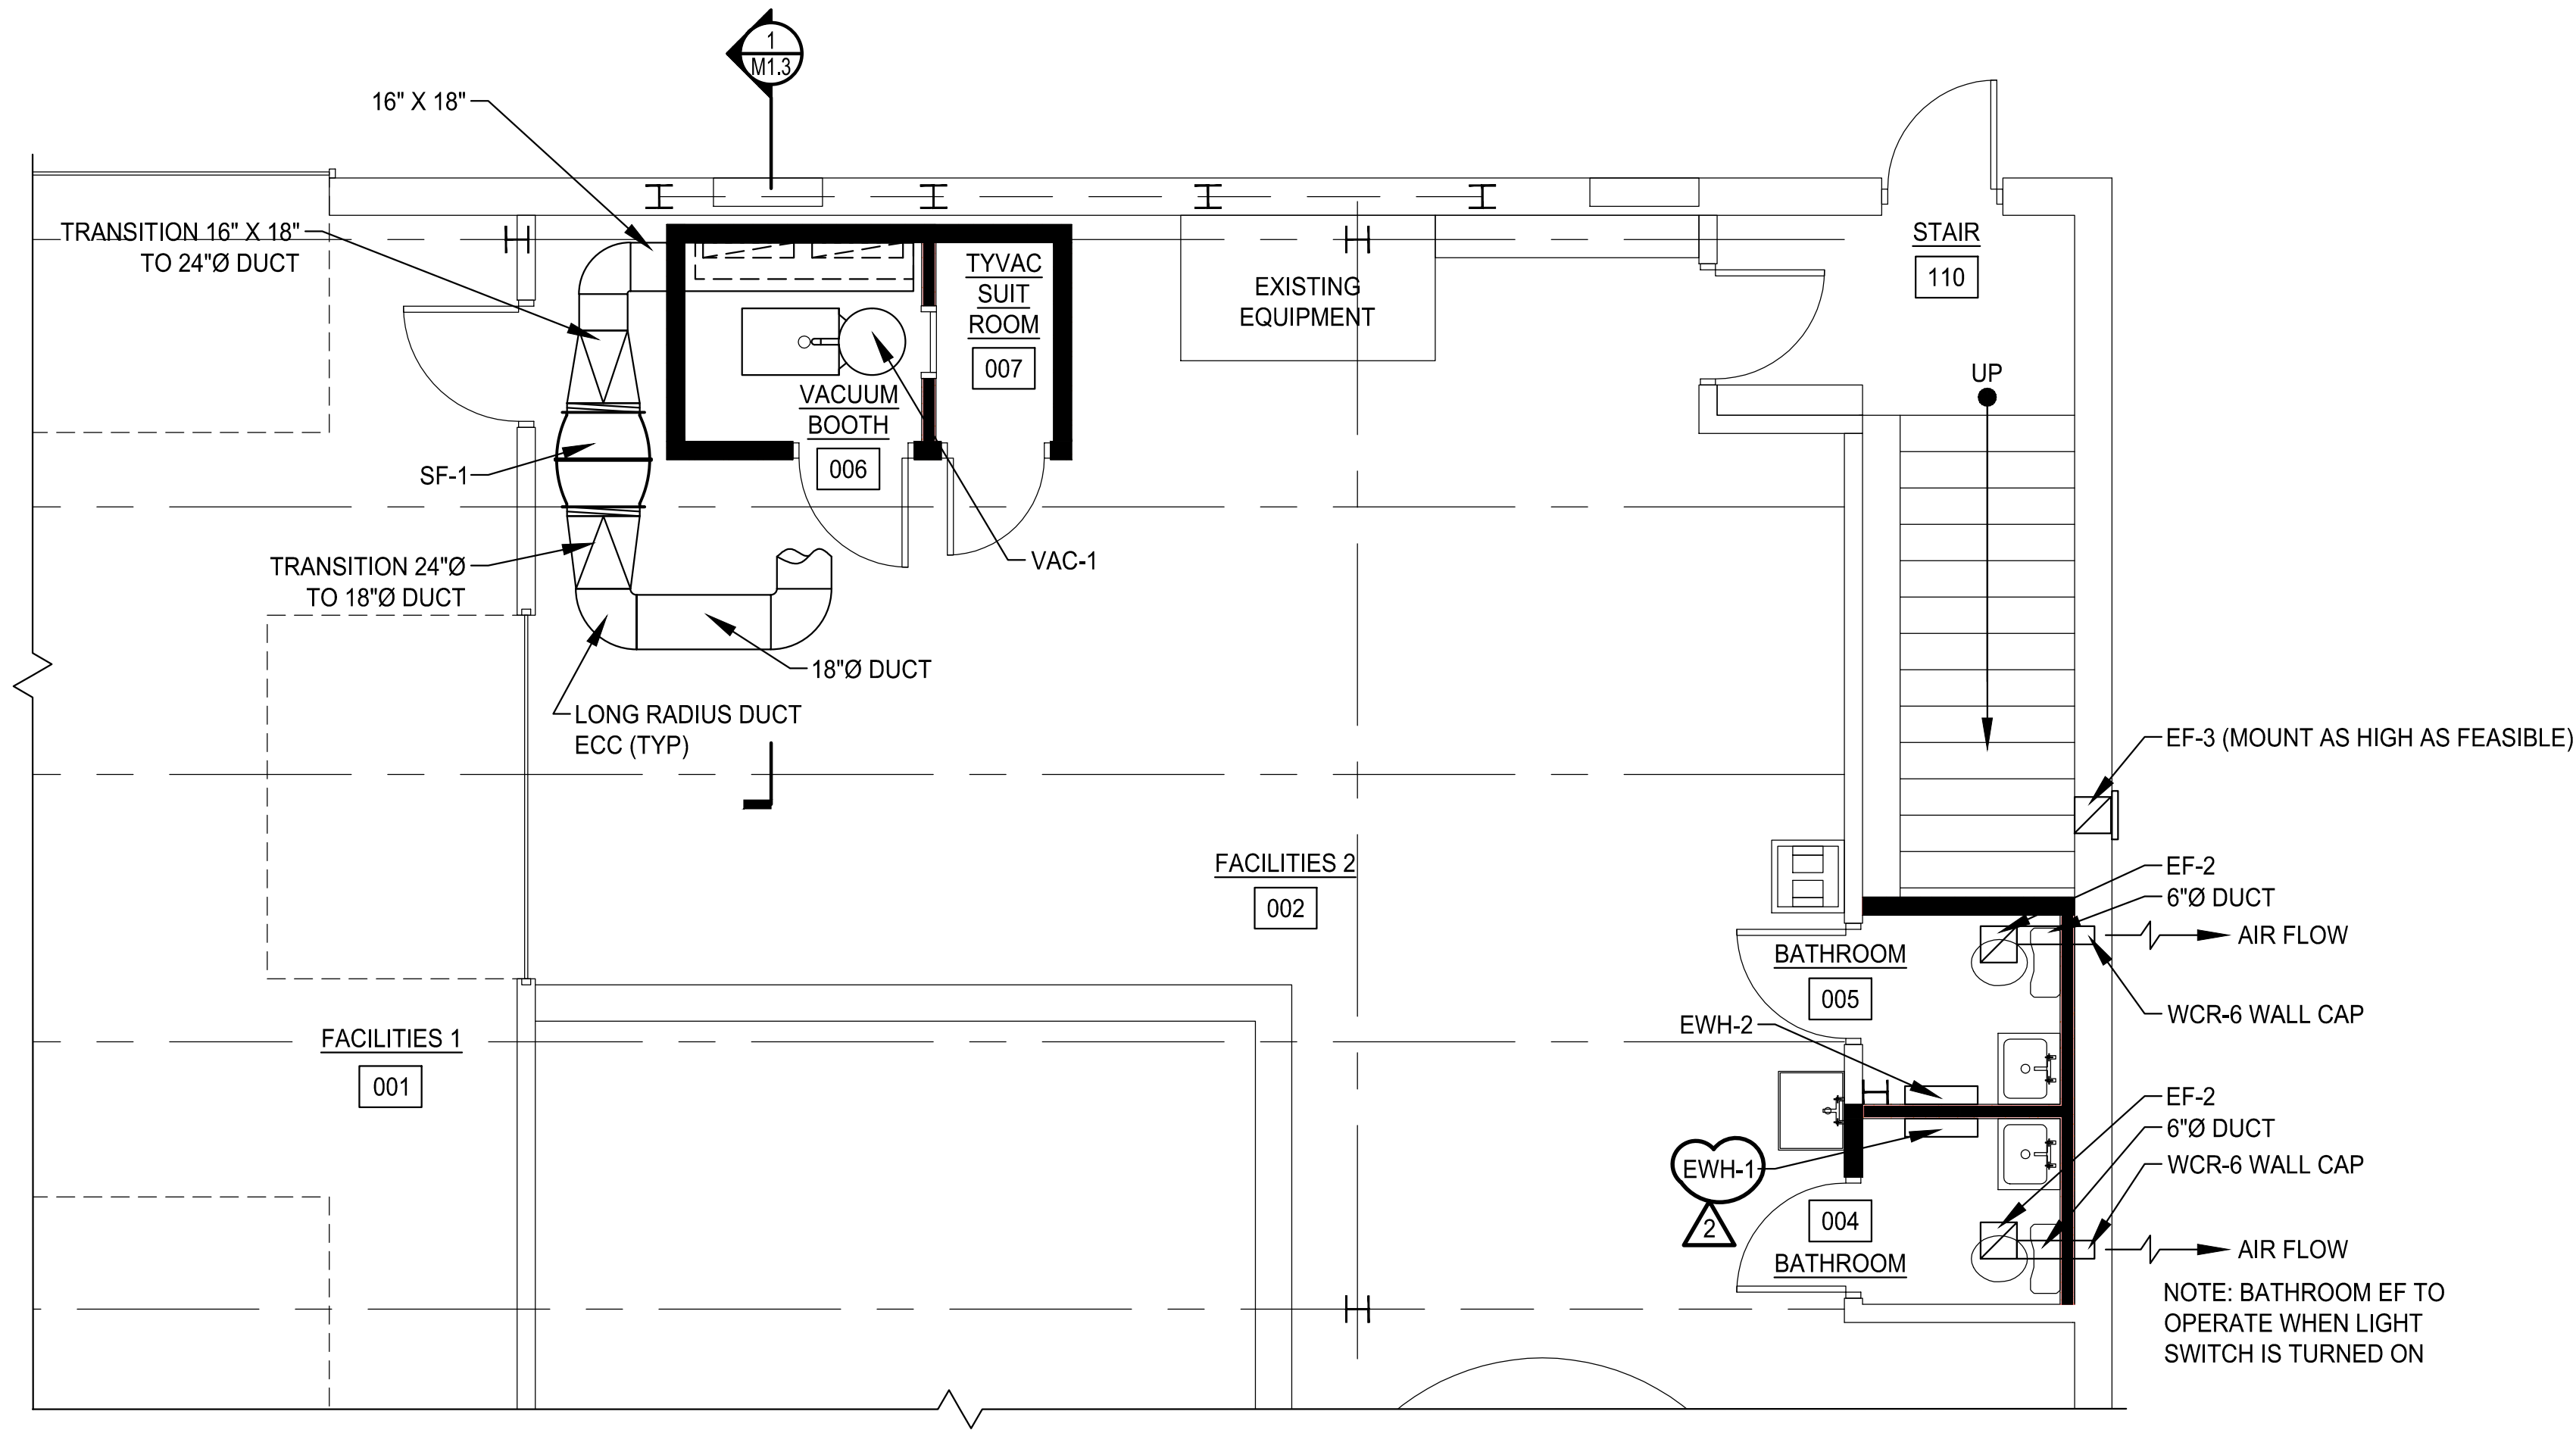

GROUND FLOOR SUPPLY FAN AND DUCTING 1
 22X34 SCALE: 1/4"=1'-0"
 11X17 SCALE: 1/8"=1'-0" M1.1

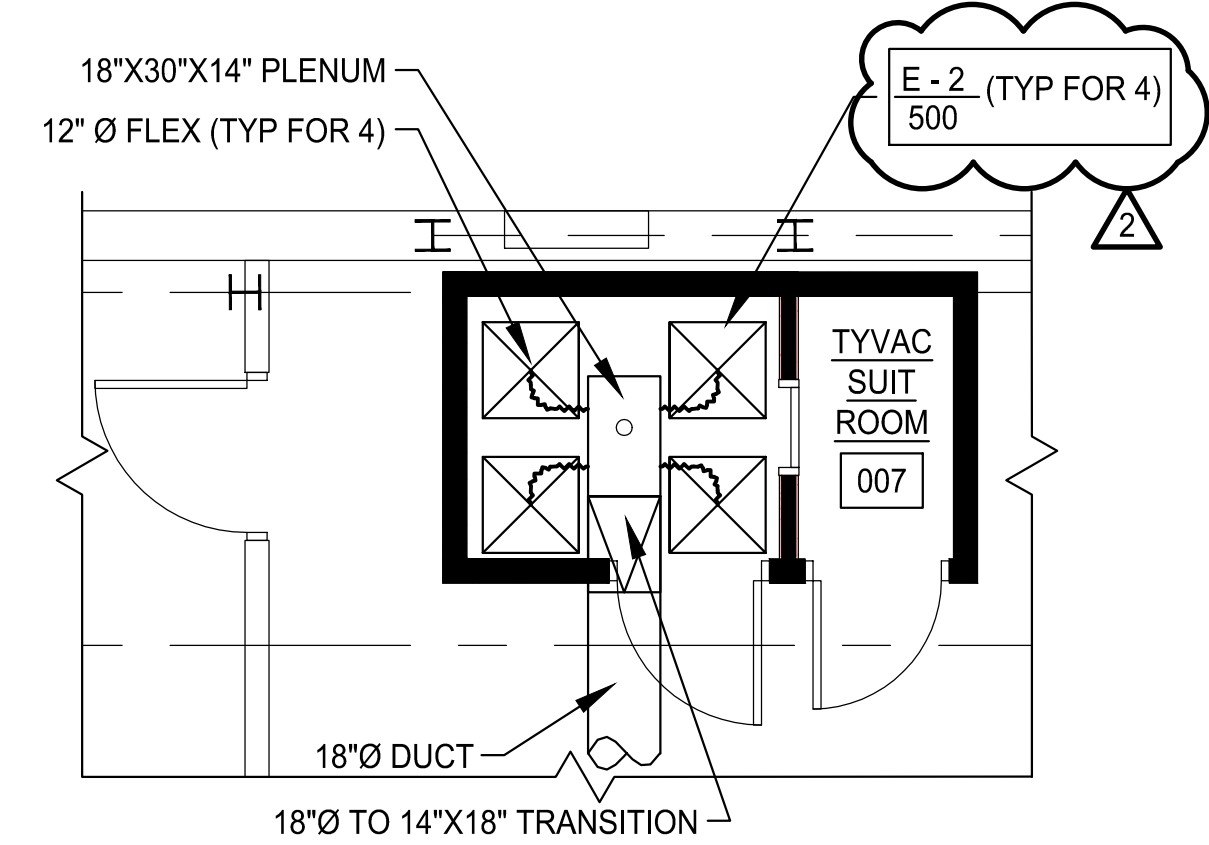

VACUUM BOOTH DIFUSERS 2
 22X34 SCALE: 1/4"=1'-0"
 11X17 SCALE: 1/8"=1'-0" M1.1

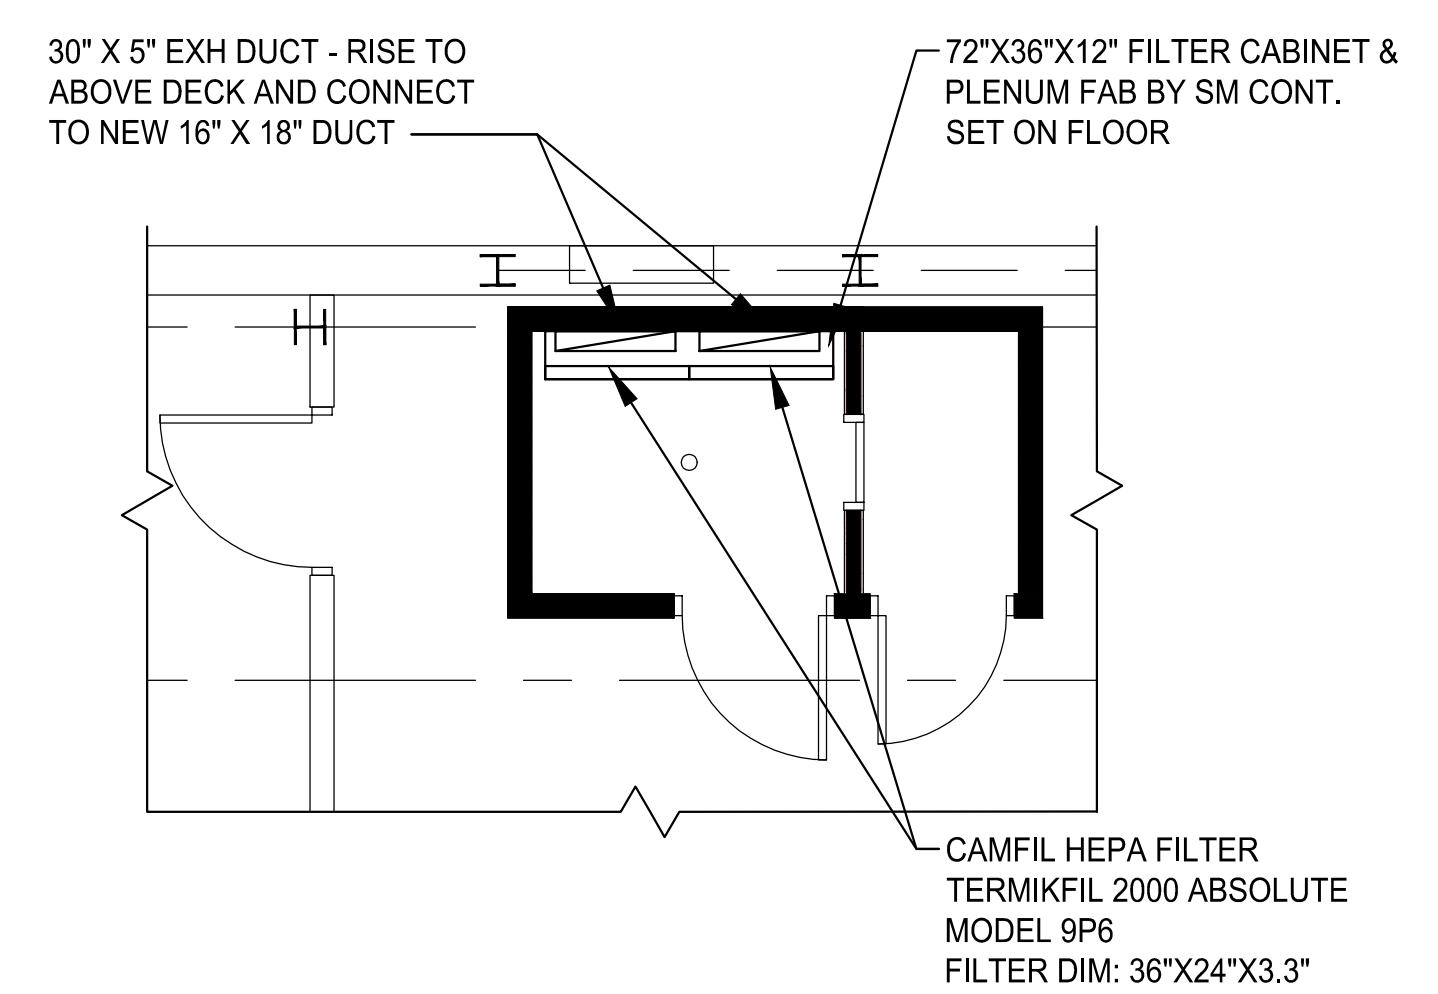

VACUUM BOOTH HEPA FILTER EXHAUST 3
 22X34 SCALE: 1/4"=1'-0"
 11X17 SCALE: 1/8"=1'-0" M1.1

NOTE:
 ALL EXISTING MAINS AND BRANCHES PROPOSED FOR
 CONNECTIONS BE VERIFIED IN THE FIELD BEFORE START
 OF WORK IN THE ASSOCIATED WORK SCOPE.

SIGNED COPY OF DRAWING
 ON FILE AT DIRIGO A/E
 OFFICE

 ROBERT BROWN
 LICENSED PROFESSIONAL ENGINEER
 6/1/2016

GROUND FLOOR HVAC MODIFICATION

REV.	DATE	DESCRIPTION
1	1/18/16	ISSUED FOR CONSTRUCTION
2	6/7/16	ISSUED FOR SET C/I
3		

DRAWN BY: DLB
 CHECKED BY: RHB

PH: (207) 225 - 3040
 1071 Auburn Road
 Suite G
 Turner, ME 04282

DIRIGO ARCHITECTURAL
 ENGINEERING • CONSTRUCTION MANAGEMENT
 EM: tperk@dirigoae.com W: www.dirigoae.com

DATE: 6/1/16
 PROJECT NO. 15-015

SHEET NO.
M1.1