


DOMESTIC WATER FLOOR PLAN

SCALE: 1/2" = 1'-0"

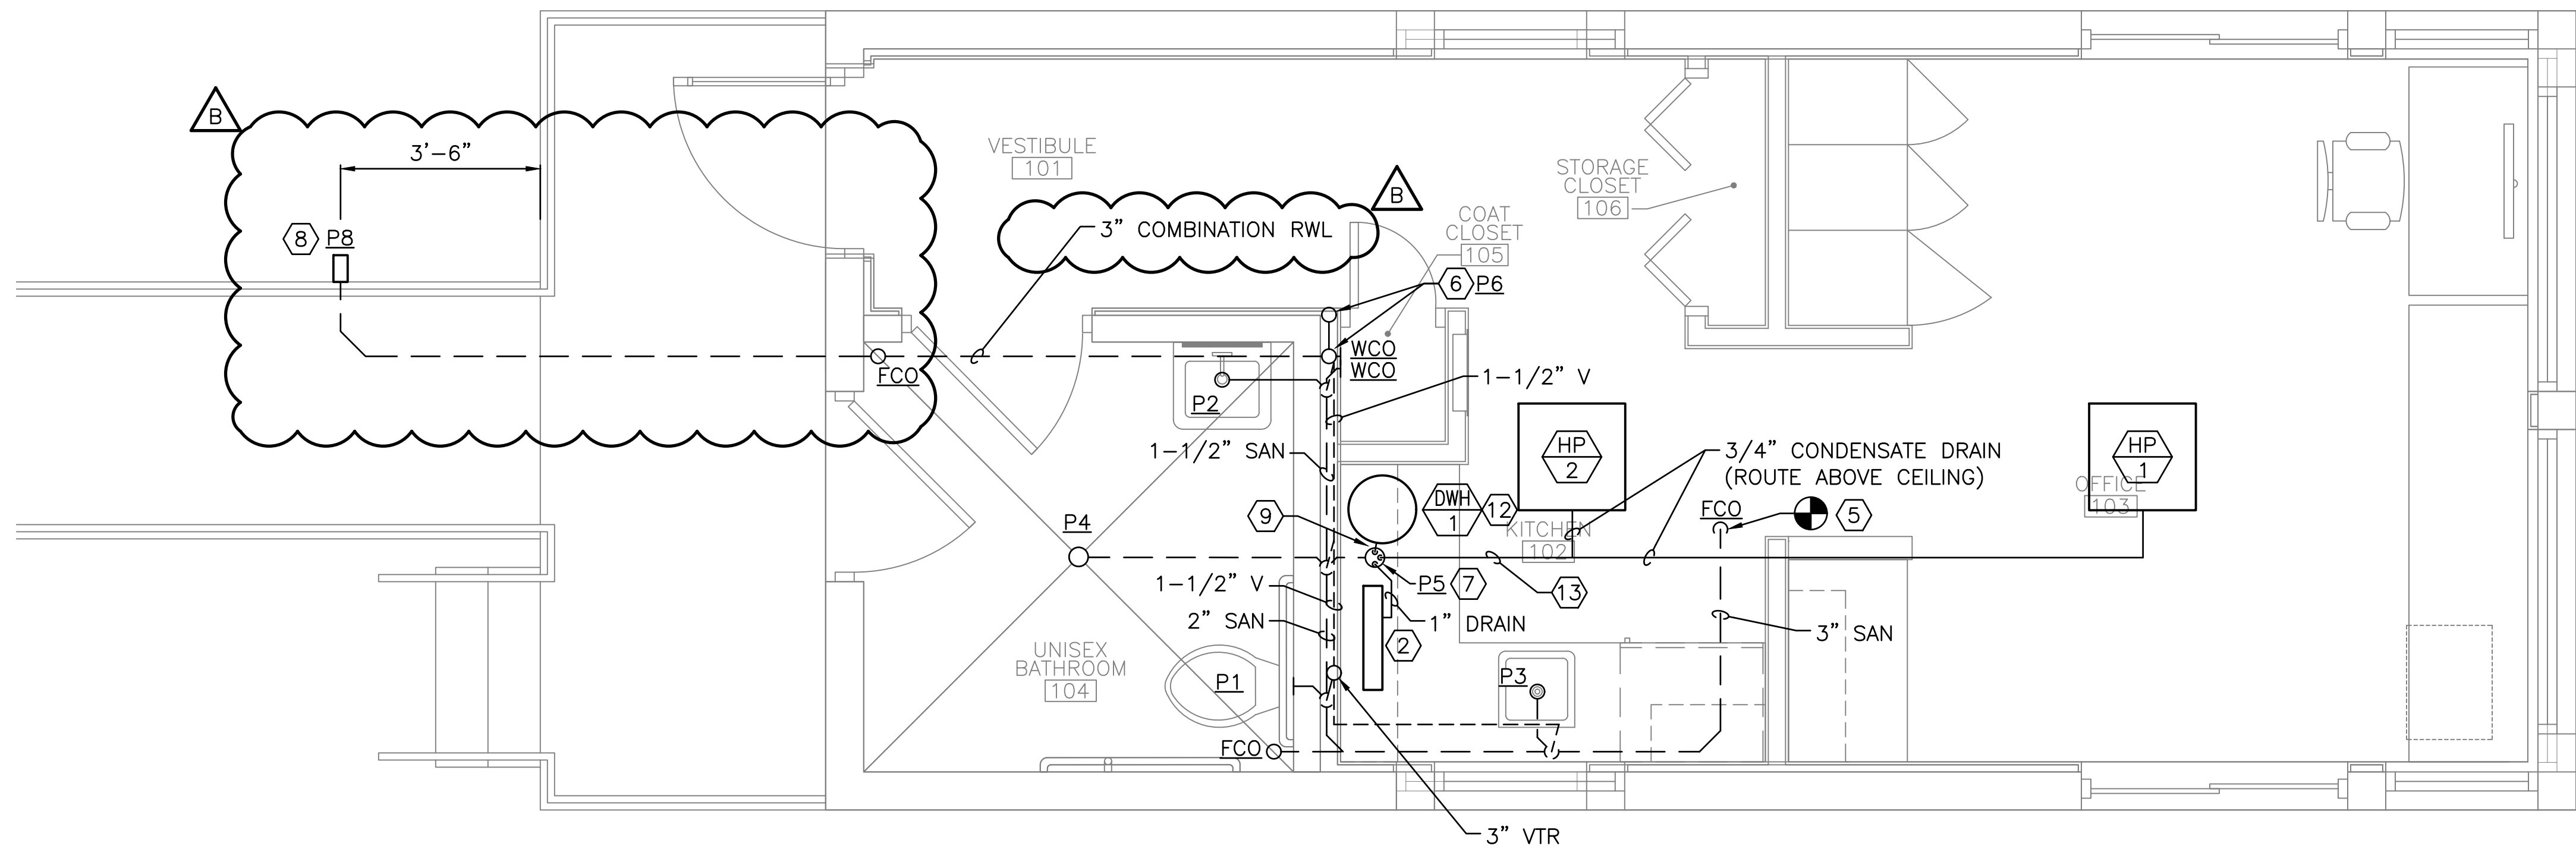

SANITARY & VENT FLOOR PLAN

SCALE: 1/2" = 1'-0"



NOTES:

- SEE SHEET P-001 FOR LEGEND, ABBREVIATIONS AND GENERAL NOTES.
- SEE PLUMBING FIXTURE SCHEDULE ON P-501 FOR PIPE SIZES.
- VENTS TO BE CONCEALED IN WALLS & BELOW COUNTER SPACE.

KEYED NOTES:

- NEW 1-1/4" PIPING CONNECTION TO EXISTING 1" DOMESTIC WATER SUPPLY.
- WATER ENTRANCE BELOW KITCHEN COUNTER IN CABINET SPACE. PROVIDE ADEQUATE SPACE FOR SERVICE, MAINTENANCE, AND TESTING. SEE DETAIL ON P-501.
- PROVIDE ADA COMPLIANT PROTECTION FOR EXPOSED PIPING AND PAINT TO MATCH WALL COLOR.
- PROVIDE TRAP PRIMER AND PIPING TO FLOOR DRAIN P4 AND P5. PIPING NOT SHOWN TO FLOOR DRAIN P5 FOR CLARITY.
- NEW 3" SANITARY DRAIN CONNECTION TO EXISTING 3" SANITARY DRAIN. NEW HORIZONTAL SANITARY PIPING SHALL BE ROUTED BELOW FLOOR JOISTS AND ABOVE SLAB. PROVIDE FLOOR CLEAN OUT.
- PROVIDE A 2-INCH VERTICAL PRIMARY ROOF DRAIN WITH NO HORIZONTAL OFFSETS ABOVE GRADE. PROVIDE A 2-INCH SECONDARY ROOF VERTICAL DRAIN. PROVIDE 1-1/2" INSULATION AROUND ROOF DRAIN AND DRAIN PIPING IN CEILING PLENUM. SEE ROOF DRAIN DETAIL FOR PIPE SIZES AND CONNECTION.
- PROVIDE INDIRECT DRAINS FROM HP-1, HP-2, WATER ENTRANCE CONFIGURATION, DWH PRESSURE/TEMPERATURE RELIEF VALVE, AND DWH DRAIN PAN. FLOOR DRAIN TO BE A FUNNEL TYPE.
- COMBINATION STORM DRAIN SHALL DISCHARGE 6-INCHES ABOVE SLAB. ALL PIPING ENCASED IN CONCRETE SHALL BE SCH 40 CAST IRON WITH A CORROSION RESISTANT COATING. PROVIDE A 3" CLEANOUT IN THE BATHROOM FLOOR. COORDINATE PIPING WITH STRUCTURAL.
- PROVIDE 3/4" DRAIN PIPE SERVING THE DWH DRAIN PAN AND 3/4" DRAIN PIPE FOR PRESSURE/TEMPERATURE RELIEF VALVE.
- PROVIDE A 3/4" THERMOSTATIC MIXING VALVE FOR DWH.
- PROVIDE 2-INCHES OF INSULATION FOR PIPING BELOW THE FLOOR JOISTS.
- INSTALL DWH DRAIN PAN ABOVE TOP OF FLOOR DRAIN FUNNEL RIM TO ALLOW FOR PROPER DRAINAGE.
- ROUTE 1" CONDENSATE DRAIN TO DROP INTO PLUMBING WALL AND ROUTE TO DRAIN INTO P5. ROUTING INTO PLUMBING WALL NOT SHOWN FOR CLARITY.

ISSUED FOR BID
NOT FOR CONSTRUCTION
JANUARY 5, 2017

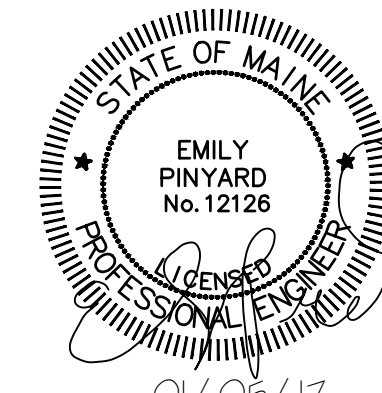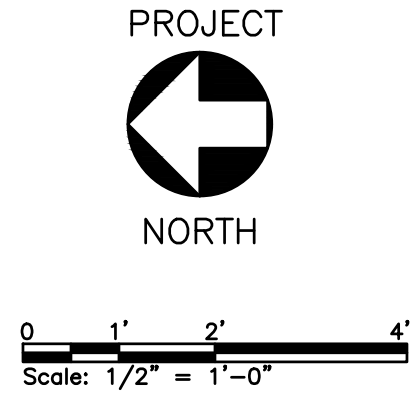

REV	DESCRIPTION	DWN	APP	DATE
C	RE-ISSUED FOR BID	MBD	ERP	01/05/17
B	RE-ISSUED FOR BID	MBD	ERP	10/28/16
A	ISSUED FOR BID	MBD	ERP	9/02/16

ecomaine 64 BLUEBERRY ROAD, PORTLAND, ME	
SCALE HOUSE WITH INSULATED BLOCK CONSTRUCTION	
PLUMBING FLOOR PLANS	

PLEASE NOTE: THIS DOCUMENT MAY NOT ACCURATELY REPRESENT THE FINAL DOCUMENT. ONLY AN ENGINEER, ARCHITECT OR SURVEYOR SIGNED, SEALED AND DATED PAPER COPY, PROVIDED BY THIS OFFICE, MAY BE UTILIZED FOR BIDDING OR CONSTRUCTION PURPOSES.	SIZE: ANSI D DATE: 09/02/2016 DES BY: MIF DWN BY: MBD CKD BY: ERP	PROJECT NO. 162.002.002 SHEET 34 OF 40	DRAWING NO. P-101
	47A York Street Portland, Maine 04101 207.553.7753 colbycoengineering.com		
	01/05/17		

X:\162 Ecomaine\162.002.002 - Scale House with CMU Drawings\Sheets\101.dwg - 1/5/2017 2:32 PM - ZACH JONES