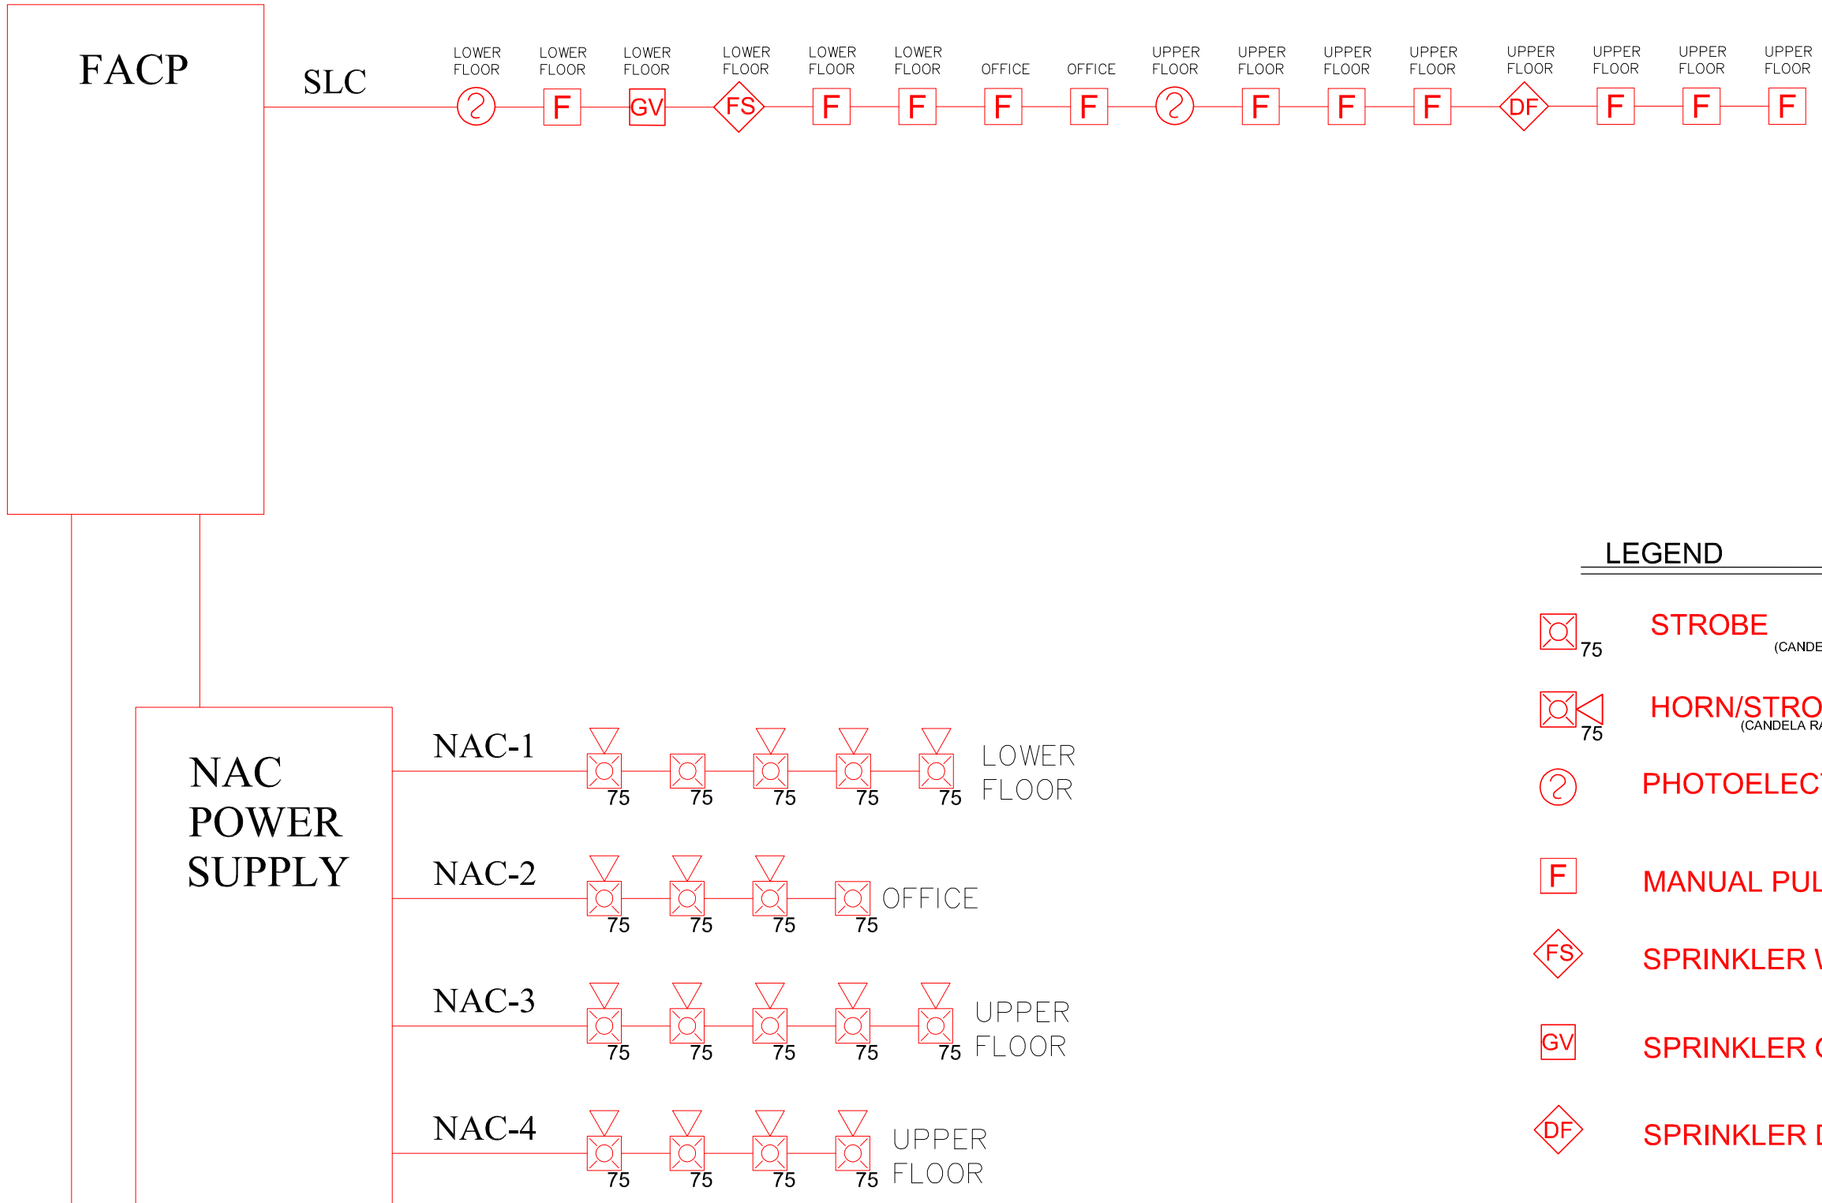

LEGEND

- 75 — STROBE (CANDELA RATING)
- 75 — HORN/STROBE (CANDELA RATING)
- PHOTOELECTRIC SMOKE DETECTOR
- F — MANUAL PULL STATION
- FS — SPRINKLER WATERFLOW
- GV — SPRINKLER GATE VALVE TAMPER
- DF — SPRINKLER DELUGE FLOW

John Kimball NICET Certified Senior Engineering Technician
Certification # 107869

SURV
Surveillance Specialties, LLC

Corporate Headquarters
Portland, ME Office
Telephone 207.774.5007
Toll Free 800.439.7787
Fax 207.774.5008
Web www.surv.com

Portland, ME Office
Telephone 207.400.0400
Toll Free 800.439.7787
Fax 207.200.0404
Web www.surv.com

NO	DESCRIPTION	BY	DATE
1	ISSUED FOR PERMIT	JMK	06-18-13

PROJECT TITLE
ECO MAINE
4 BLUEBERRY ROAD
PORTLAND MAINE

SCALE N.T.S.
DRAWN SURV-JK
DATE 06-18-13
© SECURADYNE SYSTEMS

SHEET TITLE
ALARM SYSTEM
RISER PLAN

SHEET NUMBER
RISER