

JOINT SPACING:
 4" SLABS: MAX SPACING 8" (SPACE EQUALLY BETWEEN COL BAYS)
 6" SLABS: MAX SPACING 10" (SPACE EQUALLY BETWEEN COL BAYS)

NOTES:
 1. PROVIDE CONTROL OR CONSTRUCTION JOINTS AROUND ALL SLAB DEPRESSIONS AND PITS AT THE EXTENT OF THE PERIMETER REINFORCING.
 2. SEAL ALL JOINTS AND SLAB PENETRATIONS. SEE ARCH'L FOR DETAILS.
 3. SEE SPEC. 03300, SECTION 3.05: JOINTS, FOR FURTHER INFORMATION.
 4. NO CONTROL JOINTS SHALL BE CUT IN THE GYMNASIUM SLAB

THICKENED SLAB DETAIL AT STAIR POSTS

C4

UNDERDRAIN DETAIL

C3

REENTRANT SLAB JOINT DETAIL

C2

TYPICAL SLAB JOINT LAYOUT

C1

3/4" = 1'-0" 0 1/2' 1' 2'





REF: S10.1

3/4" = 1'-0" 0 1/2' 1' 2'

REF: NA

NO SCALE REF: S10.1

NO SCALE REF: S10.1

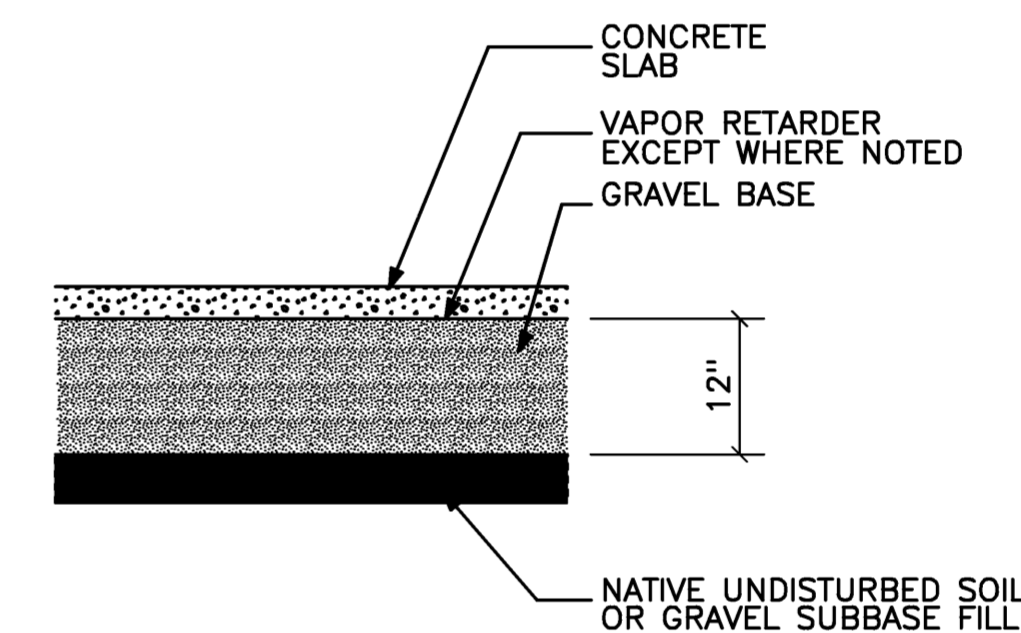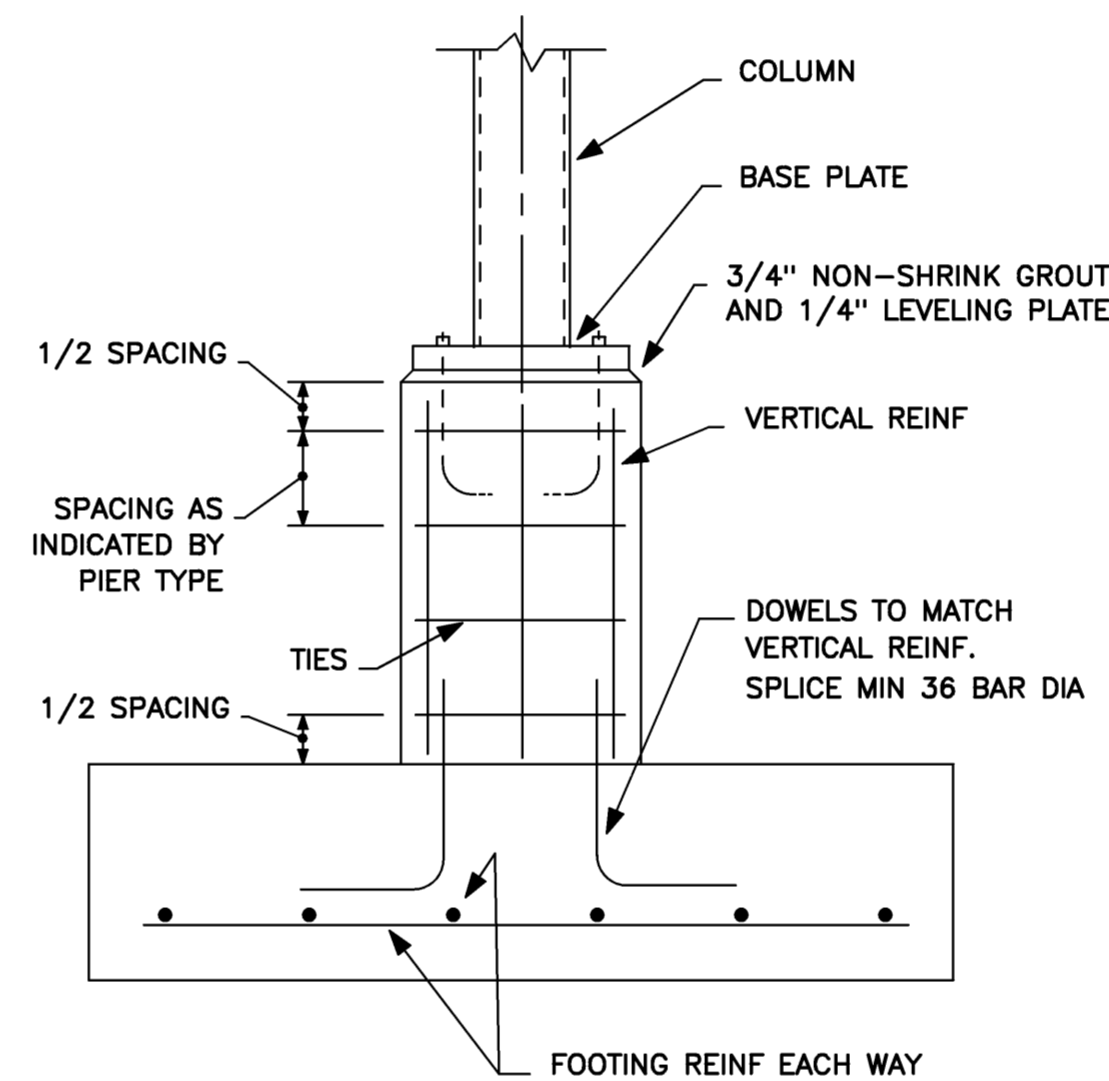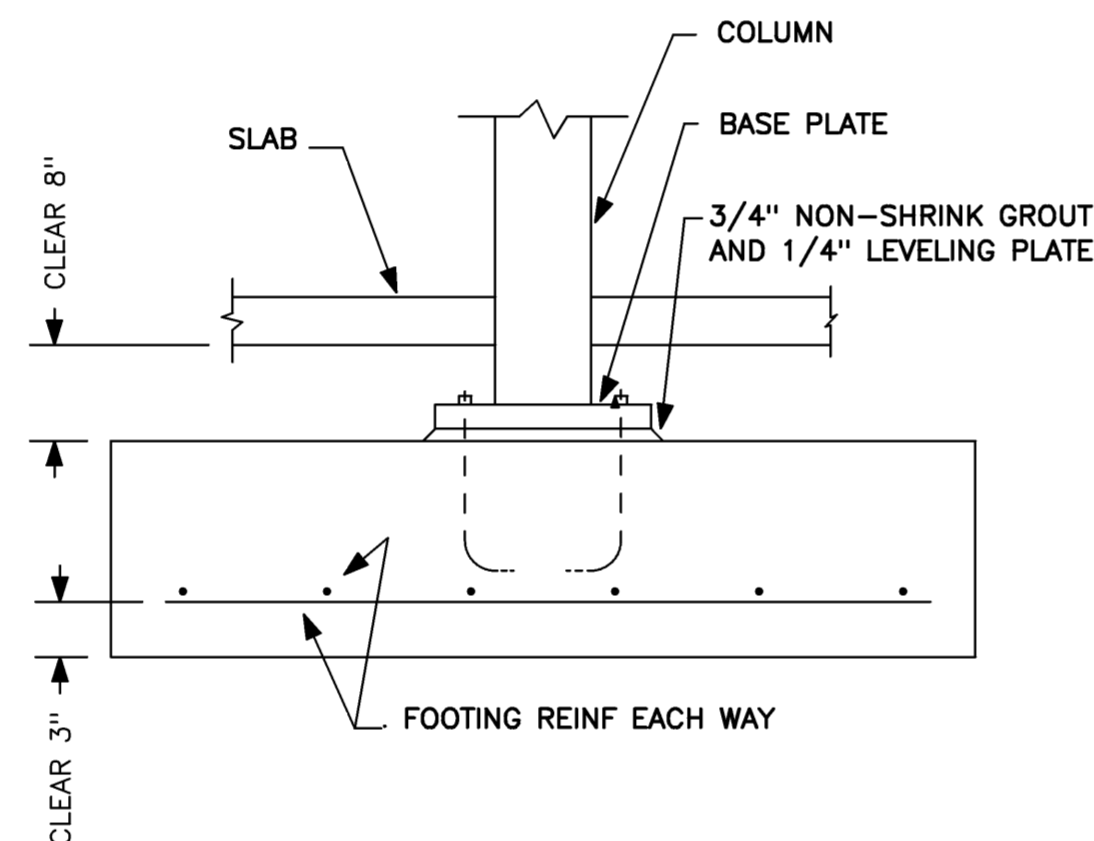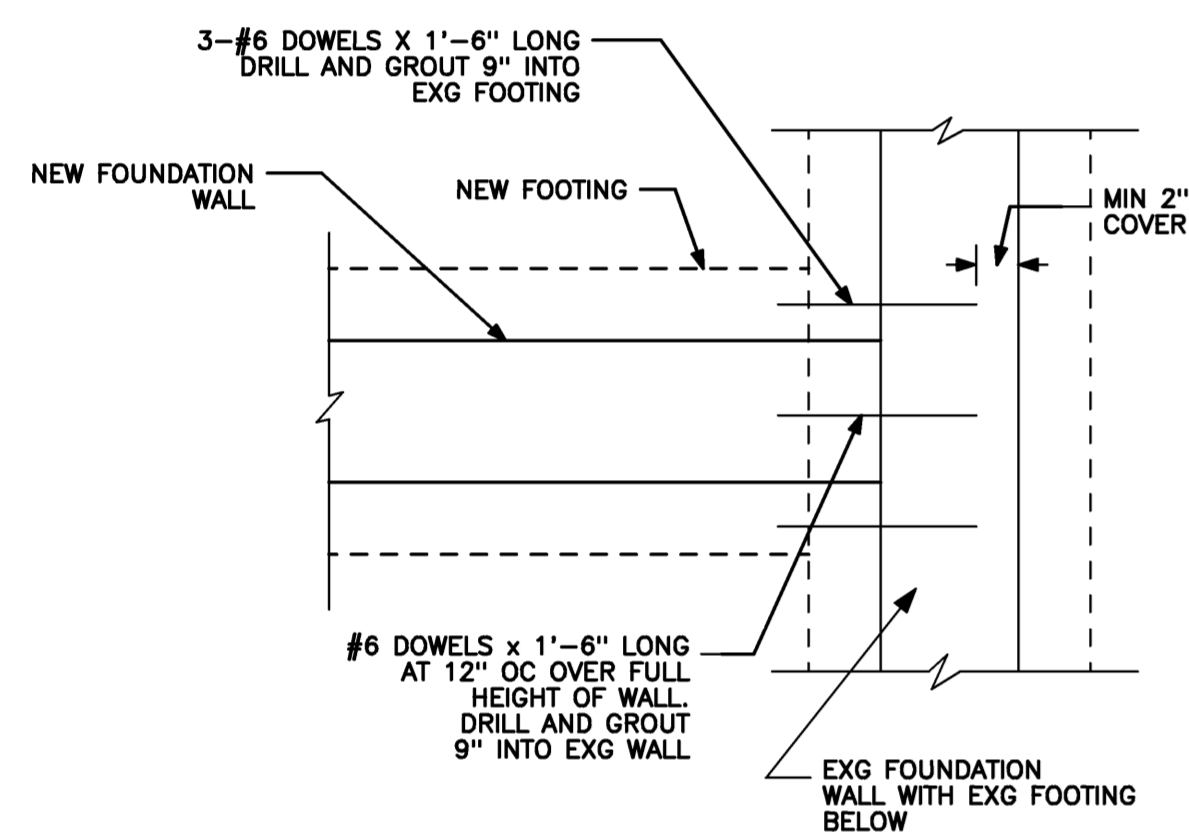

TYP. ATTACHMENT OF NEW FOUNDATION TO EXG

B4

TYPICAL INTERIOR COLUMN FOOTING DETAIL

B3

TYPICAL PIER AND FOOTING DETAIL

B2

TYPICAL SLAB/GRAVEL BASE DETAIL

B1


NO SCALE REF: NA

NO SCALE REF: S10.1

NO SCALE REF: S10.1

NO SCALE REF: S10.1

AT CONTROL JOINT CUT EVERY OTHER HORIZONTAL BAR EA SIDE OF WALL A MIN OF 3" EA SIDE OF JOINT. DO NOT CUT TOP AND BOT BARS

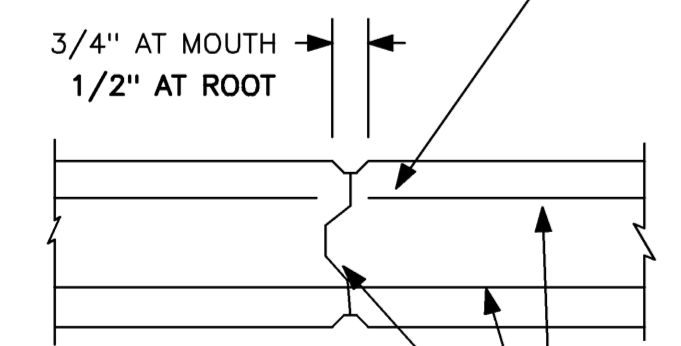


ALL HORIZONTAL REINF BARS TO RUN THRU CONSTRUCTION JOINT

PROVIDE CONTROL JOINTS @ 150'-0" O.C., MAX. AND 12'-0" MIN. FROM COLUMN.

TYPICAL WALL CONTROL/CONSTRUCTION JOINT DETAIL


A4

DOWELS TO BE SAME SIZE AND SPACING AS WALL REINFORCING

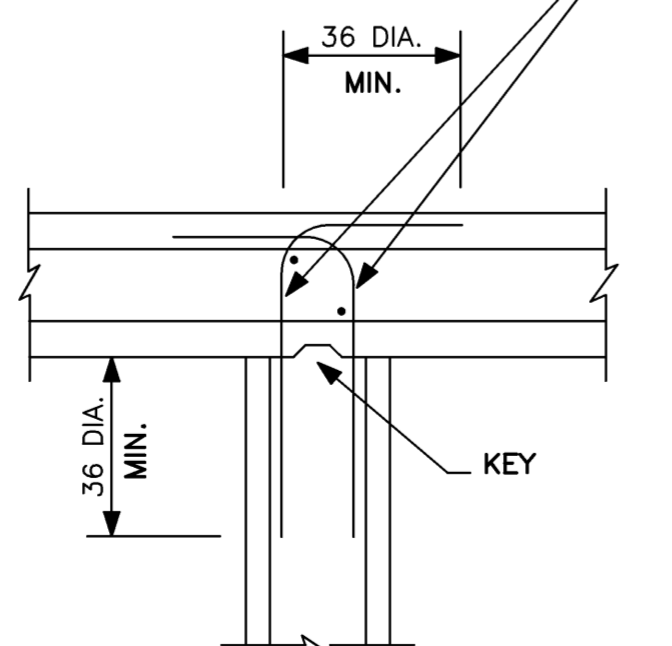


TYPICAL WALL INTERSECTION REINFORCING DETAIL

A3

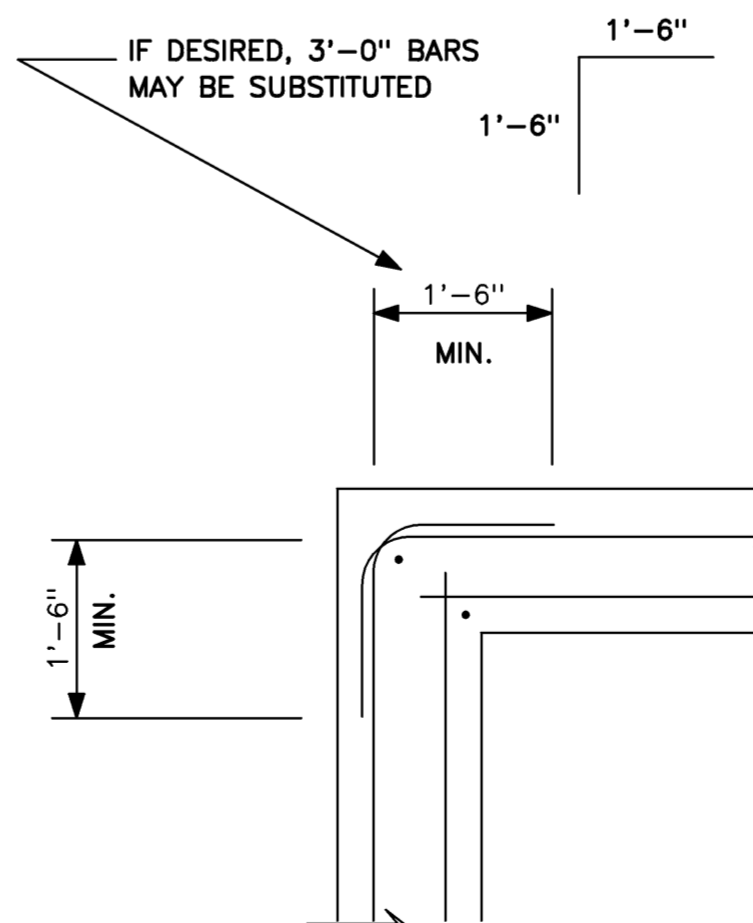


TYPICAL CORNER REINFORCING DETAIL

A2

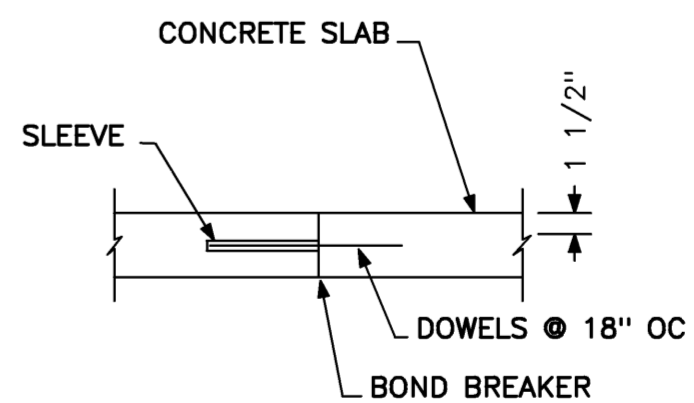

CONSTRUCTION JOINT

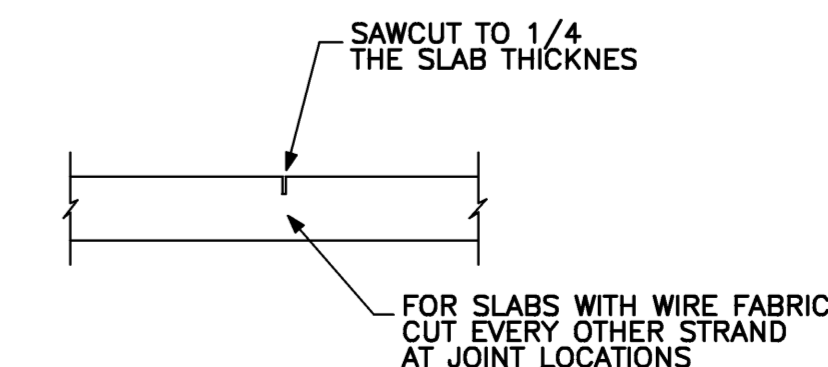

CONTROL JOINT

TYPICAL SLAB-ON-GRADE JOINT DETAILS

A1

NO SCALE REF: S10.1

NO SCALE REF: NA

NO SCALE REF: NA

NO SCALE REF: NA

Mark	Date	Description
-	05-15-06	ISSUED FOR CONSTRUCTION
-	03-14-06	FINAL REVIEW
-	02-03-06	DD REVIEW

Issue Dates

Drawing Title
FOUNDATION DETAILS
PA / PE: JCF Drawn By: SJF
Drawing Number