
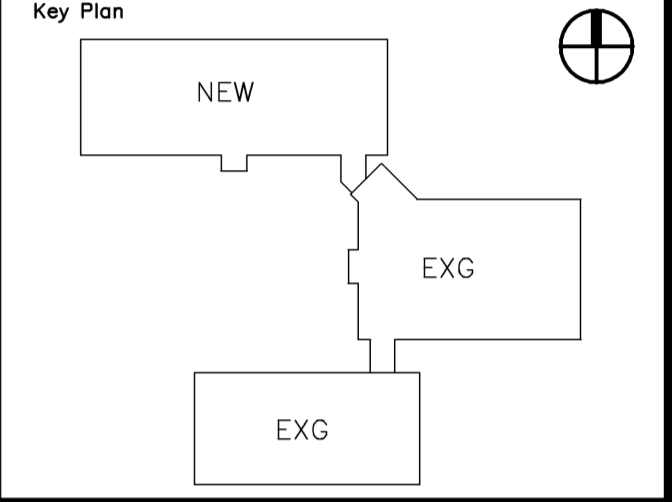


LOW VOLTAGE LIGHTING CONTROL SCHEDULE

LTG CNTRL PNL DESIGNATION	CIRCUIT #	RELAY #	LOW VOLTAGE SWITCH CONTROL	PHOTOCELL (PC) CONTROL	TIME OF DAY (TOD) CONTROL	REMARKS/RECOMMENDATIONS
ELC	EL1-1	ELC-1	SV1 (ON ONLY)		YES OFF 12AM ON 6AM	EMERG LTG -- COMMON SPACES
	EL1-2	ELC-2		YES	OFF DAWN ON DUSK	EMERG LTG -- EXTERIOR
	EL1-3	ELC-3	Sv2		OFF 12AM ON 6AM	EMERG LTG -- FIRST FLOOR
	EL1-4	ELC-4	Sv8		OFF 12AM ON 6AM	EMERG LTG -- THIRD FLOOR
	EL1-5	ELC-5	Sv3		OFF 12AM ON 6AM	EMERG LTG -- SECOND FLOOR
	MDP-25	ELC-6		YES	OFF DAWN ON DUSK	SITE LIGHTING
	MDP-29	ELC-7		YES	OFF DAWN ON DUSK	SITE LIGHTING
	EL1-9	ELC-8	SV1 (ON ONLY)		YES	EMERG LTG -- STAIRS
	SPARE	SPARE		SPARE	SPARE	SPARE
	SPARE	SPARE		SPARE	SPARE	SPARE
	SPARE	SPARE		SPARE	SPARE	SPARE
	SPARE	SPARE		SPARE	SPARE	SPARE
	SPARE	SPARE		SPARE	SPARE	SPARE
	SPARE	SPARE		SPARE	SPARE	SPARE
LC1		SPARE				
		SPARE				
		SPARE				
		SPARE				
		SPARE				
		SPARE				
LC2	P2-2	LC2-1	Sv4			LTG -- OPEN OFFICES (SOUTH)
	P2-2	LC2-2	Sv5			LTG -- OPEN OFFICES (SOUTH)
	P2-4	LC2-3	Sv6			LTG -- OPEN OFFICES (NORTH)
	P2-4	LC2-4	Sv7			LTG -- OPEN OFFICES (NORTH)
		SPARE				
		SPARE				
LC3	P3-2	LC3-1	Sv9			LTG -- OPEN OFFICES (SOUTH)
	P3-2	LC3-2	Sv10			LTG -- OPEN OFFICES (SOUTH)
	P3-4	LC3-3	Sv11			LTG -- OPEN OFFICES (NORTH)
	P3-4	LC3-4	Sv12			LTG -- OPEN OFFICES (NORTH)
		SPARE				
		SPARE				

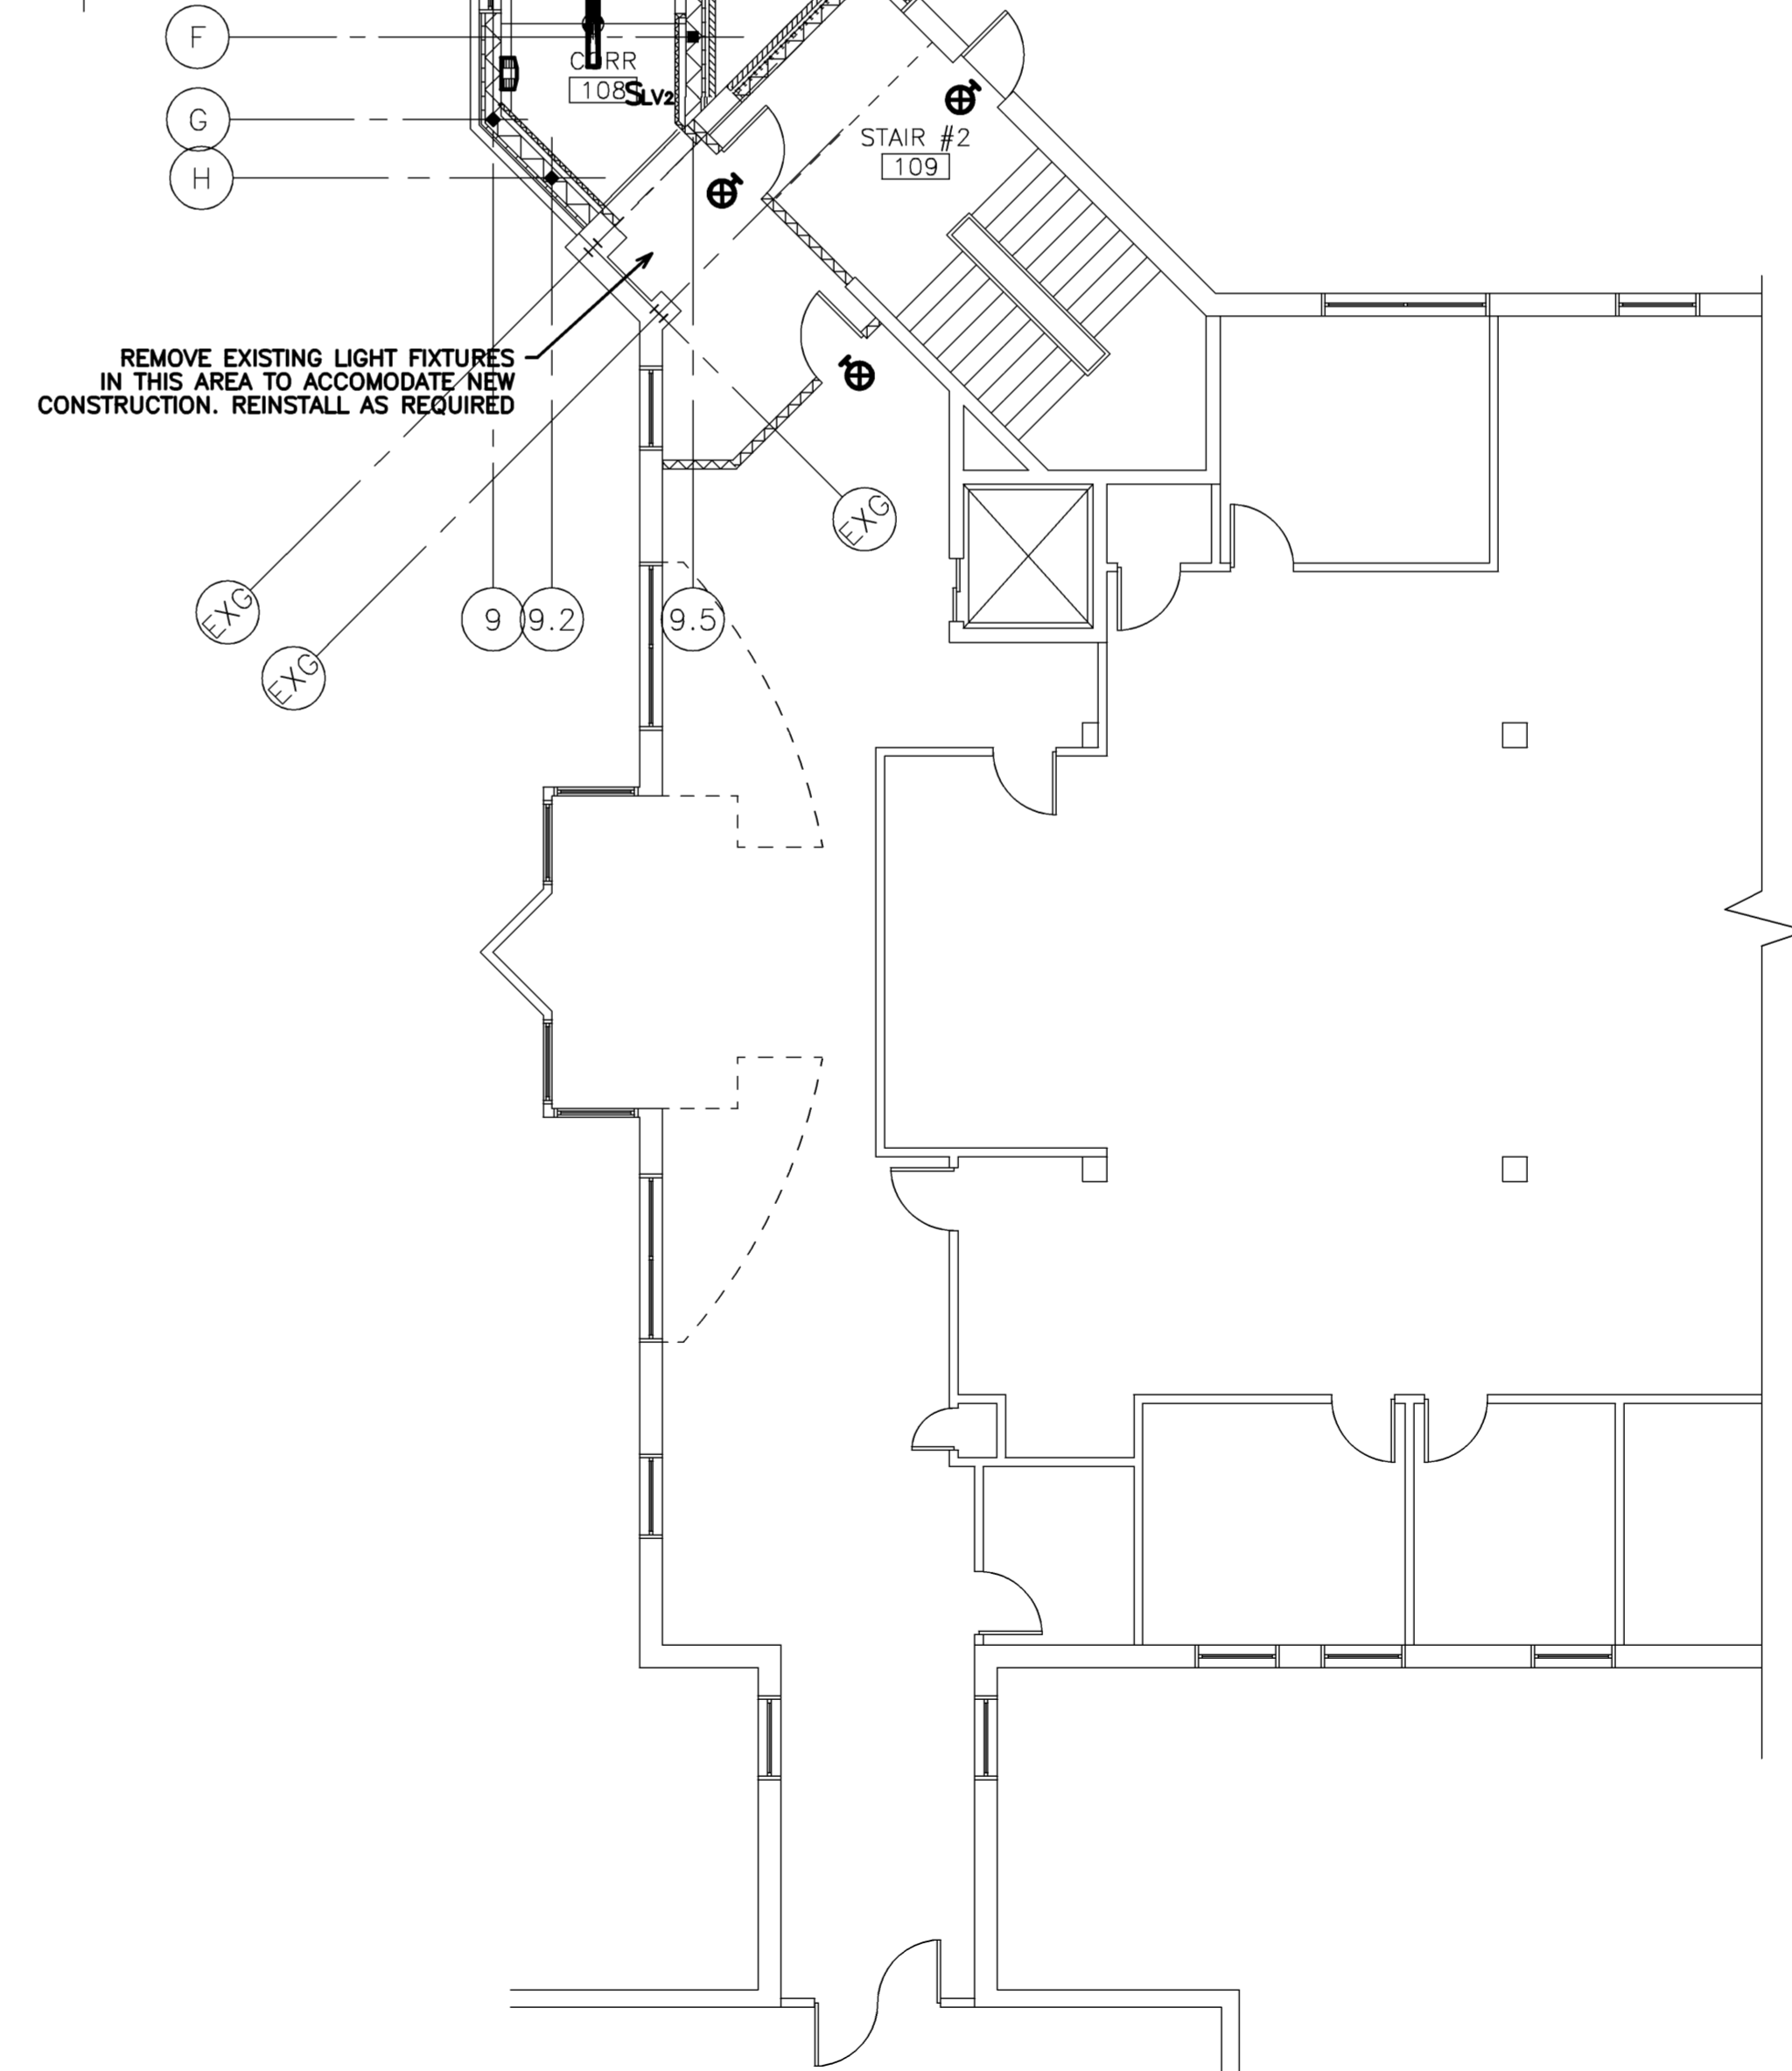

Mark	Date	Description
-	05-15-06	ISSUED FOR CONSTRUCTION
-	03-14-06	FINAL REVIEW
-	02-03-06	DD REVIEW

Issue Dates

Drawing Status

--