




- NOTE:**
- SEE SHEET E-001 FOR LEGEND AND GENERAL NOTES.
 - ALL EXISTING LIGHTS SHOWN SHALL REMAIN. EXISTING LIGHTS TO BE CLEANED, RELAMPED AND REPAIRED IF NEEDED PRIOR TO OWNER OCCUPANCY OF THE SPACE.
 - ALL EMERGENCY LIGHTING BATTERY CABINETS FEEDING REMOTE HEADS SHALL BE TESTED TO VERIFY THEY COMPLY WITH LIFE SAFETY CODE REQUIREMENTS FOR EGRESS LIGHTING. REPLACE ANY BATTERIES THAT DO NOT COMPLY WITH TESTING REQUIREMENTS OF NFPA 101.

- KEYED NOTE:**
- RELOCATE EXISTING LIGHTS AND CONNECT TO SAME BRANCH CIRCUIT AND CONTROLS AS EXISTING LIGHTS WITHIN SPACE.
 - CONNECTED NEW EMERGENCY LIGHTING UNITS TO SAME CIRCUITS AS ROOM LIGHTS ON THE LINE SIDE OF LIGHTING CONTROLS.
 - RELOCATE SWITCH FROM CURRENT LOCATION SHOWN ON ED101 TO CONTROL REMAINING FIXTURE. MODIFY EXISTING WIRING AS REQUIRED TO ACCOMMODATE NEW SWITCH LOCATION.
 - IN EXISTING PANELBOARD LP2 FURNISH & INSTALL A NEW 20 AMP. SINGLE POLE CIRCUIT BREAKER TO FEED NEW LIGHTS.
 - RELOCATE EMERGENCY LIGHTING UNIT AND EMERGENCY LIGHTING BATTERY CABINET FROM CURRENT LOCATION SHOWN ON ED101 TO NEW LOCATION SHOWN. EXTEND EXISTING WIRING AS REQUIRED TO ACCOMMODATE NEW EQUIPMENT LOCATION.
 - IN EXISTING PANELBOARD LP1 UTILIZE THREE EXISTING SPARE 20 AMP. SINGLE POLE CIRCUIT BREAKERS TO FEED NEW LIGHTS IN LOBBY AND LUOM ROOM.
 - INSTALL TWO RELOCATED 2x2 PARABOLIC FIXTURES IN EXTENSION OF EXISTING CORRIDOR AND WIRE FIXTURES TO SAME CIRCUIT AS EXISTING CORRIDOR FIXTURES.
 - WIRE NEW EXIT SIGN TO SAME UNSWITCHED BRANCH CIRCUIT AS OTHER EXIT SIGNS IN CORRIDOR AND LOADING DOCK AREA. FIELD VERIFY CIRCUIT INDICATED IS ACCURATE.
 - RE-INSTALL EXISTING LIGHTS IN NEW CEILING GRID AND RE-CONNECT EXISTING BRANCH CIRCUITS.

1	ADDENDUM 1	1-9-18
0	ISSUED FOR CONSTRUCTION	12-21-17
REV	DESCRIPTION	DATE
ISSUED FOR CONSTRUCTION		
12-21-17		
CURRENT ISSUE STATUS:		

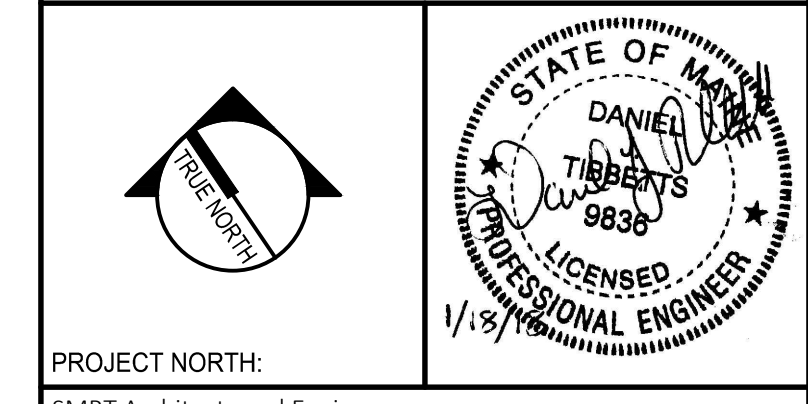

PROJECT NORTH:
 SMRT Architects and Engineers
 144 Fore Street
 Portland, Maine 04104
 1.877.700.7678
 www.smrtinc.com

**MAINE MEDICAL CENTER
 M.M.C. HUTCHINS DRIVE
 RENOVATION**
 102 HUTCHINS DRIVE PORTLAND, ME

**FIRST FLOOR
 LIGHTING PLAN**

SHEET TITLE:
 0 1/4" 1/2" 1" 2" 3"
 SCALE: AS NOTED

PROJECT MANAGER: RSC	PROJECT NO: 17123
AVE OF RECORD: DJT	
JOB CAPTAIN: SDL	
DRAWN BY: CDS	
SMRT FILE: EL101-17123	SHEET NO.

FIRST FLOOR PLAN (A1)
 1/8" = 1'-0"

EL101