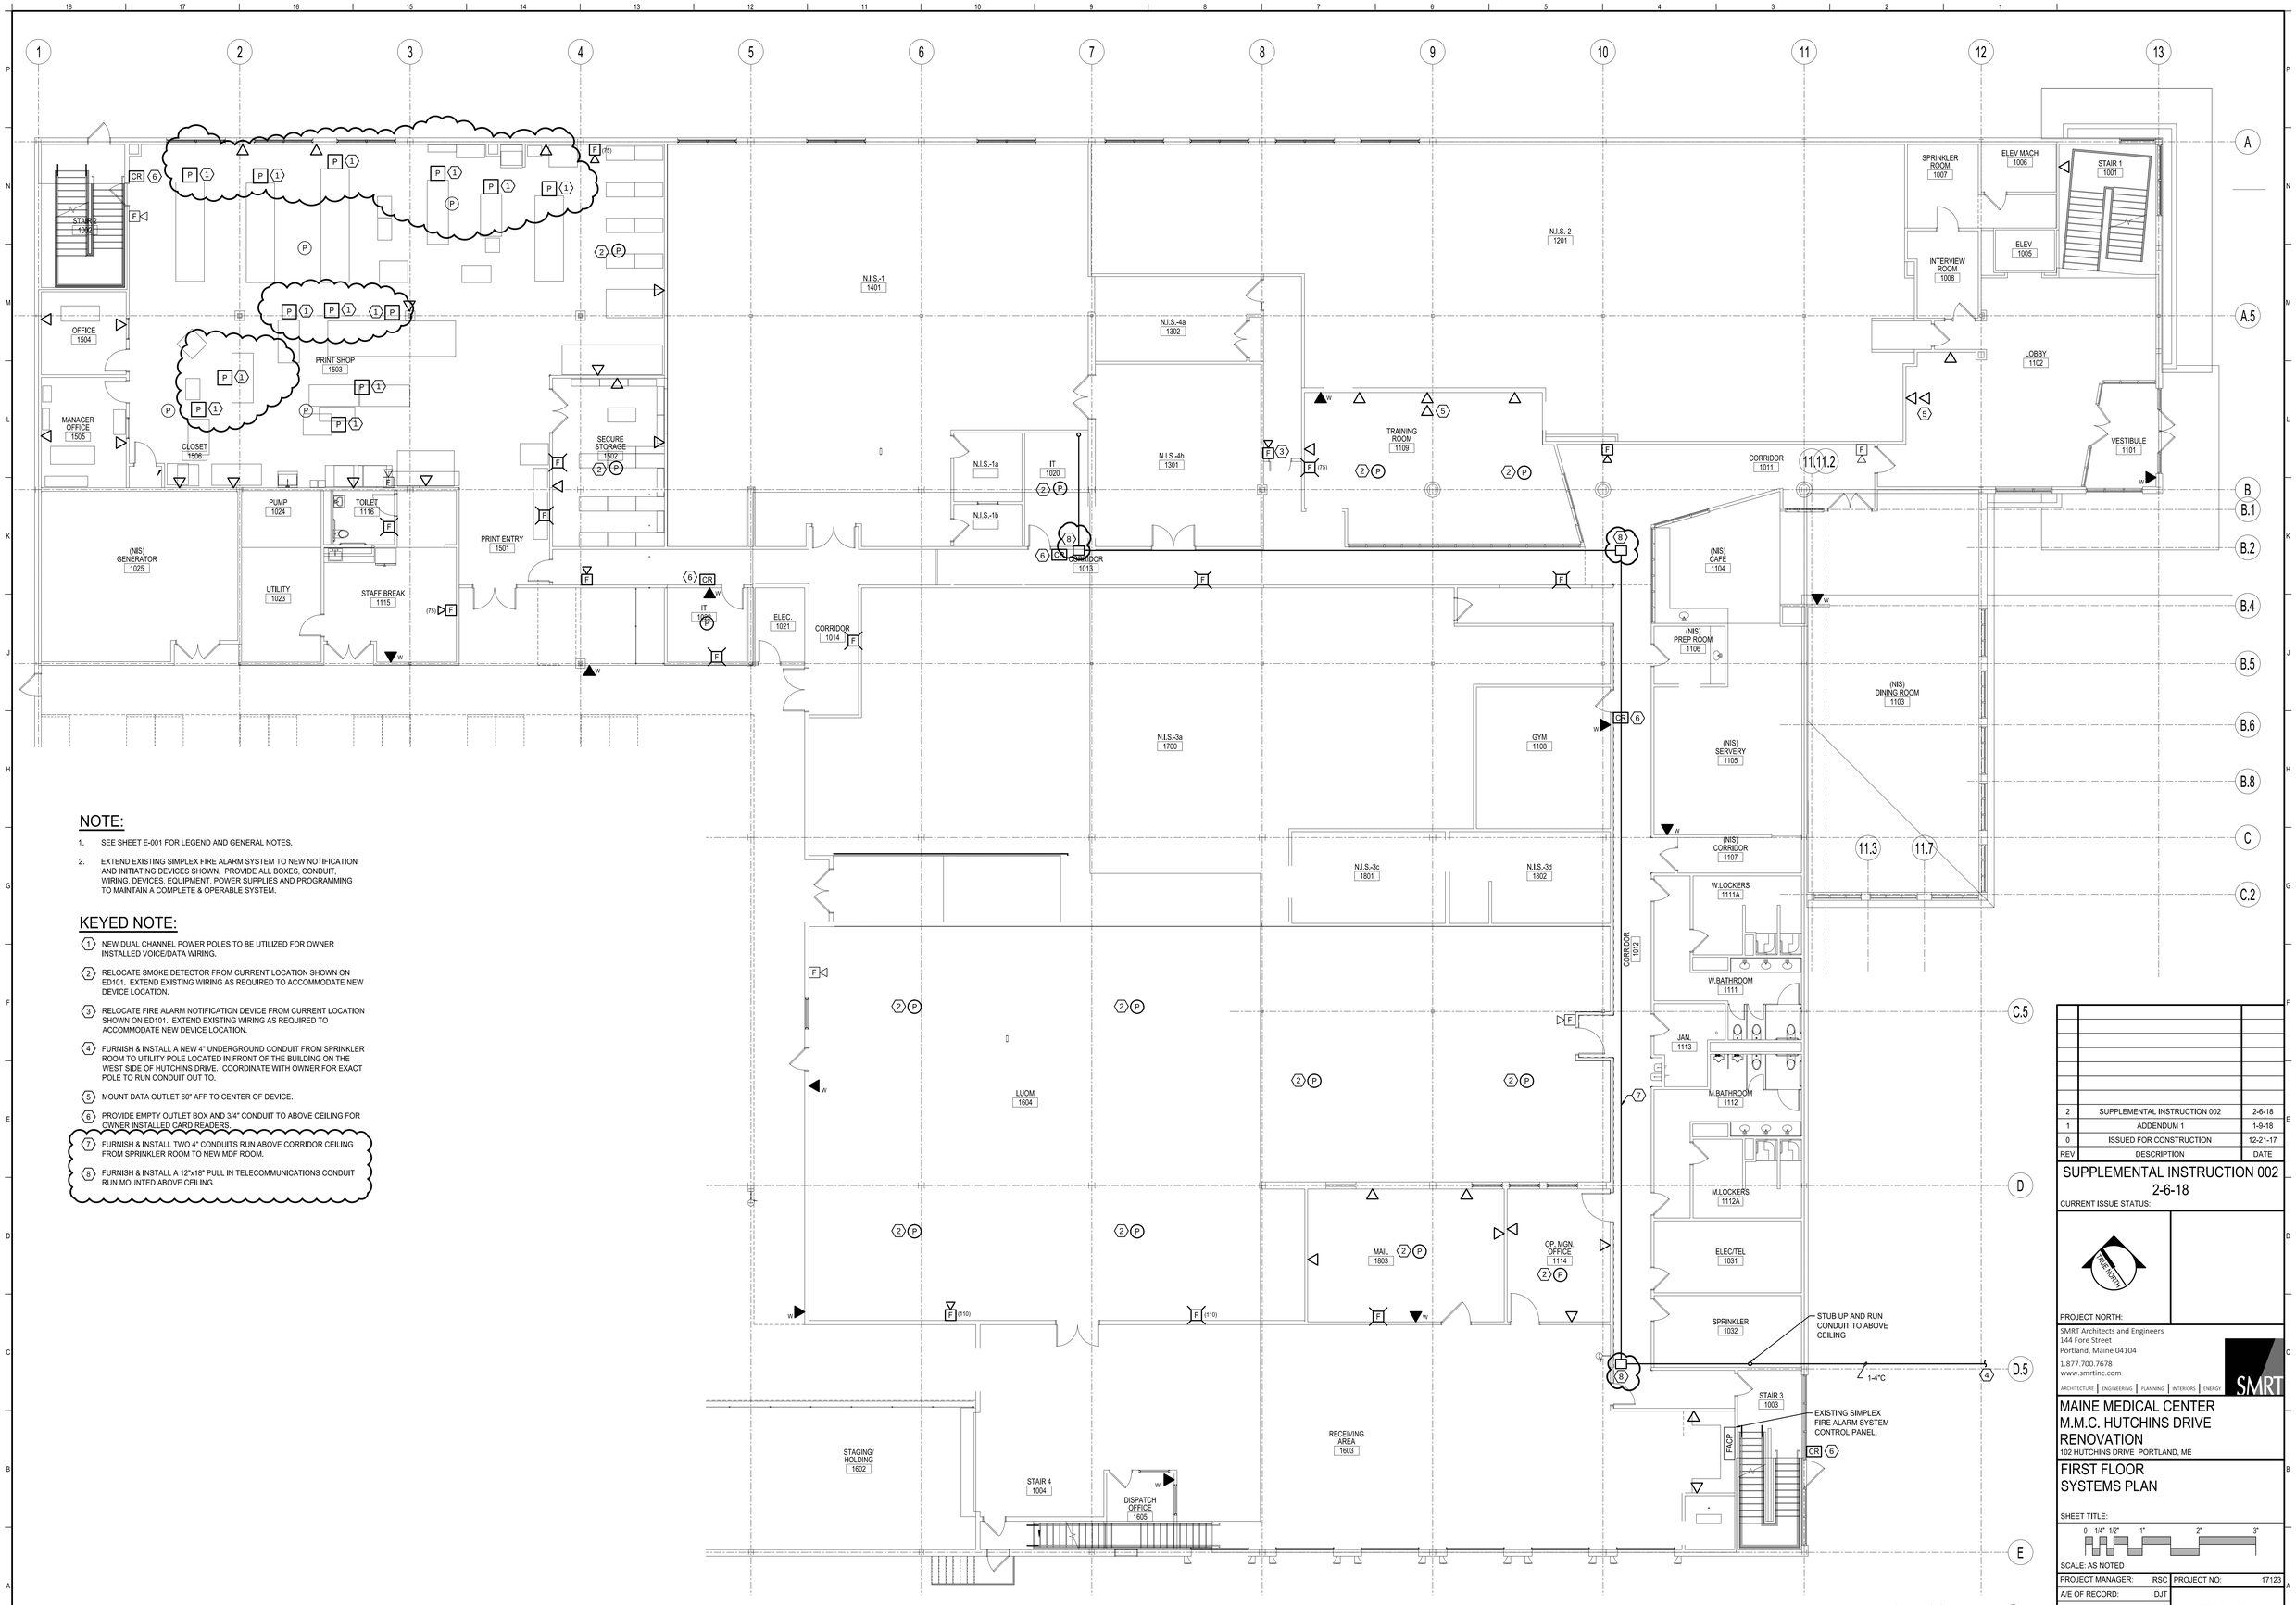

FIRST FLOOR PLAN
1/8" = 1'-0" (A1)

NOTE:

1. SEE SHEET E-001 FOR LEGEND AND GENERAL NOTES.
2. EXTEND EXISTING SIMPLEX FIRE ALARM SYSTEM TO NEW NOTIFICATION AND INITIATING DEVICES SHOWN. PROVIDE ALL BOXES, CONDUIT, WIRING, DEVICES, EQUIPMENT, POWER SUPPLIES AND PROGRAMMING TO MAINTAIN A COMPLETE & OPERABLE SYSTEM.

KEYED NOTE:

1. NEW DUAL CHANNEL POWER POLES TO BE UTILIZED FOR OWNER INSTALLED VOICE/DATA WIRING.
2. RELOCATE SMOKE DETECTOR FROM CURRENT LOCATION SHOWN ON ED101. EXTEND EXISTING WIRING AS REQUIRED TO ACCOMMODATE NEW DEVICE LOCATION.
3. RELOCATE FIRE ALARM NOTIFICATION DEVICE FROM CURRENT LOCATION SHOWN ON ED101. EXTEND EXISTING WIRING AS REQUIRED TO ACCOMMODATE NEW DEVICE LOCATION.
4. FURNISH & INSTALL A NEW 4" UNDERGROUND CONDUIT FROM SPRINKLER ROOM TO UTILITY POLE LOCATED IN FRONT OF THE BUILDING ON THE WEST SIDE OF HUTCHINS DRIVE. COORDINATE WITH OWNER FOR EXACT POLE TO RUN CONDUIT OUT TO.
5. MOUNT DATA OUTLET 60" AFF TO CENTER OF DEVICE.
6. PROVIDE EMPTY OUTLET BOX AND 3/4" CONDUIT TO ABOVE CEILING FOR OWNER INSTALLED CARD READERS.
7. FURNISH & INSTALL TWO 4" CONDUITS RUN ABOVE CORRIDOR CEILING FROM SPRINKLER ROOM TO NEW MDF ROOM.
8. FURNISH & INSTALL A 12"x18" PULL IN TELECOMMUNICATIONS CONDUIT RUN MOUNTED ABOVE CEILING.

REV	DESCRIPTION	DATE
2	SUPPLEMENTAL INSTRUCTION 002	2-6-18
1	ADDENDUM 1	1-9-18
0	ISSUED FOR CONSTRUCTION	12-21-17

SUPPLEMENTAL INSTRUCTION 002
2-6-18
CURRENT ISSUE STATUS:

PROJECT NORTH:

SMRT Architects and Engineers
144 Fore Street
Portland, Maine 04104
1.877.700.7678
www.smrtinc.com
ARCHITECTURE | ENGINEERING | PLANNING | INTERIORS | ENERGY

MAINE MEDICAL CENTER
M.M.C. HUTCHINS DRIVE RENOVATION
102 HUTCHINS DRIVE PORTLAND, ME

FIRST FLOOR SYSTEMS PLAN

SHEET TITLE:

0 1/4" 1/2" 1" 2" 3"
SCALE: AS NOTED

PROJECT MANAGER:	RSC	PROJECT NO:	17123
A/E OF RECORD:	DJT		
JOB CAPTAIN:	SDL		
DRAWN BY:	CDS		
SMRT FILE:	EY101-17123	SHEET No.	EY101

©COPYRIGHT 2018 SMRT INC