

Job 684672	Truss 002	Truss Type QUEENPOST	Qty 17	Ply 1	PROVENCHER/PORTLAND, ME
---------------	--------------	-------------------------	-----------	----------	-------------------------

Boise Cascade, Biddeford, ME 04005, Jordan Berard
 7,640 s Feb 22 2016 MiTek Industries, Inc. Mon Mar 06 15:34:40 2017 Page 1
 ID:r0ypdFQ8Ssvij7Lc?bCYXDzjHGt-q0sO5O_J4oXpDlo7zMly_T2iXFBMX47FujJI01zdccT

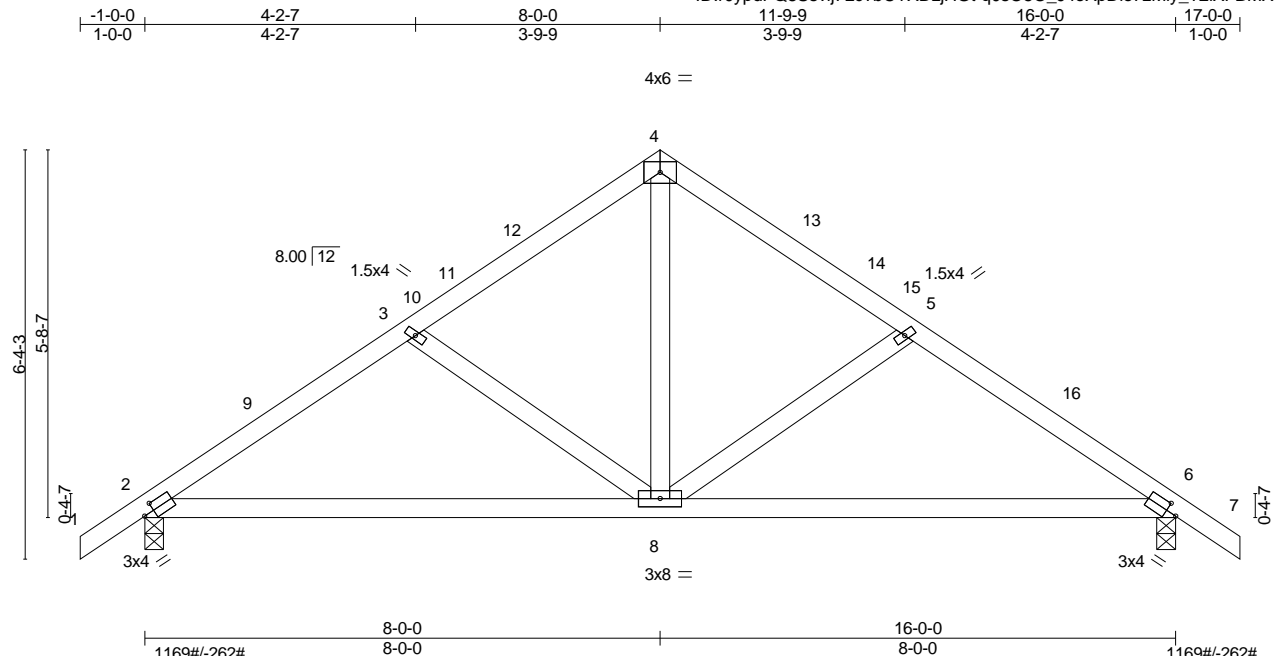


Plate Offsets (X,Y)-- [2:0-2-0,0-1-8], [6:0-2-0,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 46.2 (Ground Snow=60.0)	2-0-0 Plate Grip DOL 1.15 Lumber DOL 1.15	TC 0.28 BC 0.39 WB 0.23 (Matrix)	in (loc) l/def L/d Vert(LL) -0.07 6-8 >999 240 Vert(TL) -0.18 6-8 >999 180 Horz(TL) 0.03 6 n/a n/a	MT20	169/123
TCDL 10.0	Rep Stress Incr YES				
BCLL 0.0 *	Code IBC2009/TPI2007			Weight: 57 lb	FT = 0%
BCDL 10.0					

LUMBER-	BRACING-
TOP CHORD 2x4 SPF 1650F 1.5E	TOP CHORD Structural wood sheathing directly applied or 5-7-9 oc purlins.
BOT CHORD 2x4 SPF 1650F 1.5E	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF-S No.2	MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=1169/0-3-8 (min. 0-1-13), 6=1169/0-3-8 (min. 0-1-13)
 Max Horz 2=228(LC 7)
 Max Uplift 2=-262(LC 8), 6=-262(LC 9)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-9=-1467/268, 3-9=-1347/293, 3-10=-1080/231, 10-11=-1056/233, 11-12=-960/243,
 4-12=-956/257, 4-13=-956/257, 13-14=-960/243, 14-15=-1056/233, 5-15=-1080/231,
 5-16=-1347/293, 6-16=-1467/268
 BOT CHORD 2-8=-169/1107, 6-8=-106/1107
 WEBS 3-8=-462/217, 4-8=-108/623, 5-8=-462/217

- NOTES-** (9-10)
- 1) Wind: ASCE 7-05; 100mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) gable end zone and C-C Exterior(2) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 5-0-0, Exterior(2) 5-0-0 to 8-0-0, Interior(1) 11-0-0 to 14-0-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) TCLL: ASCE 7-05; Pg= 60.0 psf (ground snow); Pf=46.2 psf (flat roof snow); Category II; Exp C; Partially Exp.; Ct=1.1
 - 3) Unbalanced snow loads have been considered for this design.
 - 4) This truss has been designed for greater of min roof live load of 16.0 psf or 1.00 times flat roof load of 46.2 psf on overhangs non-concurrent with other live loads.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=262, 6=262.
 - 8) This truss is designed in accordance with the 2009 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
 - 9) Dimensions are in feet-inches-sixteenths
 - 10) Drawing prepared exclusively for manufacturing by Boise Cascade.

LOAD CASE(S) Standard