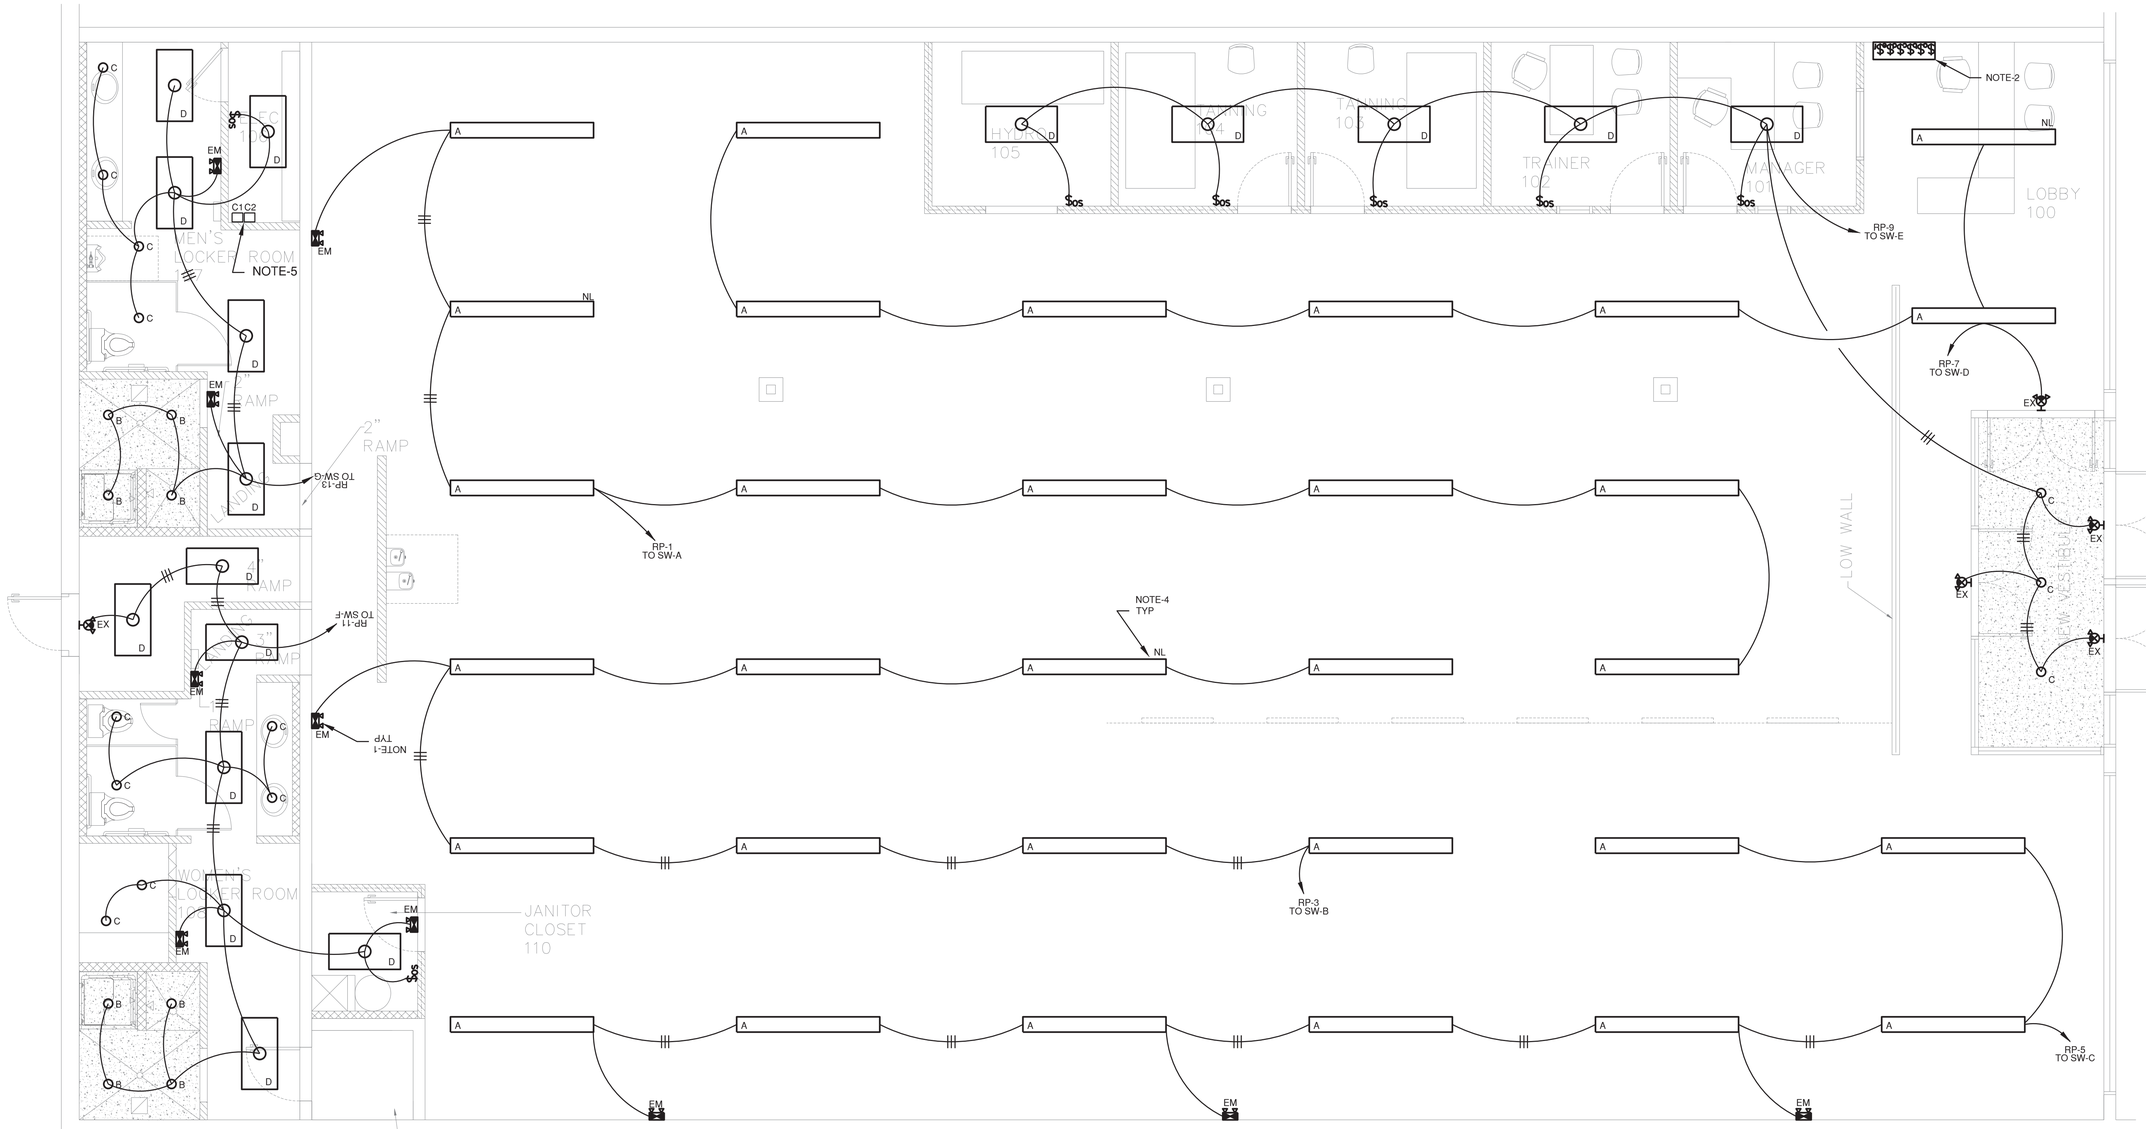

ELECTRICAL LIGHITNG PLAN

1/4" = 1'-0"

LUMINAIRE SCHEDULE

LUMINARE DESIGNATION	PART NUMBER	DESCRIPTION	COLOR	MOUNTING	HEIGHT	VOLTAGE	LAMP	COLOR TEMP	CRI
A	LITE CONTROL #P-S/D/D 1848-T8-PBACRG-CWM-TW-ELB-1CWQ	8' SUSPENDED FIXTURE	WHITE	SUSPENDED	REFER TO ARCH	120	(4) F32T8	3500 K	
B	LITHONIA LIGHTING #LF6 1/26-42TRT F6LS4 120 GEB 10	6" DOWNLIGHT-W/LENS	CLEAR SPECULAR	RECESSED		120	(1) 26TRT	3500 K	86
C	LITHONIA LIGHTING #LF6 1/26-42TRT F60 1AZ 120 GEB 10	6" DOWNLIGHT	CLEAR SPECULAR	RECESSED		120	(1) 26TRT	3500 K	82
D	LITHONIA LIGHTING #2GT8 232A12 120 GEB	2X4 FLUORESCENT	WHITE	RECESSED		120	(2) F32T8	3500 K	86
EM	LITHONIA LIGHTING #ELM2-LED	QUANTUM EMERGENCY LIGHTING UNIT	WHITE	SURFACE		120	LED		
EX	BEST LIGHTING #CTXEU2RW-RC	DUAL HEAD COMBO EM FIXTURE W/ REMOTE HEAD CAPABILITY	WHITE W/RED	SURFACE DUAL SIDE		120	LED		

LIGHTING NOTES:

1. PROVIDE DEDICATED NON-CONTACTORED, NON-SWITCHED HOT CONDUCTOR TO EACH EMERGENCY LIGHTING FIXTURE, EXIT SIGN, AND NIGHT LIGHT.
2. SWITCH BOX LOCATION. PROVIDE LOCK BOX AND VERIFY FINAL LOCATION WITH OWNER.
3. EXISTING J-BOX FOR SIGNAGE CONTRACTOR TO REUSE CIRCUITS AND TIME CLOCK / CONTACTOR. PROVIDE NEW ONE IF NECESSARY. VERIFY EXACT LOCATION IN FIELD.
4. NIGHT LIGHT FIXTURE SHALL BE UNSWITCHED ON THE CIRCUIT SHOWN AS SWITCHED FIXTURES.
5. PROVIDE NEW TIME CLOCKS. COORDINATE WITH OWNER PRIOR TO INSTALLATION. SEE E3.0 FOR DETAILS.

WORKOUT ANYTIME

PINE TREE SHOPPING CNTR
1100 BRIGHTON AVE
UNIT 12
PORTLAND, ME 04102

MEP CONTACT:JUSTIN R. HARDY, PE
5014 KINGSBRIDGE PASS
POWDER SPRINGS, GA
Phone: (678) 234-8156

STATE OF MAINE
QUIDO INOA ALVAREZ
No.13282
LICENSED PROFESSIONAL ENGINEER

09-09-15

REV. NO.	DATE	DESCRIPTION
1	3/6/2015	LANDLORD COMMENTS

PROJECT NO:
DRAWN BY:
CHECKED BY:
ISSUE DATE: 08-19-15 RELEASED FOR CONSTRUCTION

ELECTRICAL LIGHTING PLAN

E1.0