



1
E2.04 **FOURTH FLOOR ELEVATOR LOBBY**
SCALE - 1/4"=1'-0"

ELEVATOR NOTES

1. CONNECT ALL REQUIRED SMOKE DETECTORS FOR ELEVATOR RECALL. VERIFY REQUIREMENTS WITH ELEVATOR VENDOR AND LOCAL FIRE DEPARTMENT FOR ELEVATOR SMOKE DETECTORS AND INSTALL IN ACCORDANCE WITH NFPA 72.
2. PROVIDE ELEVATOR POWER SHUTDOWN VIA HEAT DETECTORS IN ELEVATOR SHAFT, PIT, AND MACHINE ROOM. HEAT DETECTORS ADJACENT TO SPRINKLER HEADS SHALL ALARM BEFORE SPRINKLER HEAD ACTIVATION BASED ON RATE OF TEMPERATURE RISE FOR THE SPRINKLER HEAD. HEAT DETECTORS SHALL BE INSTALLED WITHIN TWO FEET OF THE SPRINKLER HEAD. PROVIDE A CONNECTION TO A SHUNT-TRIP CIRCUIT BREAKER FOR ELEVATOR POWER SHUTDOWN. THE FIRE ALARM SYSTEM SHALL MONITOR SHUNT TRIP CONTROL POWER. COORDINATE WORK WITH THE LOCAL AUTHORITY HAVING JURISDICTION (AHJ).
3. PROVIDE A CONNECTION FROM THE ELEVATOR TAMPER SWITCH TO THE FIRE ALARM CONTROL PANEL (FACP).
4. COMPLY WITH REQUIREMENTS ASME A17.1 AND NFPA 72.
5. CONFIRM ELEVATOR HORSEPOWER WITH ELEVATOR MANUFACTURER PRIOR TO INSTALLATION. DESIGN BASED ON 150 HP.

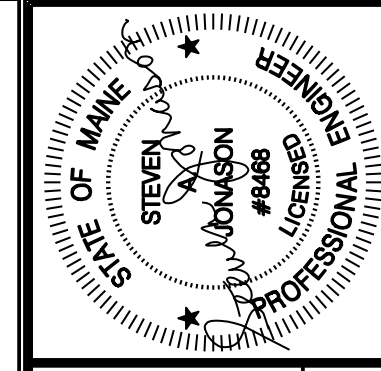

Prepared For:
PORTLAND HOTEL, INC

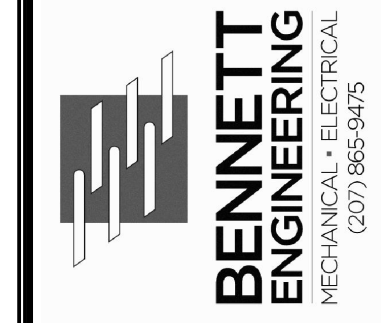

Consultant:

Architect:
HAMPTON INN
48 Union Wharf Portland, Maine 04101
(207) 772-6022 ARCHTYPE@ARCHTYPEPA.COM

Address:
City, State

Revisions:
ISSUED FOR PERMIT
PROGRESS PRINT
NOT FOR CONSTRUCTION

Date: 02-10-2016
Scale: 1/8" = 1'-0"
FOURTH FLOOR ELECTRICAL PLAN

E2.04