

12" THICK EQUIPMENT SLAB W/ FIBERMESH & #4 BAR @ 24" O.C. EACH WAY AT BOTTOM.

2'-0" WIDE X 12" DEEP THICKENED SLAB AT UNIT SEPERATION / SHEAR WALLS ABOVE - SEE SECTION FOR DETAILS & STEM WALL / CURB ALTERNATE.

INDICATES SHEAR WALL ABOVE, ANCHOR SILL TO SLAB W/ 1/2" DIAMETER x 6" TITEN HD GALV SCREW ANCHORS @ 24" MAX -TYP

HDQ8-SDS3 HOLDOWN W/ 7/8" DIAMETER GALV. ALL THREAD ANCHORS EPOXY SET 8" INTO THICKENED SLAB AT EACH END OF SHEARWALL -TYP

HD12 HOLD DOWN @ THIS SHEARWALL TO CONCRETE CONNECTION

#1 DF POST @ SHEARWALL ABOVE

2'-0" WIDE X 12" DEEP THICKENED SLAB AT UNIT SEPERATION / SHEAR WALLS ABOVE - SEE SECTION FOR DETAILS & STEM WALL / CURB ALTERNATE

INDICATES SHEAR WALL ABOVE, ANCHOR SILL TO SLAB W/ 1/2" DIAMETER x 6" TITEN HD GALV SCREW ANCHORS @ 24" MAX -TYP

HDQ8-SDS3 HOLDOWN W/ 7/8" DIAMETER GALV. ALL THREAD ANCHORS EPOXY SET 8" INTO THICKENED SLAB AT EACH END OF SHEARWALL -TYP

NOTE: COORDINATE ALL PLUMBING / UTILITIES W/ ARCHITECTURAL & M.E.P. PLANS - TYP.

4" THICK SLAB ON RIGID INSULATION - ON VAPOR BARRIER ON GRADE W/ FIBERMESH -TYP. UNO. CONTROL JOINTS @ 12'-0" O.C. MAX.

T.O. SLAB ELEV. = 100'-0"

BOND OUT AT CMU OPENING - SEE GENERAL NOTES

STEP CIP WALL DOWN TO 99'-6" & POUR SLAB OVER @ DOOR

10" THICK CIP WALL W/ TYPICAL REINFORCING @ EXTERIOR CMU ABOVE (ALIGN INSIDE FACE WITH INSIDE FACE OF CMU) - TYP.

SOLID GROUT CMU AT STAIR CONNECTIONS - TYP.

CMU STAIR SHAFT ABOVE


24" WIDE X 12" THICKENED SLAB AT CMU WALL ABOVE

10" THICK CIP WALL W/ TYPICAL REINFORCING @ EXTERIOR CMU ABOVE (ALIGN INSIDE FACE WITH INSIDE FACE OF CMU) - TYP.

8" CIP WALL ALIGNS WITH OUTSIDE FACE OF BRICK VENEER

1 FOUNDATION PLAN 'C'  
1/4" = 1'-0"

- NOTES:
1. ALL CONCRETE REINFORCING STEEL PER PLANS AND SECTION SHALL SHOW LOWER SIDE OF WALL.
  2. STEP IN TOP OF FOUNDATION WALL IS INDICATED THUS: ▽
  3. SEE S1.0 FOR STRUCTURAL GENERAL NOTES
  4. FOOTING TO BEAR 4'-6" MIN BELOW GRADE.
  5. T.O. FOOTINGS ARE INDICATED THUS: (XX'-XX")
  6. STEP IN TOP OF FOOTING IS INDICATED THUS: ▽, AND SHOWS LOWER FOOTING
  7. VERIFY ALL USGS ELEVATIONS W/ ARCHITECTURAL AND MEP PLANS - TYP.

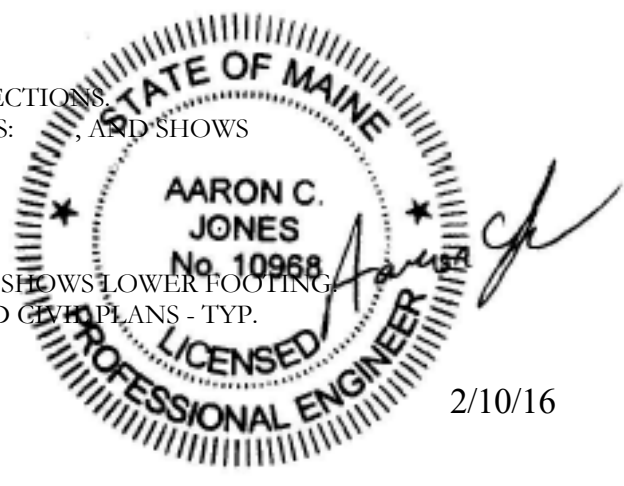

Prepared For:  
**PORTLAND HOTEL, INC**

Consultant:  
**ARCHETYPE architects**  
48 Union Wharf Portland, Maine 04101  
(207) 772-0022 ARCHETYPE@ARCHETYPEPA.COM

Architect:  
**HAMPTON INN**  
Address:  
City, State

Project:  
**PERMIT SET**

Date: 02/09/2016  
Scale: 1/4" = 1'-0"  
**FOUNDATION PLAN 'C'**

**S1.1c**  
2/10/16