
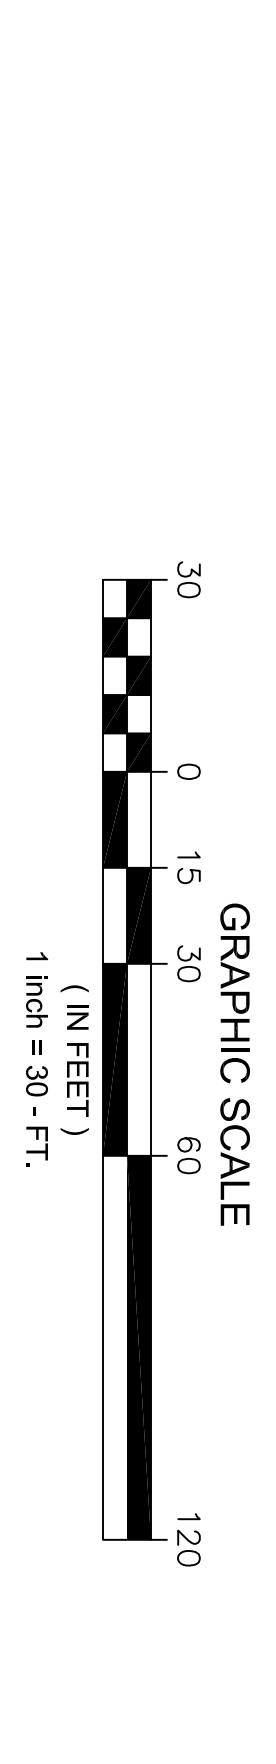


Luminaire Schedule							
Symbol	Label	Qty	Mounting Height	LLF	Watts	Lumens	Description
	A4	2	30'-0" AFG	0.900	135	17163	VP-L-64L-135-4K7-4W
	A5	1	30'-0" AFG	0.900	135	17009	VP-L-64L-135-4K7-5W
	B5	2	30'-0" AFG	0.900	135	17009	VP-L-64L-135-4K7-5W
	WP	4	12'-0" AFG	0.900	45	3998	LN2-18LU-4K-4

Calculation Summary							
Label	CalcType	Units	Avg	Max	Min	Avg/Min	Max/Min
Overall Area	Illuminance	Fc	0.43	5.0	0.0	N/A.	N.A.
Parking Area	Illuminance	Fc	1.41	4.0	0.4	3.53	10.00

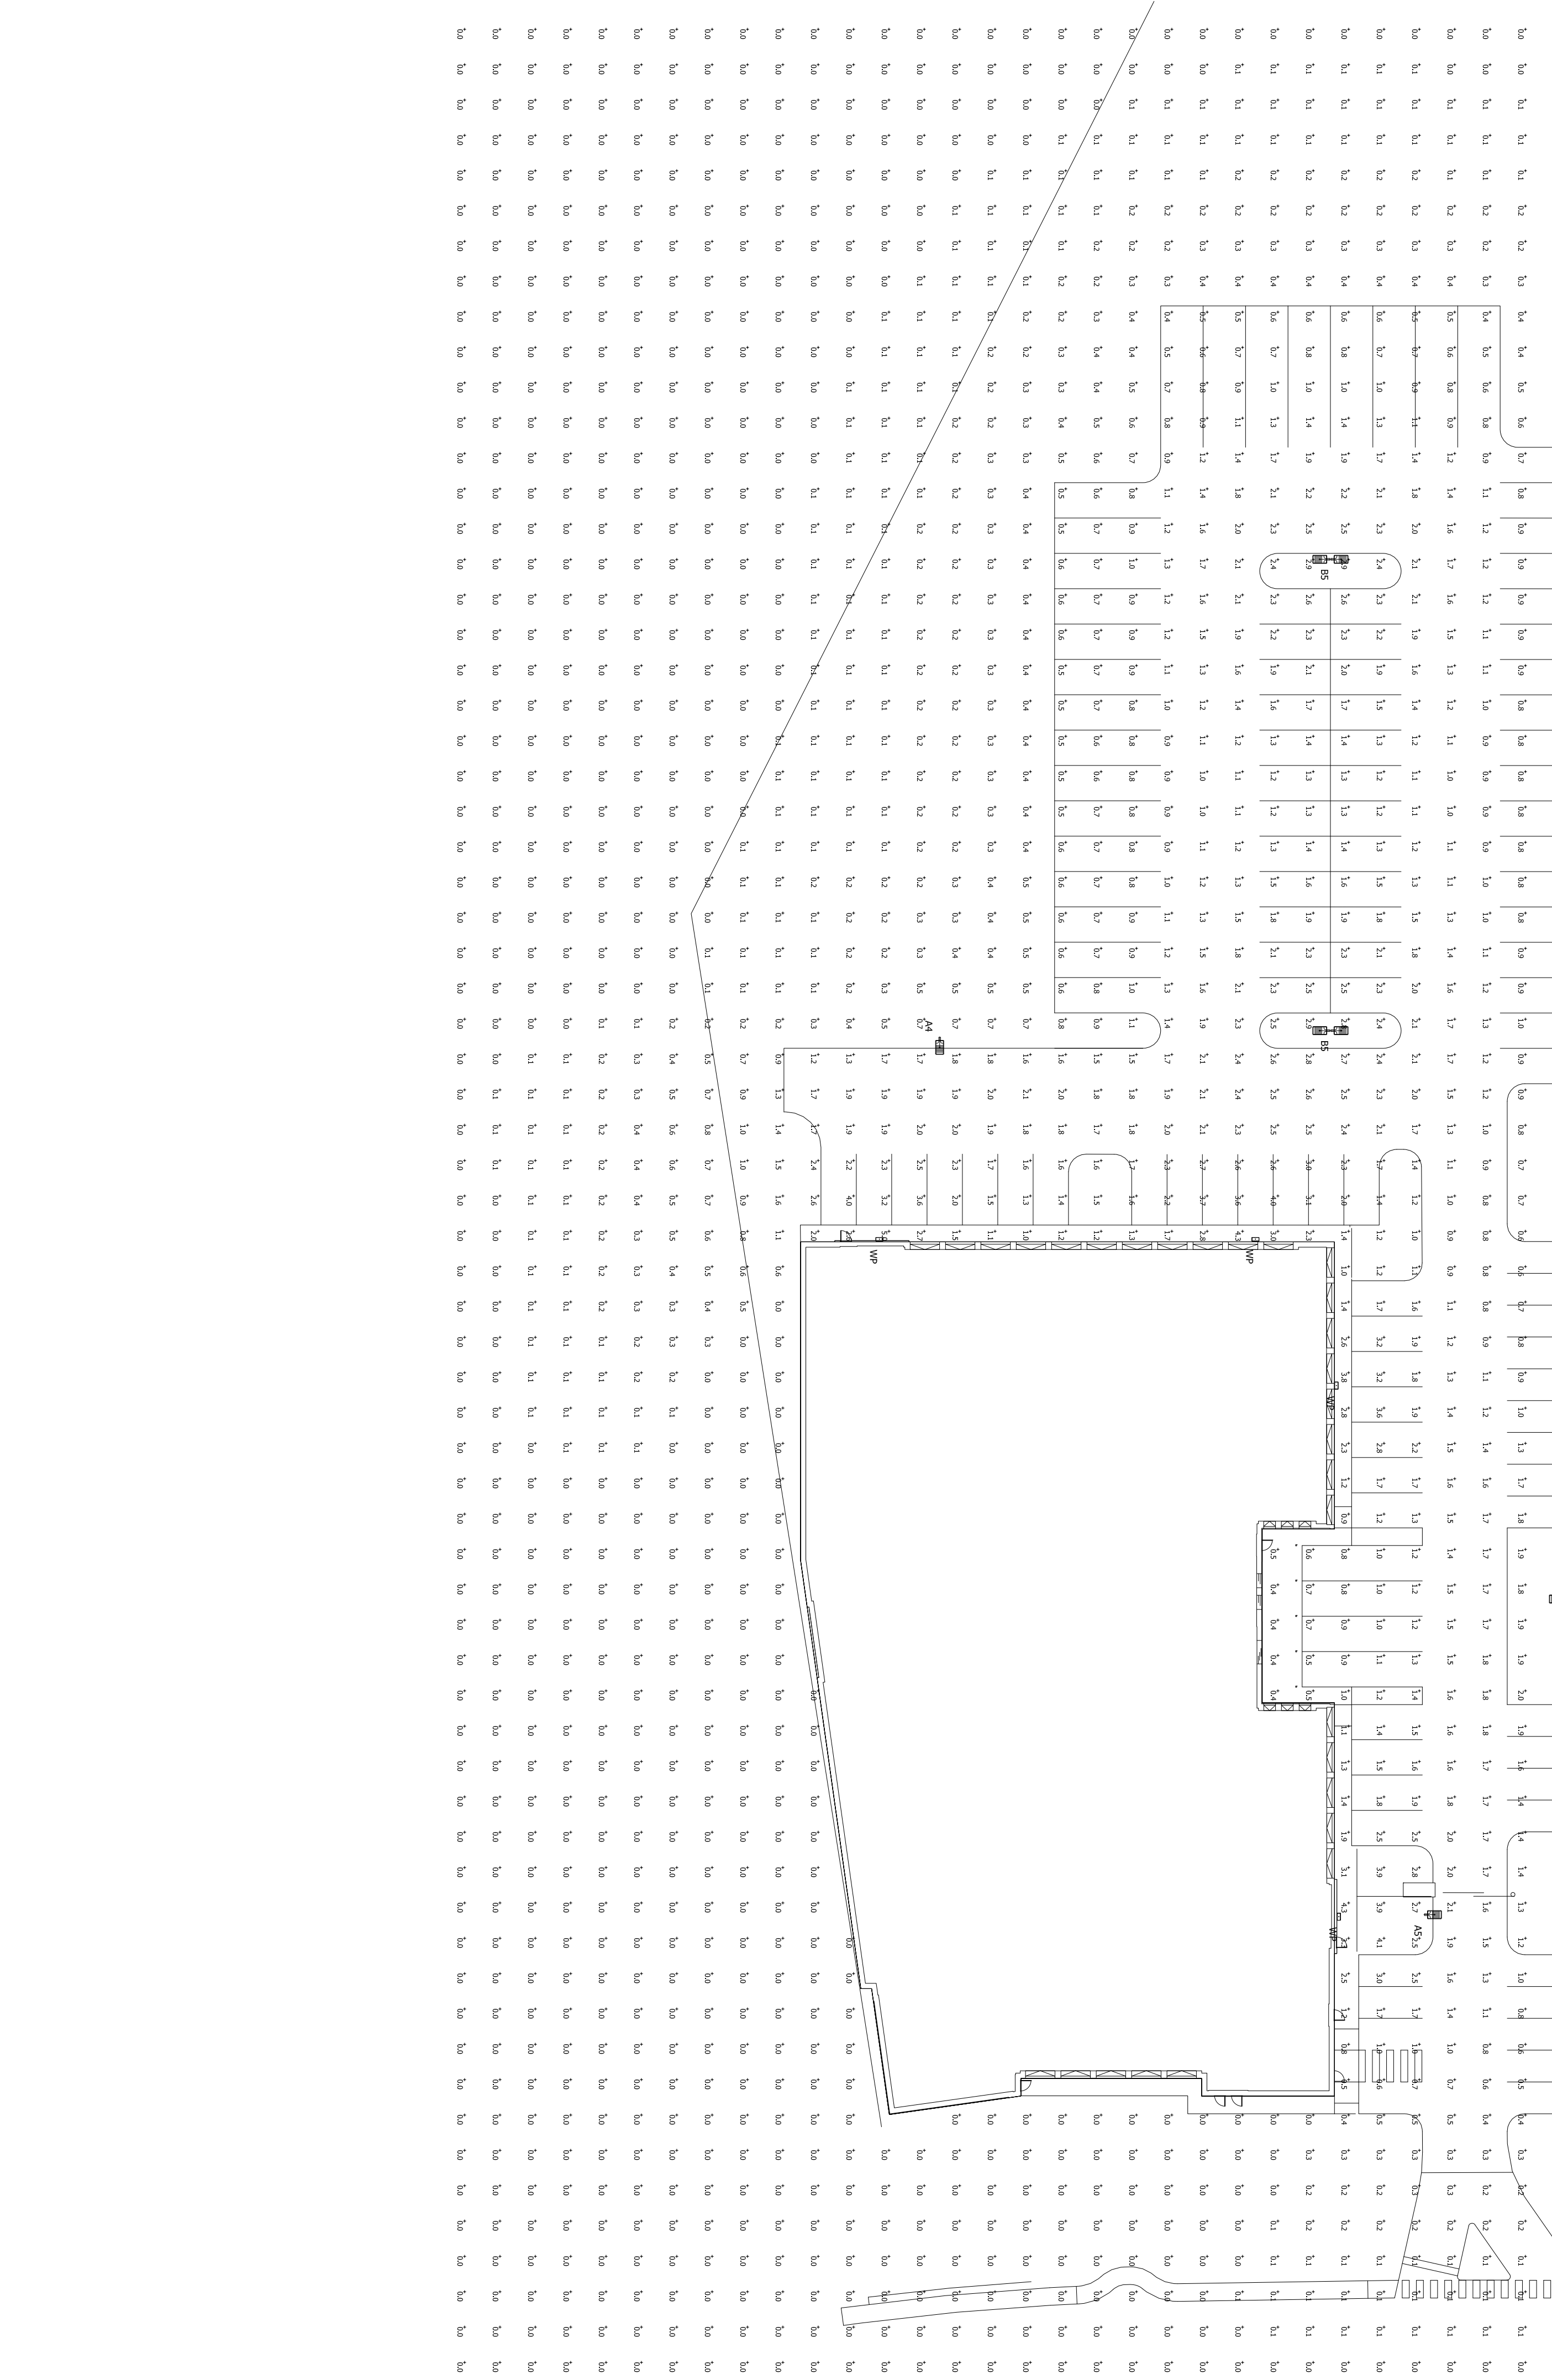

1. THIS LIGHTING DESIGN IS BASED ON LIMITED INFORMATION SUPPLIED BY OTHERS TO HUBBELL LIGHTING. SITE DETAILS PROVIDED HEREON ARE REPRODUCED ONLY AS A REFERENCE AND FIELD CONDITIONS MAY SIGNIFICANTLY AFFECT FINISHED PERFORMANCE. PRIOR TO INSTALLATION, OBTAIN ALL NECESSARY PERMITS AND REGULATORY AGENCIES. VERIFY ALL DIMENSIONS AND CONDITIONS ON-SITE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND REGULATORY AGENCIES. VERIFY ALL DIMENSIONS AND CONDITIONS ON-SITE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND REGULATORY AGENCIES. VERIFY ALL DIMENSIONS AND CONDITIONS ON-SITE.

2. LUMINAIRE DATA IS BASED ON TESTS TO INDUSTRY STANDARDS UNDER LABORATORY CONDITIONS. OPERATING VOLTAGE AND NOMINAL MANUFACTURING TOLERANCES OF LAMP, BALLAST, AND LUMINAIRE MAY AFFECT FIELD RESULTS.

3. CONFORMANCE TO FACILITY CODE AND OTHER LOCAL REQUIREMENTS IS THE RESPONSIBILITY OF THE OWNER AND/OR THE OWNER'S REPRESENTATIVE.

TITLE: **PATAGON STORAGE**
WASHAUGAL, WA
SITE LIGHTING PLAN

DESIGNED BY: **DHK**
DATE: **09/20/18**

CHECKED BY: **AS NOTED**
DATE: **1822786**

