


SYMBOL LEGEND

- POWER PANEL
- (VA) ELECTRIC MOTOR DRIVEN EQUIPMENT, HP SHOWN
- UNFUSED DISCONNECT SWITCH - 250 VOLT SIZE & NO. POLES AS NOTED.
- SM MANUAL MOTOR STARTER SWITCH WITH THERMAL OVERLOAD DEVICE, MOUNTED AT UNIT
- ⊙ JUNCTION BOX - "H" DENOTES RANGE HOOD, "DW" DENOTES DISHWASHER.
- LIGHTING FIXTURES- CAPITAL LETTERS DENOTE TYPE AS PER LIGHTING FIXTURE SCHEDULE.
- EXIT LIGHT FIXTURE-UNSWITCHED
- SELF CONTAINED EMERGENCY LIGHTING UNIT W/2 HEADS RECESSED DUAL LITE *LZ2-WGLZ
- RACEWAY & WIRING RUN CONCEALED UNDER FLOOR
- HOME RUN TO PANEL- ARROWS INDICATE QUANTITY OF CIRCUITS- NUMERALS DENOTE CIRCUIT NUMBERS
- MINIMUM CIRCUIT WIRING SHALL BE 2*12, 1*12G, 3/4\"/>
- COMBINATION CIRCUIT BREAKER & MAGNETIC MOTOR STARTER - NEMA SIZE 1 W/4 AUX. CONTACTS AND HAND-OFF-AUTO SWITCH W/RED POWER ON PILOT LIGHT.
- SINGLE POLE SWITCH, 120/277 VOLT, 20 AMP, SPEC. GRADE, GROUNDING TYPE, MOUNT 48\"/>
- DUPLEX RECEPTACLE - 20A, 125V. SPEC. GRADE GROUNDING TYPE AND MATCHING IVORY PLATE - MOUNT 24\"/>
- DUPLEX RECEPTACLE- GROUND FAULT OUTLET 20A, 125V- WITH MATCHING IVORY PLATE FURNISHED W/ OUTLET. FLUSH MOUNTED 45\"/>
- SMOKE DETECTOR, PHOTOELECTRIC TYPE SINGLE STATION - 120 VOLTS
SMOKE DETECTOR, PHOTOELECTRIC TYPE- SYSTEM CONNECTED
- FIRE ALARM PULL STATION MOUNT 48\"/>
- FIRE ALARM AUDIO/VISUAL, MOUNT 6\"/>
- FIRE ALARM VISUAL STROBE ONLY
- CABLE TV JUNCTION BOX "CTV" - SIZE AS REQUIRED BY CABLE TV CO.
- TV OUTLET LOCATION

FIRE ALARM SYSTEM COMPONENTS ARE SHOWN FOR PERMITTING ONLY. FIRE ALARM SYSTEM SHALL BE FURNISHED AND INSTALLED BY OTHERS

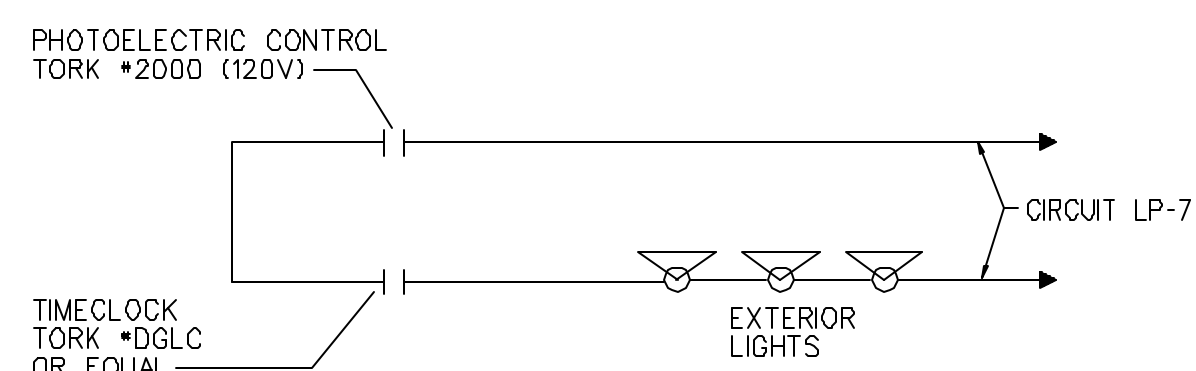

WIRING SCHEMATIC FOR EXTERIOR LIGHTING

LIGHTING FIXTURE SCHEDULE			
TYPE	DESCRIPTION	LAMPS QUANTITY & TYPE	REMARKS
A	LITHONIA *EJ2-96TB-277-GEB-(2)WGL	(2) 59W T8 SPX35 SLIMLINE	INDUSTRIAL FLUORESCENT. CHAIN HANG AT 16\"/>
B	LITHONIA *LB-232-277-GEB	(2) F32T8/SPX35	WRAPAROUND, SURFACE MOUNT
C	LITHONIA *2GT8-432-A12-277-GEB	(4) F32T8/SPX35	2' X 4' FLUORESCENT TROFFER
E	LITHONIA *LQM-3R-277-EL N	LED	EXIT SIGN WITH BATTERY
Y	LSI *CBWM-3-250-SMH-F-120-BRZ	(1) 250W MH	WALLPACK. MOUNT AT 18\"/>

NOTE
1. ALL LIGHTING BRANCH CIRCUITS SHALL BE #10 AWG MINIMUM