

EROSION & SEDIMENTATION CONTROL NOTES

1. SILTATION FENCE OR HAY BALE BARRIERS WILL BE INSTALLED DOWNSLOPE OF ALL STRIPPING OR CONSTRUCTION OPERATIONS. A DOUBLE SILT FENCE BARRIER SHALL BE INSTALLED DOWNSLOPE OF ANY SOIL MATERIAL STOCKPILES. SILT FENCES SHALL BE INSPECTED AFTER EACH RAIN EVENT AND DAILY DURING PROLONGED RAIN. SILT AND SOIL PARTICLES ACCUMULATING BEHIND THE FENCE SHALL BE REMOVED AFTER EACH SIGNIFICANT RAIN EVENT AND IN NO INSTANCE SHOULD ACCUMULATION EXCEED 1/2 THE HEIGHT OF THE FENCE. TORN OR DAMAGED AREAS SHALL BE REPAIRED.

2. TEMPORARY AND PERMANENT VEGETATION AND MULCHING IS AN INTEGRAL COMPONENT OF THE EROSION AND SEDIMENTATION CONTROL PLAN. ALL AREAS SHALL BE INSPECTED AND MAINTAINED UNTIL THE DESIRED VEGETATIVE COVER IS ESTABLISHED. THESE CONTROL MEASURES ARE ESSENTIAL TO EROSION PREVENTION AND ALSO REDUCE COSTLY REWORK OF GRADED AND SHAPED AREAS.

3. SEEDING, FERTILIZER AND LIME RATES AND TIME OF APPLICATION WILL BE DEPENDENT ON SOIL REQUIREMENTS. TEMPORARY VEGETATION SHALL BE MAINTAINED IN THESE AREAS UNTIL PERMANENT SEEDING IS APPLIED. ADDITIONALLY, EROSION AND SEDIMENTATION MEASURES SHALL BE MAINTAINED UNTIL PERMANENT VEGETATION IS ESTABLISHED.

4. ALL LAWN AREA SHALL BE PERMANENTLY SEEDED WITH THE FOLLOWING MIXTURE: 20 LB/ACRE KENTUCKY BLUEGRASS, 20 LB/ACRE CREEPING RED FESCUE AND 5 LB/ACRE PERENNIAL RYE GRASS FOR A TOTAL OF 45 LB/ACRE. FERTILIZER AND LIME RATES SHALL BE DEPENDENT ON SOIL TESTING. IN THE ABSENCE OF SOIL TESTS, FERTILIZE WITH 10-20-20 (N-P205-K201) AT 800 LB/ACRE AND LIME AT 3 TONS/ACRE. MULCH WITH HAY AT 70-90 LB/1000 S.F. 4" OF LOAM SHALL BE APPLIED PRIOR TO

5. ALL DRAINAGE SWALES, POND EMBANKMENTS AND CROSSING EMBANKMENTS SHALL BE SEEDED WITH A MIXTURE OF CREEPING RED FESCUE, REDTOP AND TALL FESCUE. THE MIXTURE SHALL CONTAIN 20 LB/ACRE CREEPING RED FESCUE, 2 LB/ACRE REDTOP AND 20 LB/ACRE TALL FESCUE. SEE THE ABOVE NOTE FOR FERTILIZER, LIME AND MULCHING RATES.

6. TEMPORARY VEGETATION OF ALL DISTURBED AREAS, MATERIAL STOCKPILES AND OTHER SUCH AREAS SHALL BE ESTABLISHED BY SEEDING WITH EITHER WINTER RYE AT A RATE OF 112 LB/ACRE OR ANNUAL RYEGRASS AT A RATE OF 40 LB/ACRE. WINTER RYE SHALL BE USED FOR FALL SEEDING AND ANNUAL RYEGRASS FOR SHORT DURATION SEEDING. SEEDING SHALL BE ACCOMPLISHED BEFORE OCTOBER 1.

7. TEMPORARY SEEDING OF DISTURBED AREAS SHALL BE ACCOMPLISHED BEFORE OCTOBER 1. PERMANENT SEEDING SHALL BE ACCOMPLISHED BEFORE SEPTEMBER 15.

8. ALL SEEDED AREAS SHALL BE MULCHED WITH HAY AT A RATE OF 2 BALES (70-90 LB) PER 1000 S.F. OF SEEDED AREA.

9. ALL DISTURBED AREAS ON THE SITE SHALL BE PERMANENTLY STABILIZED WITHIN 7 DAYS OF FINAL GRADING OR TEMPORARILY STABILIZED WITHIN 30 DAYS OF INITIAL DISTURBANCE.

10. A STABILIZED CONSTRUCTION ENTRANCE SHALL BE INSTALLED AT ALL ACCESSES TO PUBLIC ROADS (SEE PLAN). TEMPORARY CULVERTS SHALL BE PROVIDED AS REQUIRED.

11. SLOPES 2:1 OR STEEPER SHALL BE TREATED WITH POLYJUTE OPEN WEAVE GEOTEXTILE (OR EQUIVALENT) AFTER SEEDING. JUTE MATS SHALL BE ANCHORED PER MANUFACTURER'S SPECIFICATIONS.

12. EXCESSIVE DUST CAUSED BY CONSTRUCTION OPERATIONS SHALL BE CONTROLLED BY APPLICATION OF WATER OR CALCIUM CHLORIDE.

- SUBBASE AGGREGATE

EROSION CONTROL MIX

EROSION CONTROL MIX

13. THE CONTRACTOR MAY OPT TO USE EROSION CONTROL MIX BERM AS A SEDIMENT BARRIER IN LIEU OF SILTATION FENCE OR HAY BALE BARRIERS WITH APPROVAL FROM THE INSPECTING ENGINEER.

_ _ _ _ _ _ _ _ _

PRECAST CONCRETE TO BE

SET IN 6" (MIN) CONCRETE

CONCRETE CURB DETAIL

(NTS)

EROSION CONTROL MIX COMPOSITION STANDARDS:

- PARTICLE SIZE BY WEIGHT SHALL BE 100% PASSING A 6" SCREEN AND A MINIMUM OF 70%, MAXIMUM OF 85% PASSING A 0.75" SCREEN.

THE ORGANIC PORTION NEEDS TO BE FIBROUS AND ELONGATED

- LARGE PORTIONS OF SILTS, CLAYS OR FINE SANDS ARE NOT ACCEPTABLE IN THE MIX

THE pH SHOULD FALL BETWEEN 5.0 AND 8.0

EROSION CONTROL MIX BERM

(NTS)

- SOLUBLE SALTS CONTENT SHALL BE

<4.0 mmhos/cm

- THE ORGANIC MATTER CONTENT SHALL BE BETWEEN 80 AND 100%, DRY WEIGHT BASIS.

— 20'(MAX) -

6"(MIN) –

5" X 16"

CONCRETE CURB

FINISHED

PAVEMENT

STRUCTURE

PRECAST

WINTER CONSTRUCTION NOTES

1. EXPOSED AREAS SHOULD BE LIMITED TO AN AREA THAT CAN BE MULCHED IN ONE DAY PRIOR TO ANY SNOW EVENT.


2. AN AREA SHALL BE CONSIDERED STABILIZED WHEN EXPOSED SURFACES HAVE BEEN EITHER MULCHED WITH HAY AT A RATE OF 100 LB/1000 S.F. OR DORMANT SEEDED, MULCHED AND ADEQUATELY ANCHORED BY AN APPROVED ANCHORING TECHNIQUE. IN ALL CASES, MULCH SHALL BE APPLIED SO THAT THE SOIL SURFACE IS NOT VISIBLE THROUGH THE MULCH.

3. FROM OCTOBER 15 TO APRIL 1, LOAM AND SEED WILL NOT BE REQUIRED. DURING PERIODS OF TEMPERATURES ABOVE FREEZING, DISTURBED AREAS SHALL BE FINE GRADED AND PROTECTED WITH MULCH OR TEMPORARILY SEEDED AND MULCHED UNTIL PERMANENT SEEDING CAN BE APPLIED. AFTER NOVEMBER 1, DISTURBED AREAS MAY BE LOAMED, FINE GRADED AND DORMANT SEEDED AT A RATE 200-300% HIGHER THAN THE SPECIFIED PERMANENT SEEDING RATE. IF CONSTRUCTION CONTINUES DURING FREEZING WEATHER, DISTURBED AREAS SHALL BE GRADED BEFORE FREEZING AND TEMPORARILY STABILIZED WITH MULCH. DISTURBED AREAS SHALL NOT BE LEFT OVER THE WINTER OR FOR ANY OTHER EXTENDED PERIOD OF TIME UNLESS STABILIZED WITH MULCH.


4. FROM NOVEMBER 1 TO APRIL 15 ALL MULCH SHALL BE ANCHORED BY EITHER PEG LINE, MULCH NETTING, ASPHALT EMULSION CHEMICAL, TRACK OR WOOD CELLULOSE FIBER. MULCH NETTING SHALL BE USED TO ANCHOR MULCH IN ALL DRAINAGE WAYS WITH SLOPES GREATER THAN 3%, SLOPES EXPOSED TO DIRECT WINDS AND FOR SLOPES GREATER THAN 8%. MULCH NETTING SHALL BE USED TO ANCHOR MULCH IN ALL AREAS WITH SLOPES GREATER THAN 15%. AFTER OCTOBER 1, THE SAME APPLIES TO ALL SLOPES GREATER THAN 8%.

5. DURING WINTER CONSTRUCTION, DORMANT SEEDING OR MULCH AND ANCHORING SHALL BE APPLIED TO ALL DISTURBED AREAS AT THE END OF EACH WORKING DAY.

6. SNOW SHALL BE REMOVED FROM AREAS OF SEEDING AND MULCHING PRIOR TO PLACEMENT.

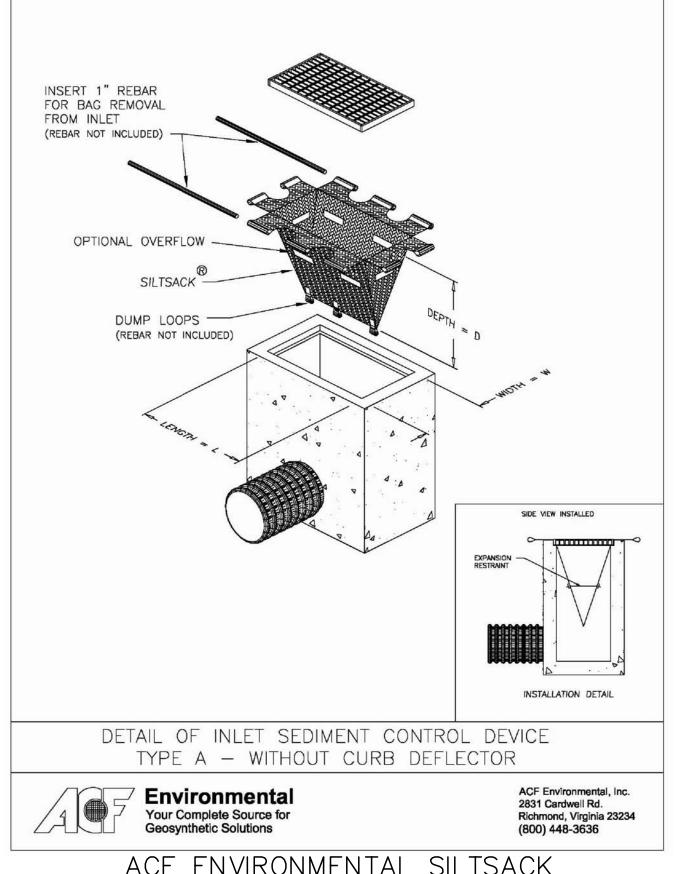

ACF ENVIRONMENTAL SILTSACK

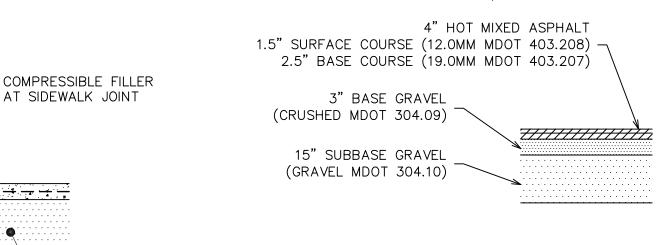


PAVEMENT CROSS-SECTION (NTS)

GRAVEL FILL TO BE COMPACTED TO 95% MODIFIED PROCTOR


IF X IS LESS THAN 48"
THEN THE SLOPE OF THE
FLARED SIDE SHALL NOT EXCEED 1 : 12. FLARED

ADA CURB RAMP WITH FLARED SIDES

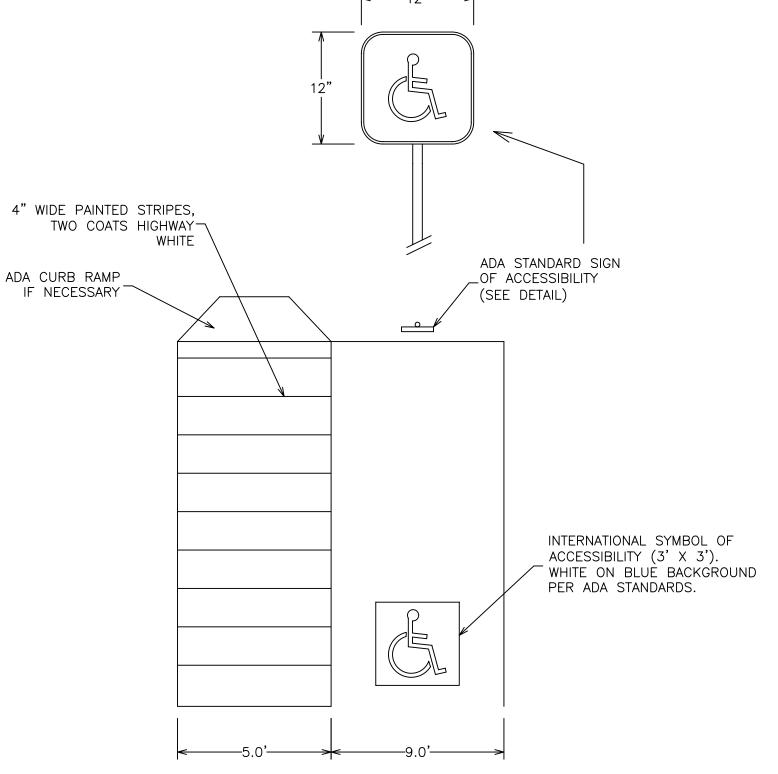

ACCESSIBLE PARKING SPACE DETAIL

(NTS)

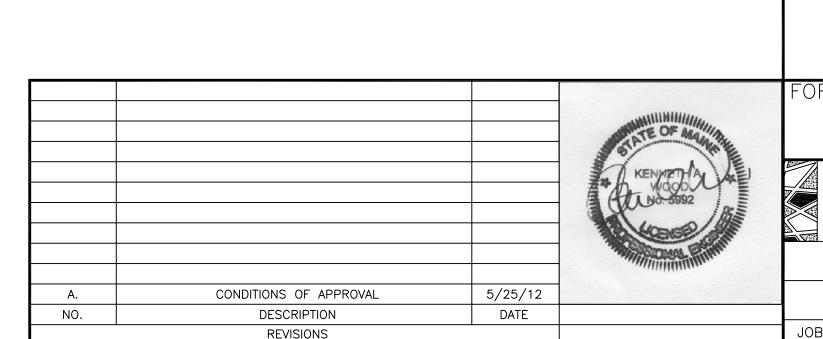

SITE DETAILS PORTLAND SPORTS CENTER WARREN AVENUE PORTLAND, MAINE

JIM GRATTELO PORTLAND SPORTS REALTY, LLC 550 WARREN AVE PORTLAND. MAINE 04103

ATTAR ENGINEERING, INC. CIVIL ◆ STRUCTURAL ◆ MARINE 1284 STATE ROAD - ELIOT, MAINE 03903

PHONE: (207)439-6023 FAX: (207)439-2128 APPROVED BY: SCALE: DRAWN BY: AS NOTED EAB DATE: REVISION : DATE 4/19/12 A: 5/25/12 JOB NO: C089-12 | CAD FILE: DOME DET SHEET 3 OF

