

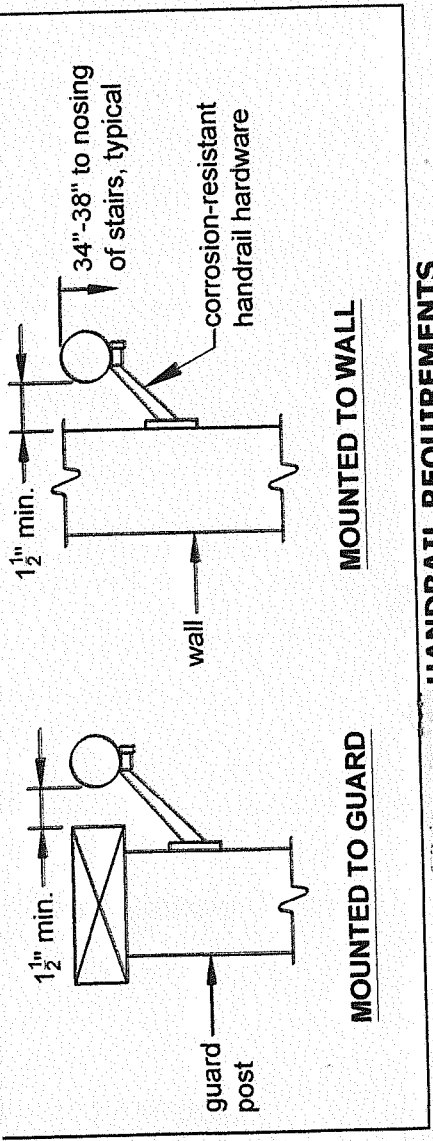


RE-SUBMITTAL
S2
FRAMING SECTIONS
& DETAILS



HANDRAIL REQUIREMENTS

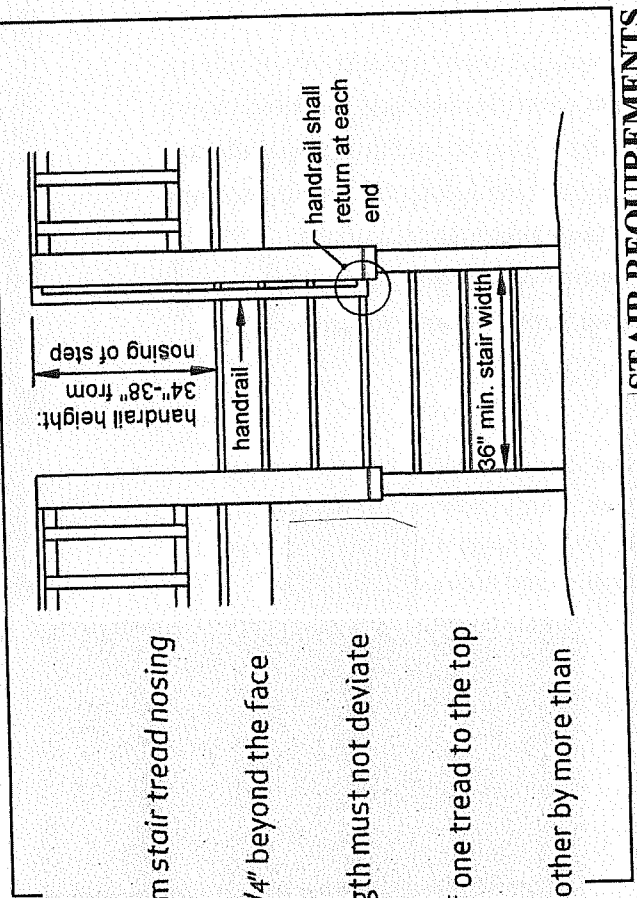

Requirements

- The minimum stair width is 36".
- The minimum tread width must be 10" from stair tread nosing to tread nosing.
- The nose must extend between 3/4" to 1 1/4" beyond the face of the riser.
- The tread widths and stair tread nose length must not deviate from one another by more than 3/8".
- The maximum stair height from the top of one tread to the top of the next must not exceed 7 3/4".
- Stair heights must not deviate from each other by more than 3/8".

STAIR REQUIREMENTS