


POD-HYD01576
 WS# 003190
 Taft Ave 80' S of Robin St
 Date: 6/8/1993
 Static: 74 psi

Flow Hydrant A
 POD-HYD01043
 WS# 002374
 Sunset Ln at Cedarhurst Ln
 Date: 7/20/1990
 Static: N/A
 Pitot: 23 psi
 Flow: 804 gpm

Test Hydrant A
 POD-HYD01419
 WS# 002921
 Warwick St Opposite Sunset Ln
 Date: 7/20/1990
 Static: 69 psi
 Residual: 64 psi

Flow Hydrant B
 POD-HYD01059
 WS# 002514
 Brighton Ave at Taft Ave
 Date: 5/21/2004
 Static: 64 psi
 Pitot: Left Port 26 psi
 Right Port 24 psi
 Flow: Left Port 855 gpm
 Right Port 822 gpm

Test Hydrant B
 POD-HYD01058
 WS# 003778
 Brighton Ave at Cabot St
 Date: 5/21/2004
 Static: 79 psi
 Residual: 77 psi

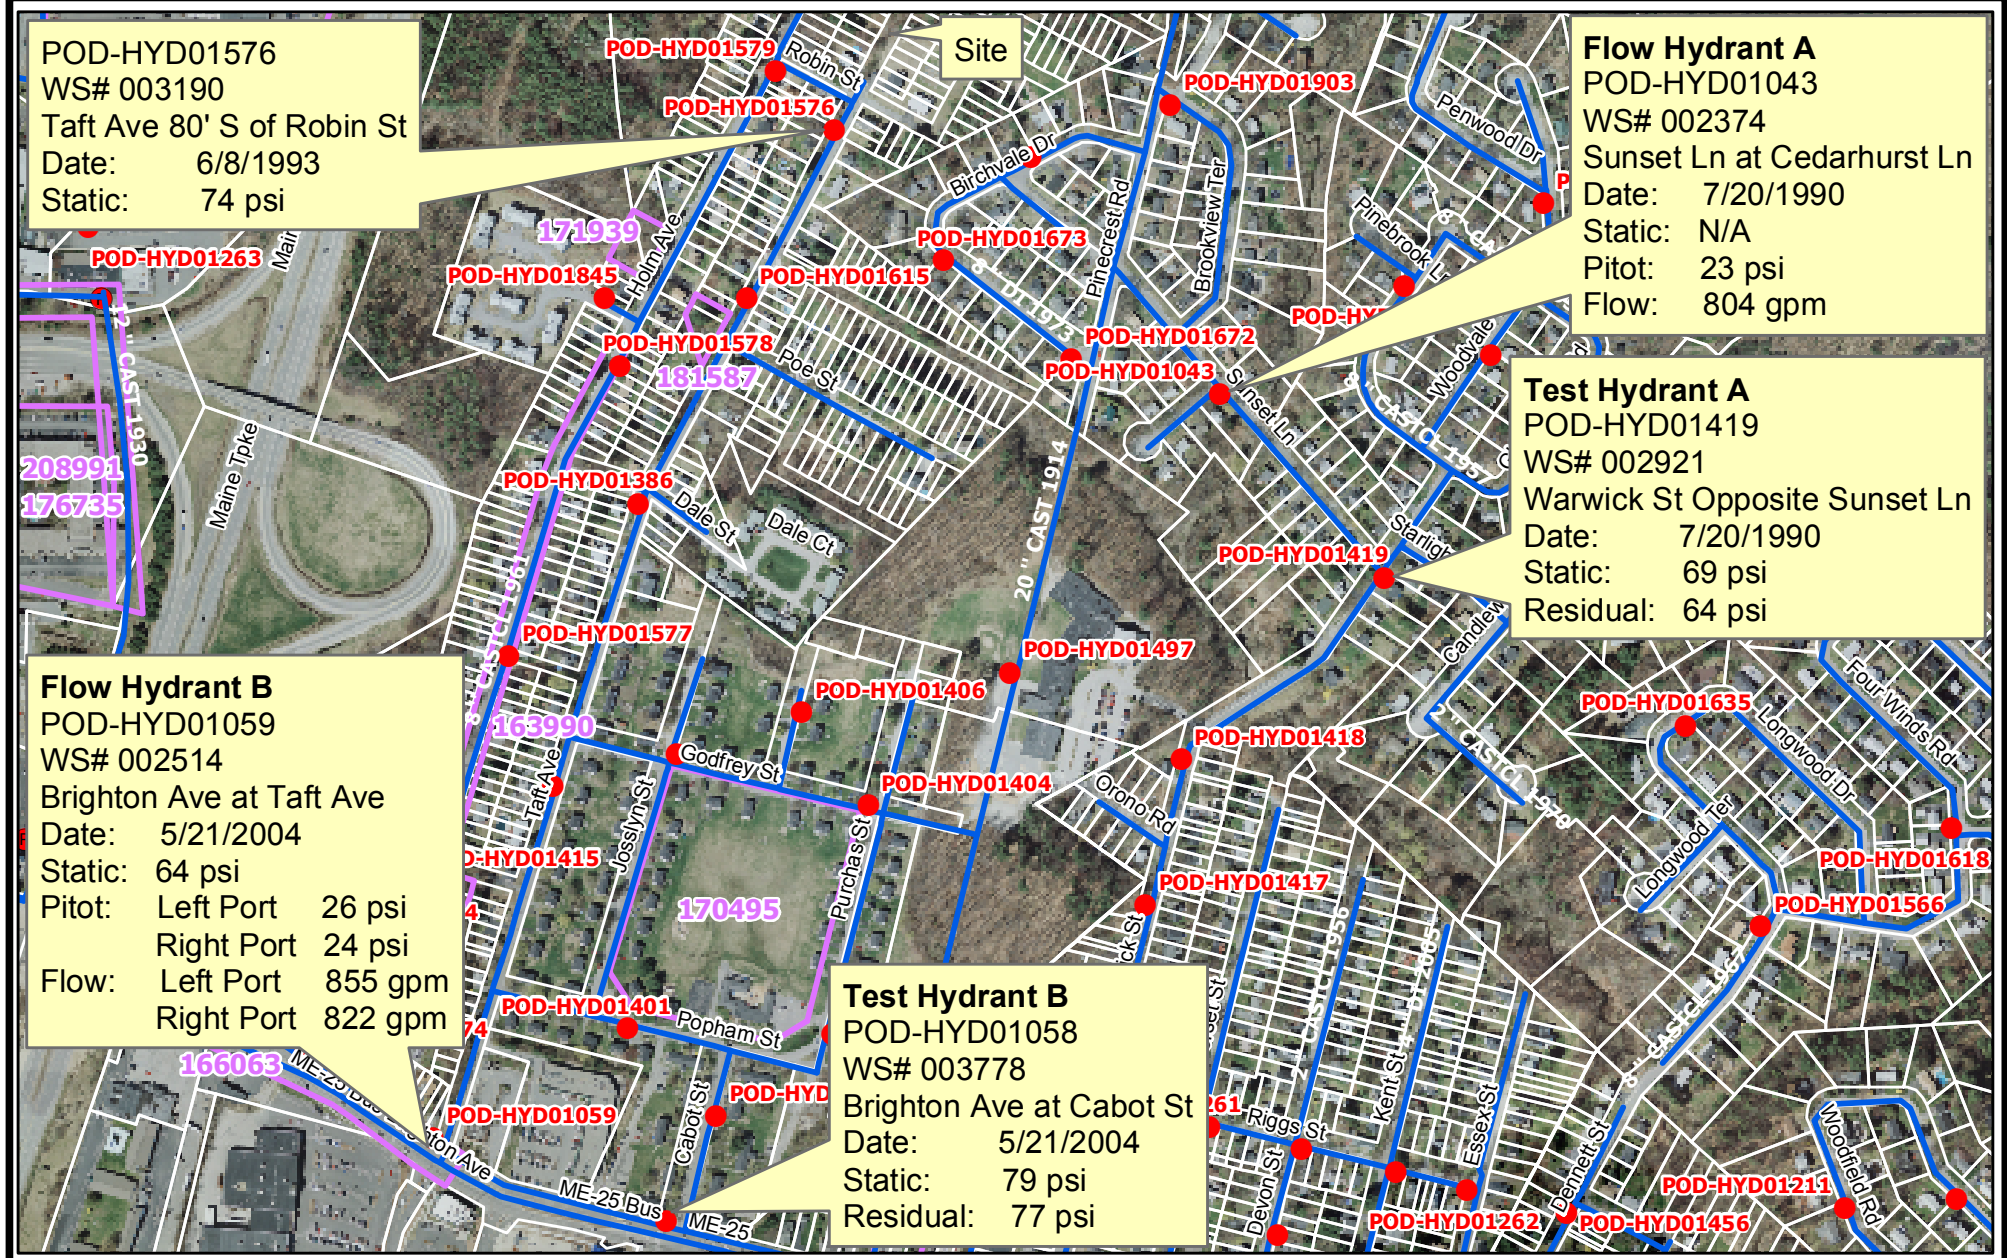

265~ Taft Avenue

Portland



PORTLAND WATER DISTRICT
 225 Douglass Street
 Portland, ME 04104



Legend

Blow Off	Fire Service	Air Valve	Sleeve
By Pass	Hydrant Control	Date Change	Tee
Distribution	Service	Material Change	Hydrants
End of Main	Transmission	Reducer	



Disclaimer: This map is suitable for preliminary study and analysis and is based on PWD record information. PWD is not liable for any damages whatsoever resulting from inaccurate data or from errors made in the location and marking of its infrastructure.

Drawn By: GJH

Prepared for: Sprinkler Systems, Inc

Scale: As Noted

Date: 1/20/2011