



**DRAWING KEYNOTES**

- 1 PROVIDE WITHIN 24" OF SPRINKLER HEAD. ACTUATION SHALL SHUT DOWN POWER TO ELEVATOR.
- 2 FOR ELEVATOR RECALL.
- 3 PROVIDE ADDRESSABLE INTERFACE MODULE (AIM) FOR EACH TAMPER AND FLOW SWITCH.


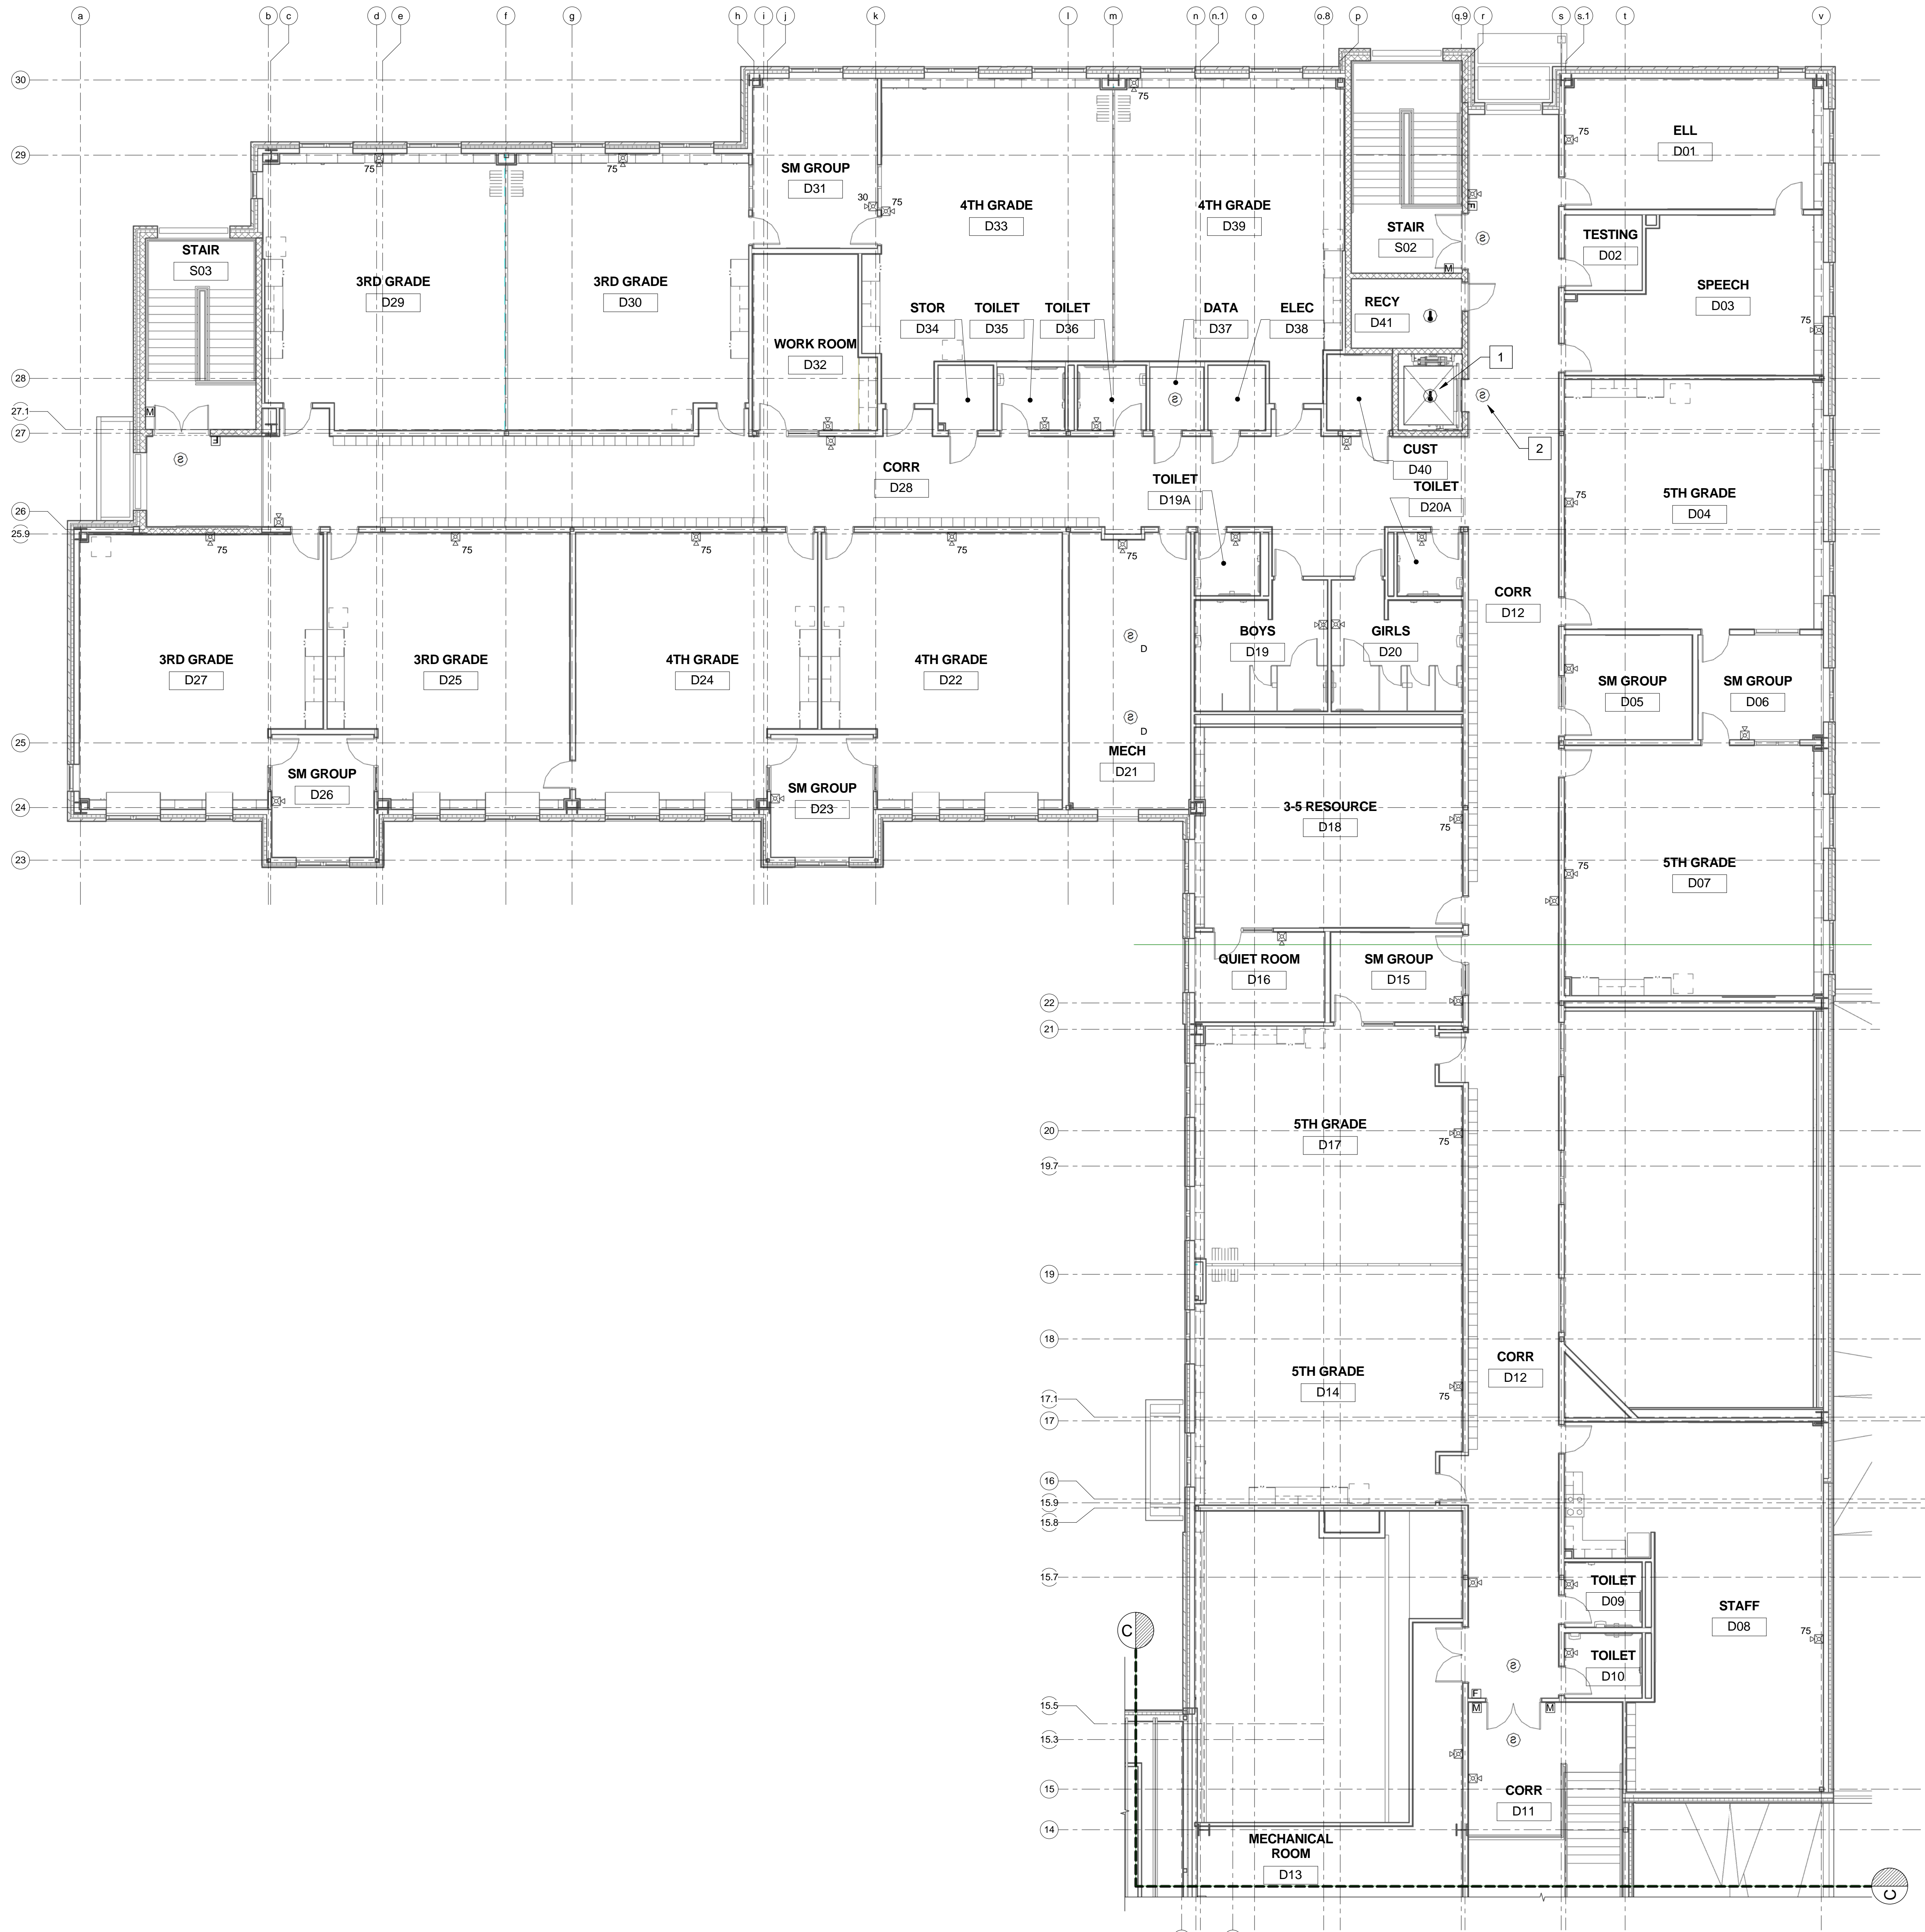


**1 SECOND FLOOR FIRE ALARM PART PLAN D**  
FA104/ SCALE: 1/8" = 1'-0"

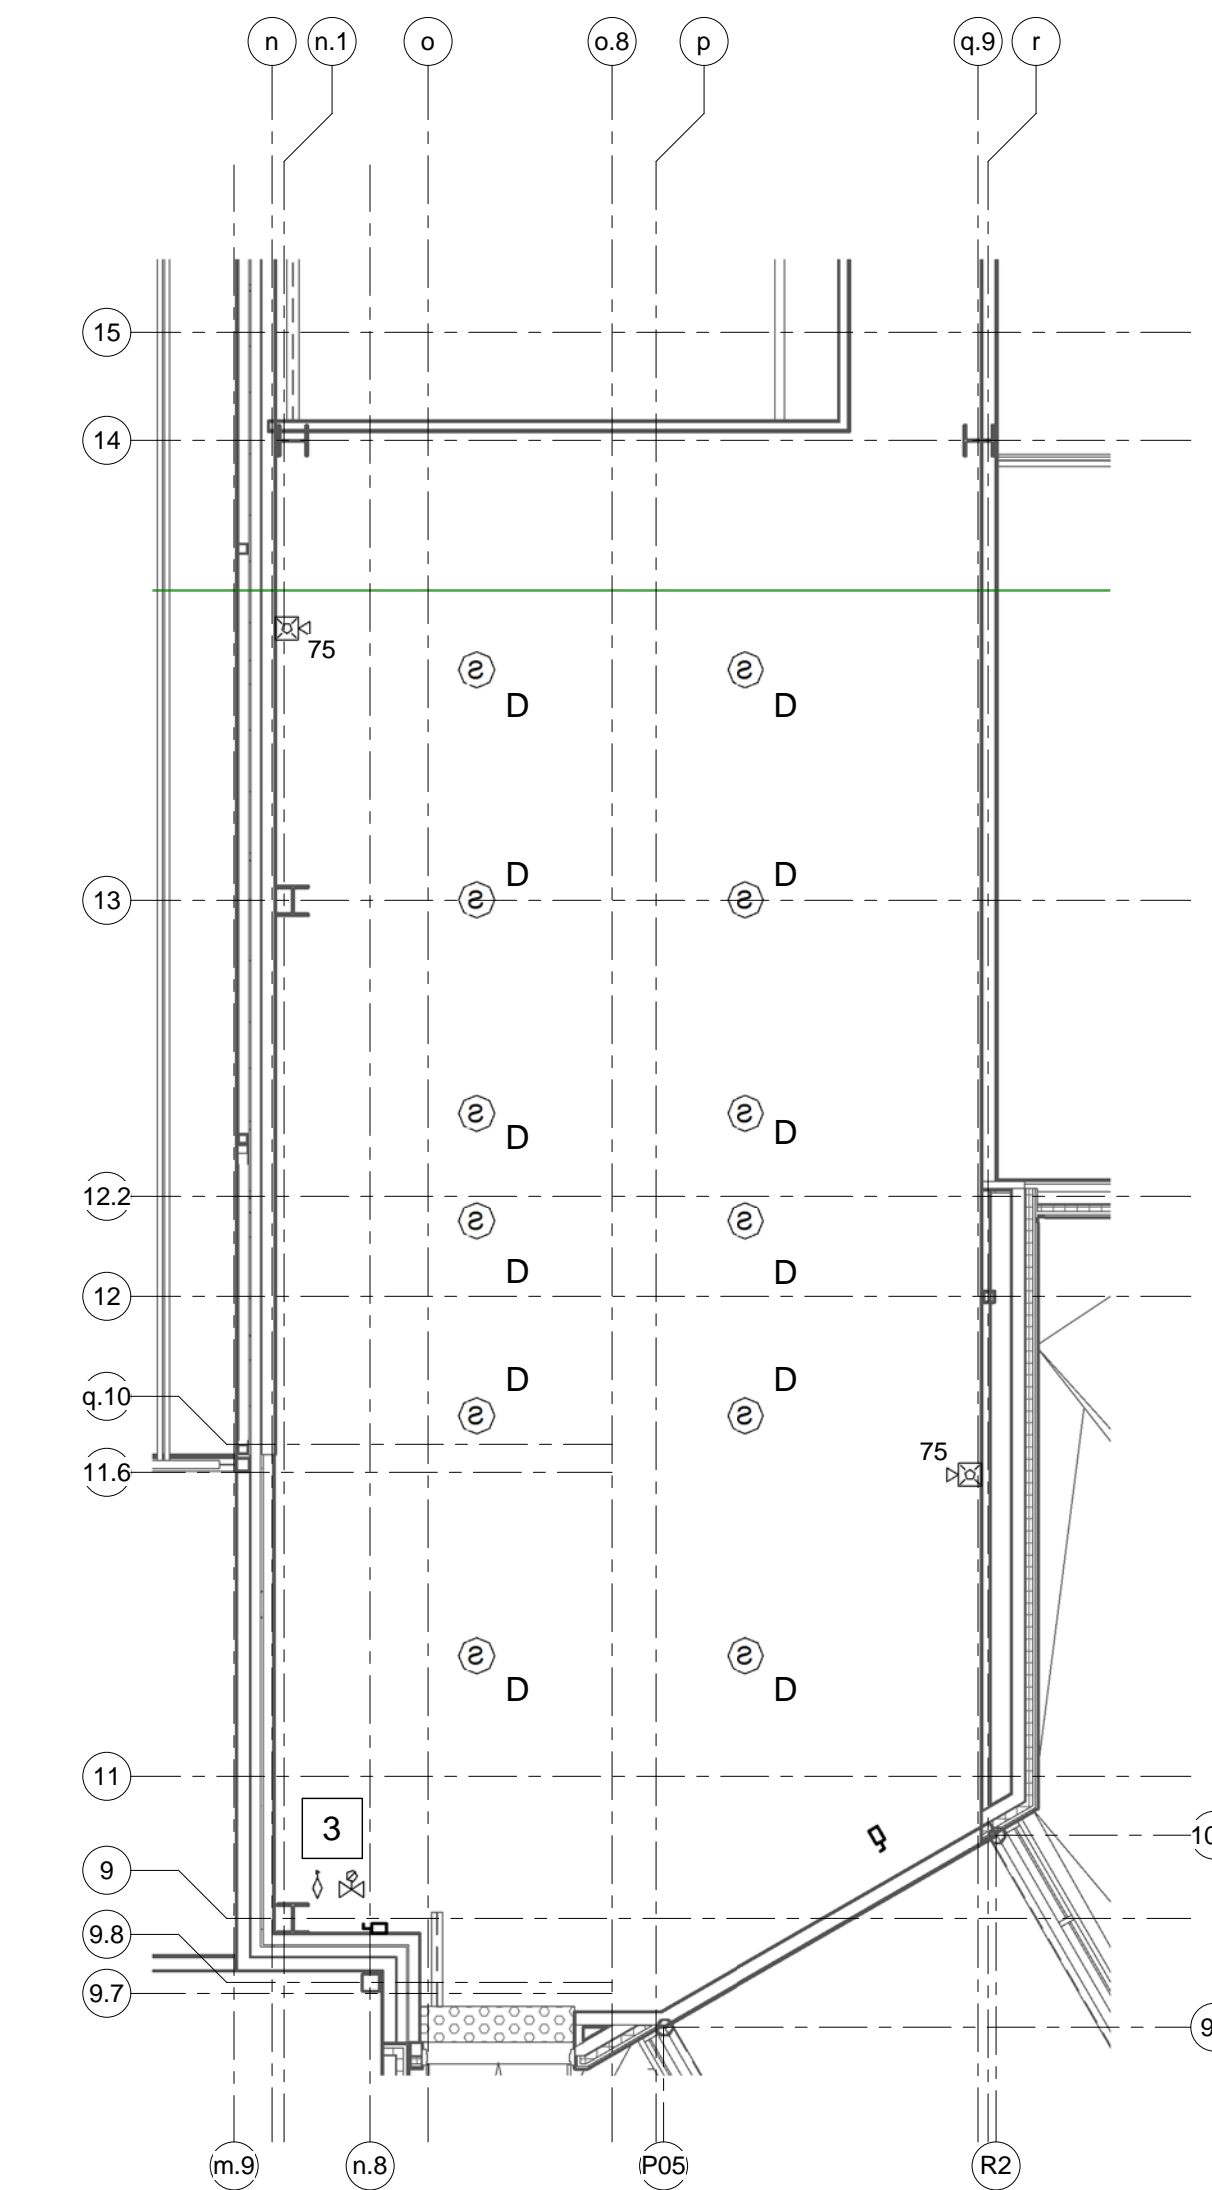

**2 MECHANICAL ROOM FIRE ALARM PART PLAN**  
FA104/ SCALE: 1/8" = 1'-0"

**GRAPHIC SCALE**

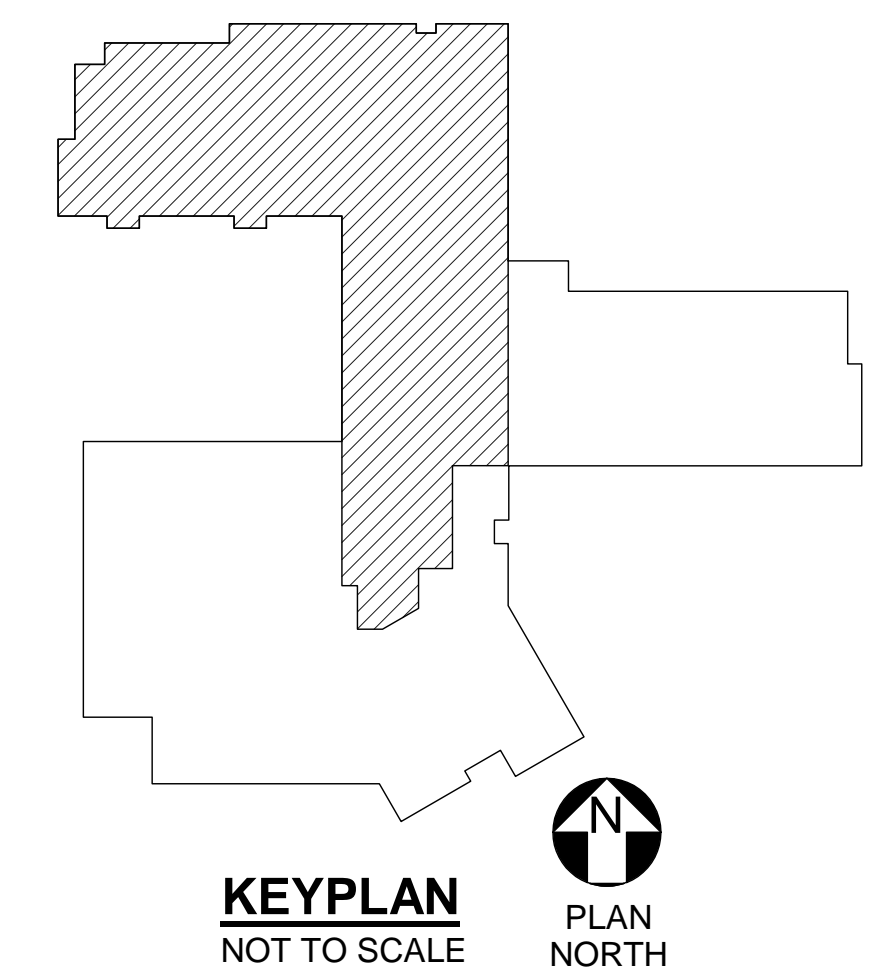

**KEYPLAN**  
NOT TO SCALE



		<b>STATE OF MAINE</b> <b>PUBLIC SCHOOL PROJECT</b> PORTLAND PUBLIC SCHOOLS NEW FRED P. HALL ELEMENTARY SCHOOL LOCATION: 23 ORONO ROAD, PORTLAND, ME TITLE: THIS DWG. SECOND FLOOR FIRE ALARM PART PLAN D	
DRAWN BY: BPD CHECK BY: DCL	DATE: 03/17/17	DRAWING NO.: FA104 SHEET NO.: 311 OF 312	OAK POINT ASSOCIATES ARCHITECTURE • ENGINEERING • PLANNING 231 Main Street, Biddeford, Maine 04005 207.283.9192
NO. DATE DESCRIPTION BY NO.		REVISIONS DATE 03/17/17	