DRAWING NOTES

1. REFER TO M-602 FOR RADIANT MANIFOLD SCHEDULE.
2. INSTALL RADIANT MANIFOLDS ABOVE CEILINGS IN WALL-RECESSED METAL ENCLOSURES.
3. PROVIDE 1/2"-THICK INSULATION ON RADIANT LOOP TUBING BETWEEN MANIFOLDS AND FLOOR SLAB.

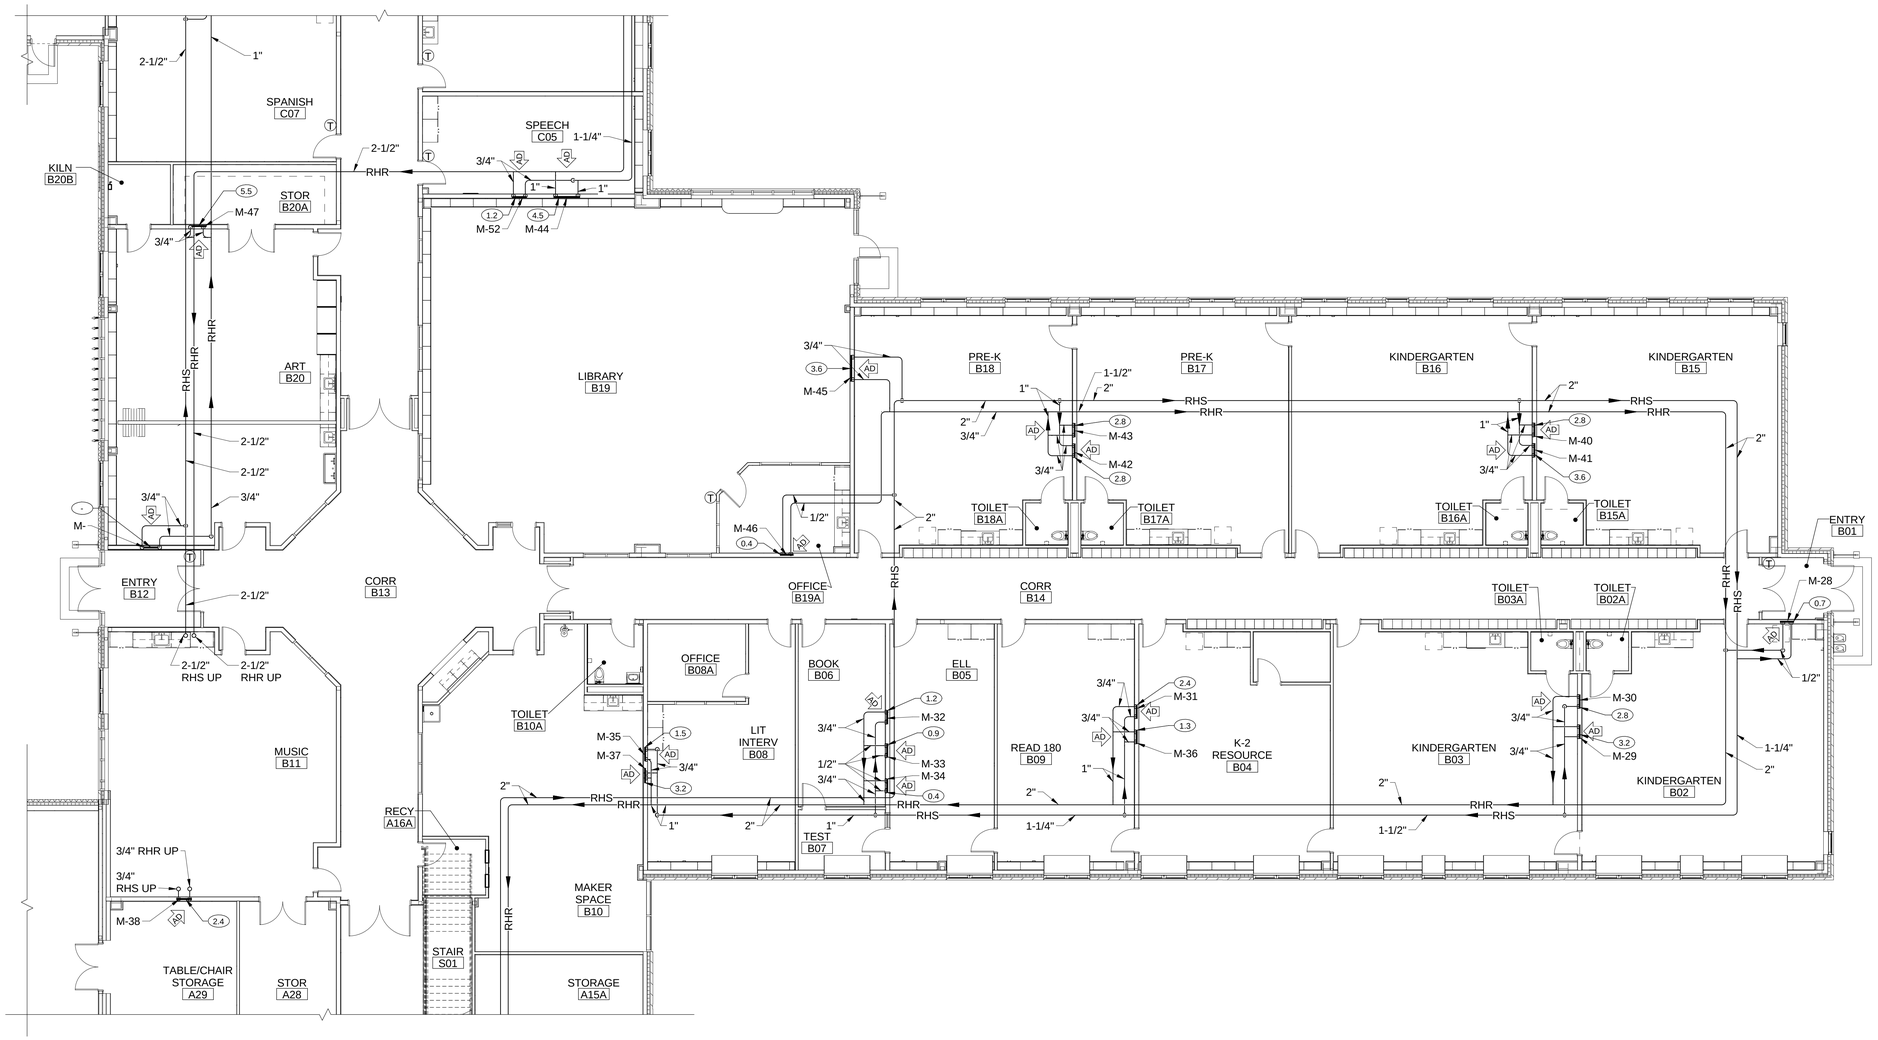

1 FIRST FLOOR MECHANICAL PIPING PART PLAN B
MP102 SCALE: 1/8" = 1'-0"



KEYPLAN
NOT TO SCALE

PLAN NORTH

GRAPHIC SCALE
1/8"=1'-0"
8' 4' 0 8' 16'
CHECK GRAPHIC SCALE BEFORE USING

NO.	DATE	DESCRIPTION	BY
		REVISIONS	

STATE OF MAINE
MATTHEW S. ALBERT
No. 9235
LICENSED
PROFESSIONAL ENGINEER
3-17-17

DRAWN BY: Author
CHECK BY: MSA
NO.
DATE 03/17/17

STATE OF MAINE PUBLIC SCHOOL PROJECT

TITLE: PORTLAND PUBLIC SCHOOLS
NEW FRED P. HALL ELEMENTARY SCHOOL
LOCATION: 23 ORONO ROAD, PORTLAND, ME

TITLE THIS DWG: FIRST FLOOR MECHANICAL PIPING PART PLAN B

OAK POINT ASSOCIATES
231 Main Street, Biddeford, Maine 04005 207.283.0193

DRAWING NO: MP102
SHEET NO: 242 OF 312

3/20/2017 7:47:48 PM
C:\Revit Local\21602.08_HALL SCHOOL_MECHANICAL_V17_RACHESON-EXT211.rvt