



ELECTRICAL PACKAGES

NO	TAG	PACKAGE #	LOCATION	SWITCHES		OPTION	FANS CONTROLLED				
				LOCATION	QUANTITY		TYPE	H.P.	VOLT	FLA	
1	#16control	DCV-2111	Wall Utility Cabinet Right	08 - Ship Loose w/ Prewire	1 Light 1 Fan	Smart Controls DCV	Exhaust	3	2,000	208	8.3
							Exhaust	3	2,000	208	8.3
							Supply	3	5,000	208	15.8

MOTOR HORSEPOWERS, VOLTAGE, AND FLA RATINGS TO BE CONFIRMED PRIOR ORDERING.

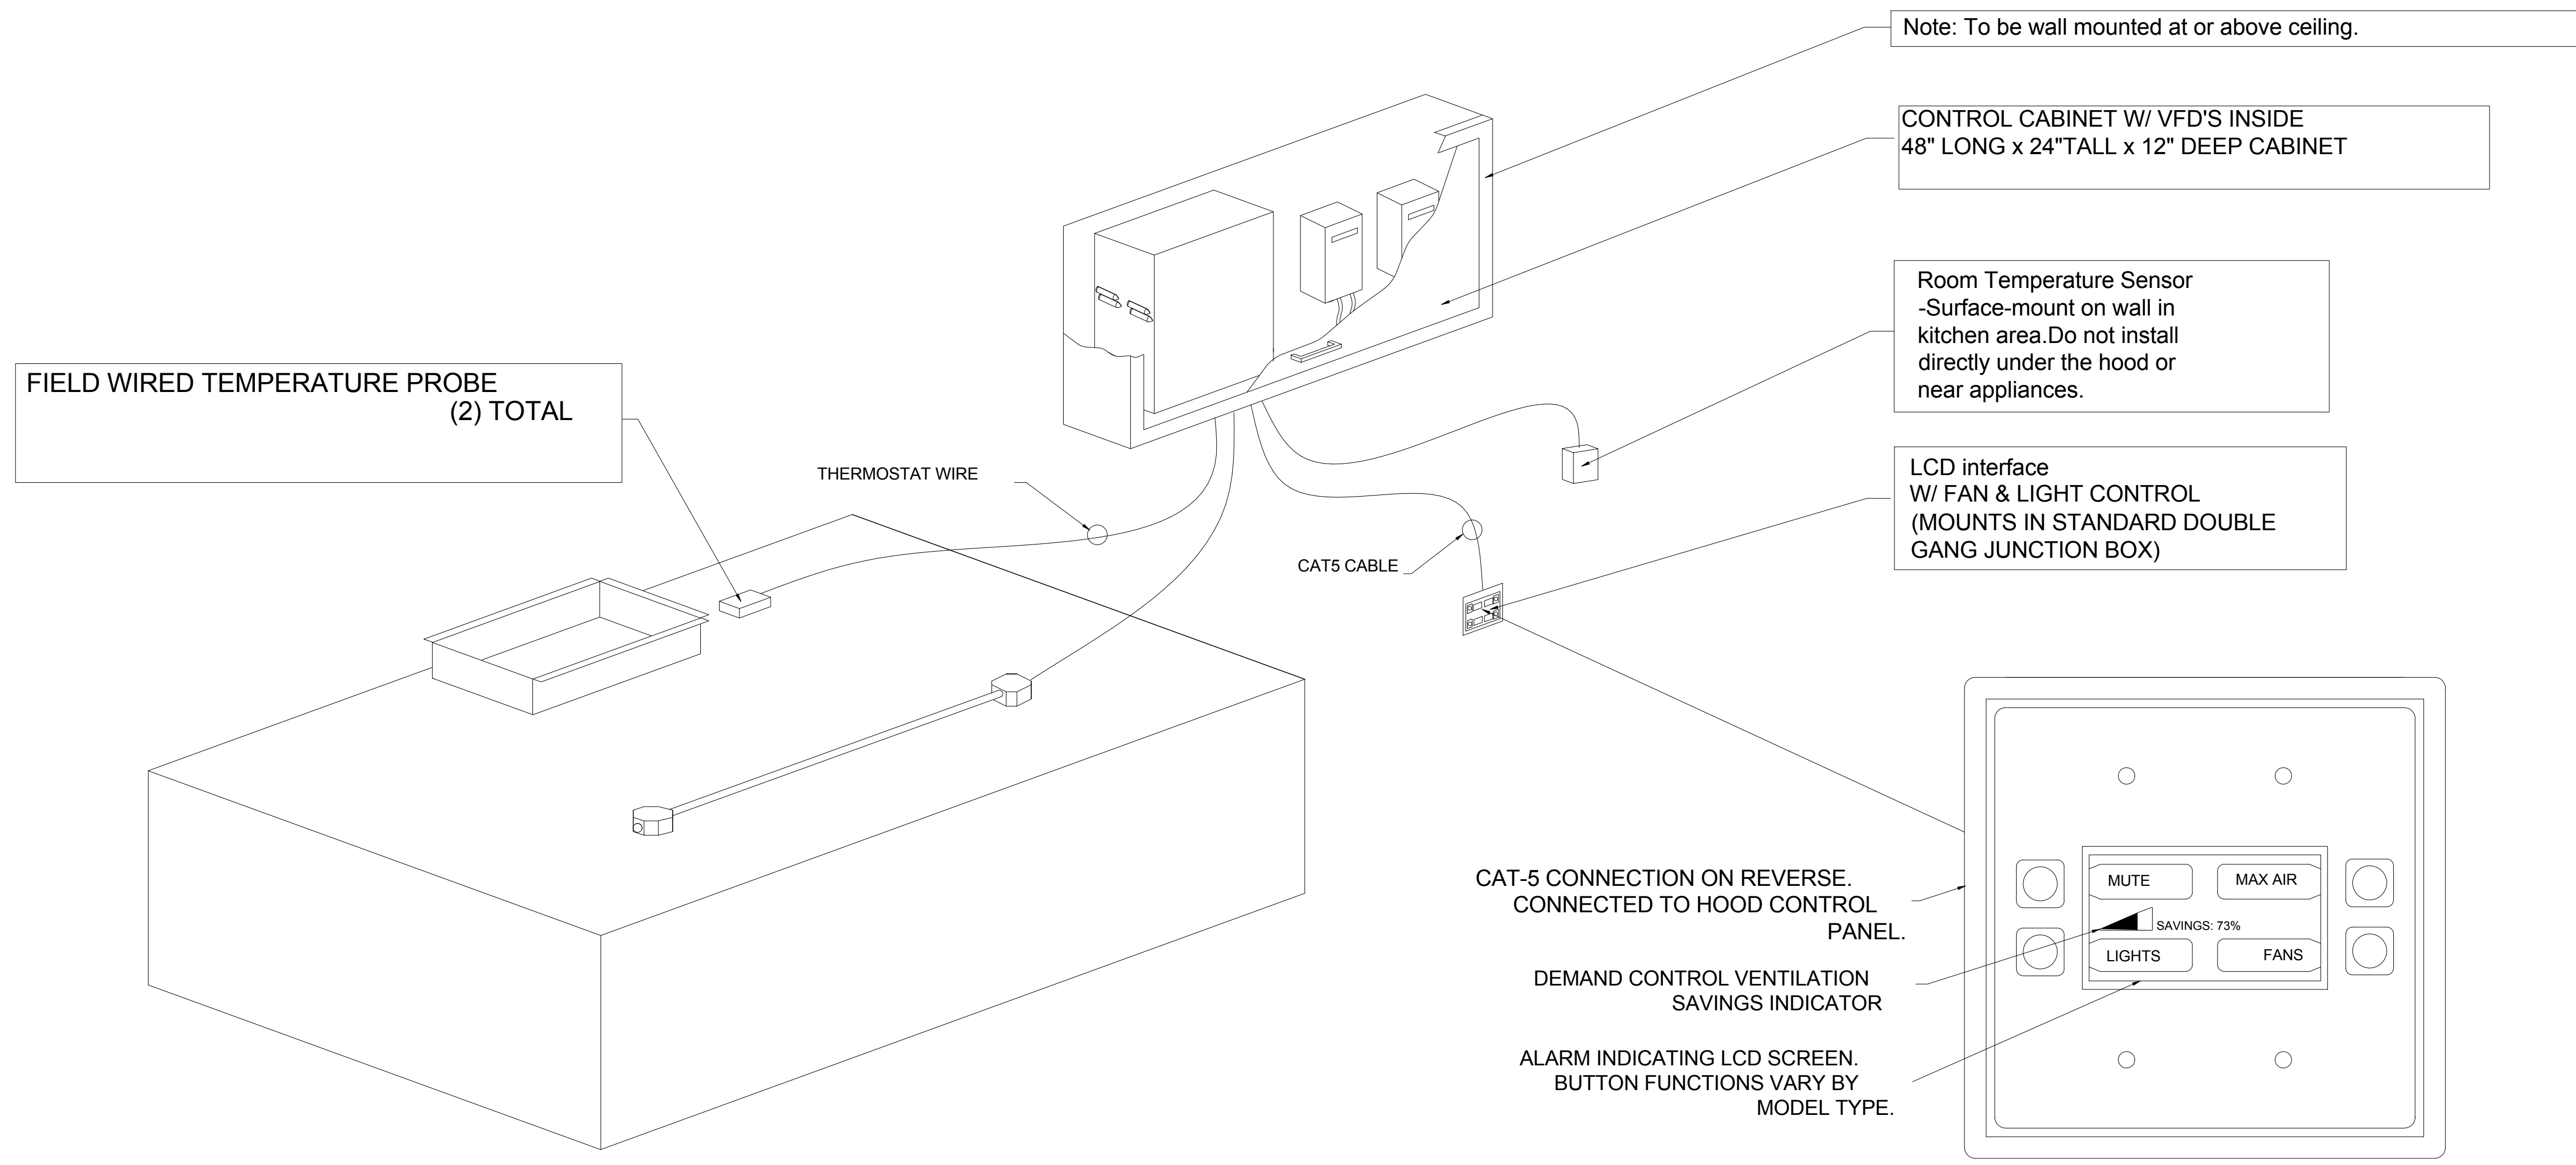

TYPICAL DCKV SYSTEM INSTALLATION

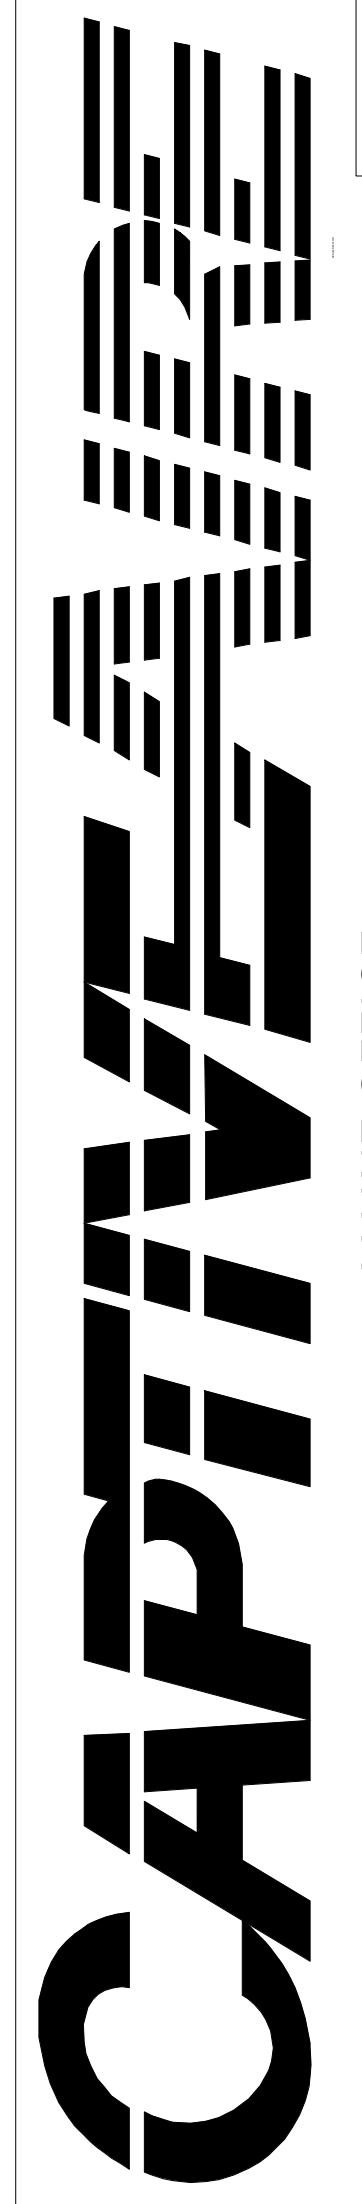

MAINE OFFICE
PO Box 86, 179 South Rd., Topshfield, ME 04489 PHONE: (919) 227-5946 EMAIL: reg2@captiveware.com

Hall Elementary School - Portland
23 Orono Rd.,
PORTLAND, ME, 04102

12/22/2016
2870227
BFC-21
3/4" = 1'-0"
MASTER DRAWING
6

STATE OF MAINE PUBLIC SCHOOL PROJECT	
TITLE PORTLAND PUBLIC SCHOOLS NEW FRED P. HALL ELEMENTARY SCHOOL	
LOCATION 23 ORONO ROAD, PORTLAND, ME	
TITLE THIS DWG. FOODSERVICE EQUIPMENT EXHAUST HOOD DETAILS 5	
DRAWN BY: TJM	DRAWING NO. Q-112
CHECK BY: TJM	SHEET NO. 229 OF 312
NO. DATE DESCRIPTION BY NO.	DATE 03/17/17
REVISIONS	