

LOCATE REINFORCING BARS WITH 3" CLEAR COVER FROM BOTTOM OF SPACE REINFORCING BARS EVENLY, TIED IN MATS, WITH SPECIFIED NUMBER OF BARS RUNNING EACH WAY.

NOTES:

SEE DRAWING SN.O FOR GENERAL NOTES AND INSPECTIONS.

- I. SEE CIVIL DRAWINGS FOR LOCATIONS AND CONSTRUCTION DETAILS OF EXTERIOR CONCRETE PADS, RAMPS, AND WALKWAYS IF APPLICABLE.
- 4. GENERAL CONTRACTOR SHALL COORDINATE UNDERSLAB UTILITIES AND FOUNDATION DRAINS.
- 5. FOUNDATION CONTRACTOR SHALL FINISH TOP OF FOUNDATION WALL SMOOTH AND LEVEL.
- 6. BACKFILL BOTH SIDES OF FOUNDATION WALLS WITH COMPACTED STRUCTURAL FILL.

REFER TO GEOTECHNICAL ENGINEER'S REPORT FOR ALL INFORMATION REGARDING SOILS, EXCAVATION, BACKFILL, SUBGRADE PREPARATION, ETC. SEE REPORT BY KMM GEOTECHNICAL CONSULTANTS, LLC. DATED NOVEMBER 4, 2013.


NOTE - ALL FILL AND ORGANICS MUST BE REMOVED FROM SITE AS NOTED IN GEOTECHNICAL REPORT. IT IS NOTED IN THE REPORT THAT THERE IS APPROXIMATELY 5' - 9' OF FILL REQUIRING REMOVAL.

BRICK CHAIRS AS MINIMUM T/4 -- CONCRETE SLAB SLAB THICKNESS \times -X---X---X-


WELDED WIRE MESH AT SLAB MID-DEPTH



S1.1 Scale: 3/4'' = 1'0''

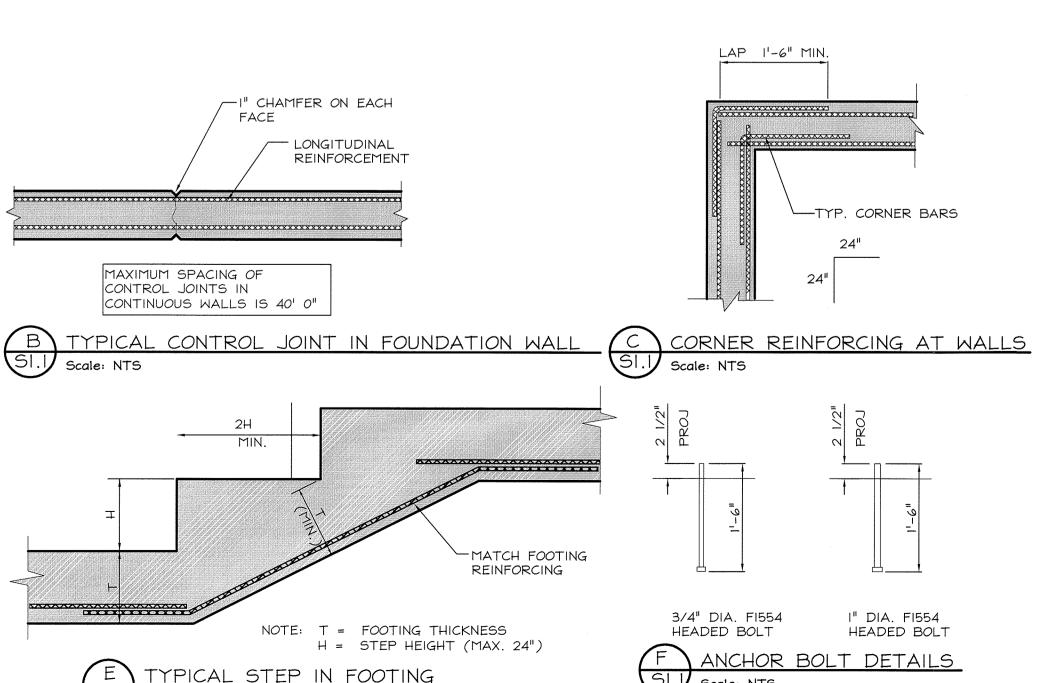

Scale: NTS

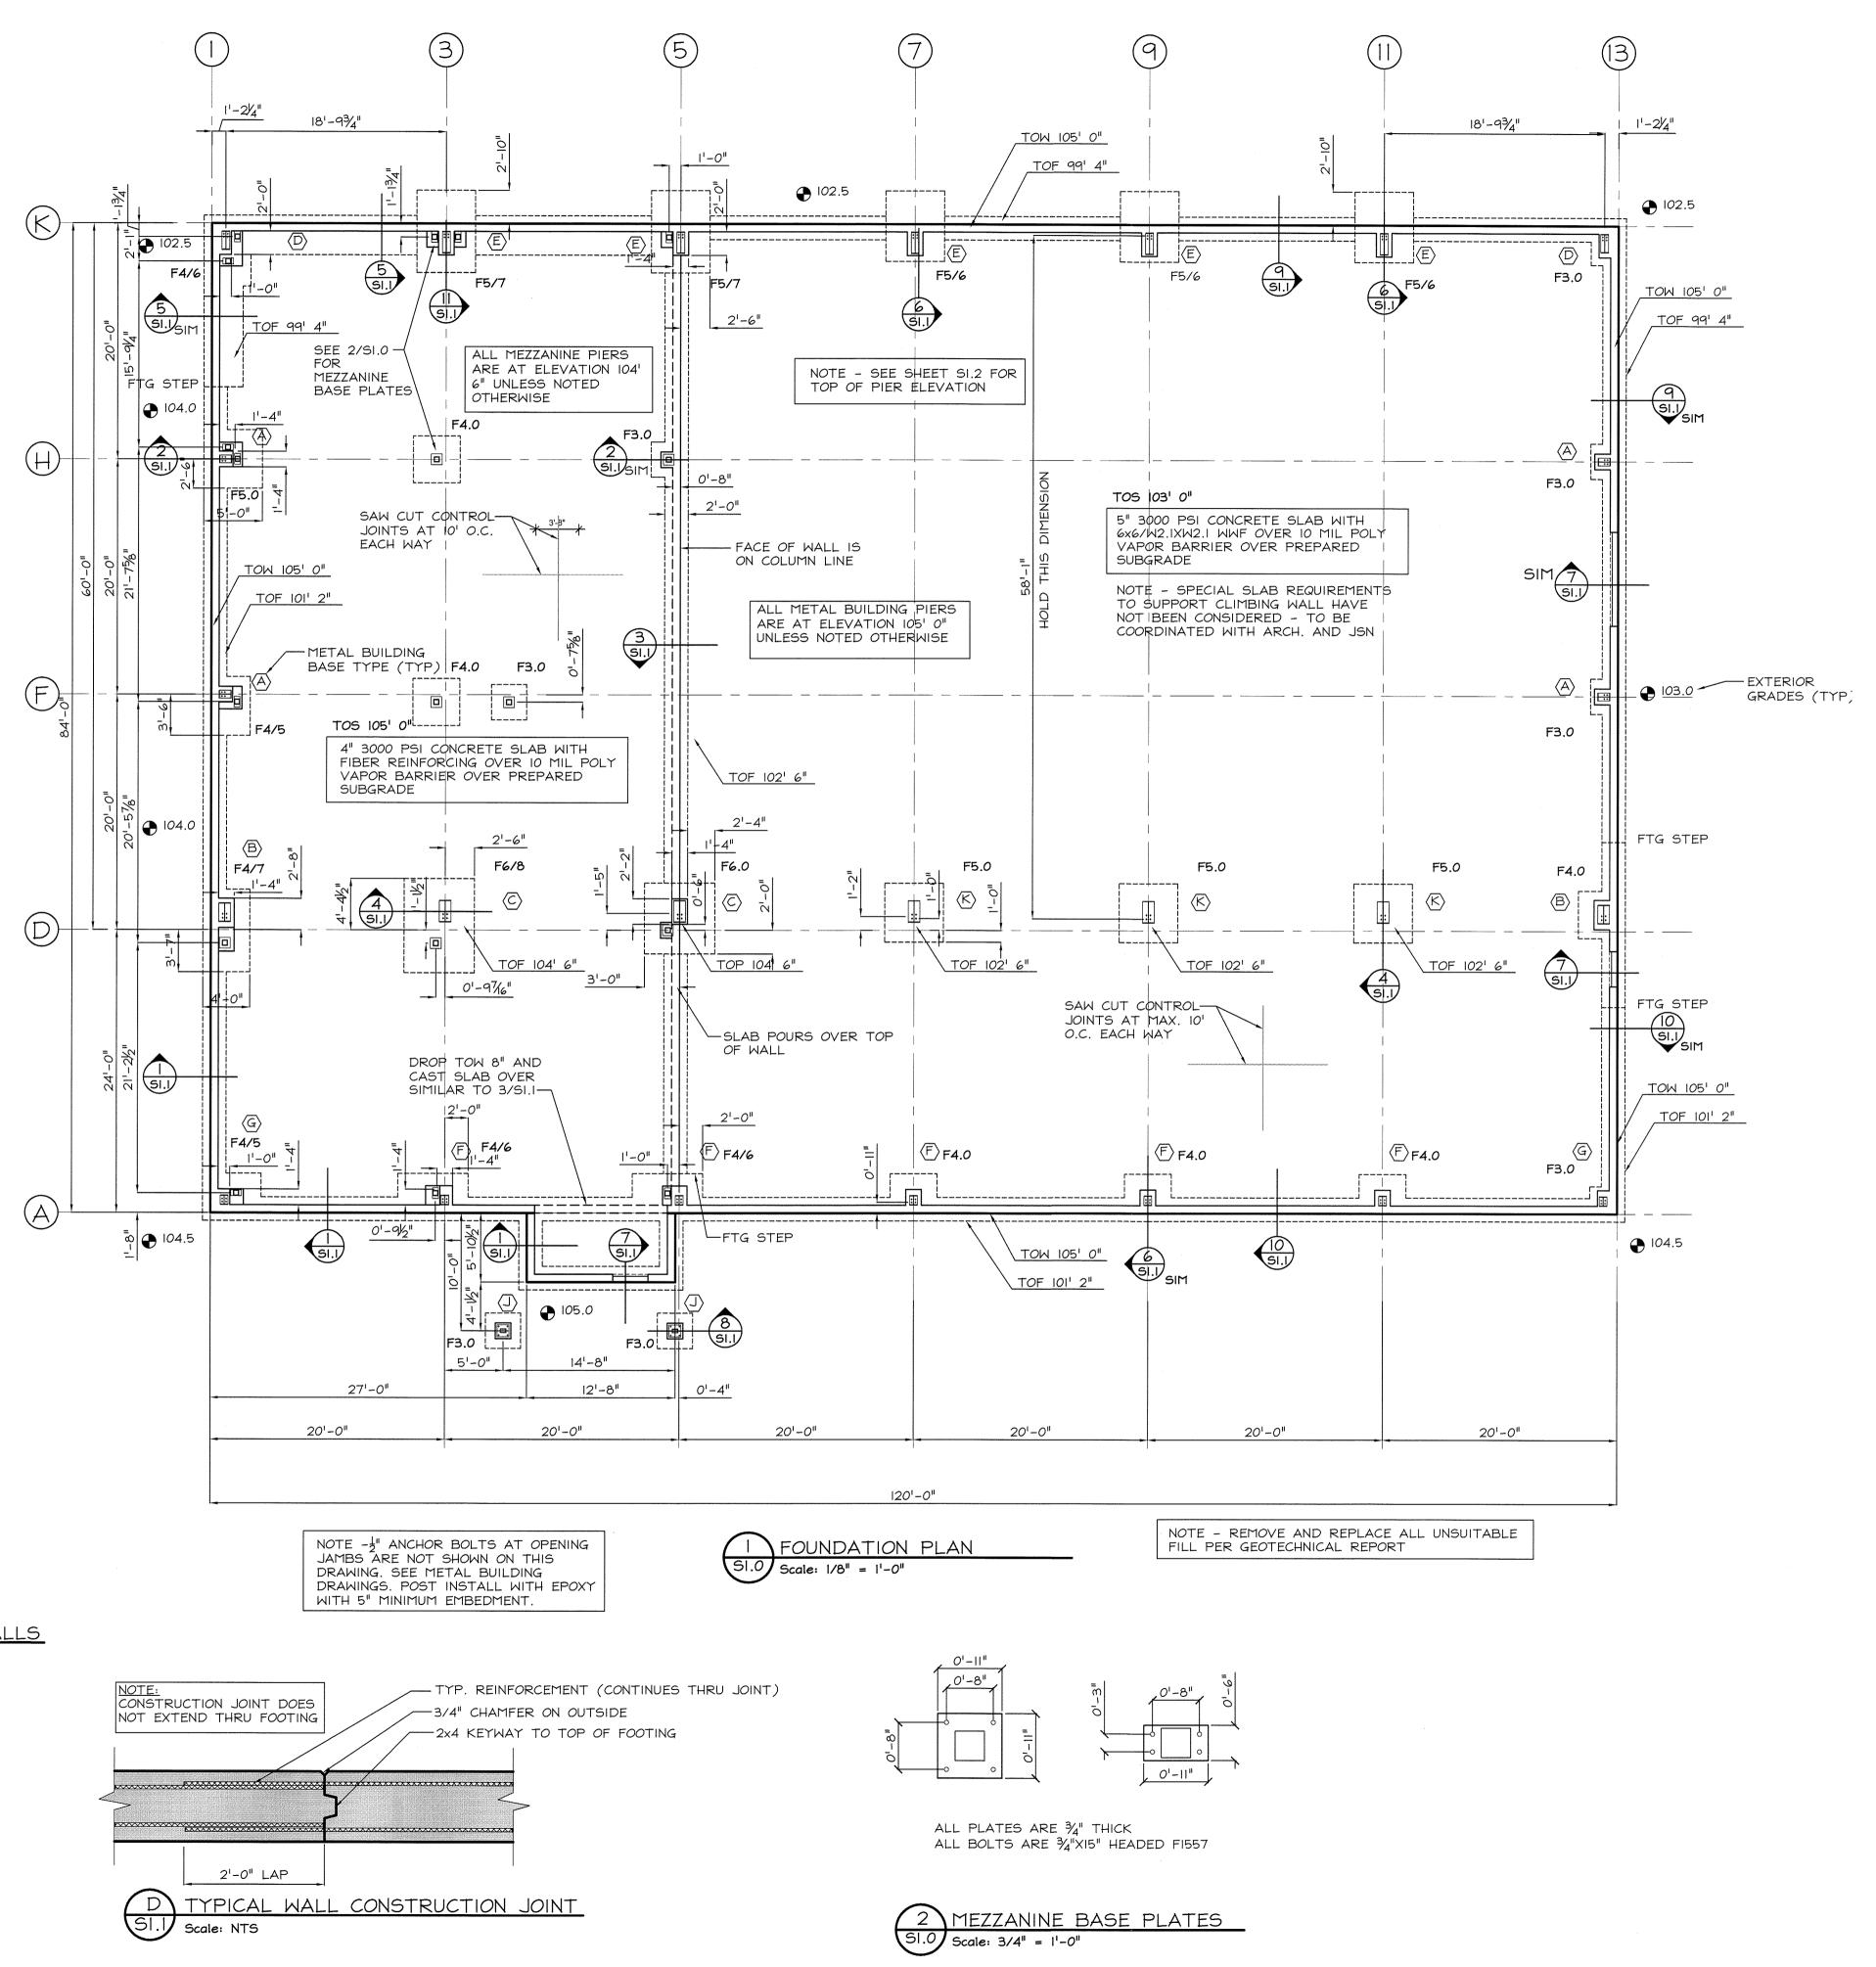




Consulting Structural Engineers One Autumn Street Portsmouth, NH 03801 (603) 433 - 8639 Fax: (603) 431 - 2811 www.jsneng.com

Evolution Rock & Fitness

> 65 Warren Ave. Portland, Maine



Date: 04/09/14 Scale: As Noted By: JSN

Revisions

Foundation Plan

Project No: 131015