

City of Portland, Maine – Building or Use Permit Application 389 Congress Street, 04101, Tel: (207) 874-8703, FAX: 874-8716

Location of Construction: 11 Bishop St		Owner: Burgess, James		Phone:		Permit No: 970844	
Owner Address:		Lessee/Buyer's Name: Spanky's Pizza, Inc. P.O. Box 189 Unity, ME 04988		Phone:		Business Name:	
Contractor Name:		Address:		Phone: 948-5961/Philip		Permit Issued: AUG - 5 1997	
Past Use: Retail		Proposed Use: Restaurant Pizza take out no searing		COST OF WORK: \$ 6,000.000		PERMIT FEE: \$ 50.00	
Proposed Project Description: Change Use/make Interior Renovations		FIRE DEPT. <input checked="" type="checkbox"/> Approved <input type="checkbox"/> Denied		INSPECTION: Use Group: Type:		Zone: CBL: B-2 293-A-007	
		Signature: <i>[Signature]</i>		Signature:		Zoning Approval: ok - Sep. permit Special Zone or Reviews: <input type="checkbox"/> Shoreland Reg. for <input type="checkbox"/> Wetland Signage <input type="checkbox"/> Flood Zone <input type="checkbox"/> Subdivision <input type="checkbox"/> Site Plan maj <input type="checkbox"/> minor <input type="checkbox"/> mm <input type="checkbox"/>	
PEDESTRIAN ACTIVITIES DISTRICT (P.A.D.)		Action: <input type="checkbox"/> Approved <input type="checkbox"/> Approved with Conditions <input type="checkbox"/> Denied		Signature: _____ Date: _____		Zoning Appeal <input type="checkbox"/> Variance <input type="checkbox"/> Miscellaneous <input type="checkbox"/> Conditional Use <input type="checkbox"/> Interpretation <input type="checkbox"/> Approved <input type="checkbox"/> Denied	
Permit Taken By: Mary Gresik		Date Applied For: 28 July 1997		Historic Preservation <input checked="" type="checkbox"/> Not in District or Landmark <input checked="" type="checkbox"/> Does Not Require Review <input type="checkbox"/> Requires Review		Action: <input type="checkbox"/> Approved <input type="checkbox"/> Approved with Conditions <input type="checkbox"/> Denied Date: 7/28/97 <i>[Signature]</i>	

CERTIFICATION

I hereby certify that I am the owner of record of the named property, or that the proposed work is authorized by the owner of record and that I have been authorized by the owner to make this application as his authorized agent and I agree to conform to all applicable laws of this jurisdiction. In addition, if a permit for work described in the application is issued, I certify that the code official's authorized representative shall have the authority to enter all areas covered by such permit at any reasonable hour to enforce the provisions of the code(s) applicable to such permit

SIGNATURE OF APPLICANT *Philip Nadeau* ADDRESS: _____ DATE: 28 July 1997 PHONE: _____

RESPONSIBLE PERSON IN CHARGE OF WORK, TITLE _____ PHONE: _____

White-Permit Desk Green-Assessor's Canary-D.P.W. Pink-Public File Ivory Card-Inspector

CEO DISTRICT *[Signature]*
A. Powers

City of Portland, Maine – Building or Use Permit Application 389 Congress Street, 04101, Tel: (207) 874-8703, FAX: 874-8716

Location of Construction: 11 Bishop St		Owner: Burgess, James		Phone:	Permit No: 970844
Owner Address:		Lessee/Buyer's Name: Spanky's Pizza, Inc. P.O. Box 189 Unity, ME 04988		Phone:	<div style="border: 2px solid black; padding: 5px; text-align: center;"> PERMIT ISSUED Permit Issued: AUG - 5 1997 CITY OF PORTLAND </div>
Contractor Name:		Address:		Phone: 948-5961/Phillip	
Past Use: Retail	Proposed Use: Restaurant Pizza take out MODERATE		COST OF WORK: \$ 6,000.000	PERMIT FEE: \$ 50.00	Zoning Approval: Zone: B-2 CBL: 293-A-007 Special Zone or Reviews: <input type="checkbox"/> Shoreland <input type="checkbox"/> Wetland <input type="checkbox"/> Flood Zone <input type="checkbox"/> Subdivision <input type="checkbox"/> Site Plan maj <input type="checkbox"/> minor <input type="checkbox"/> mm <input type="checkbox"/>
Proposed Project Description: Change Use/make Interior Renovations		FIRE DEPT. <input checked="" type="checkbox"/> Approved <input type="checkbox"/> Denied Signature: [Signature]		INSPECTION: Use Group: Type: Signature:	
		PEDESTRIAN ACTIVITIES DISTRICT (P.A.D.) Action: <input type="checkbox"/> Approved <input type="checkbox"/> Approved with Conditions <input type="checkbox"/> Denied Signature: Date:			
Permit Taken By: Mary Gresik		Date Applied For: 28 July 1998			

1. This permit application does not preclude the Applicant(s) from meeting applicable State and Federal rules.
2. Building permits do not include plumbing, septic or electrical work.
3. Building permits are void if work is not started within six (6) months of the date of issuance. False information may invalidate a building permit and stop all work..

Spanky's Pizza 878-6789

CERTIFICATION

I hereby certify that I am the owner of record of the named property, or that the proposed work is authorized by the owner of record and that I have been authorized by the owner to make this application as his authorized agent and I agree to conform to all applicable laws of this jurisdiction. In addition, if a permit for work described in the application is issued, I certify that the code official's authorized representative shall have the authority to enter all areas covered by such permit at any reasonable hour to enforce the provisions of the code(s) applicable to such permit

SIGNATURE OF APPLICANT **Philip Hadeau** ADDRESS: DATE: **28 July 1997** PHONE:

RESPONSIBLE PERSON IN CHARGE OF WORK, TITLE PHONE:

White-Permit Desk Green-Assessor's Canary-D.P.W. Pink-Public File Ivory Card-Inspector

Zoning Appeal

Variance
 Miscellaneous
 Conditional Use
 Interpretation
 Approved
 Denied

Historic Preservation

Not in District or Landmark
 Does Not Require Review
 Requires Review

Action:
 Approved
 Approved with Conditions
 Denied

Date:

CEO DISTRICT 4

COMMENTS

8-7-97

Received revised floor plan from Mr. Maden. Has planned to remove one non-load bearing wall. Have disclosed the need for a separate signage permit if necessary. He may use the existing. Will start on interior finishes. Call call for inspection when ready.

8-26-97 Minor punchlist prior to opening. Scribner & Luerxson on site. St. Mac all set.

Replacing hot water tanks, adding misc. grease trap & sink. Obtained permit.

9-2-97 Final inspection prior to opening. OK to occupy and open.

Inspection Record

Type	Date
Foundation: _____	_____
Framing: _____	_____
Plumbing: _____	_____
Final: _____	_____
Other: _____	_____



CITY OF PORTLAND, MAINE
Department of Building Inspection

Certificate of Occupancy

LOCATION 11 Bishop St

Issued to James Burgess

Date of Issue 02 September 1997

This is to certify that the building, premises, or part thereof, at the above location, built — altered — changed as to use under Building Permit No. 970844, has had final inspection, has been found to conform substantially to requirements of Zoning Ordinance and Building Code of the City, and is hereby approved for occupancy or use, limited or otherwise, as indicated below.

PORTION OF BUILDING OR PREMISES

APPROVED OCCUPANCY

Entire (First Floor)

Pizza Take Out

Limiting Conditions:

This certificate supersedes
certificate issued

Approved:

12-97

(Date)


Inspector

Inspector of Buildings

Notice: This certificate identifies lawful use of building or premises, and ought to be transferred from owner to owner when property changes hands. Copy will be furnished to owner or lessee for one dollar.

Handwritten initials

①

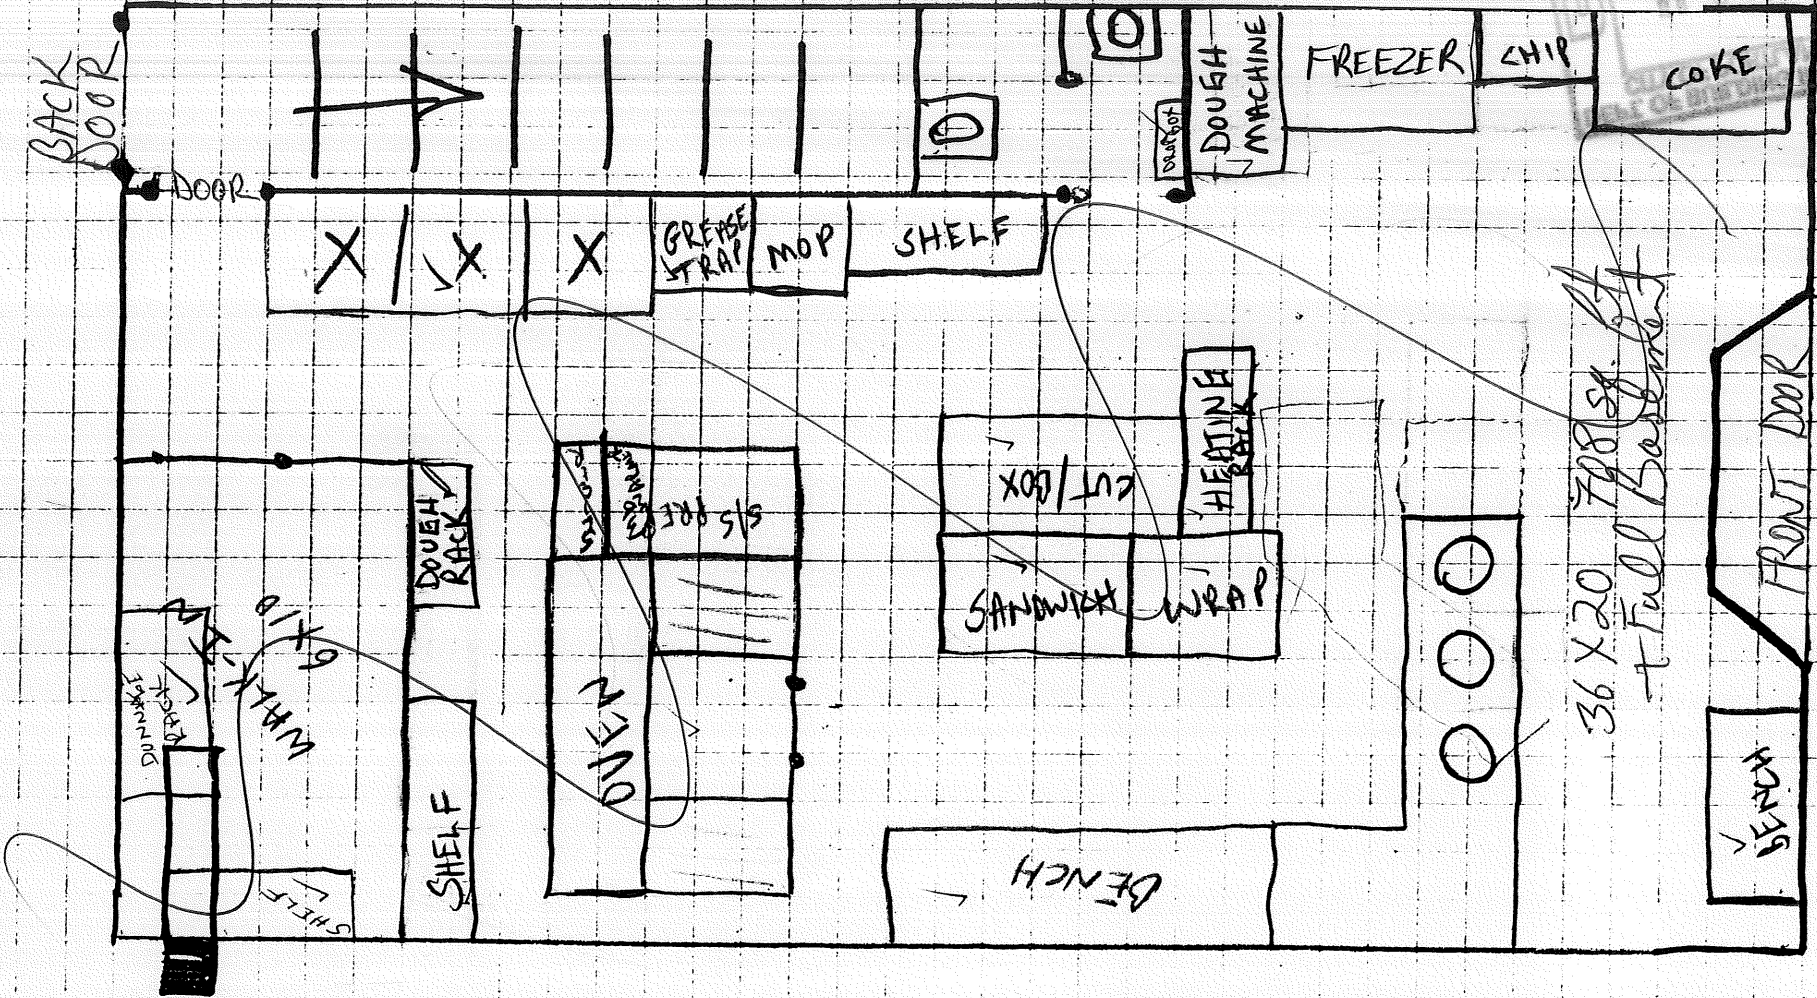

1 sq = 1' 10"

BUILDING PERMIT REPORT

DATE: 8/4/97 ADDRESS: 11 Bishop St
REASON FOR PERMIT: change of use
BUILDING OWNER: James Burgess
CONTRACTOR: _____
PERMIT APPLICANT: Philip Nadon APPROVAL: *1/*14/*17*20*24*27 ~~DENIED~~



CONDITION(S) OF APPROVAL

1. This permit does not excuse the applicant from meeting applicable State and Federal rules and laws.
2. Before concrete for foundation is placed, approvals from the Development Review Coordinator and Inspection Services must be obtained. (A 24 hour notice is required prior to inspection)
3. Precaution must be taken to protect concrete from freezing.
4. It is strongly recommended that a registered land surveyor check all foundation forms before concrete is placed. This is done to verify that the proper setbacks are maintained.
5. Private garages located beneath habitable rooms in occupancies in Use Group R-1, R-2, R-3 or I-1 shall be separated from adjacent interior spaces by fire partitions and floor/ceiling assembly which are constructed with not less than 1-hour fire resisting rating. Private garages attached side-by-side to rooms in the above occupancies shall be completely separated from the interior spaces and the attic area by means of 1/2 inch gypsum board or the equivalent applied to the garage means of 1/2 inch gypsum board or the equivalent applied to the garage side. (Chapter 4 Section 407.0 of the BOCA/1996)
6. All chimneys and vents shall be installed and maintained as per Chapter 12 of the City's Mechanical Code. (The BOCA National Mechanical Code/1993) U.L. 103.
7. Sound transmission control in residential building shall be done in accordance with Chapter 12 section 1214.0 of the city's building code.
8. Guardrail & Handrails A guardrail system is a system of building components located near the open sides of elevated walking surfaces for the purpose of minimizing the possibility of an accidental fall from the walking surface to the lower level. Minimum height all Use Groups 42" , except Use Group R which is 36". In occupancies in Use Group A, B, H-4, I-1, I-2 M and R and public garages and open parking structures, open guards shall have balusters or be of solid material such that a sphere with a diameter of 4" cannot pass through any opening. Guards shall not have an ornamental pattern that would provide a ladder effect.
9. Headroom in habitable space is a minimum of 7'6".
10. Stair construction in Use Group R-3 & R-4 is a minimum of 10" tread and 7 3/4" maximum rise. All other Use group minimum 11" tread. 7" maximum rise.
11. The minimum headroom in all parts of a stairway shall not be less than 80 inches.
12. Every sleeping room below the fourth story in buildings of use Groups R and I-1 shall have at least one operable window or exterior door approved for emergency egress or rescue. The units must be operable from the inside without the use of special knowledge or separate tools. Where windows are provided as means of egress or rescue they shall have a sill height not more than 44 inches (1118mm) above the floor. All egress or rescue windows from sleeping rooms shall have a minimum net clear opening height dimension of 24 inches (610mm). The minimum net clear opening width dimension shall be 20 inches (508mm), and a minimum net clear opening of 5.7 sq. ft.
13. Each apartment shall have access to two (2) separate, remote and approved means of egress. A single exit is acceptable when it exits directly from the apartment to the building exterior with no communications to other apartment units.
14. All vertical openings shall be enclosed with construction having a fire rating of at least one (1)hour, including fire doors with self closer's.
15. The boiler shall be protected by enclosing with (1) hour fire-rated construction including fire doors and ceiling, or by providing automatic extinguishment.
16. All single and multiple station smoke detectors shall be of an approved type and shall be installed in accordance with the provisions of the City's Building Code Chapter 9, Section 19, 920-3.2 (BOCA National Building Code/1996), and NFPA 101 Chapter 18 & 19. (Smoke detectors shall be installed and maintained at the following locations):
 - In the immediate vicinity of bedrooms
 - In all bedrooms
 - In each story within a dwelling unit, including basements

In addition to the required AC primary power source, required smoke detectors in occupancies in Use Groups R-2, R-3 and

I-1 shall receive power from a battery when the AC primary power source is interrupted. (Interconnection is required)

- 17. A portable fire extinguisher shall be located as per NFPA #10. They shall bear the label of an approved agency and be of an approved type. (2)
- 18. The Fire Alarm System shall be maintained to NFPA #72 Standard.
- 19. The Sprinkler System shall maintained to NFPA #13 Standard.
- 20. All exit signs, lights, and means of egress lighting shall be done in accordance with Chapter 10 Section & Subsections 1023. & 1024. Of the City's building code. (The BOCA National Building Code/1996)
- 21. All construction and demolition debris must be disposed at the City's authorized reclamation site. The fee rate is attached. Proof of such disposal must be furnished to the office of Inspection Services before final Certificate of Occupancy is issued or demolition permit is granted.
- 22. Section 25-135 of the Municipal Code for the City of Portland states, "No person or utility shall be granted a permit to excavate or open any street or sidewalk from the time of November 15 of each year to April 15 of the following year".
- 23. The builder of a facility to which Section 4594-C of the Maine State Human Rights Act Title 5 MRSA refers, shall obtain a certification from a design professional that the plans commencing construction of the facility, the builder shall submit the certification to the Division of Inspection Services.
- 24. This permit does not excuse the applicant from obtaining any license which may be needed from the City Clerk's office.
- 25. Ventilation shall meet the requirements of Chapter 12 Sections 1210. of the City's Building Code.
- 26. All electrical and plumbing permits must be obtained by a Master Licensed holders of their trade.
- 27. Food Service Equipment must be installed as per The City's Mechanical Code
- 28.
- 29.


P. Samuel Higgins, Chief of Code Enforcement
cc: Lt. McDougall, PFD
Marge Schmuckal


948-3331

SS switch for bath

X Outlets

(X) 220 Outlets

SS Switch

FS FAN Switch


X Outside Light Switches

26 Outlets & Switches

(L) Overhead Lights

Mirrored
8'11" x 8'11" all
around

Outside Light

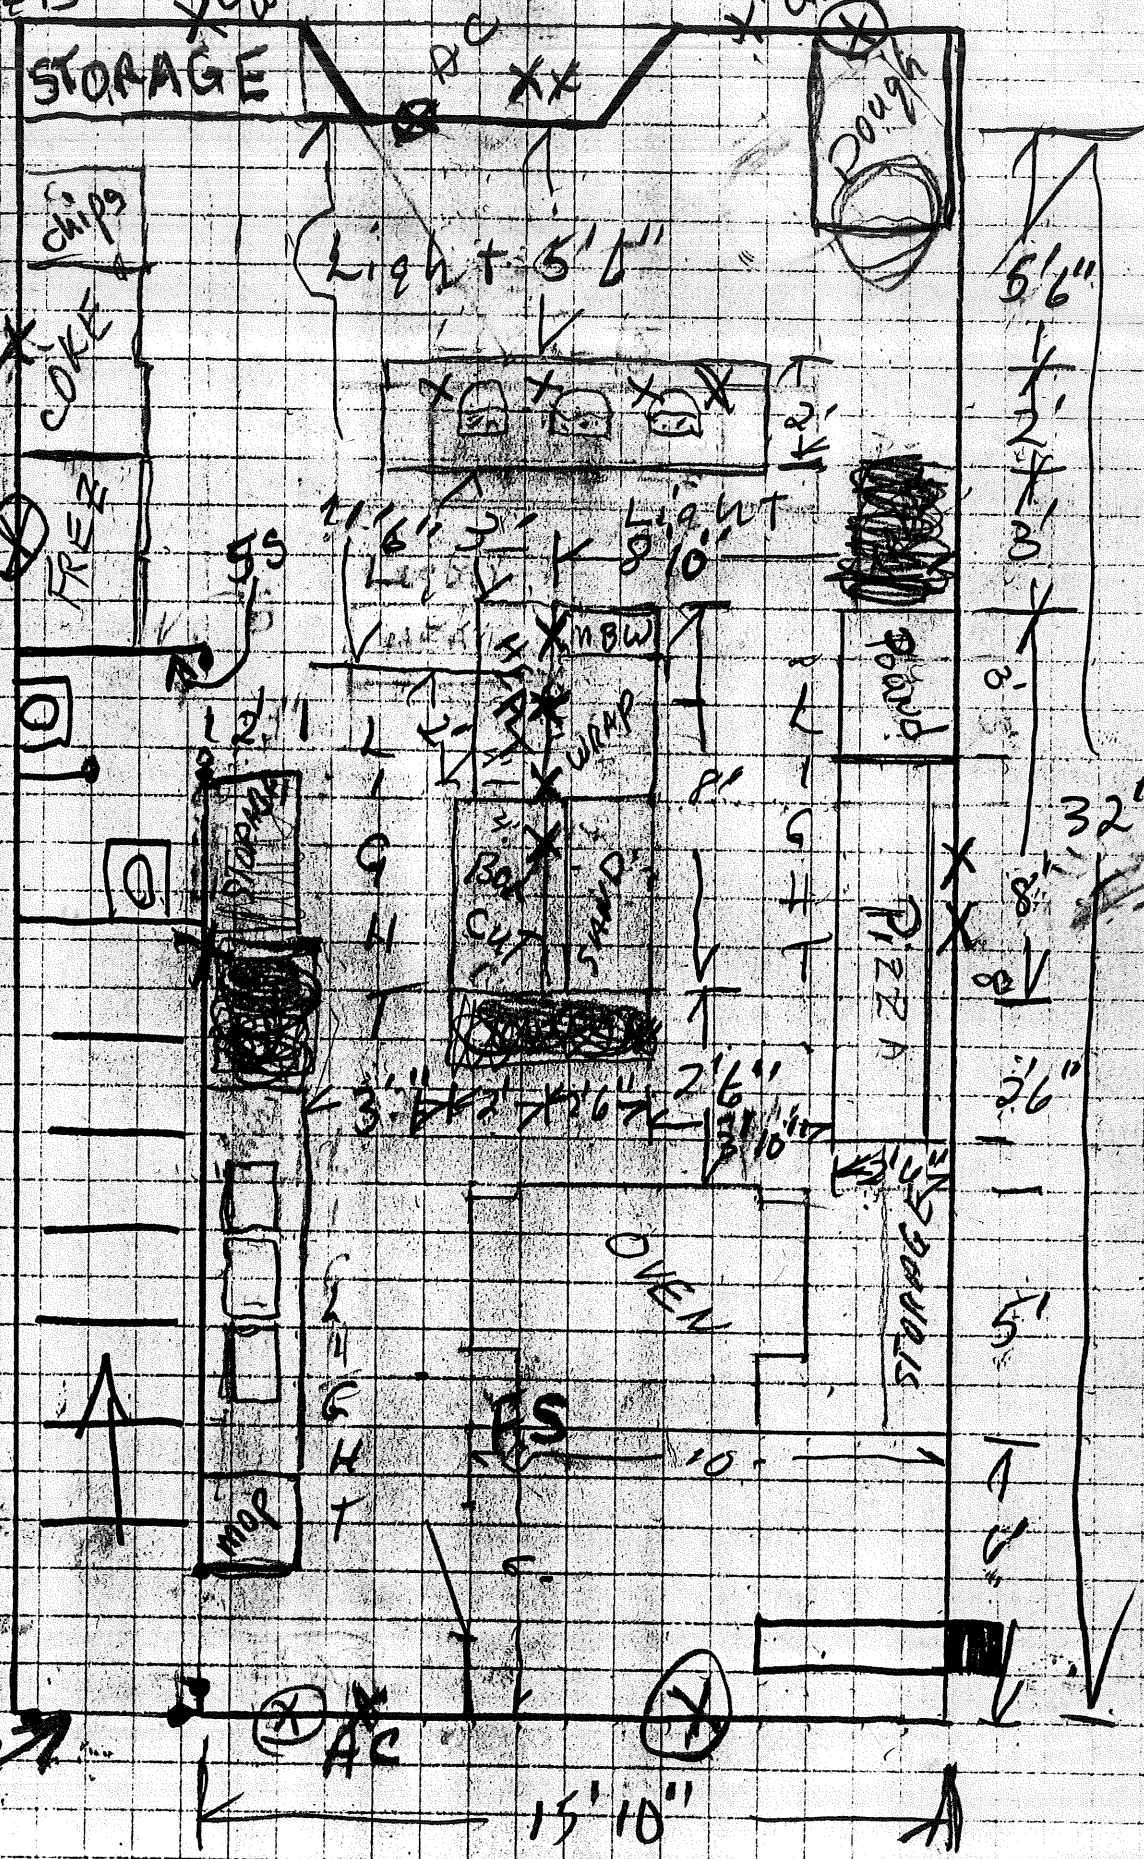

ELECTRICAL PERMIT

City of Portland, Me.



To the Chief Electrical Inspector, Portland Maine:
 The undersigned hereby applies for a permit to make electrical installations
 in accordance with the laws of Maine, the City of Portland Electrical Ordinance,
 National Electrical Code and the following specifications:

Date 19 August 1997

LOCATION: 11 Bishop St

Permit # 3397

OWNER Jim Burgess/Spanky's Pizza ADDRESS _____

							TOTAL EACH FEE		
OUTLETS	Telephone		Data		CATV			.20	
	Receptacles	16	Switches	5	Smoke Detector	21		.20	4.20
FIBER OPTICS								15.00	
FIXTURES	incandescent		fluorescent			7		.20	1.40
	fluorescent strip							.20	
SERVICES	Overhead				TTL AMPS TO	800		15.00	
	Underground					800		15.00	
Temporary Service	Overhead				AMPS OVER	800		25.00	
	Underground					800		25.00	
METERS	(number of)							1.00	
MOTORS	(number of)					1		2.00	2.00
RESID/COM	Electric units							1.00	
HEATING	oil/gas units		Interior		Exterior			5.00	
APPLIANCES	Ranges		Cook Tops		Wall Ovens			2.00	
Insta-Hot	Water heaters		Fans		Dryers			2.00	
Disposals	Dishwasher		Compactors		Others (denote)	1	1	2.00	2.00
MISC. (number of)	Air Cond/win				Pizza Oven			3.00	
	Air Cond/cent				Pools			10.00	
	HVAC		EMS		Thermostat			5.00	
	Signs							10.00	
	Alarms/res							5.00	
	Alarms/com							15.00	
	Heavy Duty(CRKT)							2.00	
	Circus/Carnv							25.00	
	Alterations							5.00	
	Fire Repairs							15.00	
	E Lights							1.00	
	E Generators							20.00	
PANELS	Service		Remote		Main			4.00	
TRANSFORMER	0-25 Kva							5.00	
	25-200 Kva							8.00	
	Over 200 Kva							10.00	
					TOTAL AMOUNT DUE				
					MINIMUM FEE/COMMERCIAL	35.00			
					MINIMUM FEE	25.00			35.00

INSPECTION: Will be ready _____ or will call _____

CONTRACTORS NAME RSJ Electric, Inc. MASTER LIC. # 3397
 ADDRESS P.O. Box 6156 Hermon, ME 04402-6156 LIMITED LIC. # _____
 TELEPHONE 848-7483

SIGNATURE OF CONTRACTOR

ELECTRICAL INSTALLATIONS—

Permit Number _____

Location _____

Owner _____

Date of Permit _____

Final Inspection 9/2/92

By Inspector 

INSPECTION: Service _____ by _____
 Service called in _____
 Closing-in _____ by _____

PROGRESS INSPECTIONS: 8/28/92 Inspection
9/2/92 Final
 _____ / _____ / _____
 _____ / _____ / _____
 _____ / _____ / _____
 _____ / _____ / _____

DATE:	REMARKS:

CONTRACTOR'S NAME: _____
 ADDRESS: _____
 TELEPHONE: _____
 SIGNATURE OF CONTRACTOR: 