NOTES:

1. SEE DRAWING E0 FOR GENERAL NOTES AND LEGEND.
2. INTENT OF DEMOLITION IS TO REMOVE ALL WIRING FROM DEVICES AND EQUIPMENT IN THIS SPACE BACK TO THE COMMON PANELS IN THE ELECTRICAL ROOM.

KEYED NOTES:

1. CCTV CAMERA SYSTEM EQUIPMENT AND ASSOCIATED WIRING TO BE REMOVED AND RETURNED TO OWNER.
2. EXISTING GAS BURNER EMERGENCY SWITCHES. TO BE REMOVED AND REINSTALLED BY BASEMENT STAIRWELL IS REQUIRED BY CODE.
3. CARBON MONIXIDE DETECTOR, TO BE REMOVED.
4. INTENT OF THIS PROJECT IS THAT PANELS PPH AND PP2 ARE TO BE REMOVED AND EXISTING CIRCUITS WIRED FROM NEW PANEL PPA.
5. PANEL PP3 SHALL BE REMOVED AS PART OF THIS PROJECT. ANY REMAINING CIRCUITS NOT DEMOLISHED AS PART OF THIS WORK SHALL BE RECONNECTED TO SPARE BREAKERS IN PANEL PPA.
6. PANEL PP4 SHALL BE REMOVED AND REINSTALLED IN THE SEPARATE OFFICE AREA AT THE NORTH END OF THIS BUILDING. RECONNECT EXISTING WIRING.
7. DEVICES IN THIS AREA TO REMAIN IN PLACE. REWIRE AS SHOWN ON POWER AND LIGHTING PLANS.
8. HVAC UNIT IN THIS AREA TO BE REMOVED AND RELOCATED. REMOVE ALL WIRIRING BACK TO PANEL PP3.

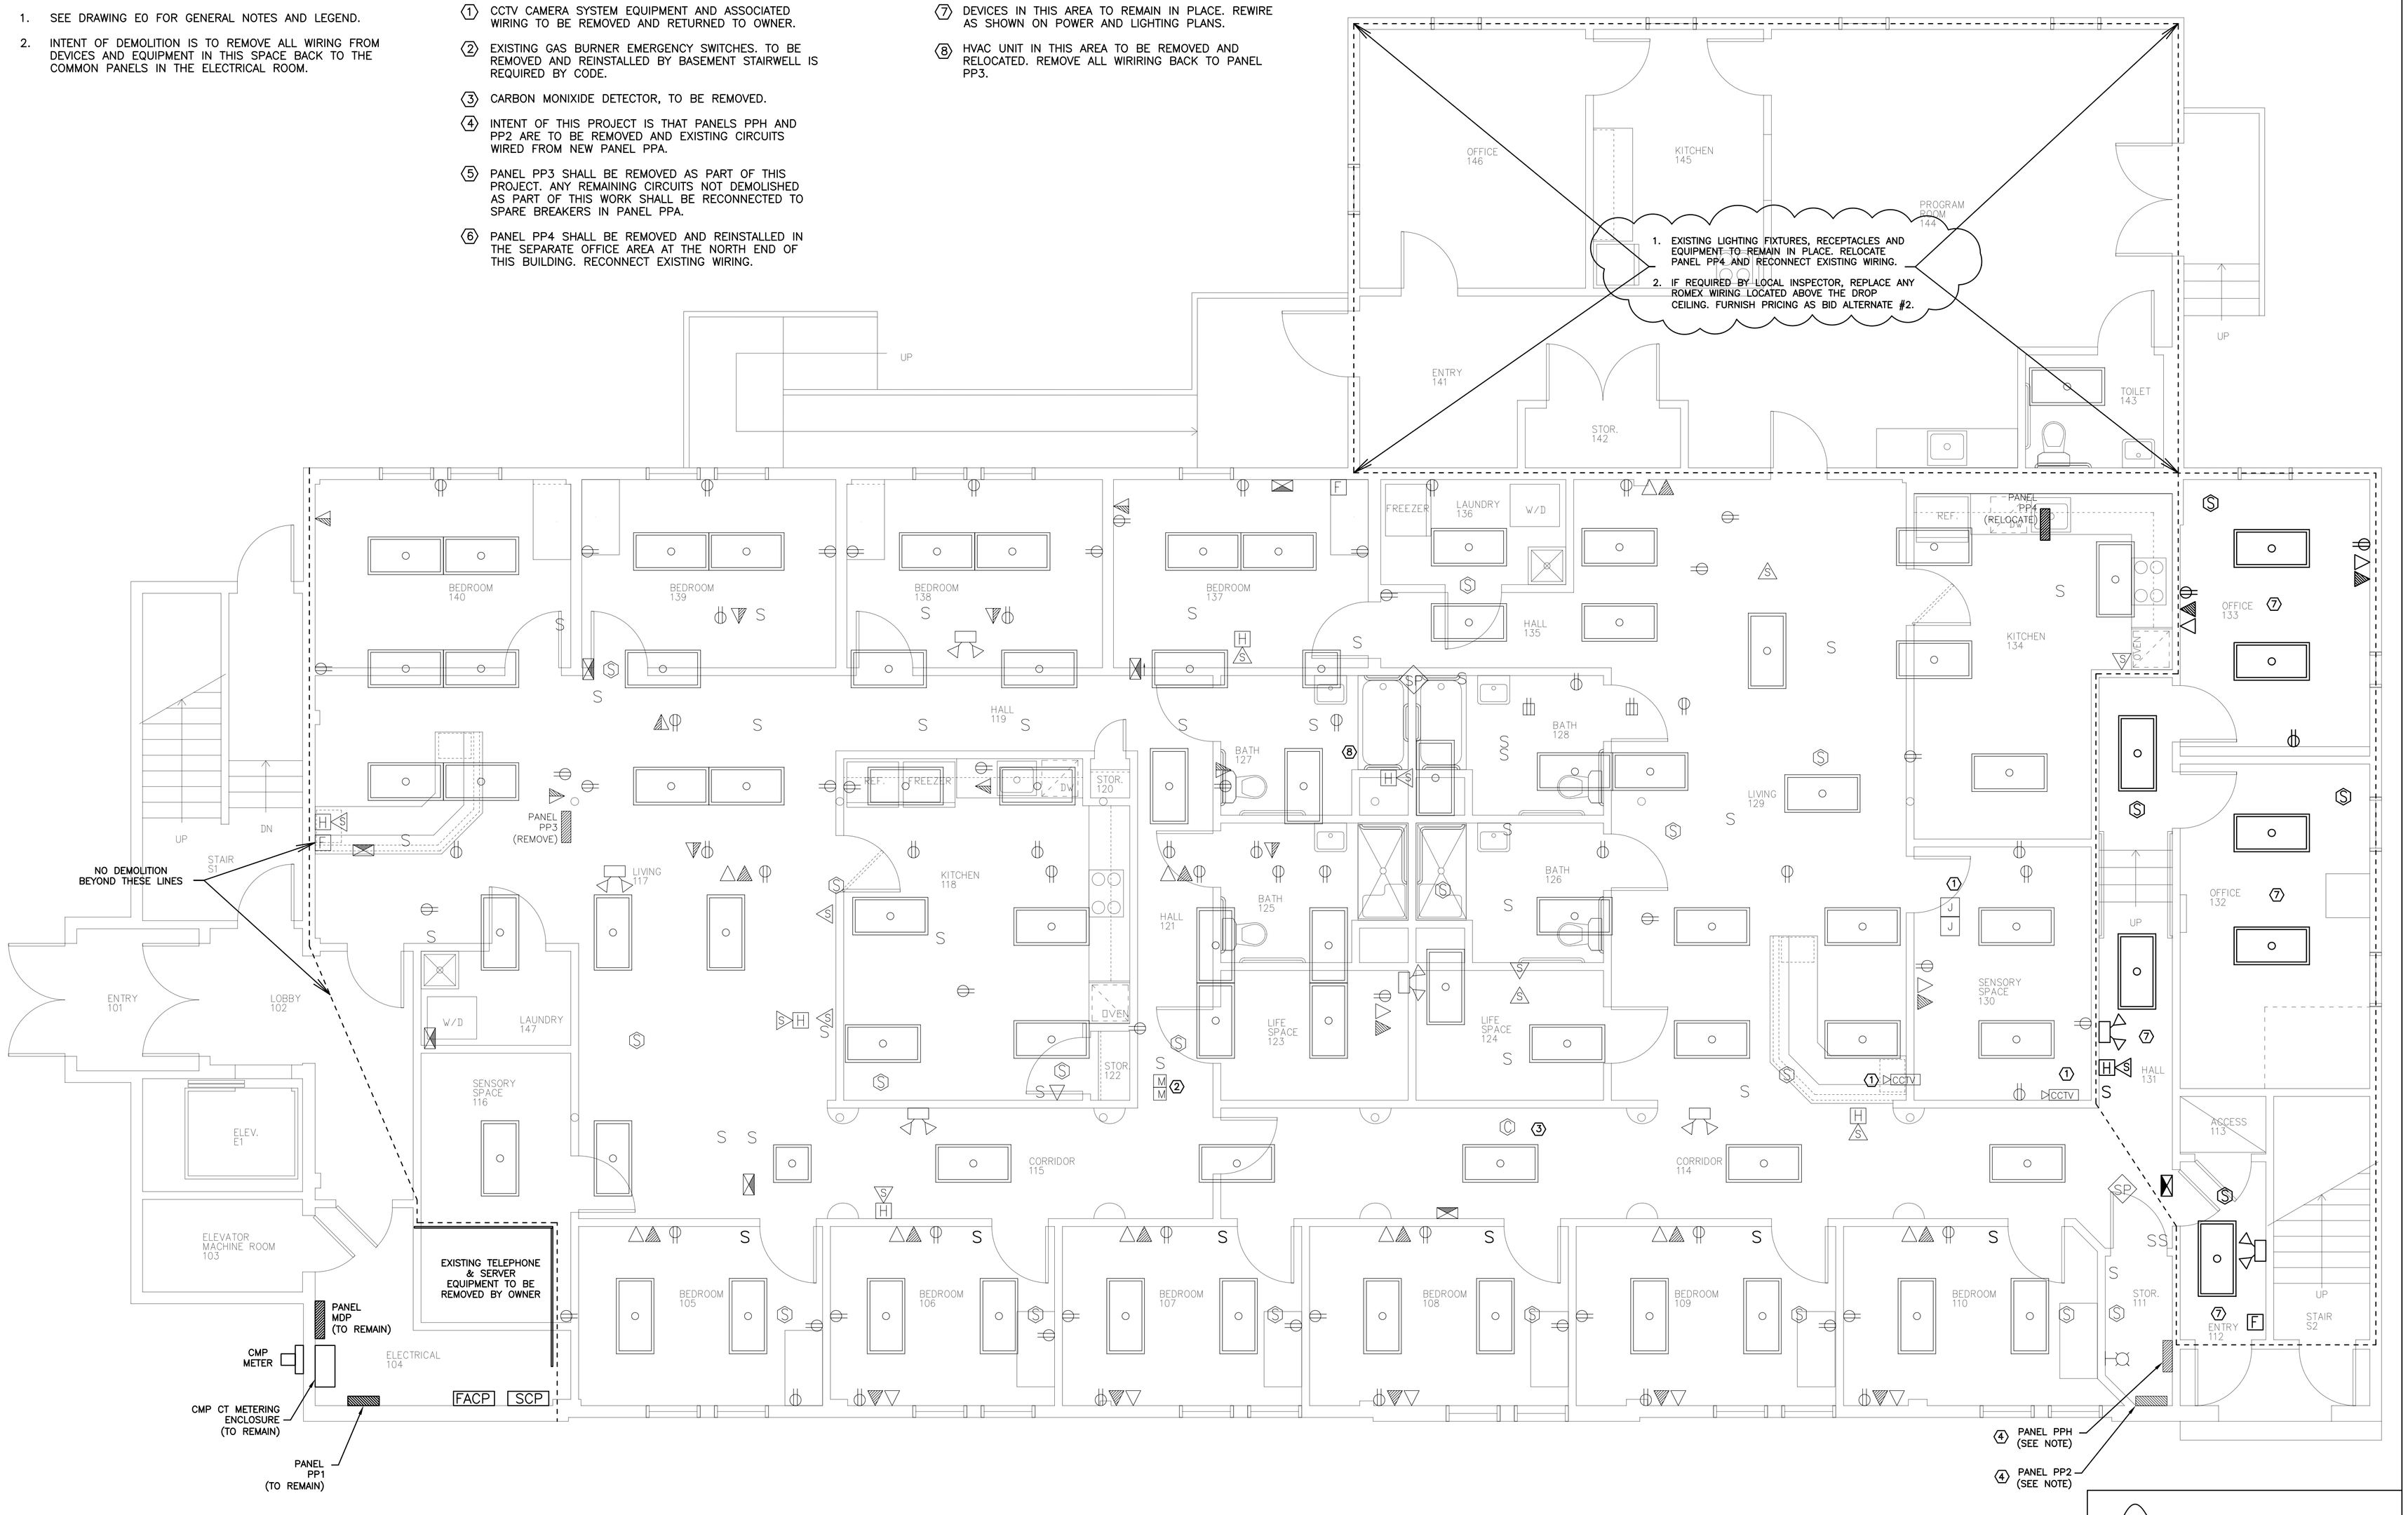

Michael Charek Architects
25 Hartley Street
Portland, Maine 04103
(207) 761-0556

STATE OF MAINE
TIMOTHY D. MATTHEWS
No. 9199
LICENSED PROFESSIONAL ENGINEER

Spurwink
Bishop Street
17 Bishop Street
Portland, Maine 04103

Title

ELECTRICAL EXISTING CONDITIONS AND DEMOLITION PLAN

Scale: 1/4"=1'-0"

Date: 2/6/09

Revisions

Revision #1 3/16/09

Sheet

E1

SWIFTCURRENT
Engineering Services
273 Main Street
Yarmouth, ME 04096
Tel: (207) 847-9280

© 2009 Michael R. Charek, Architect