


Test Hydrant: POD-HYD01616

Static: 69 psi
Residual: 60 psi

Flow Hydrant: POD-HYD01034

Static: 70 psi
Pitot: 66 psi
Flow: 1363 GPM

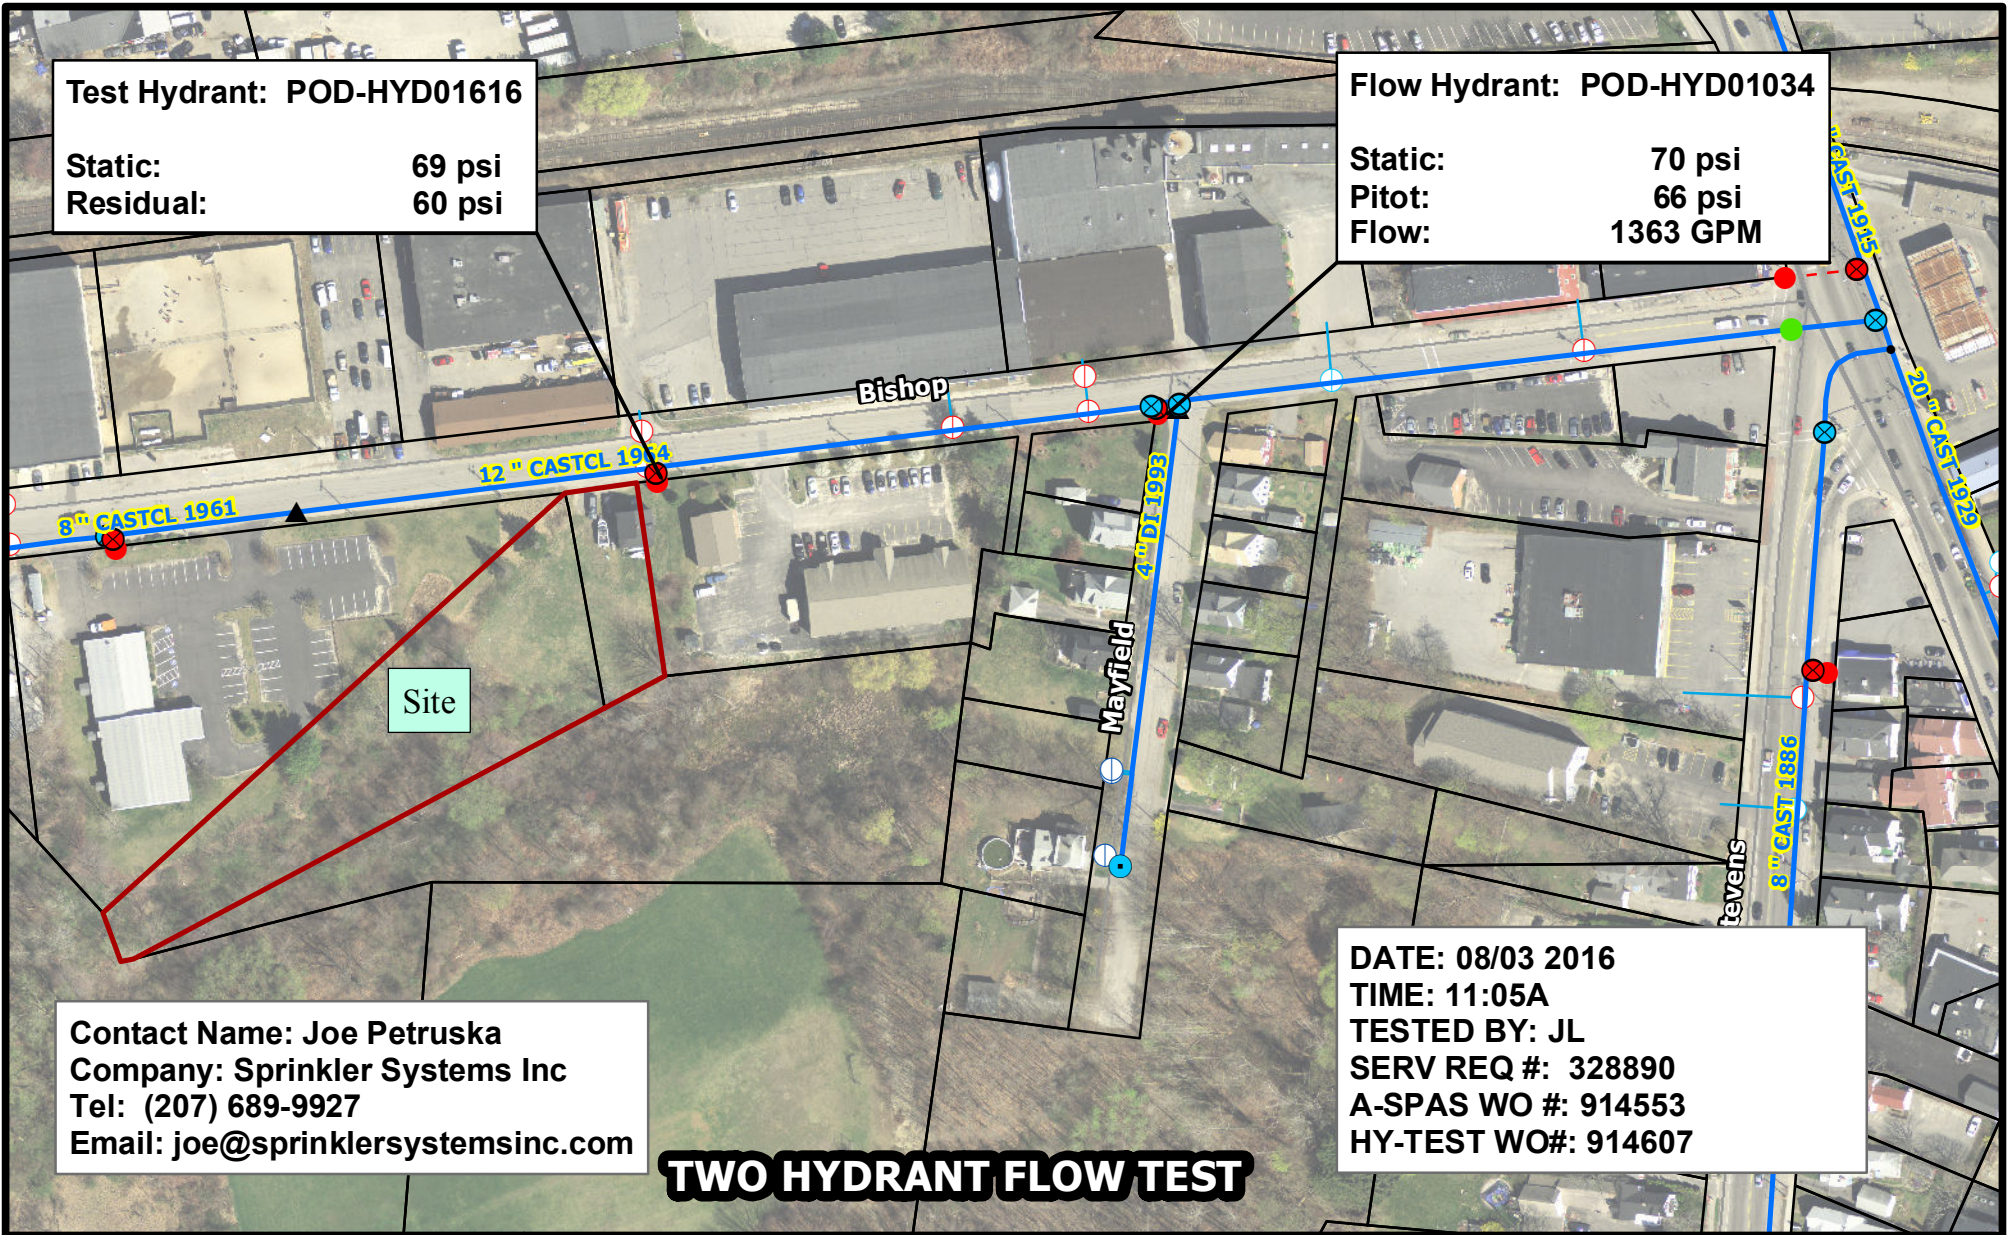


Contact Name: Joe Petruska
Company: Sprinkler Systems Inc
Tel: (207) 689-9927
Email: joe@sprinklersystemsinc.com

DATE: 08/03 2016
TIME: 11:05A
TESTED BY: JL
SERV REQ #: 328890
A-SPAS WO #: 914553
HY-TEST WO#: 914607

TWO HYDRANT FLOW TEST

72 Bishop Street
Portland



Disclaimer: This map is suitable for preliminary study and analysis and is based on PWD record information. PWD is not liable for any damages whatsoever resulting from inaccurate data or from errors made in the location and marking of its infrastructure.



PORTLAND WATER DISTRICT
225 Douglass Street
PO Box 3553
Portland, ME 04104
Telephone: (207) 774-5961
Fax: (207) 761-8307

Legend

- Air Valve
- Blow Off
- By Pass
- ⊗ Distribution
- ⊗ Transmission
- Connection
- Attribute Change
- ▲ Reducer
- Hydrant
- ⊗ Hydrant Control
- ⊕ Combined Service
- ⊕ Domestic Service
- ⊕ Fire Service
- ⊕ Private Hydrants
- ⊕ Meter Pits
- Manhole
- CSO
- Gravity
- Force

Drawn By: HAS

Prepared for: Joe Petruska
Sprinkler Systems, Inc.

Date: August 4, 2016