


**LEGEND**

- S SINGLE POLE SWITCH - MOUNTED 48" AFF TO TOP
- S<sub>3</sub> THREE WAY SWITCH - MOUNTED 48" AFF TO TOP
- S<sub>4</sub> FOUR WAY SWITCH - MOUNTED 48" TO TOP
- S<sub>M</sub> MOTION SENSING SWITCH - MOUNTED 48" TO TOP
- ⊙ SPECIALTY OUTLET 30A AND UP - DEPENDANT ON EQUIPMENT - SEE PANEL SCHEDULE
- ⊞ GFI RECEPTACLE - MOUNTED 18" AFF TO CENTER UNLESS NOTED OTHERWISE
- ⊕ DUPLEX OUTLET - MOUNTED 18" AFF TO CENTER UNLESS NOTED OTHERWISE
- ⊕ DOUBLE DUPLEX OUTLET - MOUNTED 18" AFF TO CENTER UNLESS NOTED OTHERWISE
- J JUNCTION BOX - SIZED AS REQUIRED
- ⊞ DISCONNECT SWITCH - FUSED AS REQUIRED (DIAGONAL LINE INDICATES FUSED)
- ⊙ EXIT LIGHT W/ LED LAMPS
- ⊙ EXIT/EMERGENCY LIGHT COMBINATION UNIT
- ⊙ EMERGENCY LIGHT BATTERY UNIT
- ▼ DATA OUTLET LOCATION (SINGLE CABLE)
- ▼ DATA OUTLET LOCATION (TWO CABLES)
- ⊞ FLOOR BOX POWER
- Ⓜ CEILING MOTION SENSOR
- R RELAY
  
- GFI GROUND FAULT INTERRUPTER W/ SURGE SUPPRESSION
- EWC ELECTRIC WATER COOLER
- EF EXHAUST FAN
- WP WEATHERPROOF
- PC PARTIAL CIRCUIT
- FBO FURNISHED BY OTHERS
- C COUNTER HEIGHT (SEE MILLWORK DRAWINGS)
- H HOSPITAL GRADE DEVICE W/ RED FACEPLATE
- IG ISOLATED GROUND DEVICE
- BD BUSS DUCT
- DTT DRY TYPE TRANSFORMER
  
- FIRE ALARM SYSTEM**
- F MANUAL PULL STATION - MOUNTED 48" AFF TO CENTER
- F<sup>Ⓢ</sup> HORN STROBE UNIT - MOUNT 80" AFF TO CENTER - EXCEPTION NO CLOSER THAN 6' TO CEILING
- S<sup>Ⓢ</sup> VISUAL STROBE ONLY UNIT - MOUNT 80" AFF TO CENTER
- Ⓢ SMOKE DETECTOR
- Ⓢ<sup>CO</sup> SMOKE/CO COMBINATION DETECTOR
- H HEAT DETECTOR
- T SPRINKLER TAMPER SWITCH
- FL SPRINKLER WATERFLOW SWITCH
- ANN FIRE ALARM ANNUNCIATOR
- FACP FIRE ALARM CONTROL PANEL

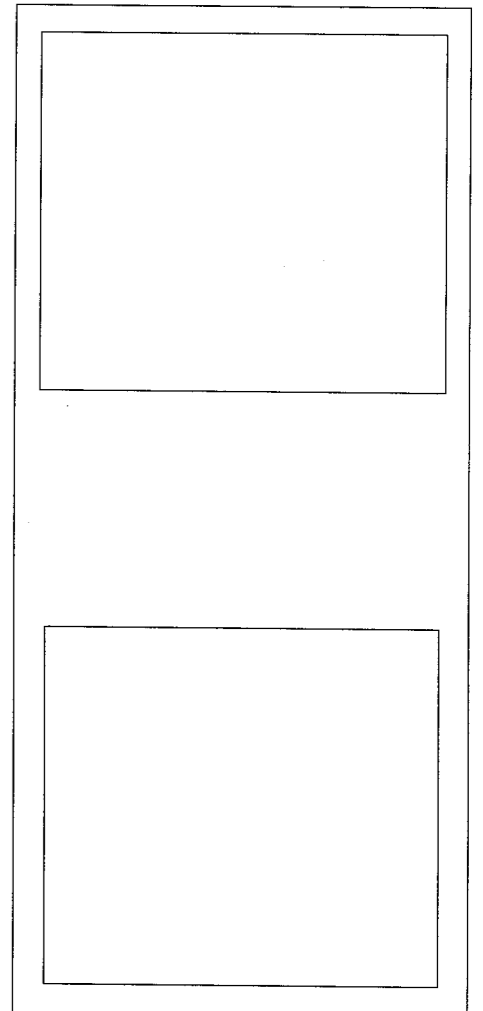

**B.H. Milliken**  
ELECTRICAL CONTRACTORS

175 ANDERSON STREET  
PORTLAND, MAINE 04101  
207.879.1877

**ACADEMY FOR ACTIVE LEARNERS**  
134 WARREN AVENUE  
PORTLAND, MAINE

TITLE:  
**LEGEND**

SCALE: NTS

DATE: 3/22/16

SHEET:  
**E1.0**