

DEPT. OF BUILDING INSPECTION
 CITY OF PORTLAND, ME
 JAN 4 2005
 RECEIVED

04/16/52
gms 6008

AUSTIN'S BOOT'S & BUCKLE'S
 188 WARREN AVE.
 PORTLAND, MAINE

DATE: _____
 DRAWN BY: BRL
 CHECKED BY: _____
 DATE: DEC 20, 2004


MECHANICAL FLOOR PLAN

SCALE: 1/4" = 1'
 M-1

AIRTEMP MECHANICAL CONTRACTORS

11 WALLACE AVENUE

SOUTH PORTLAND, MAINE 04106

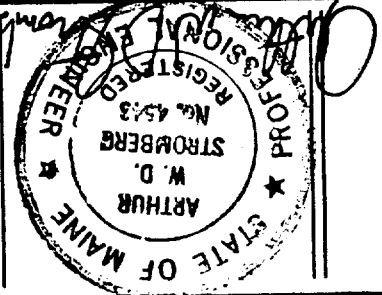

AIR HANDLING UNIT SCHEDULE

TAG	AREA SERVED	COOLING TONS	HEATING WHP IN	MANUFACTURER	MODEL NUMBER	ELECTRIC VOLTS/PHASE	MCA MAX AMPS/PHASE	WEIGHT	STAGES	REMARKS
AHU-1	BAR AREA	----	----	CARRIER						
AHU-2	DANCE FLOOR	----	----	CARRIER						
ERV-1	AHU-2	----	----	ALDES	ERV100DS	120 / 1	81			
HRV-1	AHU-1	----	----	ALDES	HRV100SD	120 / 1	81			
HRV-2	AHU-1	----	----	ALDES	HRV100SD	120 / 1	81			


REMARKS: 1. EXISTING UNITS TO BE REUSED

EXHAUST FAN SCHEDULE

TAG	AREA SERVED	CFM	MANUFACTURER	MODEL NUMBER	ELECTRIC VOLTS/PHASE	AMPS	WEIGHT	REMARKS
EF-1	MEN'S ROOM	150	COEK	GC-160	120 / 1	415	25 LBS	CEILING MOUNT
EF-2	WOMEN'S ROOM	225	COEK	GC-340	120 / 1	415	25 LBS	CEILING MOUNT

AIR DEVICE SCHEDULE

TAG	SIZE	MAX CFM	MAX HC	THROW	REMARKS
CD-1	6"	98-107	415-15	1-2-4	SQUARE CONE DIFFUSER T-BAR LAY-IN
CD-2	8"	173-279	415-19	2-3-6	SQUARE CONE DIFFUSER T-BAR LAY-IN
CD-3	10"	273-426	419-21	3-4-8	SQUARE CONE DIFFUSER T-BAR LAY-IN
RD	24" X 24"	----	----	----	EGGCRATE RETURN GRILLE T-BAR LAY-IN
RG	24" X 12"	----	----	----	EGGCRATE RETURN GRILLE T-BAR LAY-IN

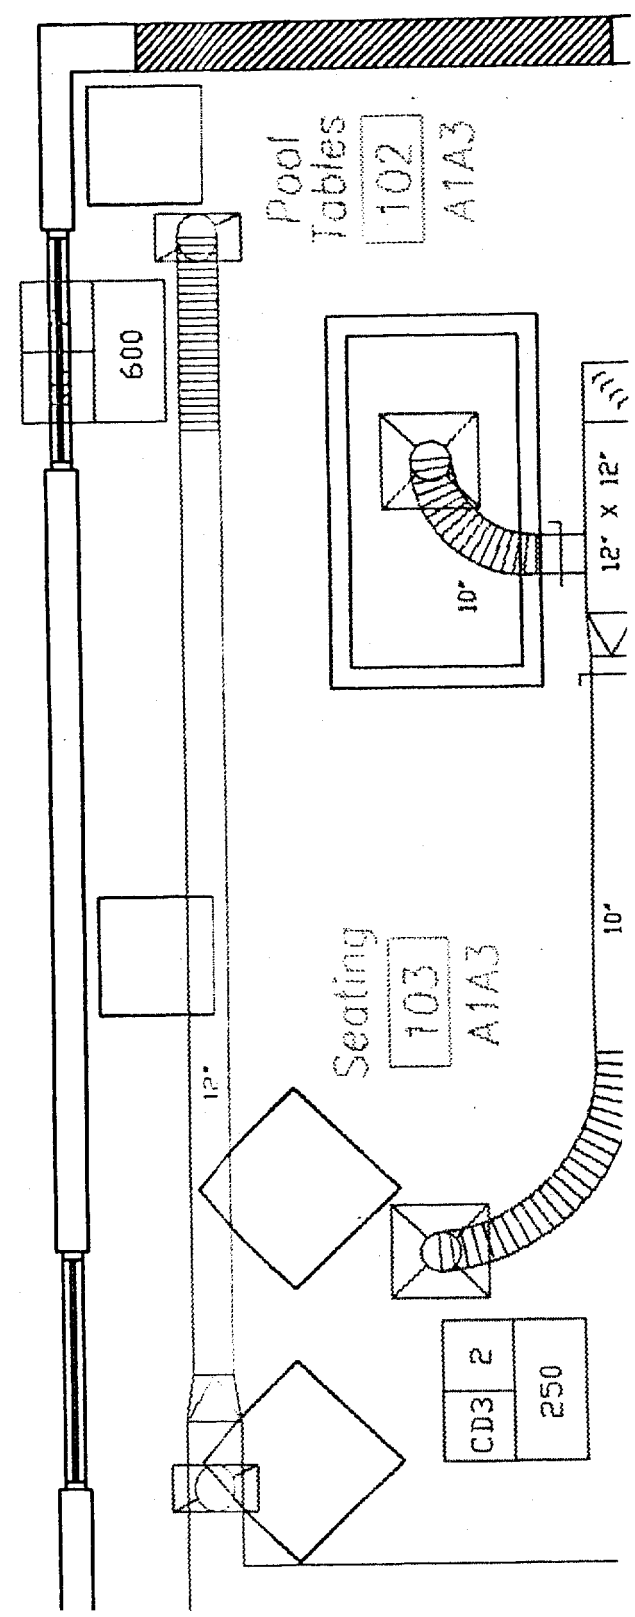

36" X 36"
FRESH AIR
LOUVER

20" X 8"
EXHAUST AIR
LOUVER

