

# Installation and Service Instructions



for use by heating contractor

# VIESSMANN®

Vitorond 100, VR1 Series  
Oil-Fired Boiler  
Heating input 91 to 140 MBH  
27 to 41 kW



## VITOROND® 100

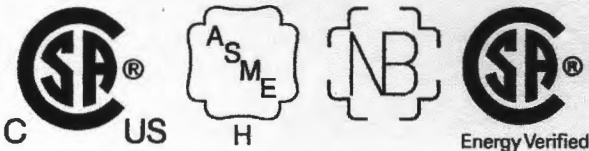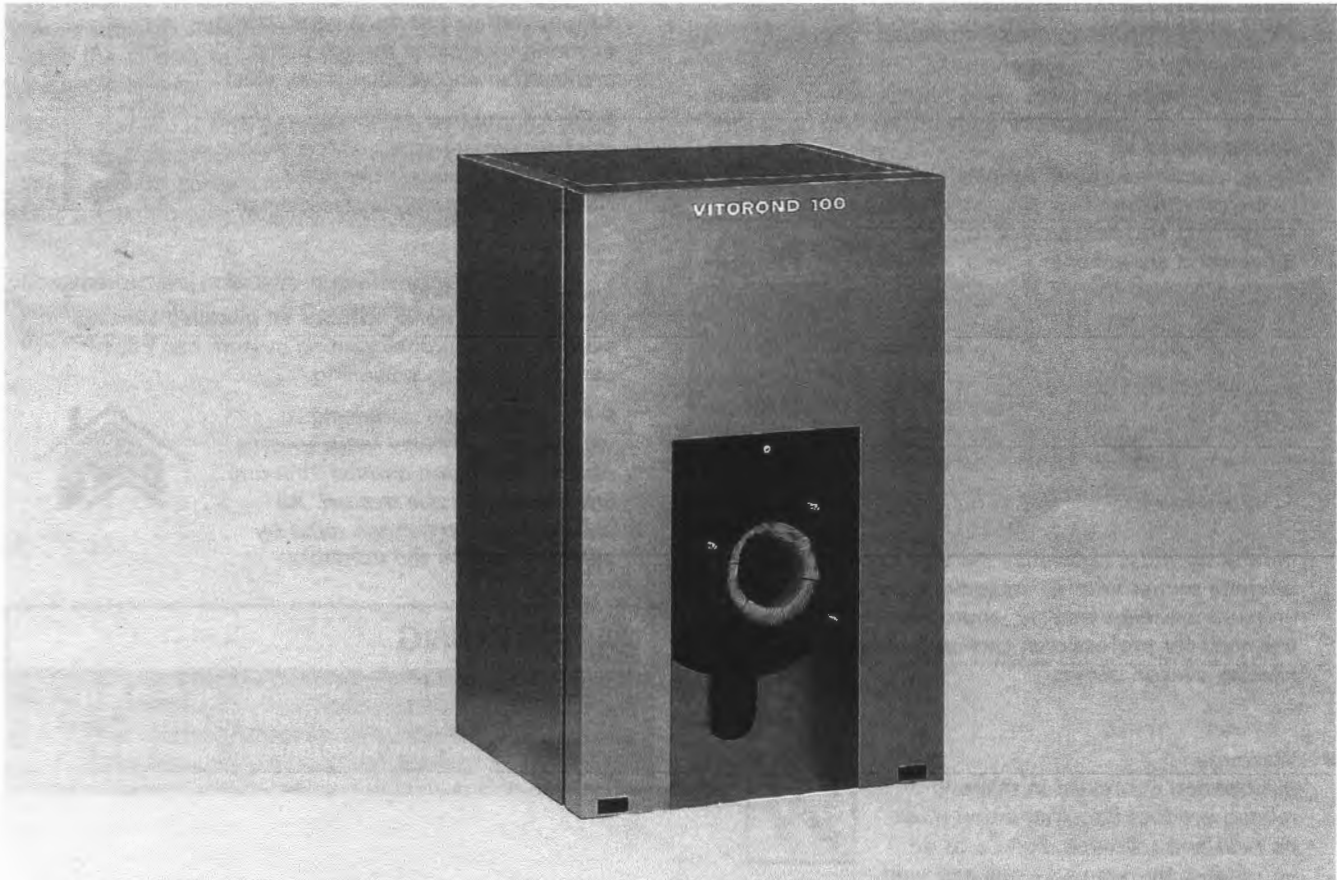

Product may not be exactly as shown

**IMPORTANT**

Read and save these instructions for future reference.



## ***Burner Test Certificate***

- Date: 2015/01/19
- Time: 14:01:38
- Test Station #: 1
- Test Performed by: ANN
- Burner Code: C8511418
- Burner Model: OEM F3 VIESSMANN
- Burner Serial # : 851141800008
- Prepurge Timing: Ok
- Lock Out Timing: Ok
- Dielectric Test: Ok
- Earth Ground Test: Ok