PROJECT SUMMARY:

THE PROJECT SCOPE INCLUDES THE DESIGN, SPECIFICATION, PROCUREMENT, INSTALLATION AND COMMISSIONING OF A COMPLETE, TURN-KEY, GRID-TIED PHOTOVOLTAIC ELECTRIC SYSTEM.

MODULE TYPE	(8) Q CELL Q.PEAK-G4.I 305
INVERTER	(I) SE3000H-US
OPTIMIZER	(8) SOLAREDGE P320
ARRAY PITCH	25°
ARRAY AZIMUTH	202°
RACKING	IRONRIDGE XRIOO ALUMINUM RAIL
ATTACHMENT	ALUMINUM L-FEET WITH SS LAG SCREWS, 3 X5/16

AUTHORITIES HAVING JURISDICTION:

BUILDING AUTHORITY	PORTLAND MAINE
ELECTRICAL AUTHORITY	PORTLAND MAINE
ZONING/PLANNING AUTHORITY	PORTLAND MAINE
ELECTRICAL UTILITY	CENTRAL MAINE POWER

DESIGN CRITERIA:

OCCUPANCY	RESIDENTIAL
DESIGN WIND LOAD	100 MPH
RISK CATEGORY	
GROUND SNOW LOAD	60 PSF
EXPOSURE CATEGORY	С
ROOF HEIGHT	~10' ABOVE GRADE TO EAVES
ROOF COMPOSITION	ASPHALT SHINGLE
RAFTER	
RAFTER SPACING	16" O.C.

SHEET LIST:

G00I	TITLE SHEET
A00I	SITE PLAN
A002	MODULE LAYOUT
E00I	ONE-LINE DIAGRAM

GENERAL NOTES:

- ALL WORK SHALL COMPLY WITH LOCAL AND STATE ORDINANCES AND BUILDING CODES.
- ELECTRICAL INSTALLATION SHALL COMPLY WITH STATE AND LOCALLY ADOPTED ELECTRICAL CODE.
- ROOFTOP PENETRATIONS SHALL BE SEALED.
- ALL EQUIPMENT SHALL BE LISTED AND TESTED BY A RECOGNIZED LABORATORY.
- SYSTEM SHALL CONFORM TO RAPID SHUTDOWN REQUIREMENTS PER NEC 690.
- CONDUIT RUNS BETWEEN SUB-ARRAYS, COMBINERS, AND DISCONNECTS SHALL BE INSTALLED IN THE MOST DIRECT ROUTE POSSIBLE.
- ELECTRICAL EQUIPMENT SHALL BE INSTALLED TO MAINTAIN CLEARANCES REQUIRED BY NEC 110.
- EQUIPMENT SHALL BE LABELED PER NEC 2017 REQUIREMENTS.

SYMBOLS:

MOD PV MODULE

DISCONNECT

MODULE LEVEL POWER

DC COMBINER AND DC

PV DC TO AC INVERTER

ELECTRONIC / OPTIMIZER



POWER METER



FUSED DISCONNECT SWITCH



NON-FUSED DISCONNECT SWITCH



2.44KW GRID TIED SOLAR PHOTOVOLTAIC SYSTEM

REVISION

ENERGY

142 PRESUMSCOT STREET PORTLAND, ME 04103 (207)-221-6342

CLIENT:


INDU GUPTA **I58 DOROTHY STREET**

PORTLAND MAINE, 04103

SYSTEM TYPE:





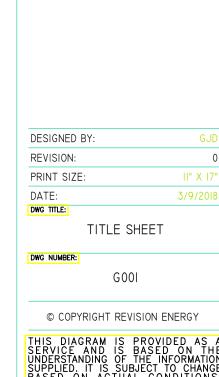

0