


FEMA EMERGENCY RADIO NETWORK WGAN PORTLAND, MAINE



VICINITY MAP

WGAN TRANSMITTER SITE
236 LANE AVENUE
PORTLAND, ME 04103
CUMBERLAND COUNTY

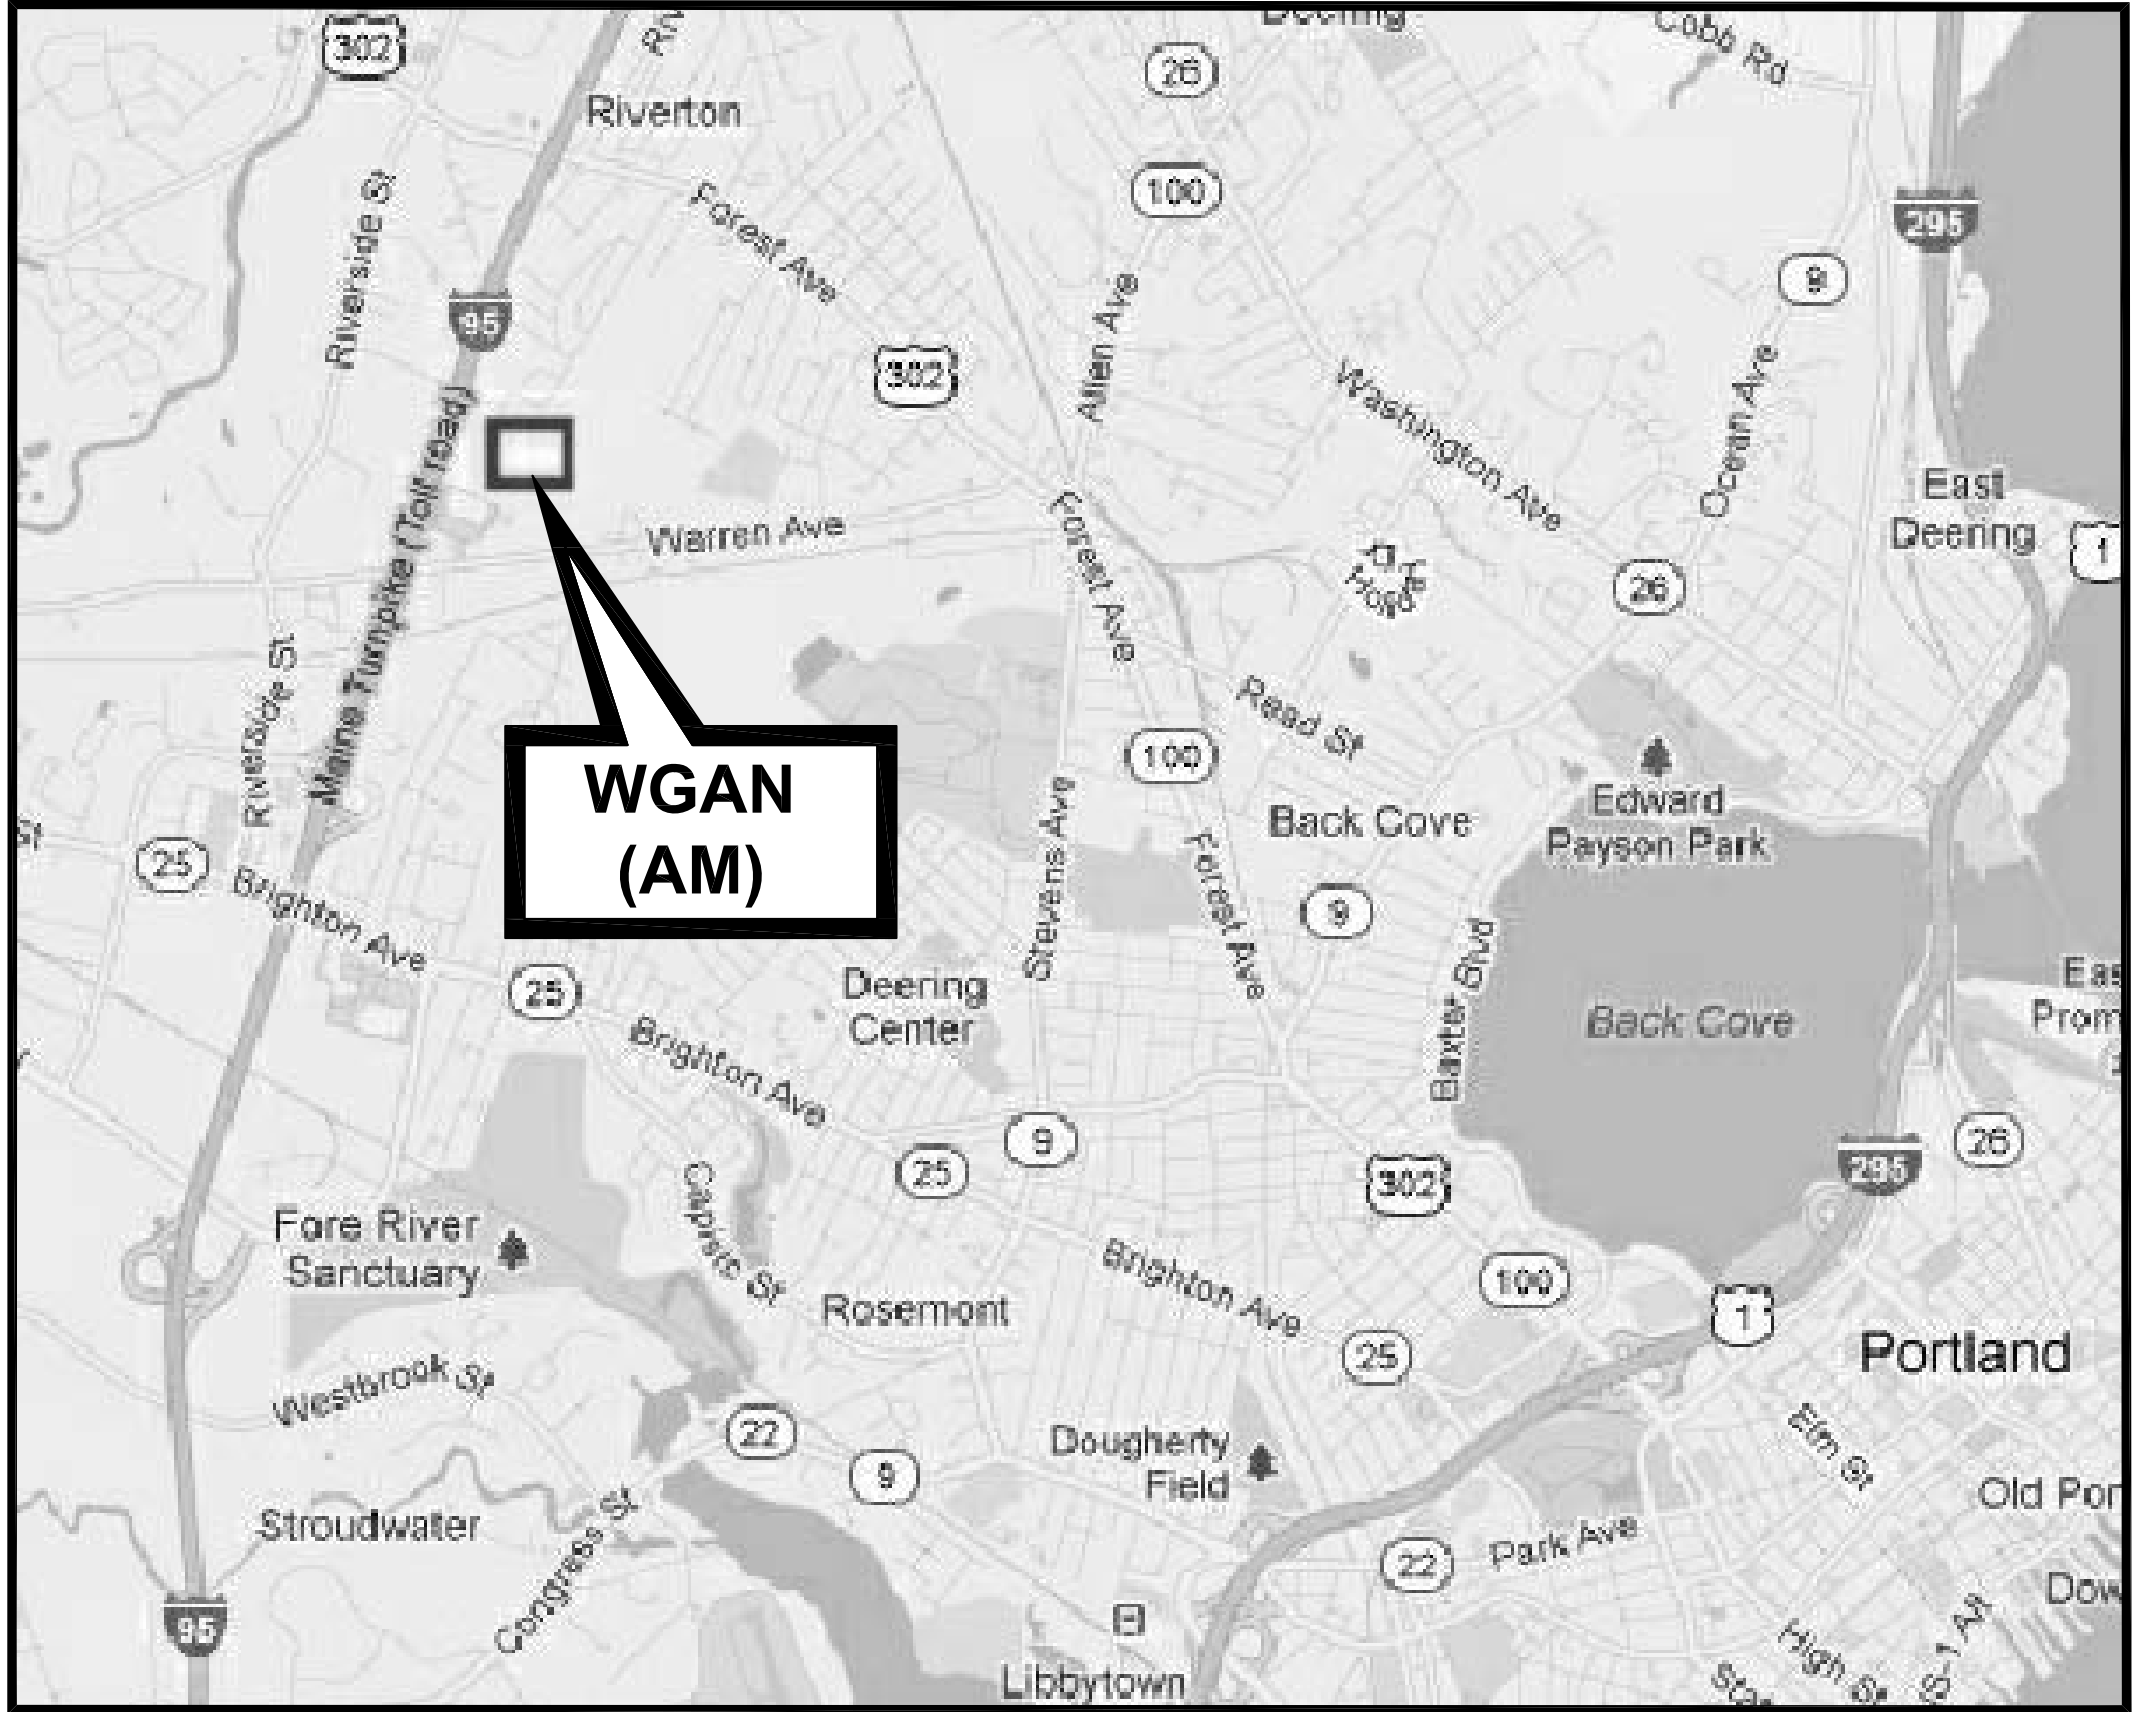

PROJECT AERIAL VIEW
SEE SITE PLAN, DWG G-101

INDEX

- G-001 VICINITY MAP AND INDEX
- G-101 SITE PLAN

- C-101 STORMWATER MANAGEMENT PLAN
- C-102 CIVIL PLAN
- C-301 CIVIL SECTIONS

- S-001 STRUCTURAL GENERAL NOTES
- S-101 FOUNDATION AND FENCE PLAN
- S-102 SITE GENERATOR FOUNDATION PLAN

- S-301 MISCELLANEOUS SECTIONS

- S-501 MISCELLANEOUS DETAILS
- S-502 SIGN AND FENCE DETAILS

- M-101 MECHANICAL PLAN
- M-201 MECHANICAL FUEL SYSTEM ELEVATIONS
- M-501 MECHANICAL FUEL PIPING DETAILS
- M-601 FUEL SYSTEM P&ID

- E-101 ELECTRICAL SITE PLAN
- E-102 ELECTRICAL GROUNDING PLAN
- E-103 ELECTRICAL POWER PLAN
- E-104 GROUNDING AND POWER PLAN
- E-105 GROUNDING AND POWER PLAN

- E-401 TRANSMITTER / GENERATOR ELECTRICAL PANEL SCHEDULES
- E-402 TRANSMITTER / GENERATOR ELECTRICAL RISER DIAGRAM
- E-403 ELECTRICAL SCHEDULES
- E-404 TRANSMITTER / GENERATOR UPS / TIME DELAY DIAGRAM

- E-501 INSTALLATION DETAILS
- E-502 INSTALLATION DETAILS
- E-503 INSTALLATION DETAILS
- E-504 INSTALLATION DETAILS

REFERENCED BUILDING CODES

- CITY OF PORTLAND TECHNICAL MANUAL 2010
- MAINE UNIFORM BUILDING CODE 2010
- INTERNATIONAL BUILDING CODE 2009
- INTERNATIONAL MECHANICAL CODE 2009
- ASCE 7-05
- NFPA 30, 2008 EDITION
- NATIONAL ELECTRIC CODE, 2008 EDITION
- NFPA 101 LIFE SAFETY CODE, 2009 EDITION



PHASE REVIEW	Project Manager	DC Reviewer	Architectural	Mechanical	Plumbing	Electrical	Civil


Mark	Date	Description
0	11/7/12	ISSUED FOR CONSTRUCTION

Designed by	DCB
Drawn by	RAM
Checked by	MLM
Reviewed by	DCB
Date	2012



63 SOUTH ROYAL STREET SUITE 300
 MOBILE, AL 36602
 PHONE: (251) 420-7898
 FAX: (251) 420-7898
 Engineering Services by
 KBR Engineering Co., LLC

FEMA EMERGENCY RADIO NETWORK
 ON WGAN PORTLAND, MAINE
COVER SHEET
VICINITY MAP AND INDEX




Drawing Number:
G-001

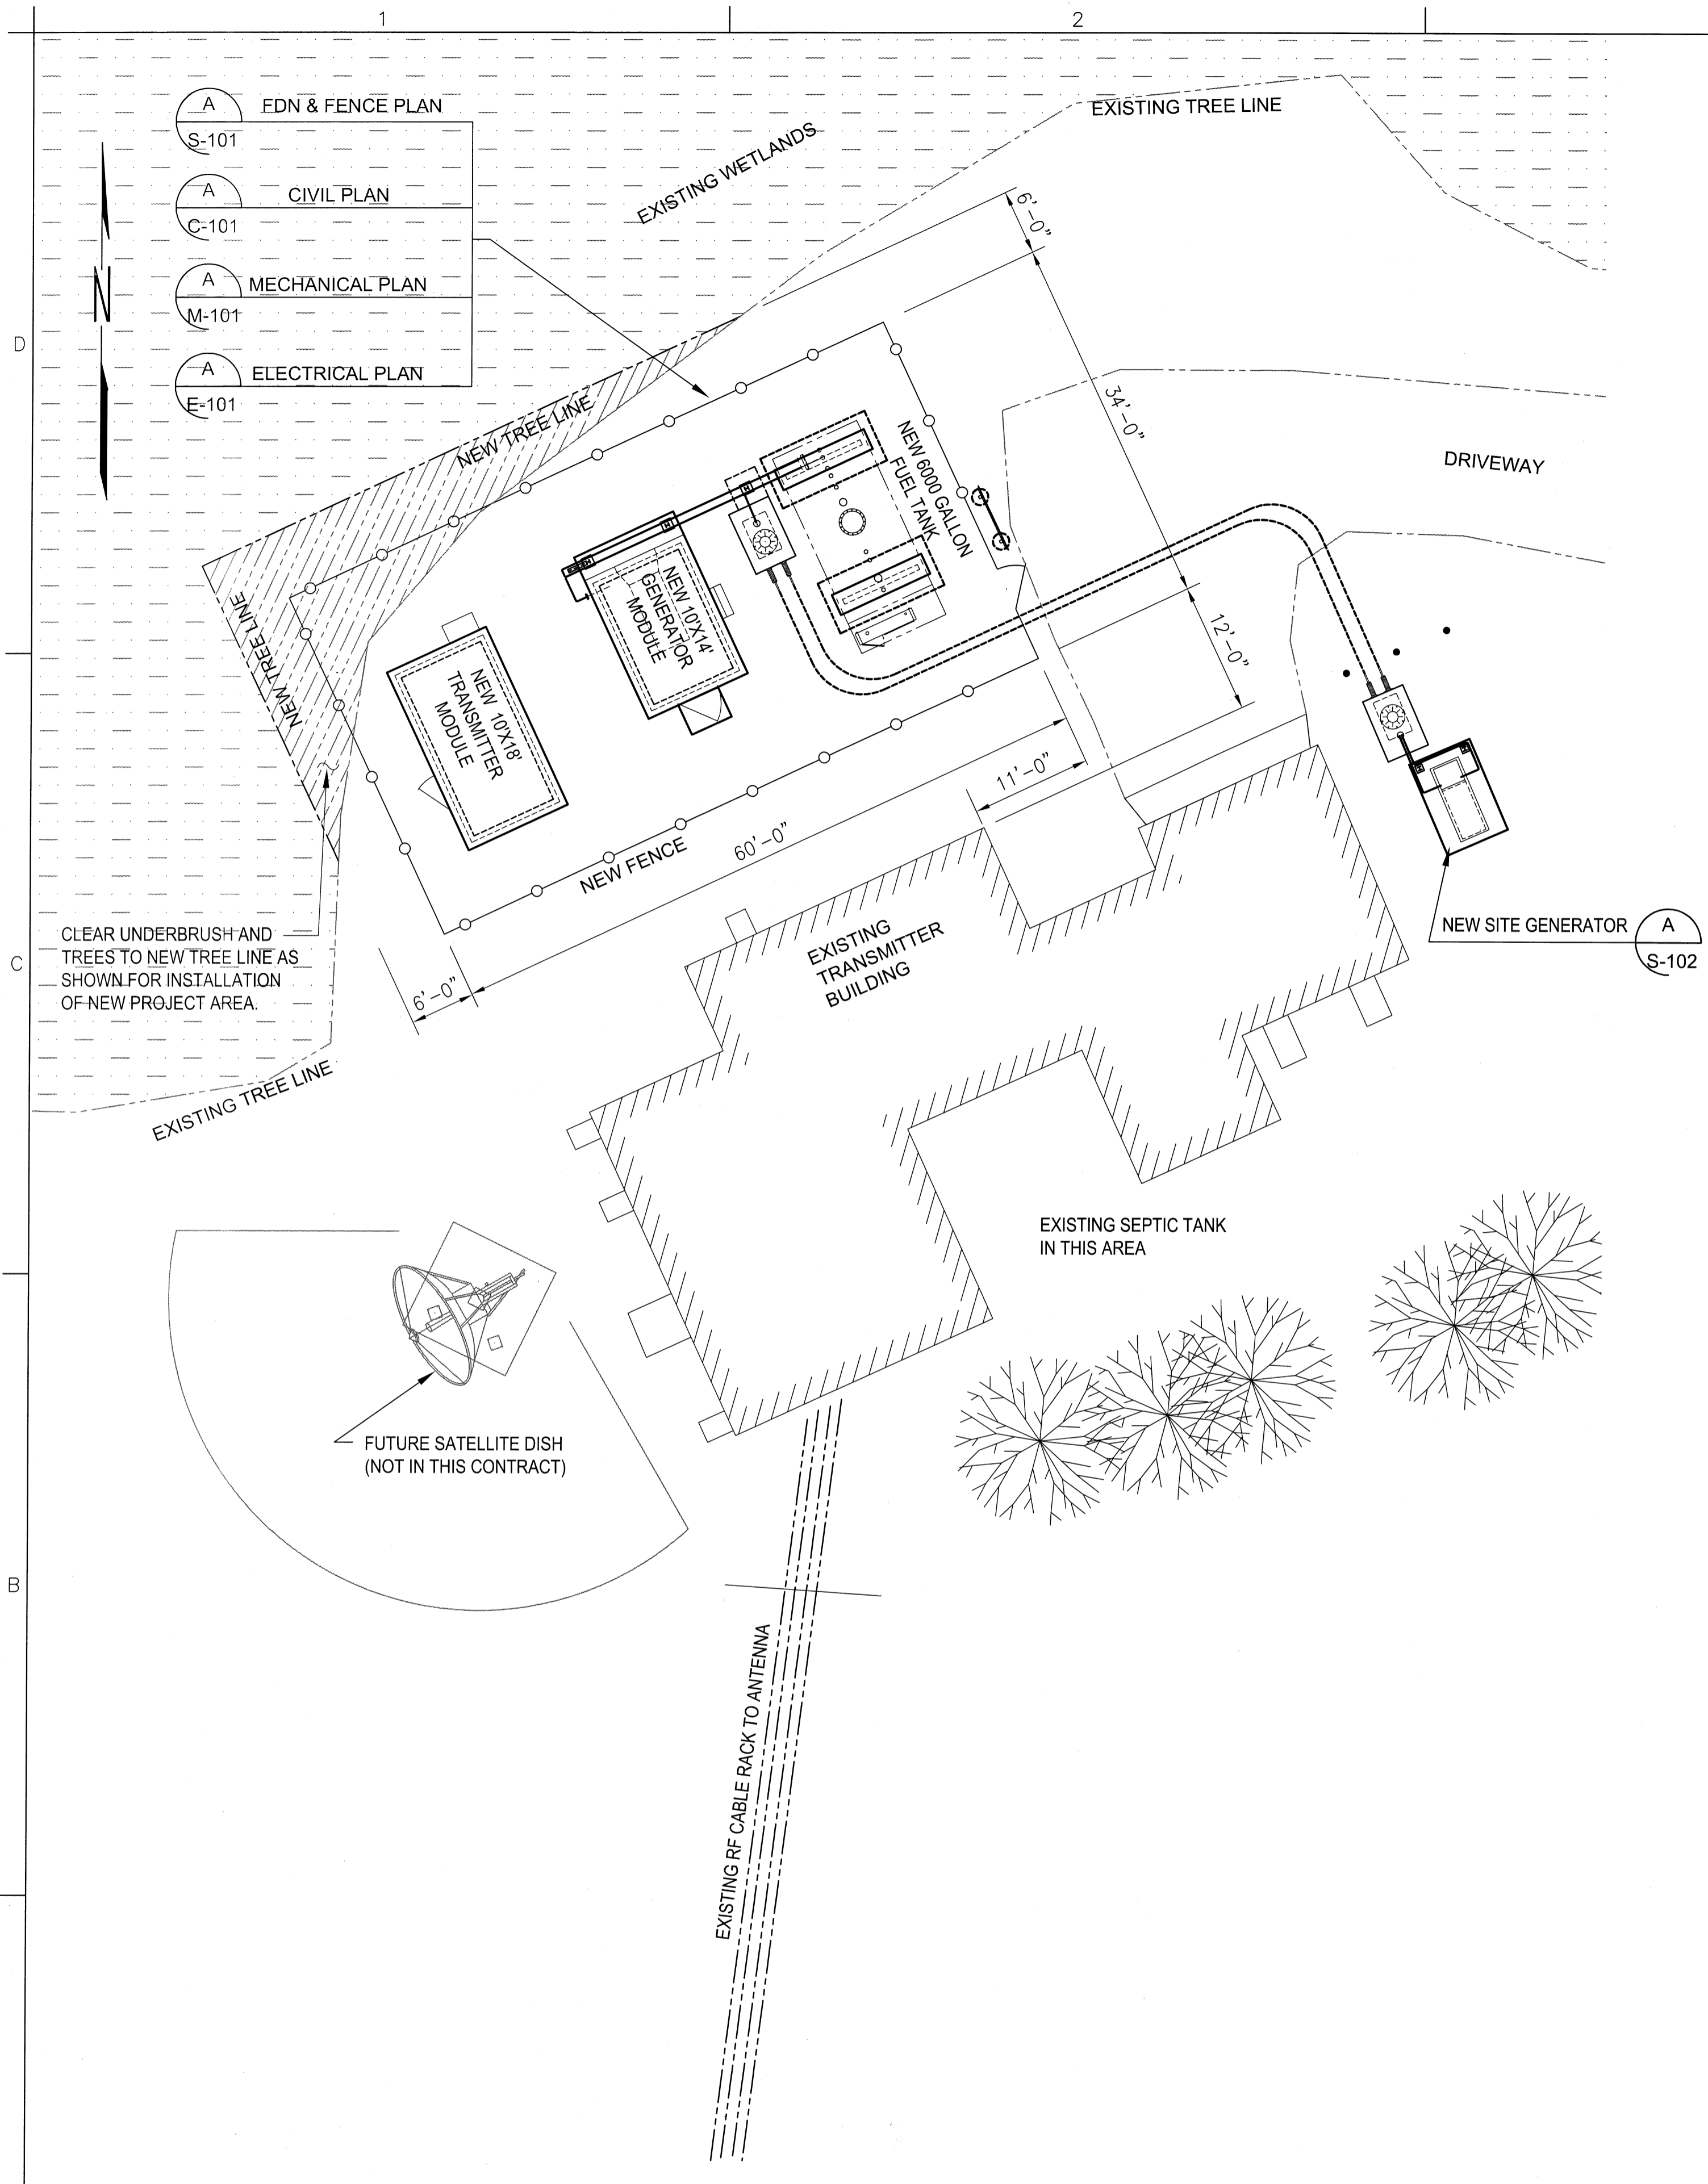

1 STATION WGAN - SITE PLAN
 G-001 SCALE: 1"=10'-0"

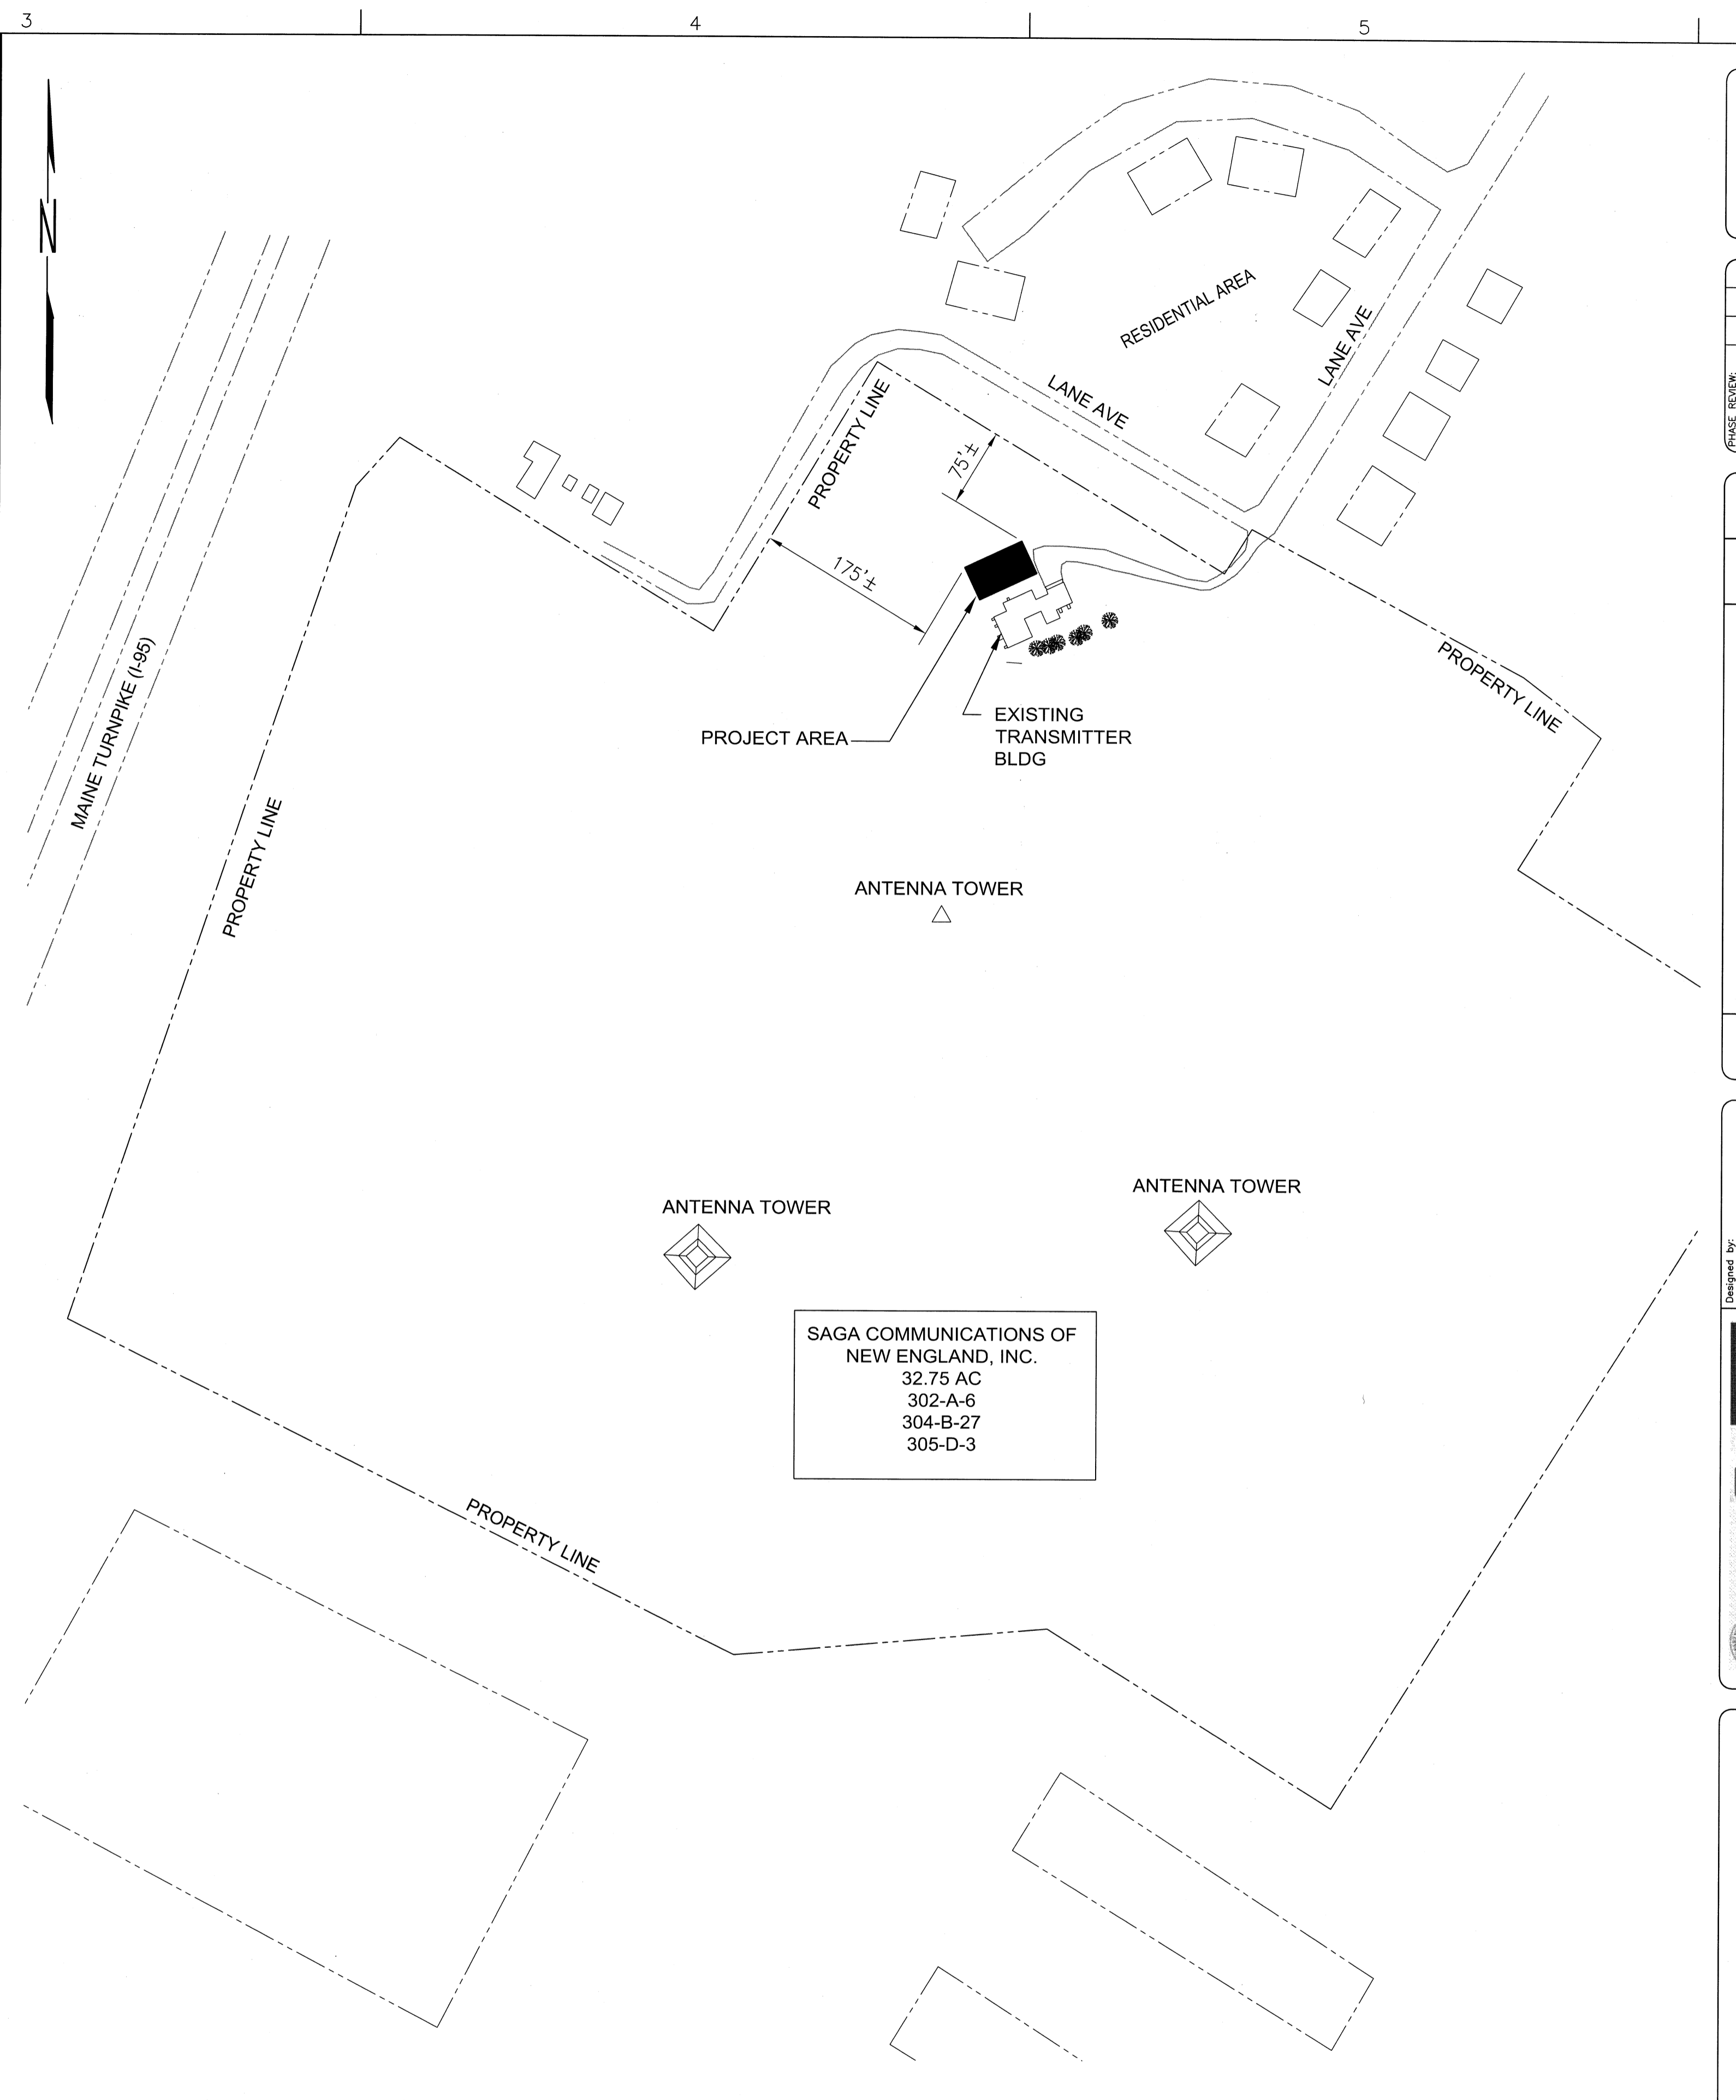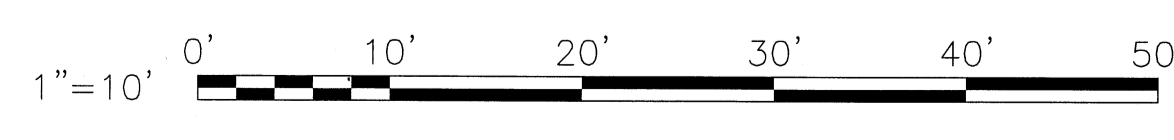

WGAN PROPERTY PLAN
 SCALE: 1"=100'

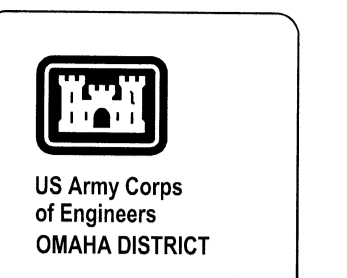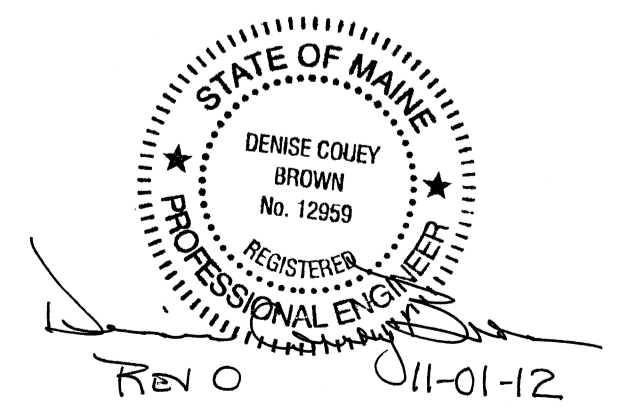


PHASE REVIEW:	Project Manager	DC Reviewer	Architectural	Mechanical	Electrical	Civil

DESIGNED BY	DCB	CHECKED BY	MLM
DRAWN BY	RAM	REVIEWED BY	DCB
DATE	2012	ISSUED FOR CONSTRUCTION	11/7/12
NO.		DESCRIPTION	
1			

FEMA ENGINEERING SERVICES BY
KBR Engineering Co. LLC
 65 SOUTH KENNA STREET SUITE 200
 KENNA, ME 04846
 PHONE: (207) 430-7800
 FAX: (207) 430-7898

FEMA EMERGENCY RADIO NETWORK
 ON WGAN PORTLAND, MAINE
SITE PLAN

Drawing Number:
G-101

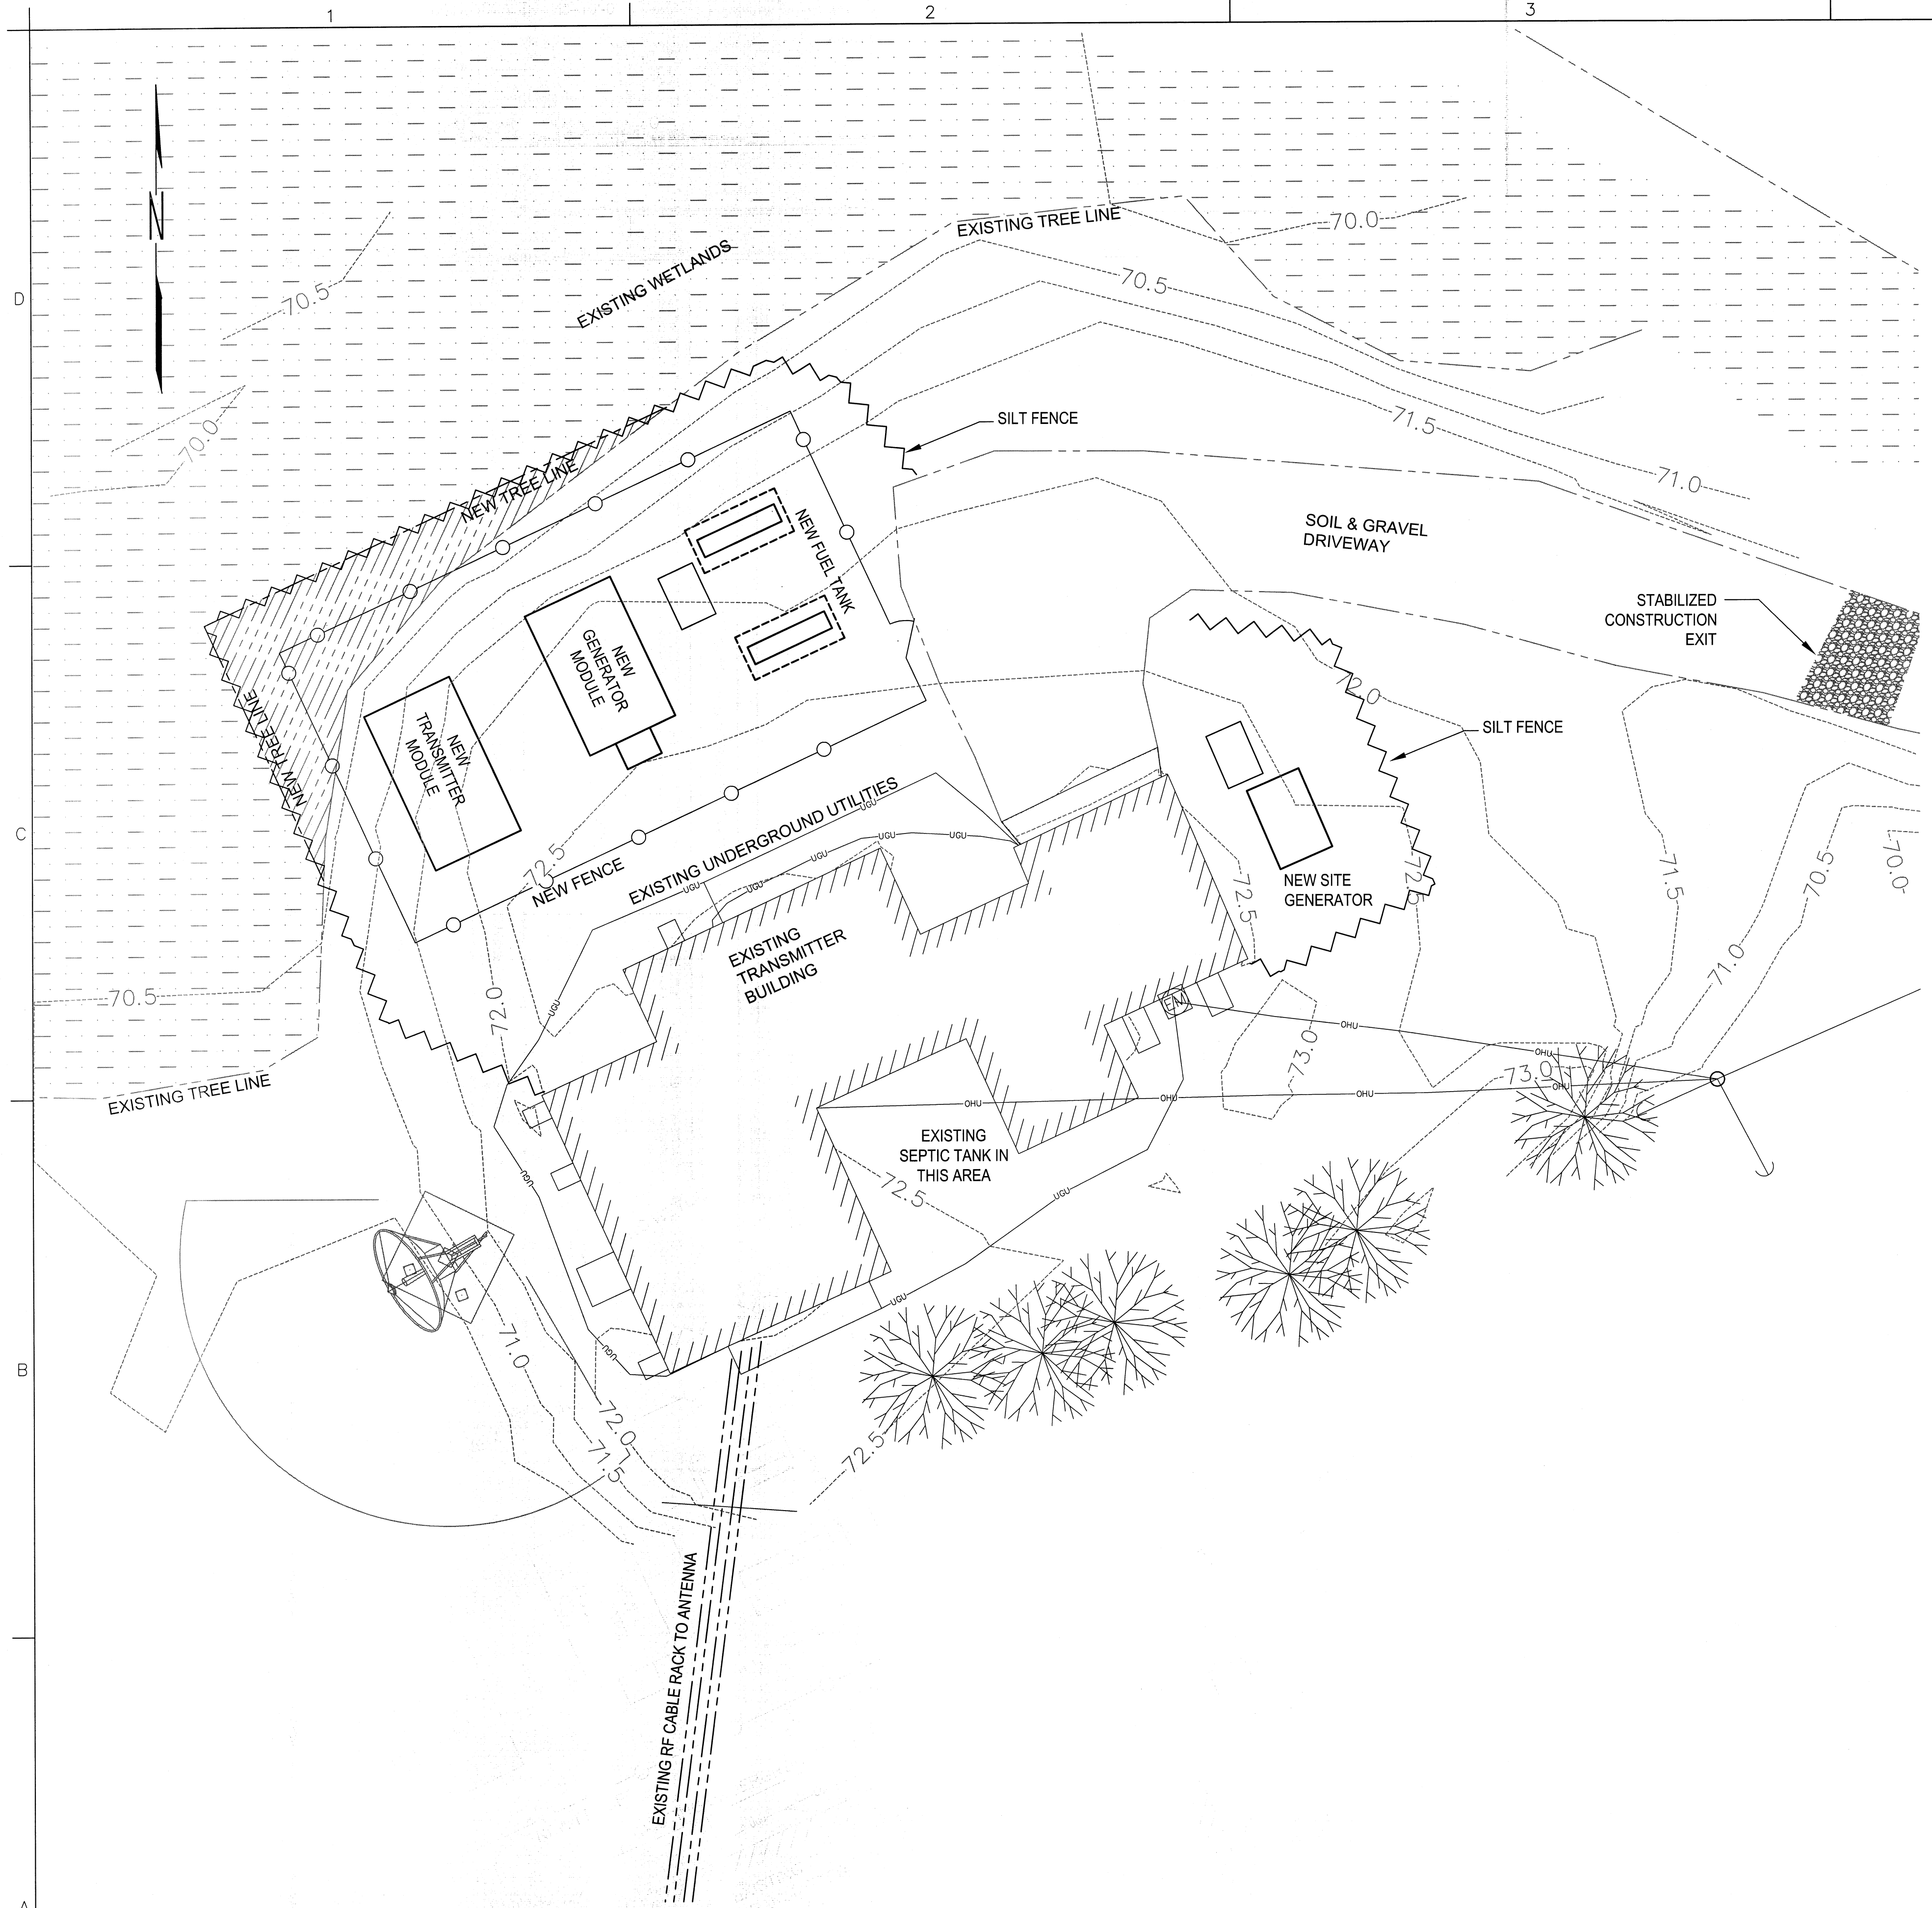

STORM WATER QUALITY NOTES - CONSTRUCTION BMP'S

- THIS PROJECT SHALL COMPLY WITH ALL LOCAL, STATE AND FEDERAL REQUIREMENTS.
- SUFFICIENT BMP'S SHALL BE INSTALLED TO PREVENT SILT, MUD OR OTHER CONSTRUCTION DEBRIS FROM BEING TRACKED INTO THE ADJACENT STREET(S) OR STORM WATER CONVEYANCE SYSTEMS DUE TO CONSTRUCTION VEHICLES OR ANY OTHER CONSTRUCTION ACTIVITY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR CLEARING ANY SUCH DEBRIS THAT MAY BE IN THE STREET AT THE END OF EACH WORK DAY OR AFTER A STORM EVENT THAT CAUSES A BREACH IN THE INSTALLED CONSTRUCTION BMP'S.
- ALL STOCK PILES OF UNCOMPACTED SOIL AND/OR BUILDING MATERIALS THAT ARE INTENDED TO BE LEFT UNPROTECTED FOR A PERIOD GREATER THAN SEVERAL CALENDAR DAYS ARE TO BE PROVIDED WITH EROSION AND SETTLEMENT CONTROLS. SUCH SOIL MUST BE PROTECTED EACH DAY WHEN THE PROBABILITY OF RAIN IS 40% OR GREATER.
- CONTRACTOR SHALL FIELD ADJUST AND PROVIDE ADDITIONAL SEDIMENT CONTROL MEANS AT NO ADDITIONAL COST TO OWNER IF WARRANTED BY FIELD CONDITIONS.
- ALL SLOPES THAT ARE CREATED OR DISTURBED BY CONSTRUCTION ACTIVITY MUST BE PROTECTED AGAINST EROSION AND SEDIMENT TRANSPORT AT ALL TIMES.
- THE STORAGE OF ALL CONSTRUCTION MATERIALS AND EQUIPMENT MUST BE PROTECTED AGAINST ANY POTENTIAL RELEASE OF POLLUTANTS INTO THE ENVIRONMENT.
- ALL GRADED, DISTURBED OR ERODED AREAS THAT WILL NOT BE PERMANENTLY PAVED, COVERED BY STRUCTURES OR COVERED BY WEED CONTROL FABRIC AND CRUSHED STONE, SHALL BE TREATED WITH HYDROSEED, SOD OR EQUIVALENT. ALL REQUIRED REVEGETATION AND EROSION CONTROL SHALL BE COMPLETED WITHIN 90 CALENDAR DAYS.
- ALL EROSION / SETTLEMENT CONTROL FACILITIES SHALL BE MAINTAINED IN WORKING ORDER AND AS SPECIFIED BY THE STATE ENVIRONMENTAL AGENCY. THESE FACILITIES SHALL BE INSPECTED AFTER EVERY PRECIPITATION EVENT. ANY NECESSARY REPAIRS WILL BE MADE IMMEDIATELY. ACCUMULATED SEDIMENTS WILL BE REMOVED AS REQUIRED TO KEEP THE DEVICES FUNCTIONAL. IN ALL CASES, REMOVE DEPOSITS WHERE ACCUMULATIONS REACH 3" ABOVE GRADE. ALL UNDERCUTTING OR EROSION OF THE TOE ANCHOR WILL BE REPAIRED IMMEDIATELY WITH COMPACTED BACKFILL MATERIALS. ADHERE TO ANY MANUFACTURER'S RECOMMENDATIONS.
- ANY CONTROL STRUCTURE DISTURBED DURING DAILY OPERATIONS SHALL BE REPAIRED, REPLACED OR RECONSTRUCTED AS REQUIRED UPON COMPLETION OF THE WORK DAY.
- THE CONTRACTOR WILL BE RESPONSIBLE DURING CONSTRUCTION AND FOR ONE YEAR FOR MAINTAINING THE E&S MEASURES TO INSURE COMPLIANCE WITH THE APPROVED PLAN AND THE APPLICABLE REGULATIONS OF THE STATE.
- ANY DISTURBED AREAS THAT WILL BE LEFT EXPOSED MORE THAN 13 DAYS AND NOT SUBJECT TO CONSTRUCTION TRAFFIC, WILL IMMEDIATELY RECEIVE A TEMPORARY SEEDING. IF THE SEASON PREVENTS THE ESTABLISHMENT OF A TEMPORARY COVER, THE DISTURBED AREA WILL BE MULCHED WITH STRAW OR EQUIVALENT MATERIAL, AT A RATE OF 2.5 TO 3 TONS PER ACRE. ANY STEEP SLOPES (GREATER THAN 3:1) SHALL BE STABILIZED DAILY.

SITE AREA

THE PROPOSED CONSTRUCTION PROJECT SHALL IMPACT APPROXIMATELY 0.09 ACRES (510 SF OF CONCRETE, 2250 SF OF GRAVEL GROUND COVER AND 1100 SF OF GRASS). GRADING PROPOSED ON THIS SITE AND POTENTIAL WETLAND IMPACT WILL BE IN ACCORDANCE WITH DWG C-102.

ACCORDING TO THE FEMA FLOOD INSURANCE RATE MAP 2300510006C, THE SITE IS OUTSIDE THE 500-YEAR FLOODPLAIN.

PLANNING AND ORGANIZATION


DURING CONSTRUCTION, THE KBR SITE MANAGER WILL OVERSEE THE IMPLEMENTATION AND MAINTENANCE OF THE STORMWATER PLAN.

BEST MANAGEMENT PRACTICES

- SILT FENCE - THE CONSTRUCTION SITE WILL BE SURROUNDED BY A SILT FENCE TO PREVENT RUNOFF OF SEDIMENT.
- STABILIZED CONSTRUCTION EXIT - A GRAVEL CONSTRUCTION EXIT WILL PREVENT DISPERSION OF SEDIMENT ONTO NEARBY ROADS.

ALL BMP'S SHALL BE IN ACCORDANCE WITH THE MAINE DEPARTMENT OF ENVIRONMENTAL PROTECTION PUBLICATION "MAINE EROSION AND SEDIMENT CONTROL BMP'S".

1 STATION WGAN - SITE PLAN
G-001 SCALE: 1"=10'-0"

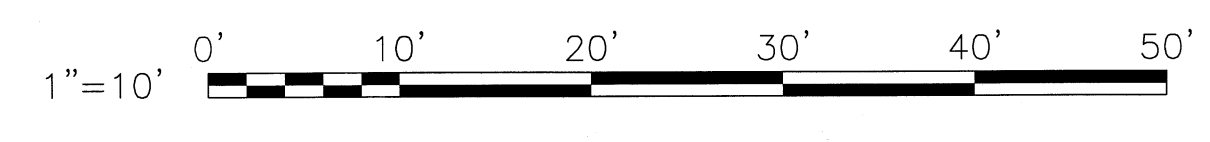


PROJECT REVIEWER:	
Project Manager	
QC Reviewer	
Architectural	
Structural	
Mechanical	
Plumbing	
Electrical	
Cost	

ISSUED FOR CONSTRUCTION	0	11/7/12	Revised
Mark		Date	Revised

Designed by	DCB
Checked by	MLM
Drawn by	RAM
Reviewed by	DCB
Date	2012


FEMA logo
KBR logo
 63 SOUTH ROYAL STREET SUITE 200
 PORTLAND, MAINE 04101-2600
 PHONE: (251) 400-7800
 FAX: (251) 400-7888

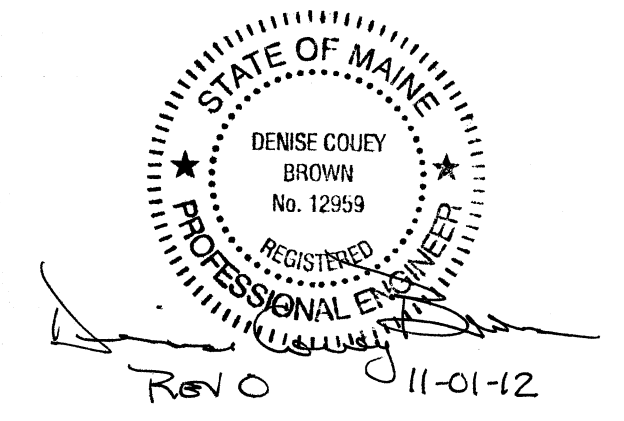


STORMWATER MANAGEMENT PLAN

FEMA EMERGENCY RADIO NETWORK
ON WGAN PORTLAND, MAINE

Drawing Number:
C-101

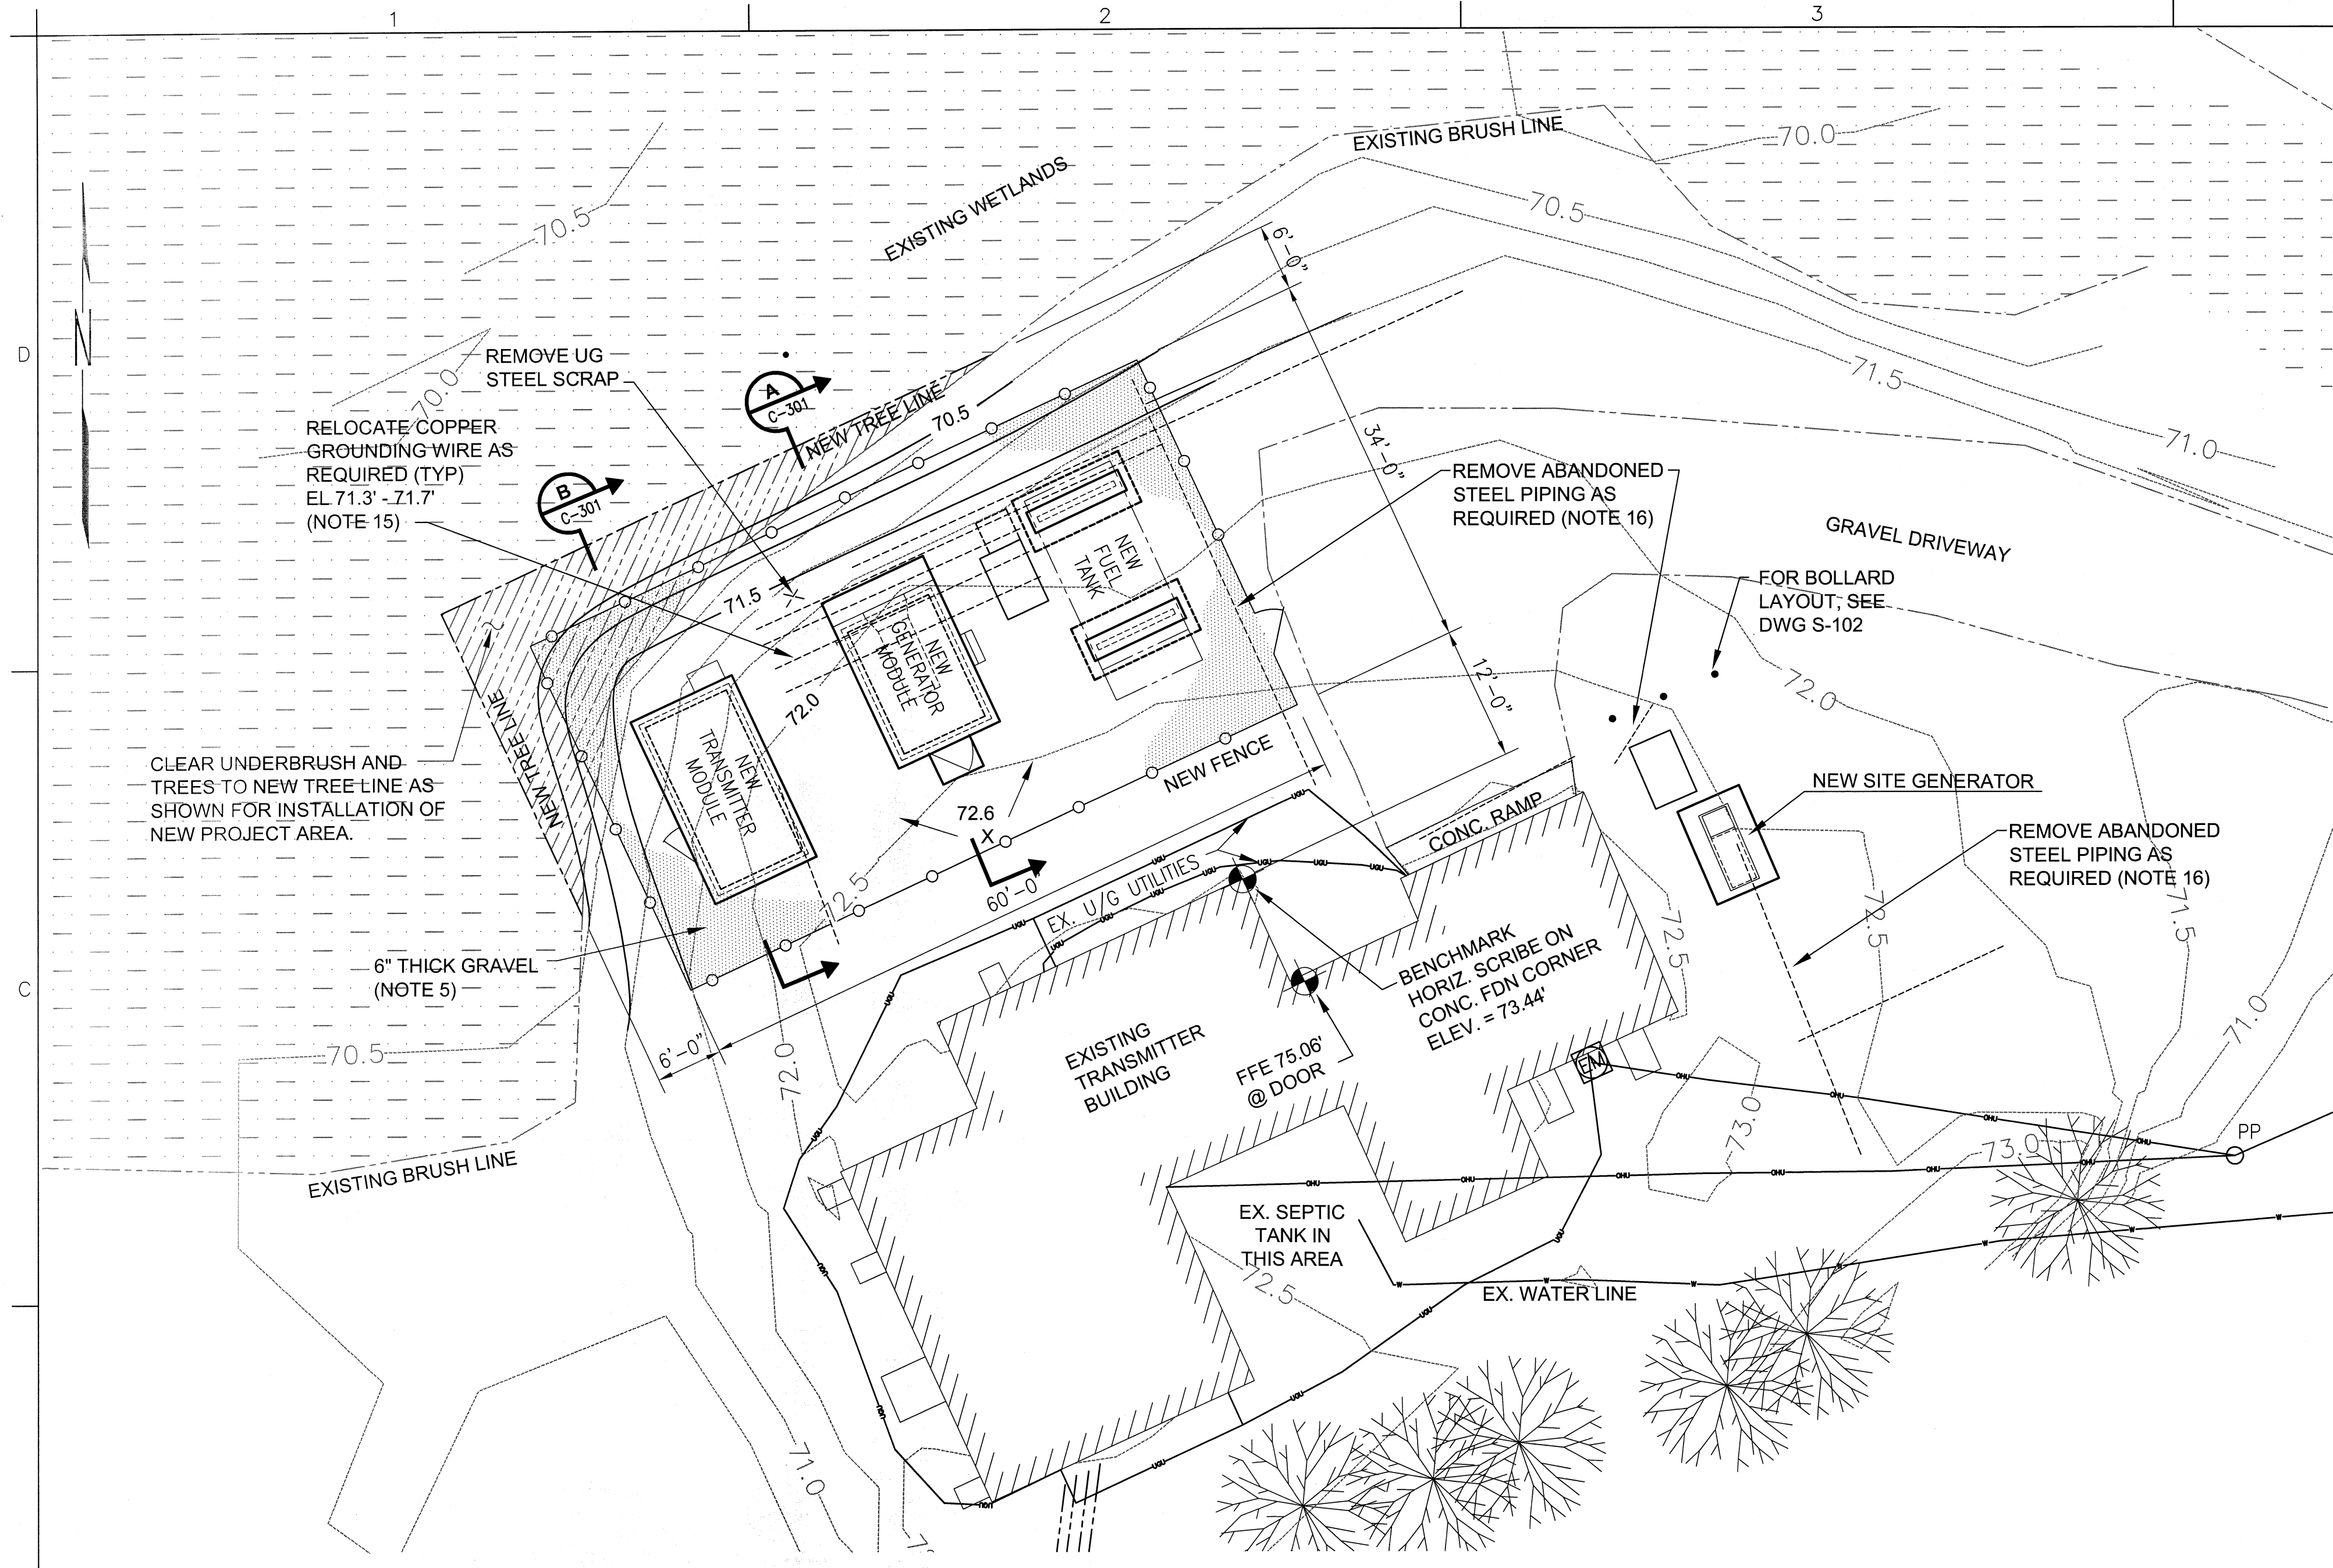

1 STATION WGAN - SITE PLAN
G-001 SCALE: 1"=10'-0"




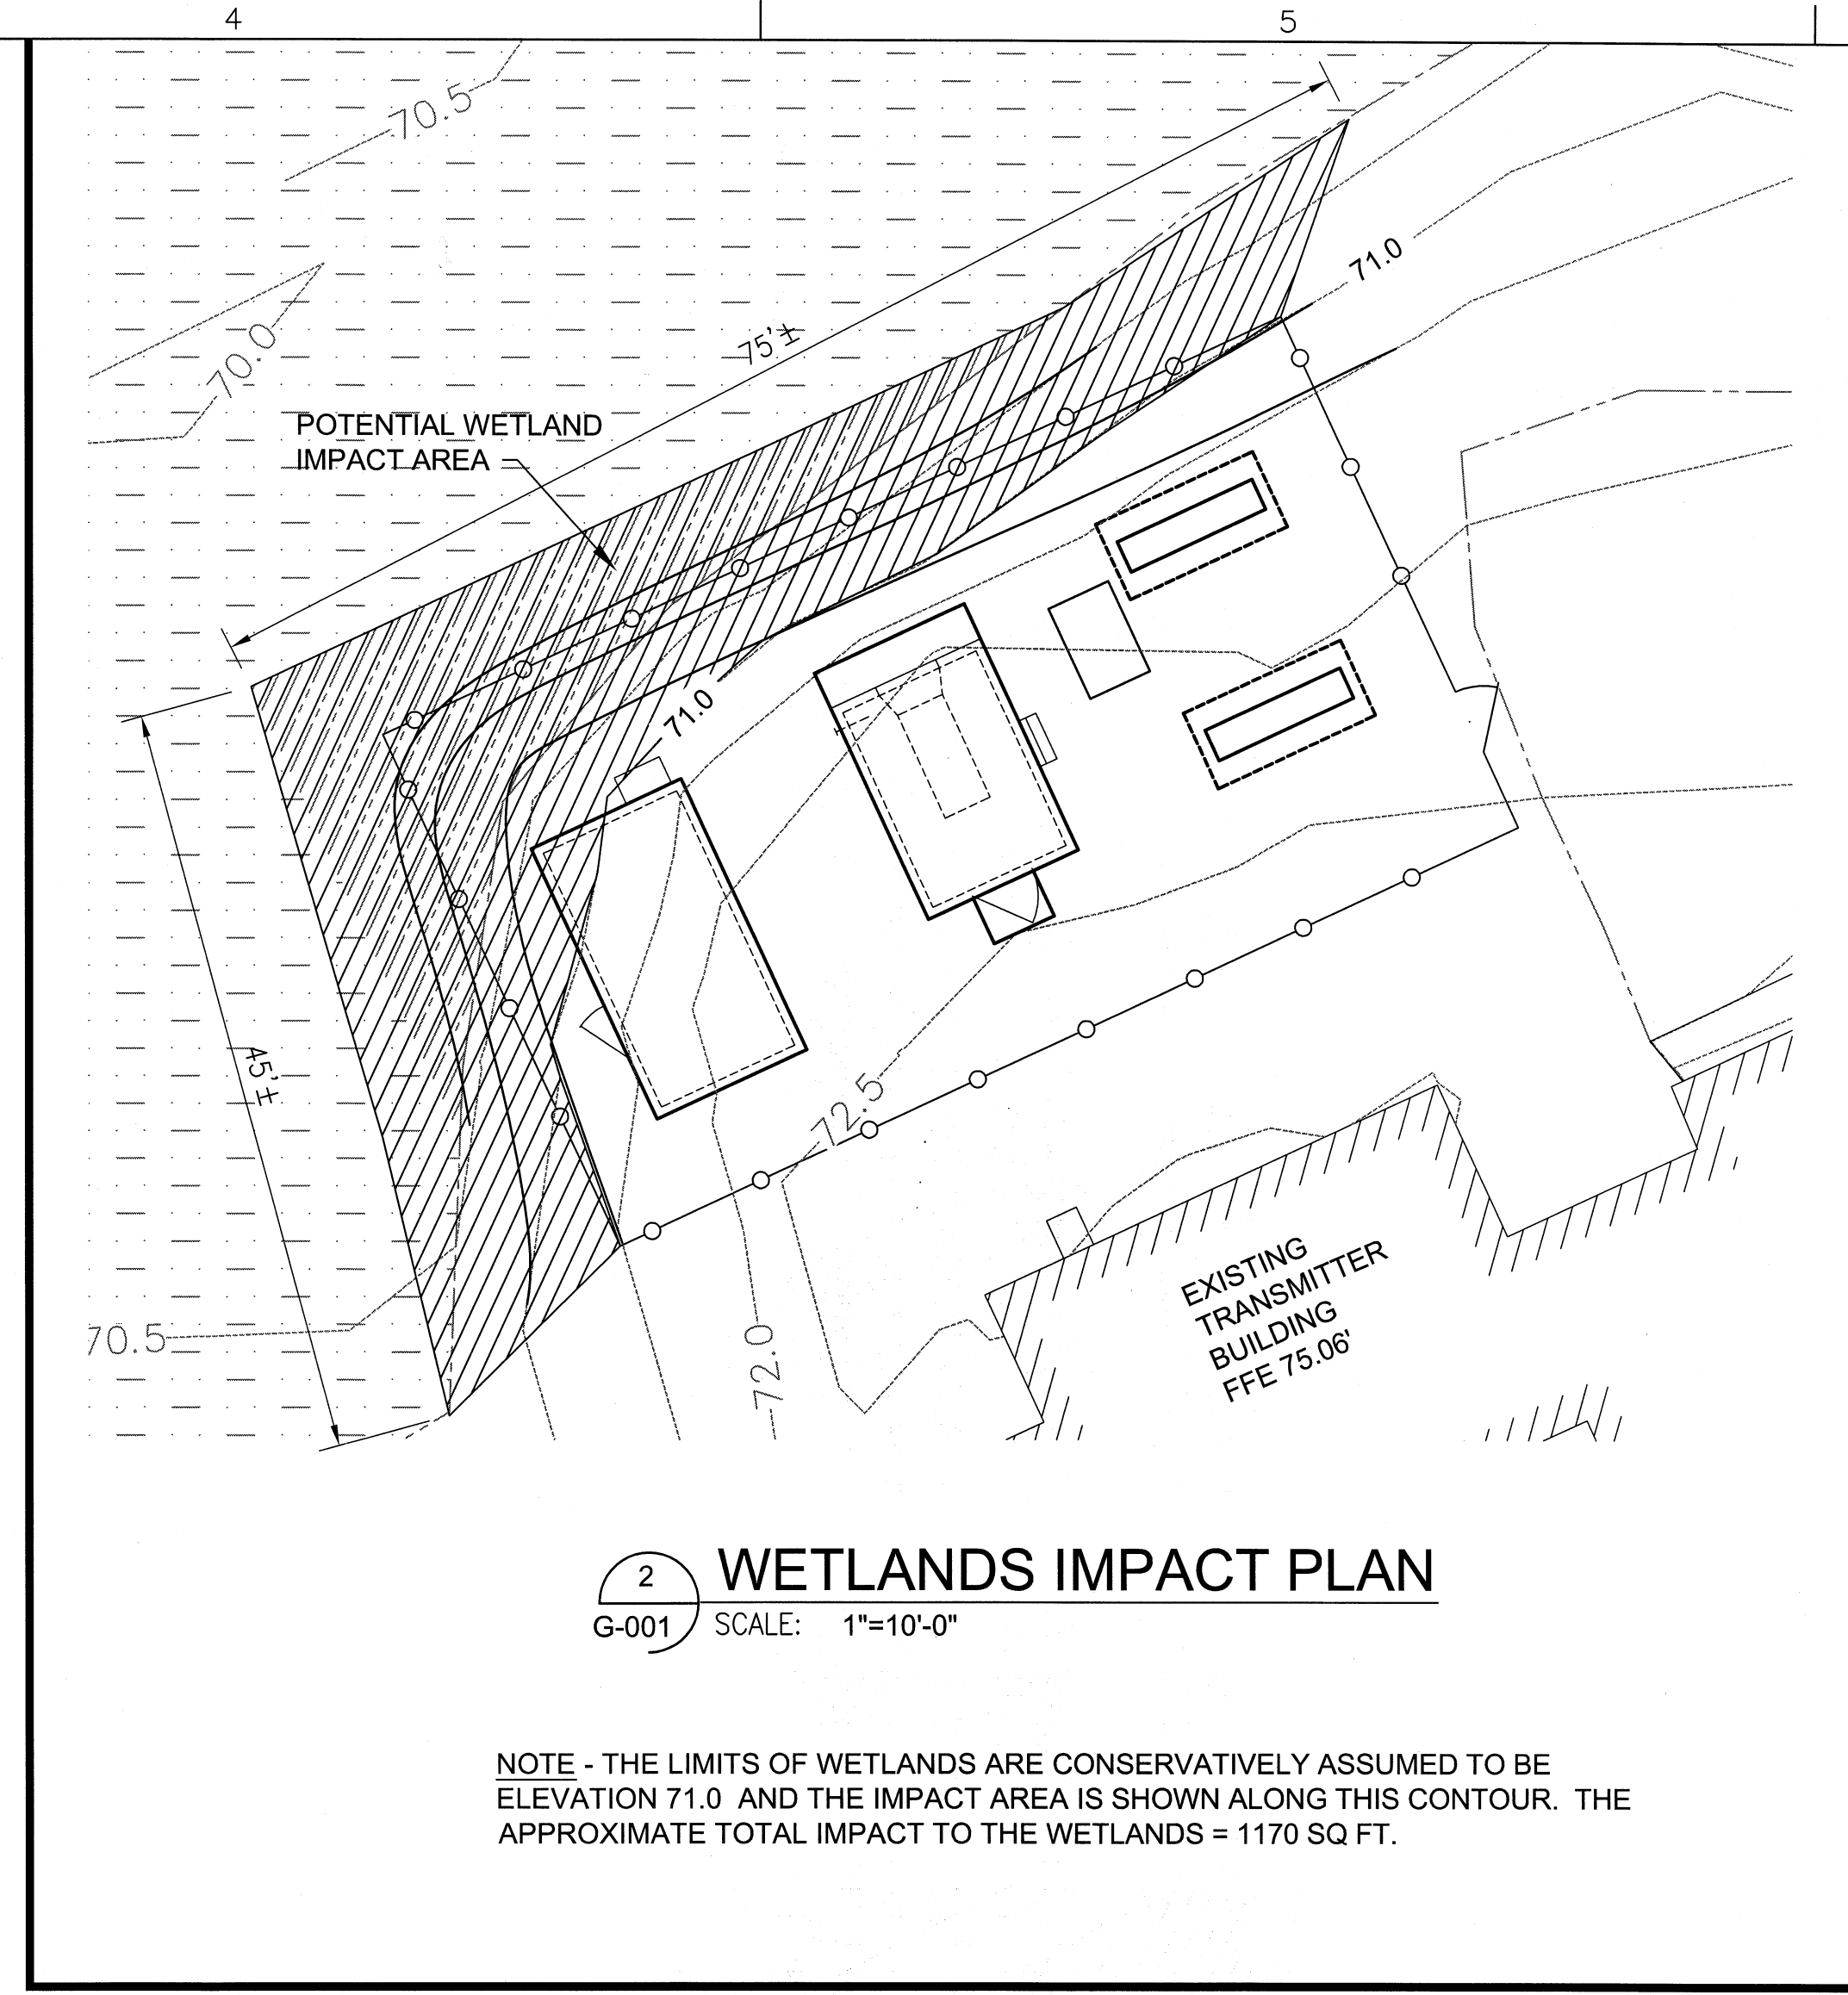


2 WETLANDS IMPACT PLAN
G-001 SCALE: 1"=10'-0"

NOTE - THE LIMITS OF WETLANDS ARE CONSERVATIVELY ASSUMED TO BE ELEVATION 71.0 AND THE IMPACT AREA IS SHOWN ALONG THIS CONTOUR. THE APPROXIMATE TOTAL IMPACT TO THE WETLANDS = 1170 SQ FT.

NOTES:

- SITE PREPARATION, EXCAVATION, AND BACKFILLING SHALL BE ACCOMPLISHED PER THE PLANS, SPECIFICATION 31 23 00.00 20, AND RECOMMENDATIONS IN THE GEOTECHNICAL REPORT BY SCHONEWALD ENGINEERING ASSOCIATES INC. DATED AUGUST 2012. GEOTECHNICAL SERVICES DURING CONSTRUCTION INCLUDING OBSERVATION AND TESTING OF THE EXCAVATIONS, BACKFILL AND COMPACTION, SHALL BE PERFORMED BY THE GEOTECHNICAL ENGINEER OF RECORD.
- EXISTING SOILS SHOULD BE OVEREXCAVATED TO 2 FEET BELOW THE SPECIFIED BOTTOM OF FOOTING ELEVATION TO ACCOMMODATE FOR A LAYER OF 2 FEET THICK CRUSHED STONE BEDDING MATERIAL. THE STONE SHOULD BE WRAPPED IN A NON-WOVEN GEOTEXTILE FABRIC. SEE SPECIFICATION 31 23 00.00 20 FOR STONE AND FABRIC MATERIALS.
- DURING DRILLING, GROUNDWATER WAS ENCOUNTERED AT AN APPROXIMATE DEPTH OF 9 FEET BELOW GRADE. POSITIVE DRAINAGE SHALL BE MAINTAINED DURING CONSTRUCTION. CONSTRUCTION DEWATERING MAY BE REQUIRED AND MUST BE PRESERVE THE UNDISTURBED CONDITION OF THE SUBGRADE.
- MAINTAIN UNIFORM MOISTURE CONDITIONS IN THE EXPOSED SUBGRADE SOILS PRIOR TO CONSTRUCTION OF THE FOUNDATION. A 3 INCH THICK SEAL SLAB IS REQUIRED OVER THE BASE OF THE EXCAVATION IF FOUNDATIONS ARE NOT PLACED THE SAME DAY THE EXCAVATION IS COMPLETED.
- GRAVEL SHALL BE PLACED WITHIN FENCED AREA AS SHOWN ON THE DRAWINGS. GRAVEL SHALL BE CLEAN, COARSELY GRADED NATURAL GRAVEL, CRUSHED STONE, OR A COMBINATION CONFORMING TO ASTM C 33 COARSE AGGREGATE GRADING SIZE 57. WEED CONTROL FABRIC SHALL BE PLACED UNDER THE GRAVEL, AND EXTEND 1 FOOT BEYOND FENCE LINE TO ALLOW GRAVEL TO TAPER TO EXISTING GRADE.
- WHERE THE PROPOSED DUCTBANK OR FUEL LINE CROSSES THE EXISTING DRIVEWAY/PARKING AREA, 4 INCHES OF GRAVEL SHALL BE PLACED OVER THE BACKFILLED TRENCHES. WHERE THE DUCTBANK AND FUEL LINE CROSS AN EXISTING GRASSED AREA, TOPSOIL AND SEEDING SHALL BE PLACED OVER THE COMPACTED BACKFILL. DISTURBED AREAS AROUND THE PROPOSED GENSET AND SUMP SHALL BE SEEDDED OR SODDED WITH 3" MINIMUM TOPSOIL. FOR DUCTBANK SECTION, SEE DWG E-504. FOR FUEL LINE TRENCH DETAIL, SEE DWG M-501. FOR TRENCH BACKFILL, SEE SPECIFICATION 31 23 00.00 20.
- FOLLOWING CONSTRUCTION OF FOUNDATIONS, THE SITE ELEVATION SHALL BE REPLACED TO EXISTING GRADE EXCEPT WHERE NOTED ON DRAWINGS. AREA MUST BE GRADED TO DRAIN WITH NO AREAS OF STANDING WATER PRIOR TO INSTALLATION OF GRAVEL.
- THE PROPOSED ELEVATIONS SHOWN ARE TOP OF GRADE. THE CRUSHED STONE WILL BE PLACED OVER THIS GRADE.
- CONTRACTOR SHALL BE RESPONSIBLE FOR ALL INSTALLATION AND MAINTENANCE OF EROSION AND SEDIMENT CONTROL DEVICES REQUIRED BY STATE AND LOCAL CODES, LAWS AND REGULATIONS. REFER TO DWG C-101.
- WETLANDS ARE LOCATED ON THE SUBJECT PROPERTY. THE WETLANDS ARE NOT TO BE IMPACTED IN ANY WAY DURING CONSTRUCTION EXCEPT AS NOTED. THE WETLANDS SHOWN ARE NOT DELINEATED AND ARE BASED ON THE U.S. FISH AND WILDLIFE WETLANDS INVENTORY, ELEVATION AND THE EXISTING BRUSH LINE.
- TOPOGRAPHIC SURVEY DATA FOR PROJECT SITE PROVIDED BY SEBAGO TECHNICS, INC. SEE SURVEY PLAN DATED JULY 2012. COORDINATES AND BEARINGS ARE REFERENCED TO GRID NORTH, MAINE STATE PLANE COORDINATE SYSTEM, WEST ZONE 1802 (NAD 83). THE VERTICAL DATUM SHOWN IS NAVD 88.
- GEOPHYSICAL DATA FOR THE PROJECT PROVIDED BY HAGER-RICHTER GEOSCIENCE, INC. SEE REPORT DATED JULY 2012 IN APPENDIX D OF THE GEOTECHNICAL REPORT.
- FOR FOUNDATION ELEVATIONS, SEE DWG S-301.
- FENCE TO BE IN ACCORDANCE WITH DETAIL ON DWG S-502 AND SPECIFICATION 32 31 13.53.
- CONTRACTOR TO COORDINATE WITH STATION ENGINEER AND ON-SITE PROJECT MANAGER ON LOCATION OF EXISTING ANTENNA GROUNDING SYSTEMS IN ADDITION TO THOSE SHOWN ON THIS DRAWING. GROUNDING WIRES AND/OR CONDUCTORS TO BE RELOCATED AS SHOWN ON THE ELECTRICAL DRAWINGS PRIOR TO EXCAVATION ACTIVITIES.
- CONTRACTOR RESPONSIBLE FOR VERIFYING EXISTING UNDERGROUND PIPING SHOWN IS NO LONGER IN SERVICE PRIOR TO REMOVAL.

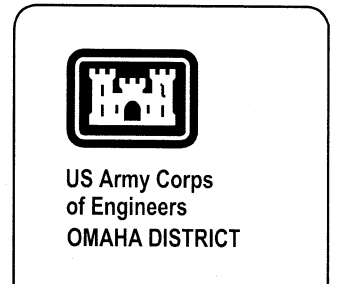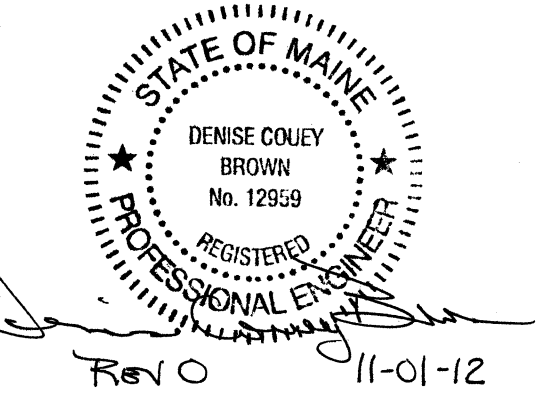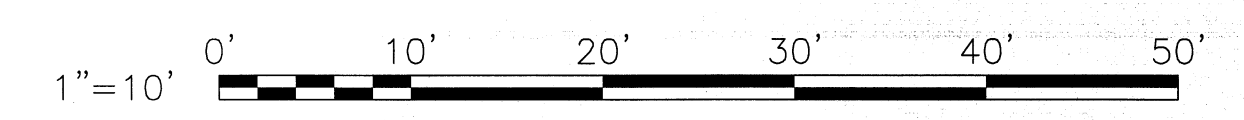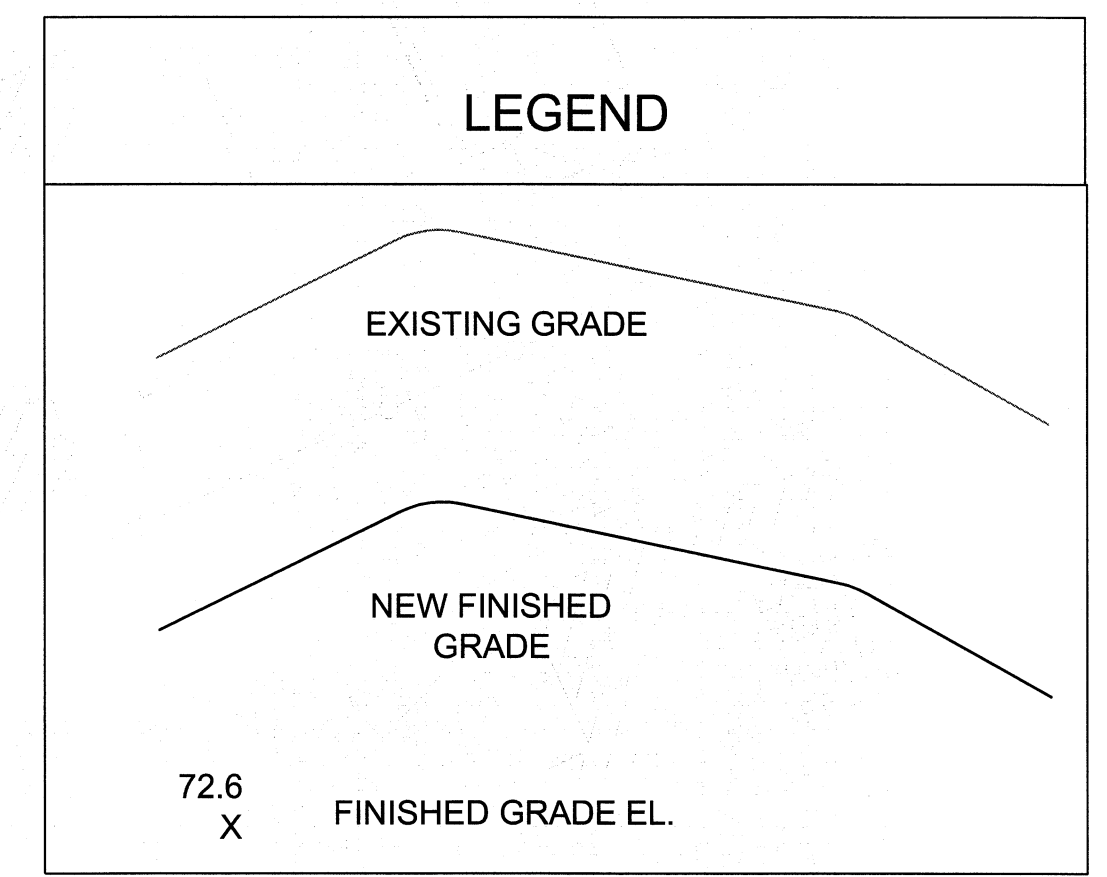

PHASE REVIEW:		Project Manager	DCB
DC Reviewer	Architectural	Structural	Memorial
Plumbing	Electrical	Other	
Mark	0	ISSUED FOR CONSTRUCTION	11/7/12
Date			

Designed by:	DCB
Drawn by:	RAM
Checked by:	MLM
Reviewed by:	DCB
Date:	2012

KBR
63 SOUTH ROYAL STREET SUITE 200
PORTLAND, MAINE 04101
PHONE: (207) 400-7600
FAX: (207) 400-7888

FEMA
FEDERAL EMERGENCY MANAGEMENT AGENCY


KBR
Engineering Services by
r&R Engineering Co. LLC

FEDERAL EMERGENCY RADIO NETWORK
ON WGAN PORTLAND, MAINE
CIVIL PLAN


Drawing Number:
C-102

NOTES:

- FOR CIVIL GENERAL NOTES AND PLAN, SEE DWG C-102.
- FOR EXCAVATION & BACKFILL REQUIREMENTS, SEE GEOTECHNICAL REPORT AND SPECIFICATION 31 23 00 .00 20.
- FOR TOP OF CONCRETE ELEVATIONS, SEE DWG S-301.

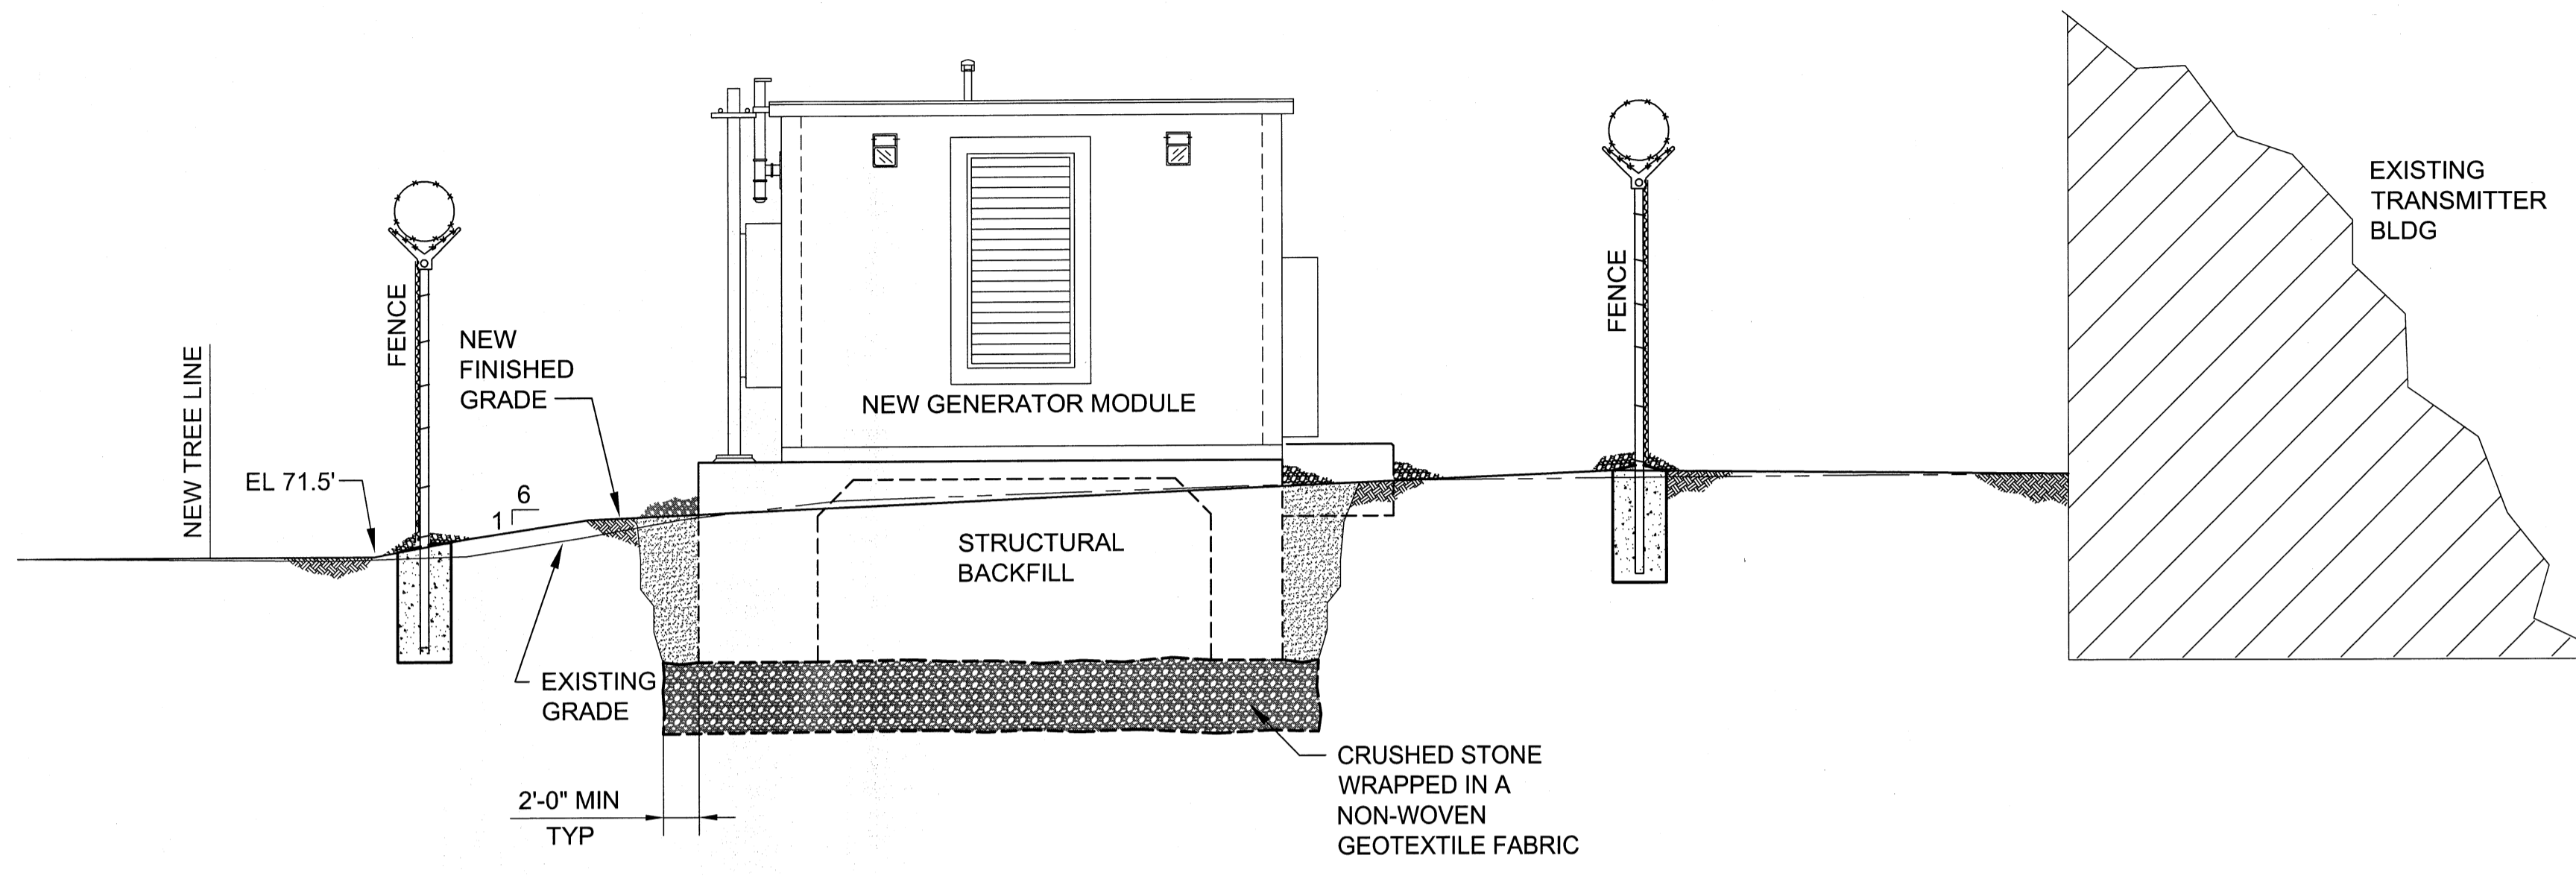

A CROSS SECTION
C-102 SCALE: 1/4"=10'

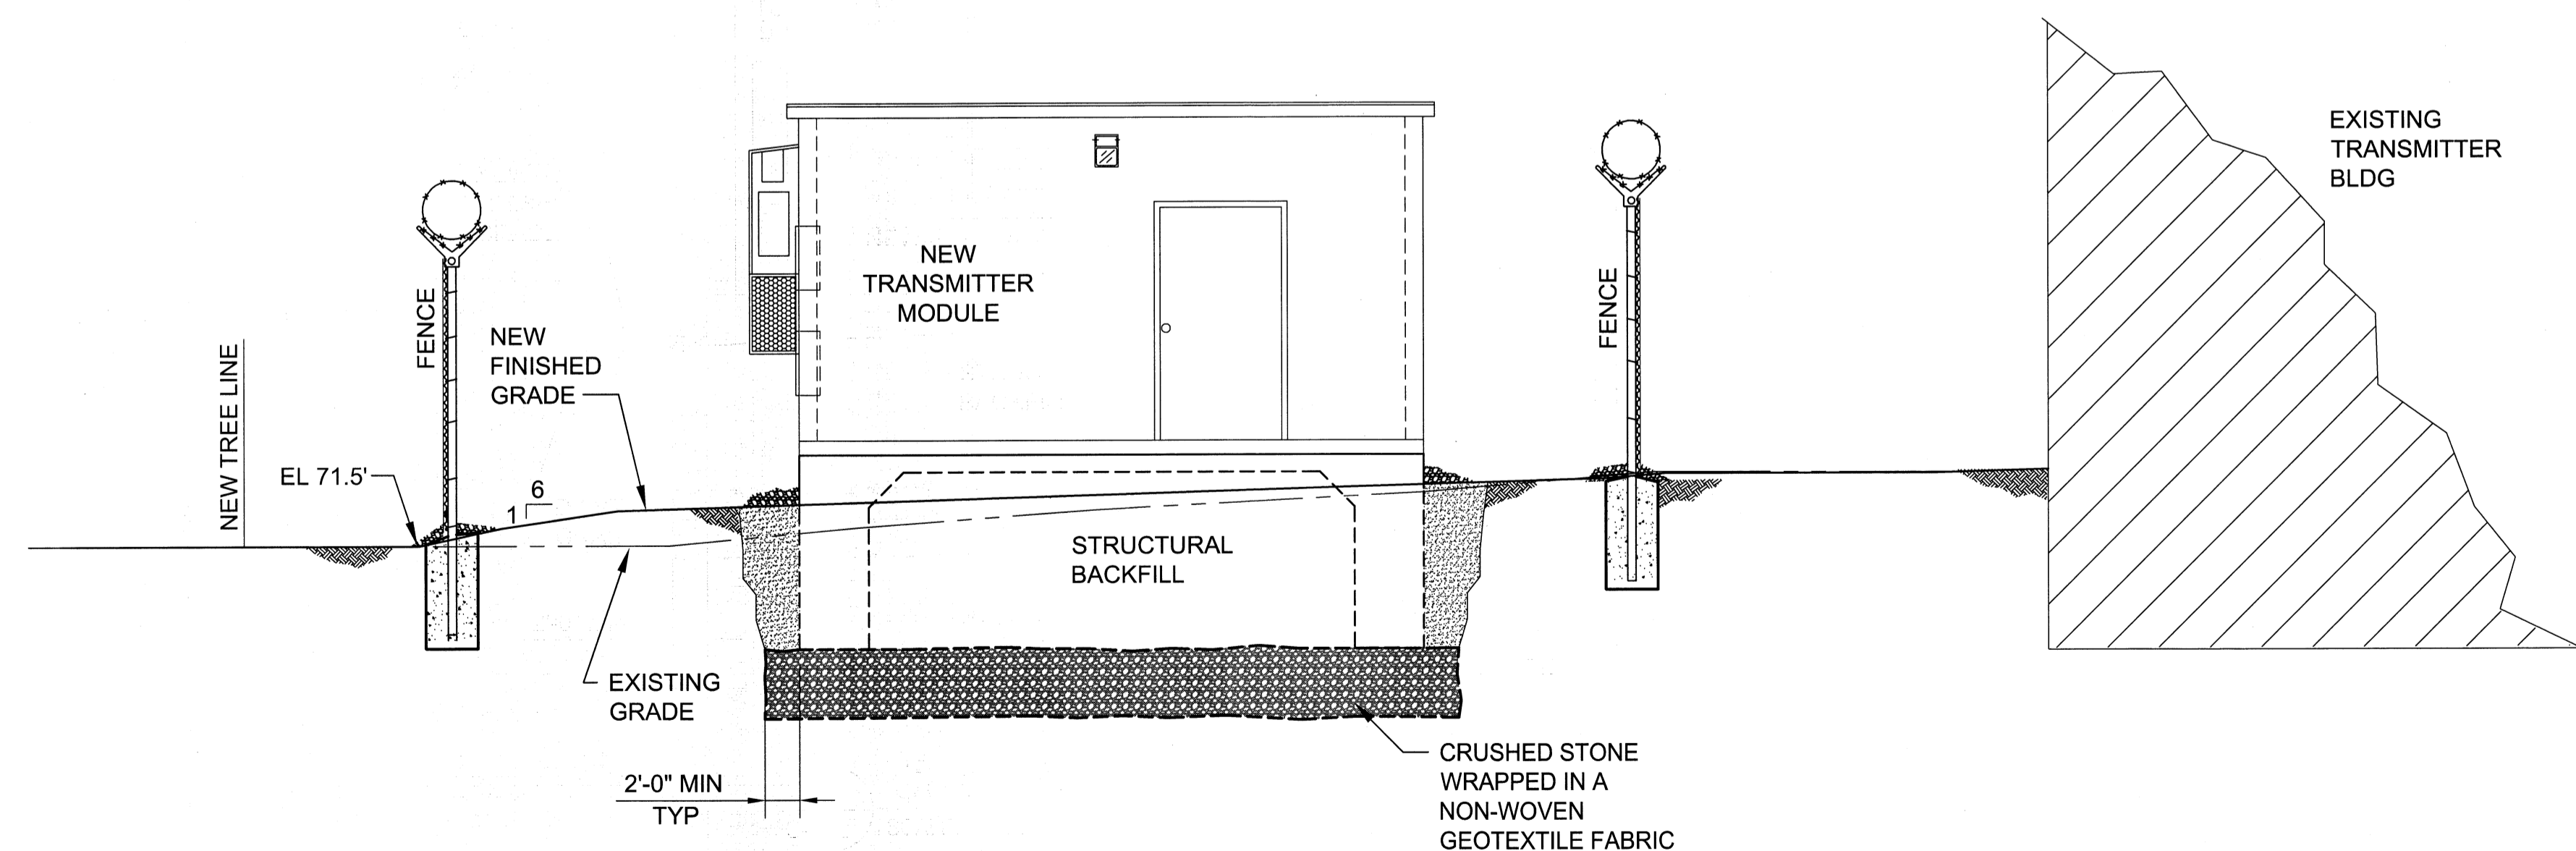

B CROSS SECTION
C-102 SCALE: 1/4"=10'



Project Manager	DCB
DC Designer	DCB
Architectural	
Structural	
Mechanical	
Plumbing	
Electrical	
Civil	

Date	Mark	Description
11/1/12		ISSUED FOR CONSTRUCTION


Designed by	DCB
Drawn by	RAM
Checked by	DCB
Reviewed by	CHB
Date	2012

43 SOUTH ROYAL STREET SUITE 200
MOBILE, AL 36602
PHONE: (251) 462-7800
FAX: (251) 462-7898

Engineering Services by
KBR Engineering Co., LLC

FEMA EMERGENCY RADIO NETWORK
ON WIGAN PORTLAND, MAINE

CIVIL SECTIONS

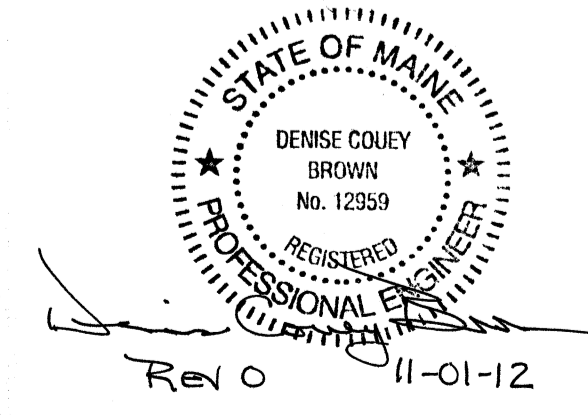

Drawing Number:
C-301

GENERAL NOTES

CONCRETE MATERIALS

- UNLESS OTHERWISE NOTED ON DRAWINGS, CAST-IN-PLACE CONCRETE MIXES SHALL BE AS SHOWN IN SPEC 03 30 53.
- REINFORCING BARS SHALL BE DEFORMED AND SHALL CONFORM TO ASTM A615, GRADE 60 AND SPECIFICATION 03 30 53.
- ANCHOR BOLT MATERIAL SHALL BE AS SHOWN ON THE DRAWINGS.
- EMBEDDED STEEL MATERIAL SHALL CONFORM TO ASTM A36 UNLESS NOTED OTHERWISE ON DRAWINGS.
- EMBEDDED PIPE SLEEVES SHALL BE ASTM A53 GRADE B UNLESS OTHERWISE NOTED ON DRAWINGS.
- GROUT UNDER ALL STRUCTURAL COLUMNS, EQUIPMENT BASES AND AROUND ANCHOR BOLTS, SHALL BE PREPACKAGED, CEMENTITIOUS NON-SHRINK, NON-METALLIC. GROUT SHALL HAVE MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 5,000 PSI AND CONFORM TO ASTM C 1107.

CONCRETE CONSTRUCTION METHODS

- SITE PREPARATION, EXCAVATION, AND BACKFILLING SHALL BE ACCOMPLISHED PER THE PLANS, SPECIFICATION 31 23 00 00 20, AND THE RECOMMENDATIONS IN THE GEOTECHNICAL REPORT. GEOTECHNICAL SERVICES DURING CONSTRUCTION INCLUDING OBSERVATION AND TESTING OF THE EXCAVATIONS, BACKFILL AND COMPACTION, SHALL BE PERFORMED BY THE GEOTECHNICAL ENGINEER OF RECORD. SEE CIVIL DRAWING C-102.
- COORDINATE CONCRETE WORK WITH PIPING, ELECTRICAL AND MECHANICAL WORK PRIOR TO PLACING CONCRETE.
- EXPOSED EDGES OF CONCRETE SHALL HAVE 3/4 INCH CHAMFER.
- ALL CONCRETE REINFORCEMENT DETAILING SHALL BE IN ACCORDANCE WITH ACI 318-08.
- CONCRETE COVER FOR REINFORCING BARS FOR CAST-IN-PLACE CONCRETE SHALL CONFORM TO THE MINIMUM CONCRETE COVER SPECIFIED IN ACI 318-08, UNLESS SHOWN OTHERWISE ON DRAWINGS.
- TENSION SPLICES IN REINFORCING BARS SHALL BE CLASS "B" (ACI 318-08) UNLESS SHOWN OTHERWISE ON THE DRAWINGS AND COMPRESSION SPLICES SHALL BE IN ACCORDANCE WITH ACI 318-08, SECTION 12.16, UNLESS OTHERWISE SHOWN ON DRAWINGS.
- SURFACE FINISHES ARE DESCRIBED IN THE CONCRETE CONSTRUCTION SPECIFICATIONS. FINISH FOR SLABS AND PADS SHALL BE BROOM FINISHED UNLESS INDICATED OTHERWISE ON THE DRAWINGS.
- CONCRETE INDICATED ON THE DRAWINGS TO BE "ROUGHENED" SHALL BE CLEAN, FREE OF LAITANCE AND ROUGHENED TO A FULL AMPLITUDE OF APPROXIMATELY 1/4 INCH.

STRUCTURAL STEEL

- STRUCTURAL STEEL "W" SHAPES SHALL CONFORM TO ASTM A 992, GRADE 50. ALL CHANNELS, ANGLES, AND PLATES SHALL CONFORM TO ASTM A 36 UNLESS NOTED OTHERWISE.
- HIGH STRENGTH BOLTS, NUTS, AND HARDENED WASHERS SHALL CONFORM TO ASTM A 325, ASTM A 563 DH, AND ASTM F 436 RESPECTIVELY. BOLTS, NUTS, AND WASHERS SHALL BE MECHANICALLY GALVANIZED.
- WELDING ELECTRODES SHALL CONFORM TO AWS A5.1, WITH A MINIMUM ELECTRODE TENSILE STRENGTH OF 70 KSI.
- ALL STRUCTURAL AND MISCELLANEOUS STEEL SHALL BE HOT-DIP GALVANIZED AFTER FABRICATION IN ACCORDANCE WITH THE APPLICABLE PROVISIONS OF ASTM A 123, A 143, A 384, AND A 385. ALL DAMAGED HOT-DIP GALVANIZED AREAS SHALL BE COATED WITH ZRC COLD GALVANIZING COMPOUND, OR APPROVED EQUAL.
- STRUCTURAL STEEL FABRICATION AND ERECTION SHALL BE IN ACCORDANCE WITH SPECIFICATION 05 12 00.

FOUNDATION DESIGN LOAD DATA:

DESIGN WIND, SNOW AND SEISMIC LOADING VALUES ARE GREATER THAN THE VALUES REQUIRED BY IBC SITE SPECIFIC DATA

GEOTECHNICAL:

ALLOWABLE SOIL BEARING LOAD = 3000 PSF

6,000 GALLON DOUBLE WALL FUEL TANK (UL-2085):

8'-0" DIAMETER, 16'-0" LENGTH

DEAD LOAD:

TANK, SADDLES, PLATFORM, ETC. = 22,900 LBS

FLUID LOAD:

DIESEL FUEL = 51,200 LBS

WIND LOAD:

V = 156 MPH
Iw = 1.15
EXPOSURE = C

TRANSMITTER MODULE:

10'-0" WIDE, 18'-0" LONG

DEAD LOAD:

PRE-CAST BLDG AND CONTENTS = 45,000 LBS

LIVE LOAD:

9,000 LBS

WIND LOAD:

V = 156 MPH
Iw = 1.15
ENCLOSED BLDG.
EXPOSURE = C

SNOW LOAD:

Pg = 80 LB/SF
Pf = 72.6 LB/SF
Ce = 0.9
I = 1.2
Ct = 1.2

SEISMIC LOAD:

Ie = 1.5
Ss = 1.25
S1 = 0.40
SITE CLASS = D
S0s = 0.83
S01 = 0.43
SEISMIC DESIGN CATEGORY = D
BASE SHEAR = 31,100 LBS
Cs = 0.42
R = 3
ANALYSIS METHOD = EQUIVALENT
LATERAL FORCE - NON BUILDING STRUCTURE

SEISMIC LOAD:

Ie = 1.5
Ss = 1.25
S1 = 0.40
SITE CLASS = D
S0s = 0.83
S01 = 0.43
SEISMIC DESIGN CATEGORY = D
BASE SHEAR = 14,630 LBS
Cs = 0.25
R = 5
ANALYSIS METHOD = EQUIVALENT
LATERAL FORCE - BUILDING STRUCTURE

GENERATOR MODULE:

10'-0" WIDE, 14'-0" LONG

DEAD LOAD:

PRE-CAST BLDG AND CONTENTS = 37,000 LBS

LIVE LOAD:

7,000 LBS

WIND LOAD:

V = 156 MPH
Iw = 1.15
ENCLOSED BLDG.
EXPOSURE = C

SNOW LOAD:

Pg = 80 LB/SF
Pf = 72.6 LB/SF
Ce = 0.9
I = 1.2
Ct = 1.2

SEISMIC LOAD:

Ie = 1.5
Ss = 1.25
S1 = 0.40
SITE CLASS = D
S0s = 0.83
S01 = 0.43
SEISMIC DESIGN CATEGORY = D
BASE SHEAR = 12,000 LBS
Cs = 0.25
R = 5
ANALYSIS METHOD = EQUIVALENT
LATERAL FORCE - BUILDING STRUCTURE

SITE GENERATOR, WEATHER ENCLOSURE & SUBBASE FUEL TANK:

DEAD LOAD:

GENSET, ENCLOSURE, AND TANK = 4,300 LBS

FLUID LOAD:

NOMINAL CAPACITY = 215 GALLONS
DIESEL FUEL = 1,800 LBS

WIND LOAD:

V = 156 MPH
Iw = 1.15
EXPOSURE = C

SEISMIC LOAD:

Ie = 1.5
Ss = 1.40
S1 = 0.42
SITE CLASS = D
S0s = 0.94
S01 = 0.45
SEISMIC DESIGN CATEGORY = D
BASE SHEAR = 3,200 LBS
Cs = 0.56
R = 2.5
ANALYSIS METHOD = EQUIVALENT
LATERAL FORCE - NON BUILDING STRUCTURE

HOLD FOR GENSET VENDOR DATA



Project Manager	
QC Reviewer	
Architectural	
Structural	
Mechanical	
Plumbing	
Electrical	
Civil	


ISSUED FOR CONSTRUCTION	1/17/12	Date
Description		
Work		

Designed by	DCB
Drawn by	RAM
Checked by	MLM
Reviewed by	DCB
Date:	2012

KBR
63 SOUTH ROYAL STREET SUITE 200
MOBILE, AL 36602
PHONE: (251) 455-7000
FAX: (251) 455-7496

FEMA
FEDERAL EMERGENCY MANAGEMENT AGENCY


KBR Engineering Services by KBR Engineering Co. LLC

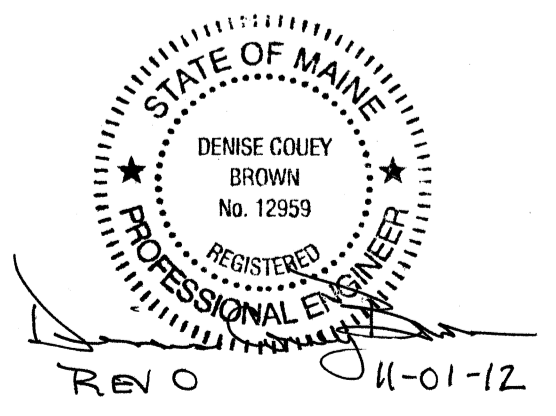

FEMA EMERGENCY RADIO NETWORK
ON WIGAN PORTLAND, MAINE


STRUCTURAL GENERAL NOTES

Drawing Number:
S-001

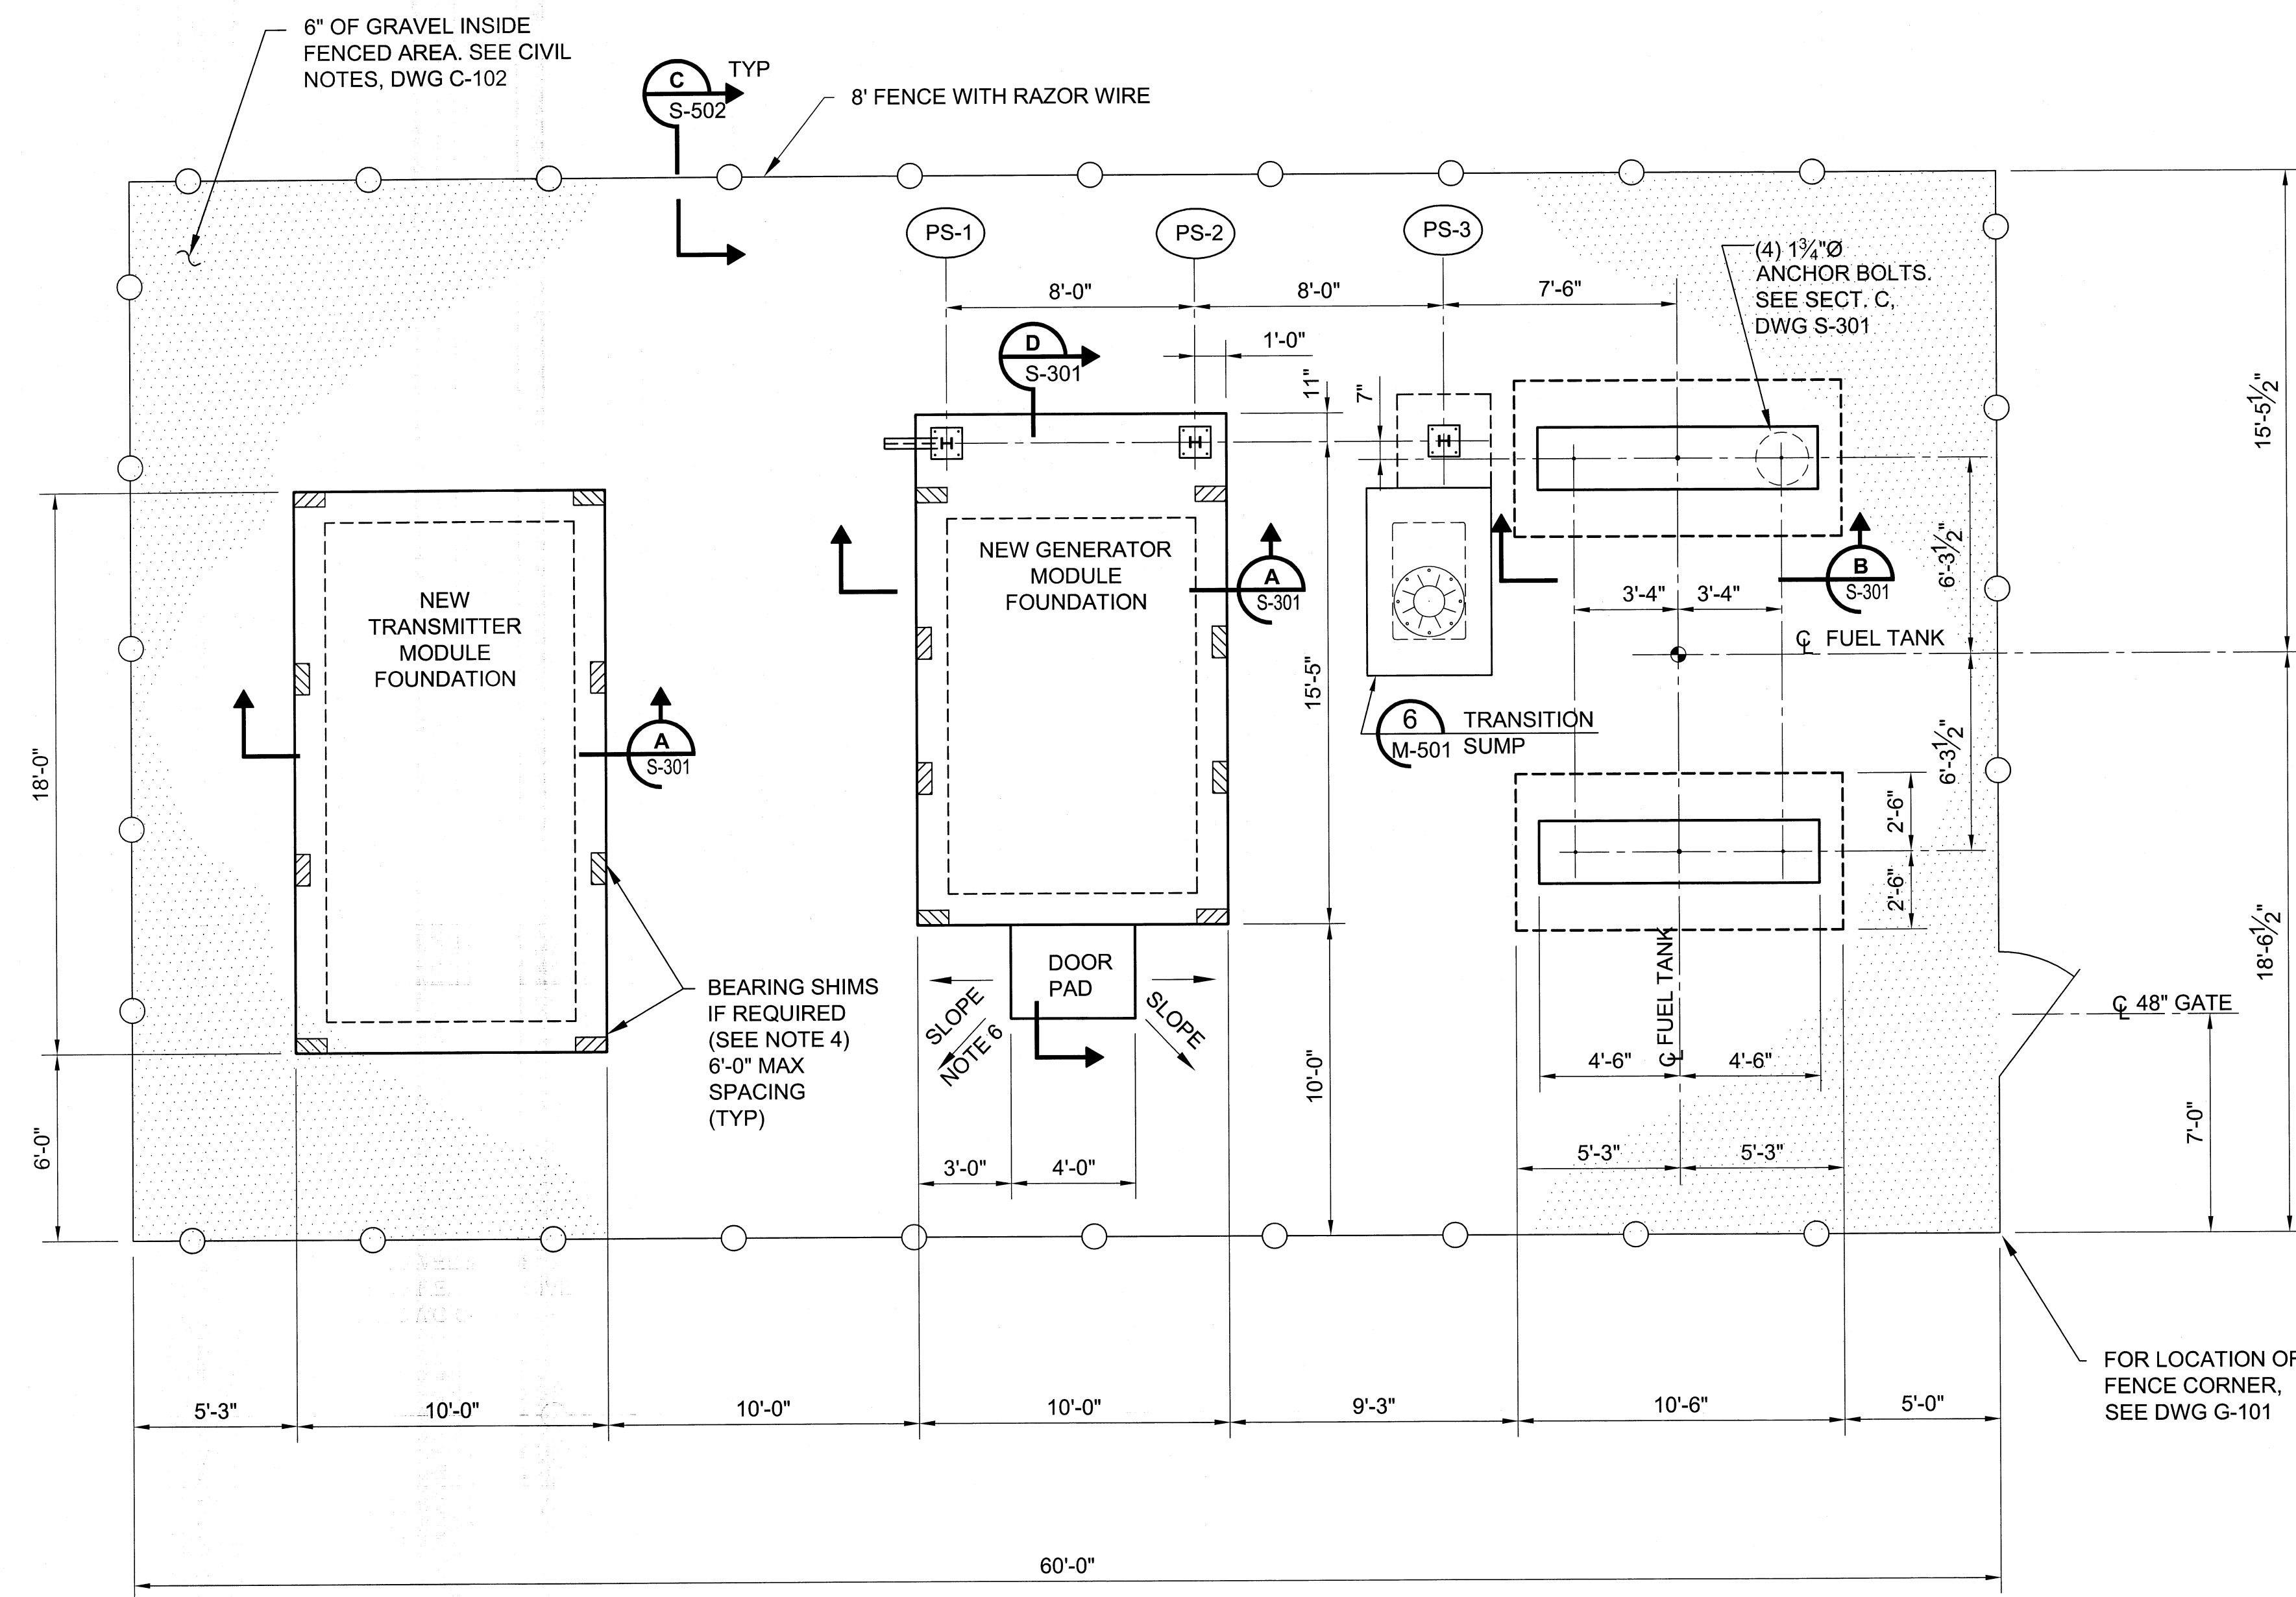

NOTES:

- FOR STRUCTURAL GENERAL NOTES, SEE DWG S-001. FOR CIVIL NOTES, SEE DWG C-102.
- PS-1 PIPE SUPPORT DESIGNATOR. SEE DWG S-501.
- SEE ELECTRICAL DRAWINGS FOR GROUNDING.
- BEARING SHIMS SHALL BE USED AS REQUIRED TO ASSURE PERIMETER BEARING OF GENERATOR AND TRANSMITTER MODULES. BEARING SHIMS PROVIDED WITH MODULE.
- CONTRACTOR TO CONTACT ENGINEER IF WEIGHT OF EQUIPMENT PURCHASED EXCEEDS THE DEAD AND FLUID LOADS SHOWN ON DWG S-001.
- SLOPE FINISHED GRADE AND GRAVEL AWAY FROM DOOR PAD AS SHOWN.





Project Manager	
QC Reviewer	
Architectural	
Structural	
Mechanical	
Plumbing	
Electrical	
Civil	

0	ISSUED FOR CONSTRUCTION	11/7/12	Mark
		Date	Revised

Designed by:	DCB
Drawn by:	RAM
Checked by:	MLM
Reviewed by:	DCB
Date:	2012


FEMA
KBR
 63 SOUTH ROYAL STREET SUITE 200
 MOBILE, AL 36602
 PHONE (251) 400-7788
 FAX (251) 400-7788
 Engineering Services by
 KBR Engineering Co., LLC

A
G-101 FOUNDATION AND FENCE PLAN
 SCALE: 1/4"=1'-0"

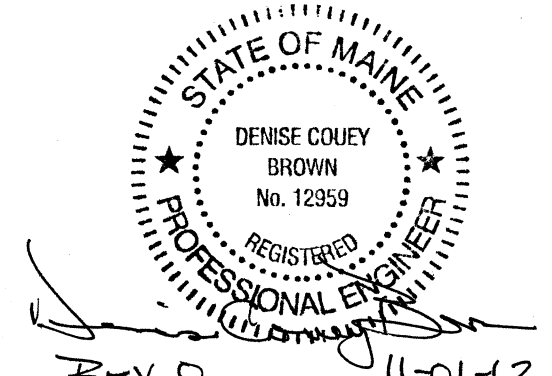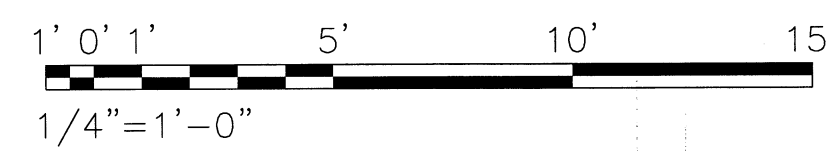


FEMA EMERGENCY RADIO NETWORK
 ON WIGAN PORTLAND, MAINE
**FOUNDATION AND FENCE
 PLAN**

Drawing
 Number:
S-101

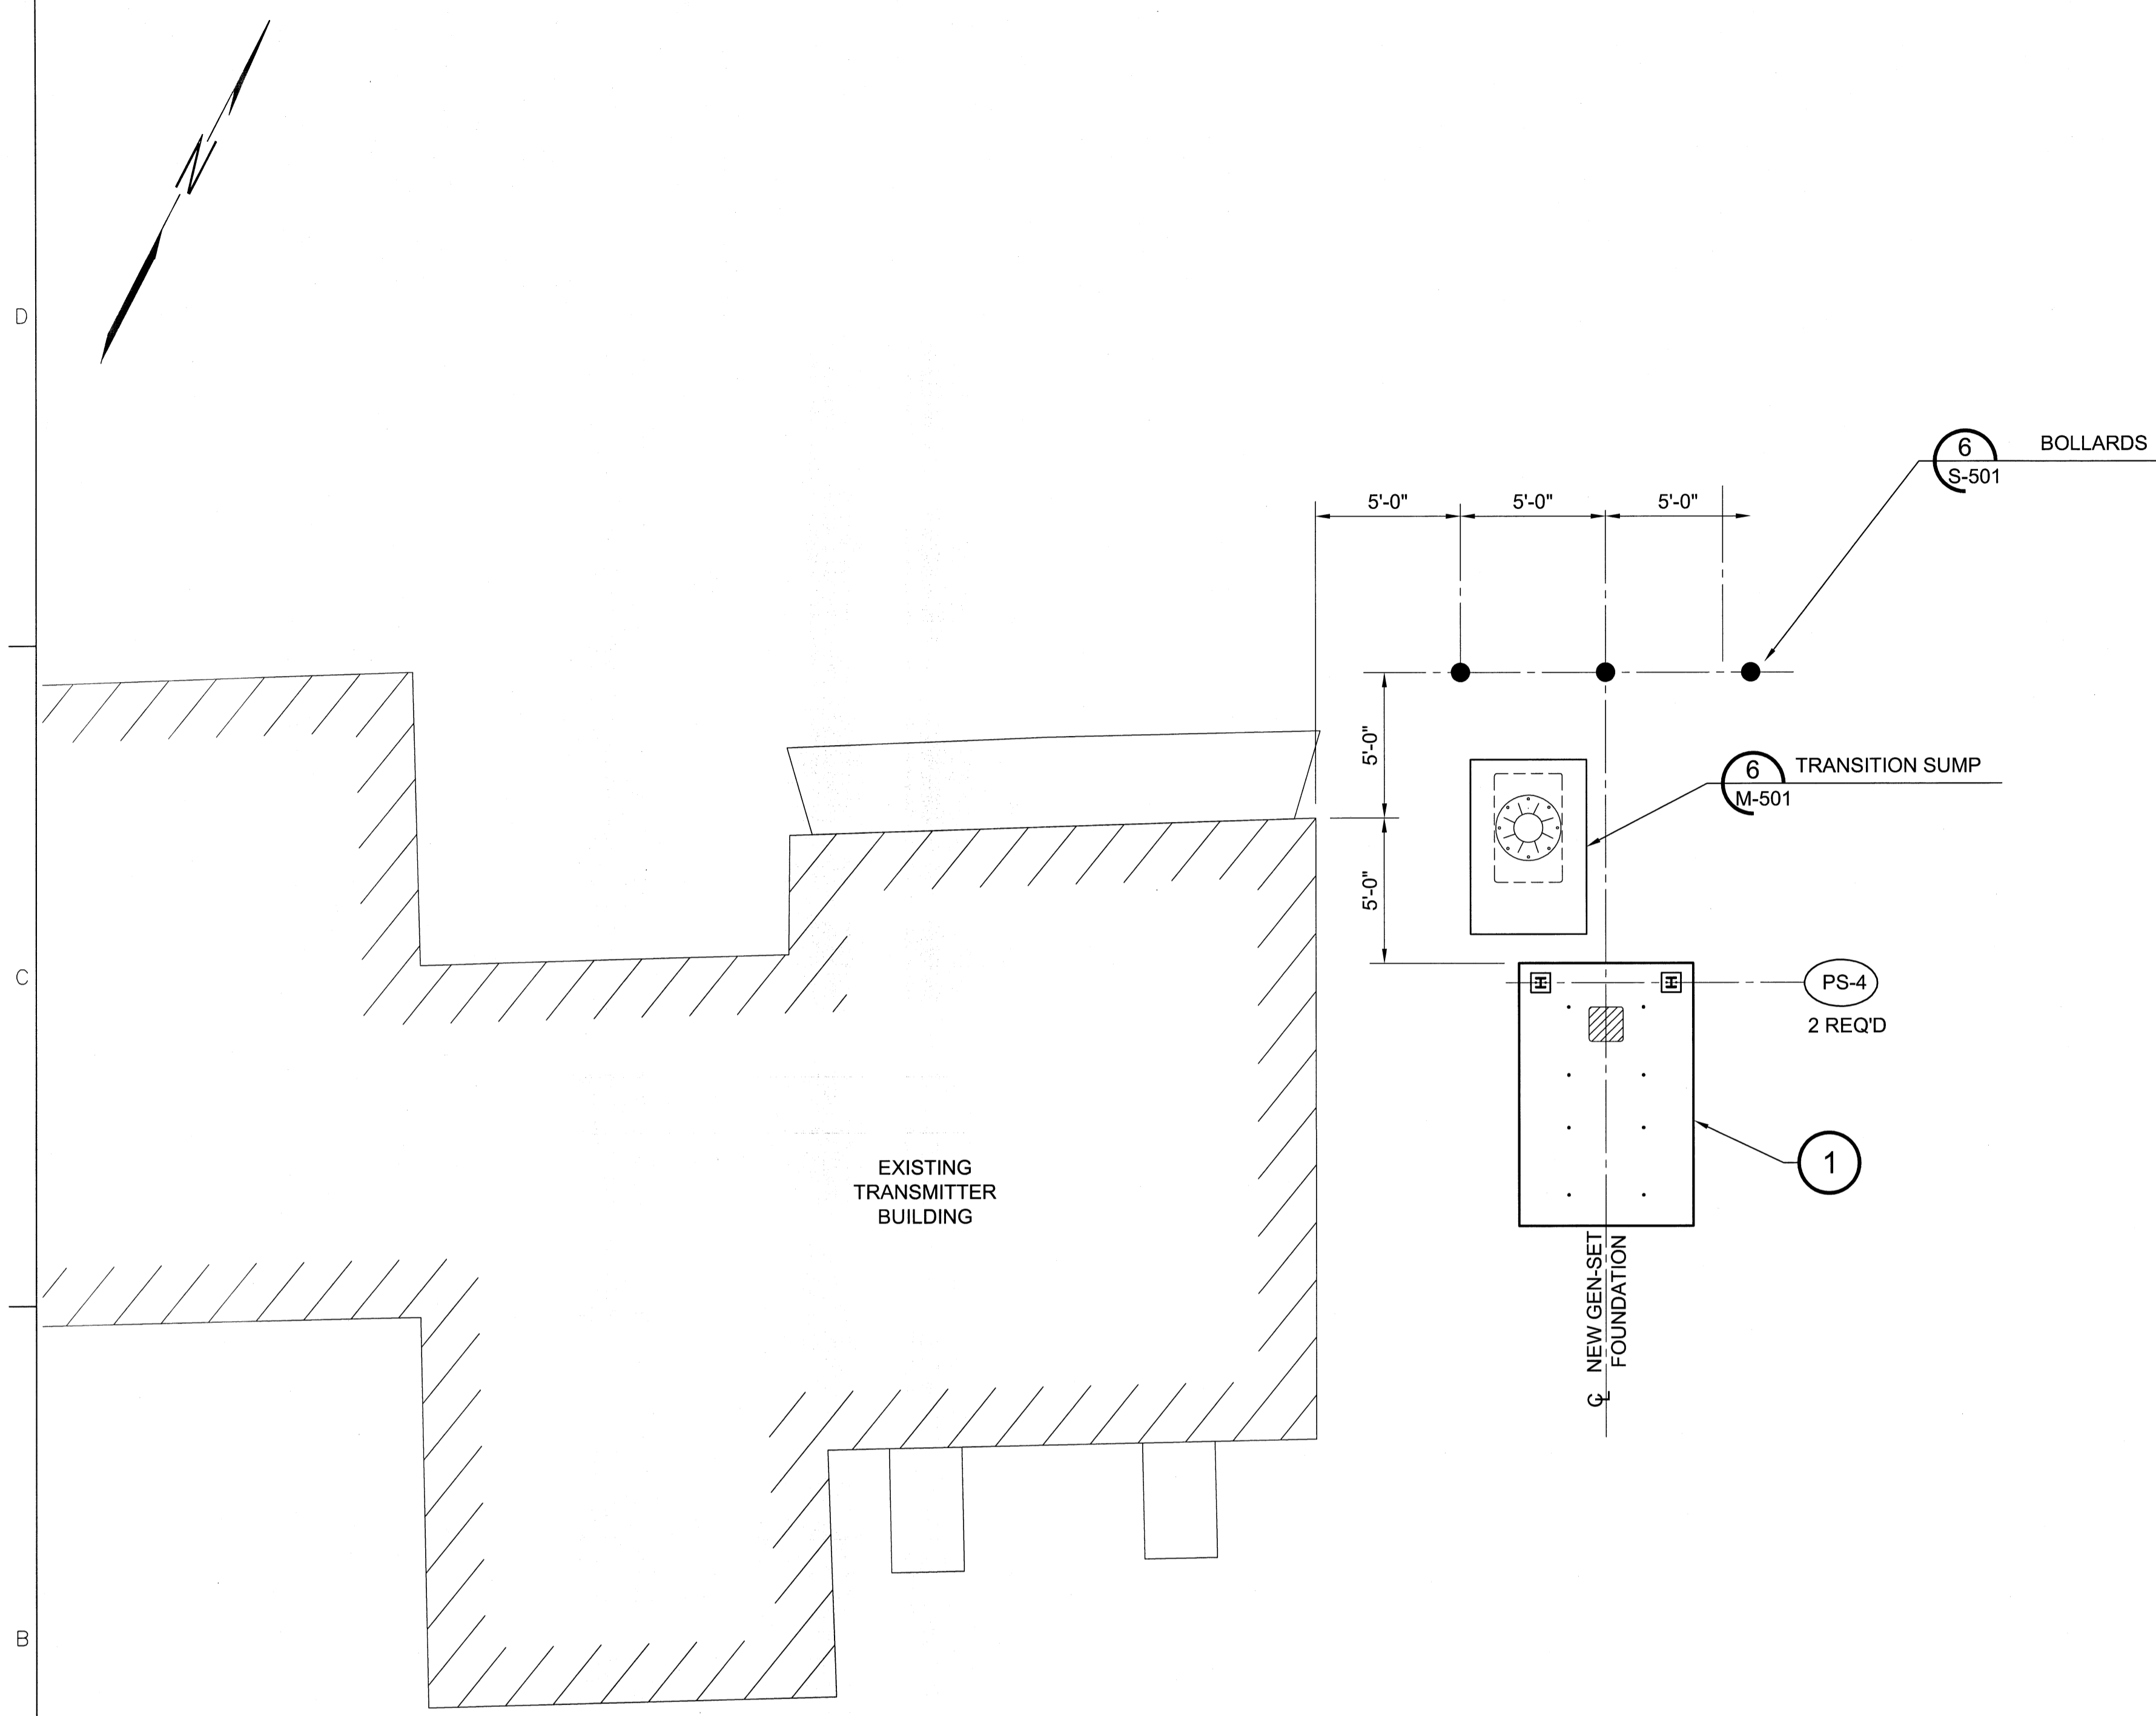


1 SITE GENERATOR FOUNDATION PLAN
 SCALE: 1/4"=1'-0"

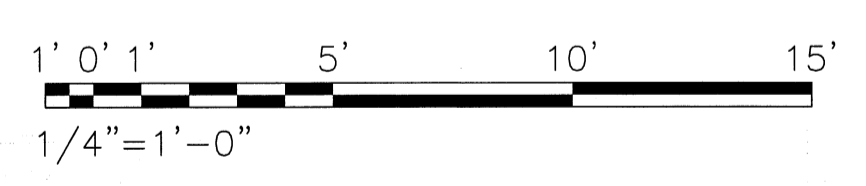

NOTES:

- FOR STRUCTURAL GENERAL NOTES, SEE DWG S-001. FOR CIVIL NOTES, SEE DWG C-102.
- (PS-1) PIPE SUPPORT DESIGNATOR. SEE DWG S-501.
- SEE ELECTRICAL DRAWINGS FOR GROUNDING.

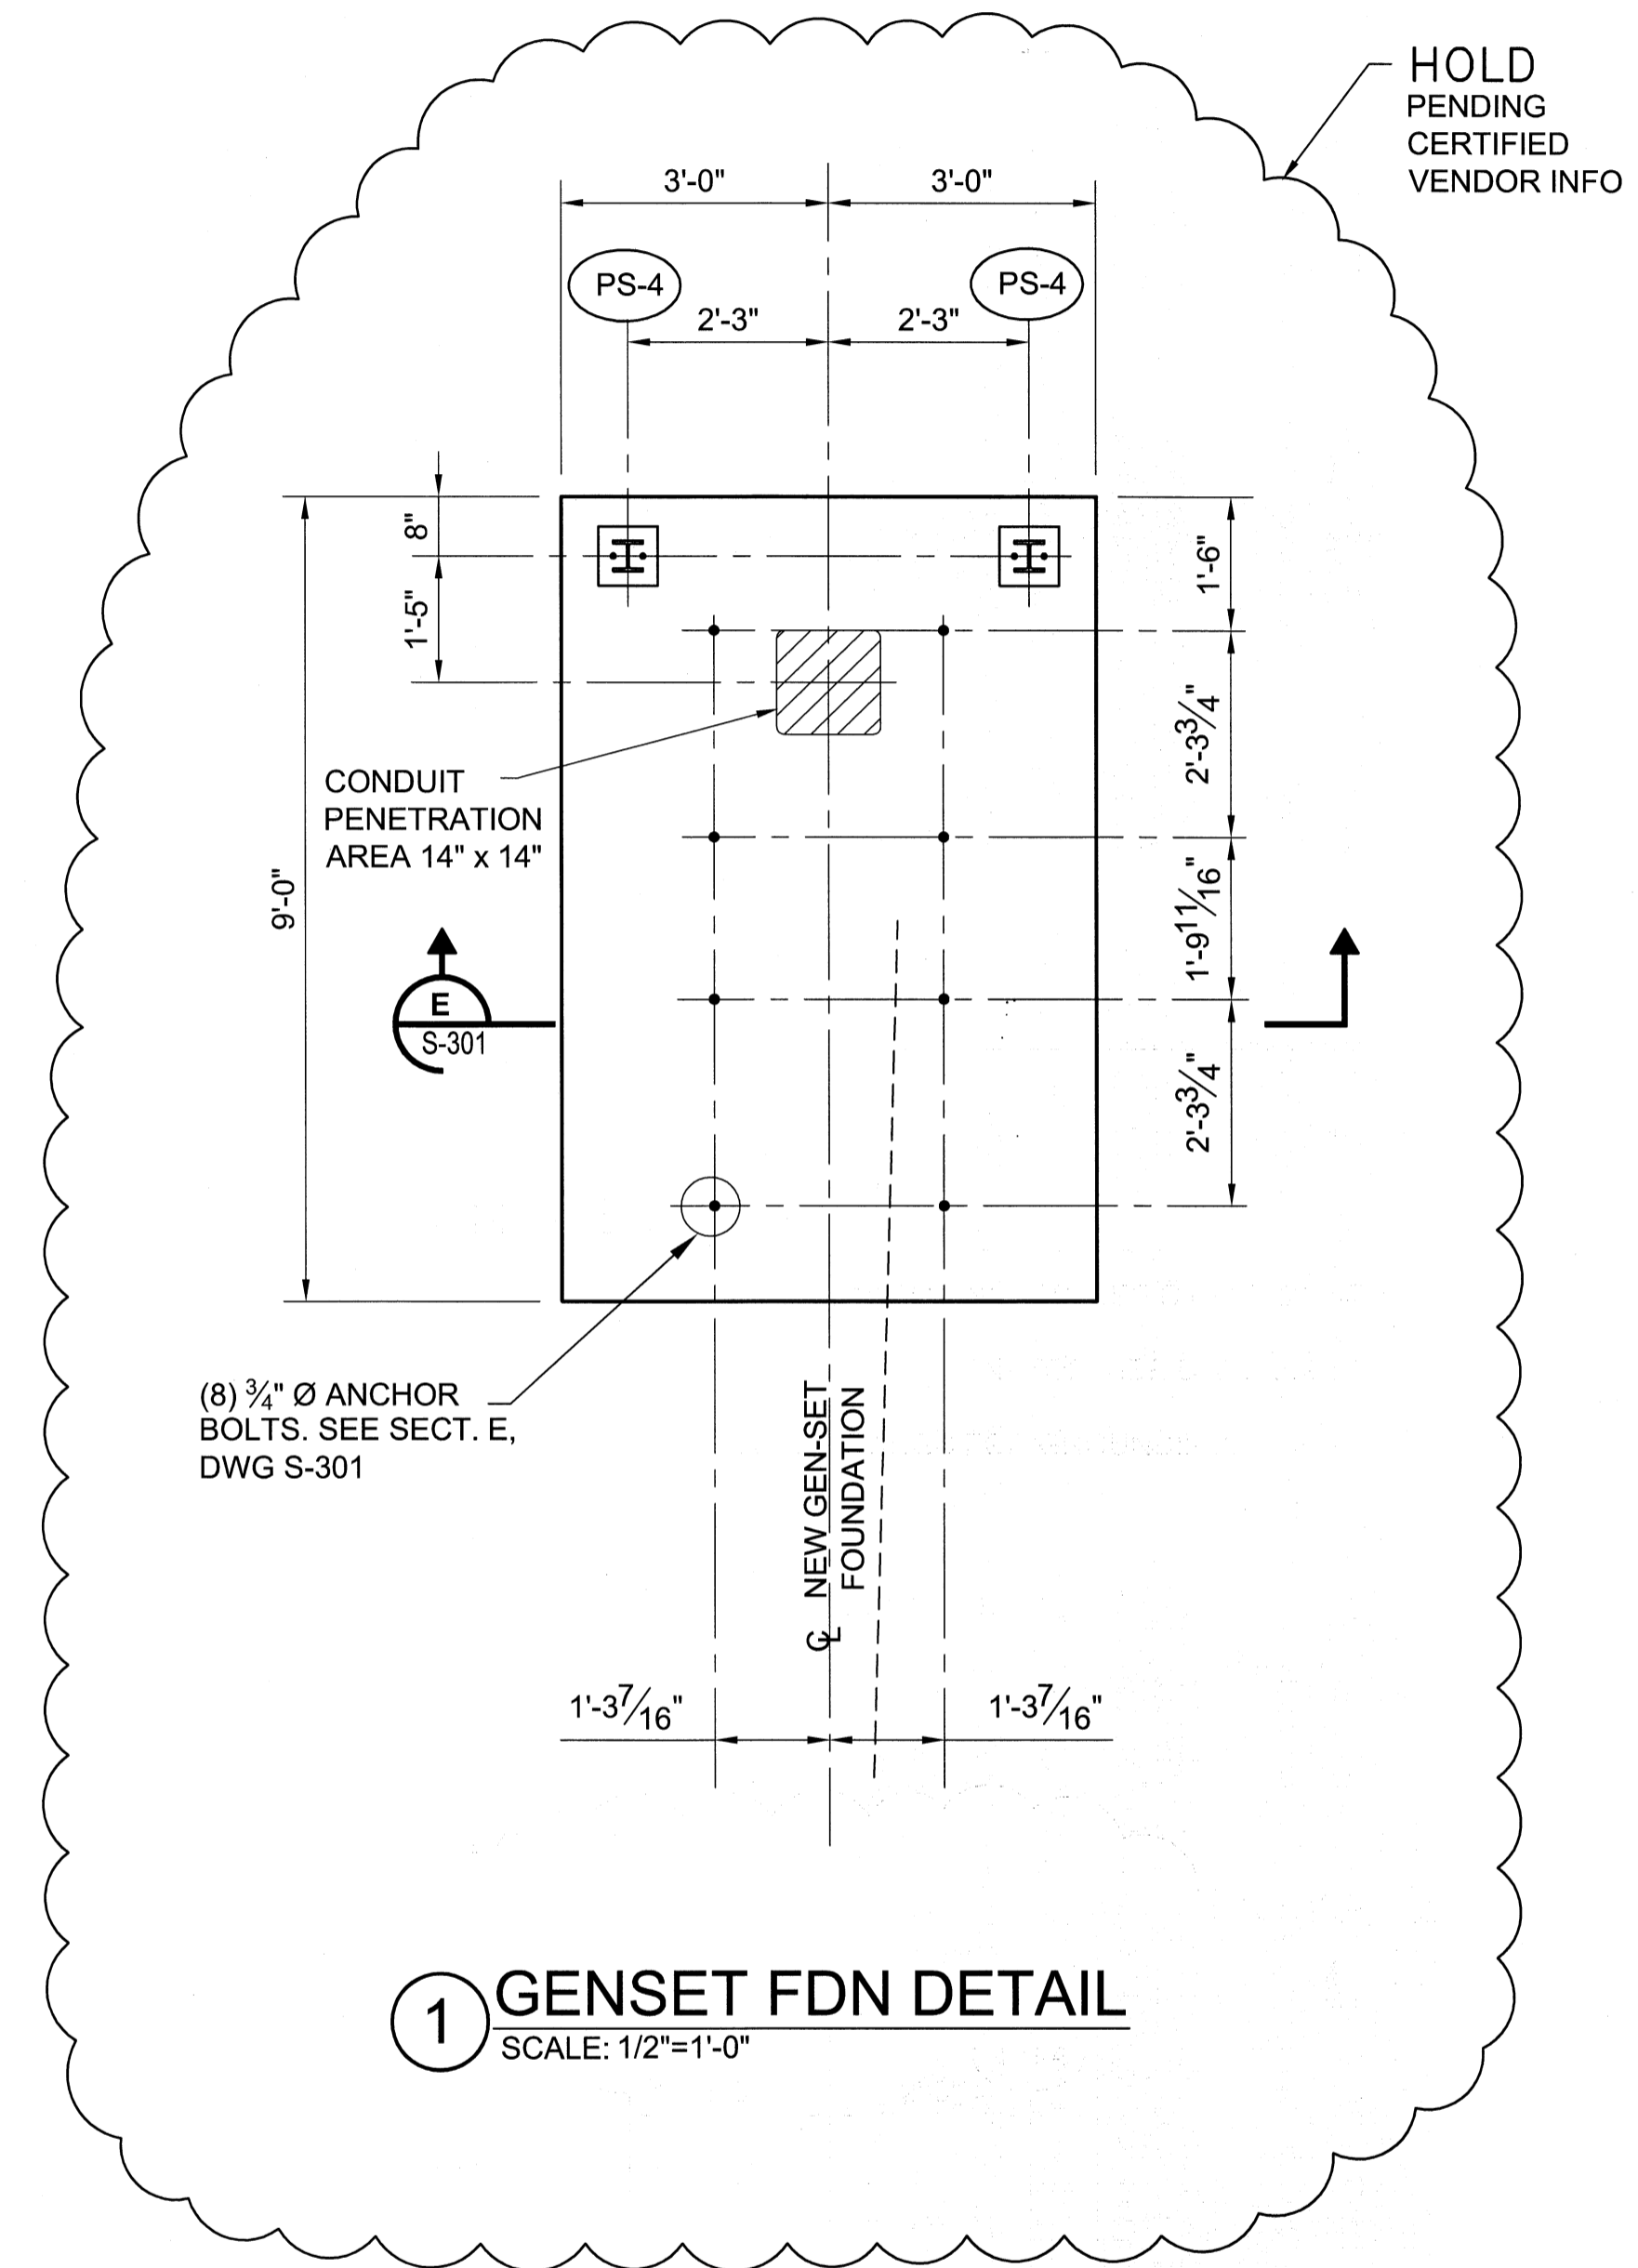

1 GENSET FDN DETAIL
 SCALE: 1/2"=1'-0"

HOLD PENDING CERTIFIED VENDOR INFO




PHASE REVIEW	Project Manager	DC Reviewer	Architectural	Structural	Mechanical	Plumbing	Electrical	Cost

Mark	Description	Date	By
0	ISSUED FOR CONSTRUCTION	11/7/12	Agard

Designed by:	DCB
Checked by:	MLM
Drawn by:	RAM
Reviewed by:	CHB
Date:	2012

KBR
 63 SOUTH ROYAL STREET SUITE 200
 PORTLAND, ME 04106
 PHONE: (203) 405-7600
 FAX: (203) 405-7888

FEMA
 ENGINEERING SERVICES BY
 KBR ENGINEERING CO., LLC

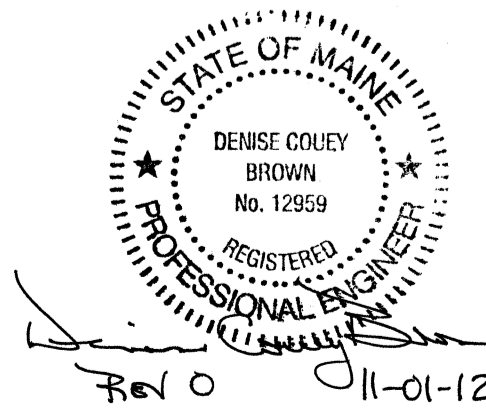


FEMA EMERGENCY RADIO NETWORK
 ON WGAN PORTLAND, MAINE


SITE GENERATOR FOUNDATION PLAN

Drawing Number:
S-102


REV 0 11-01-12

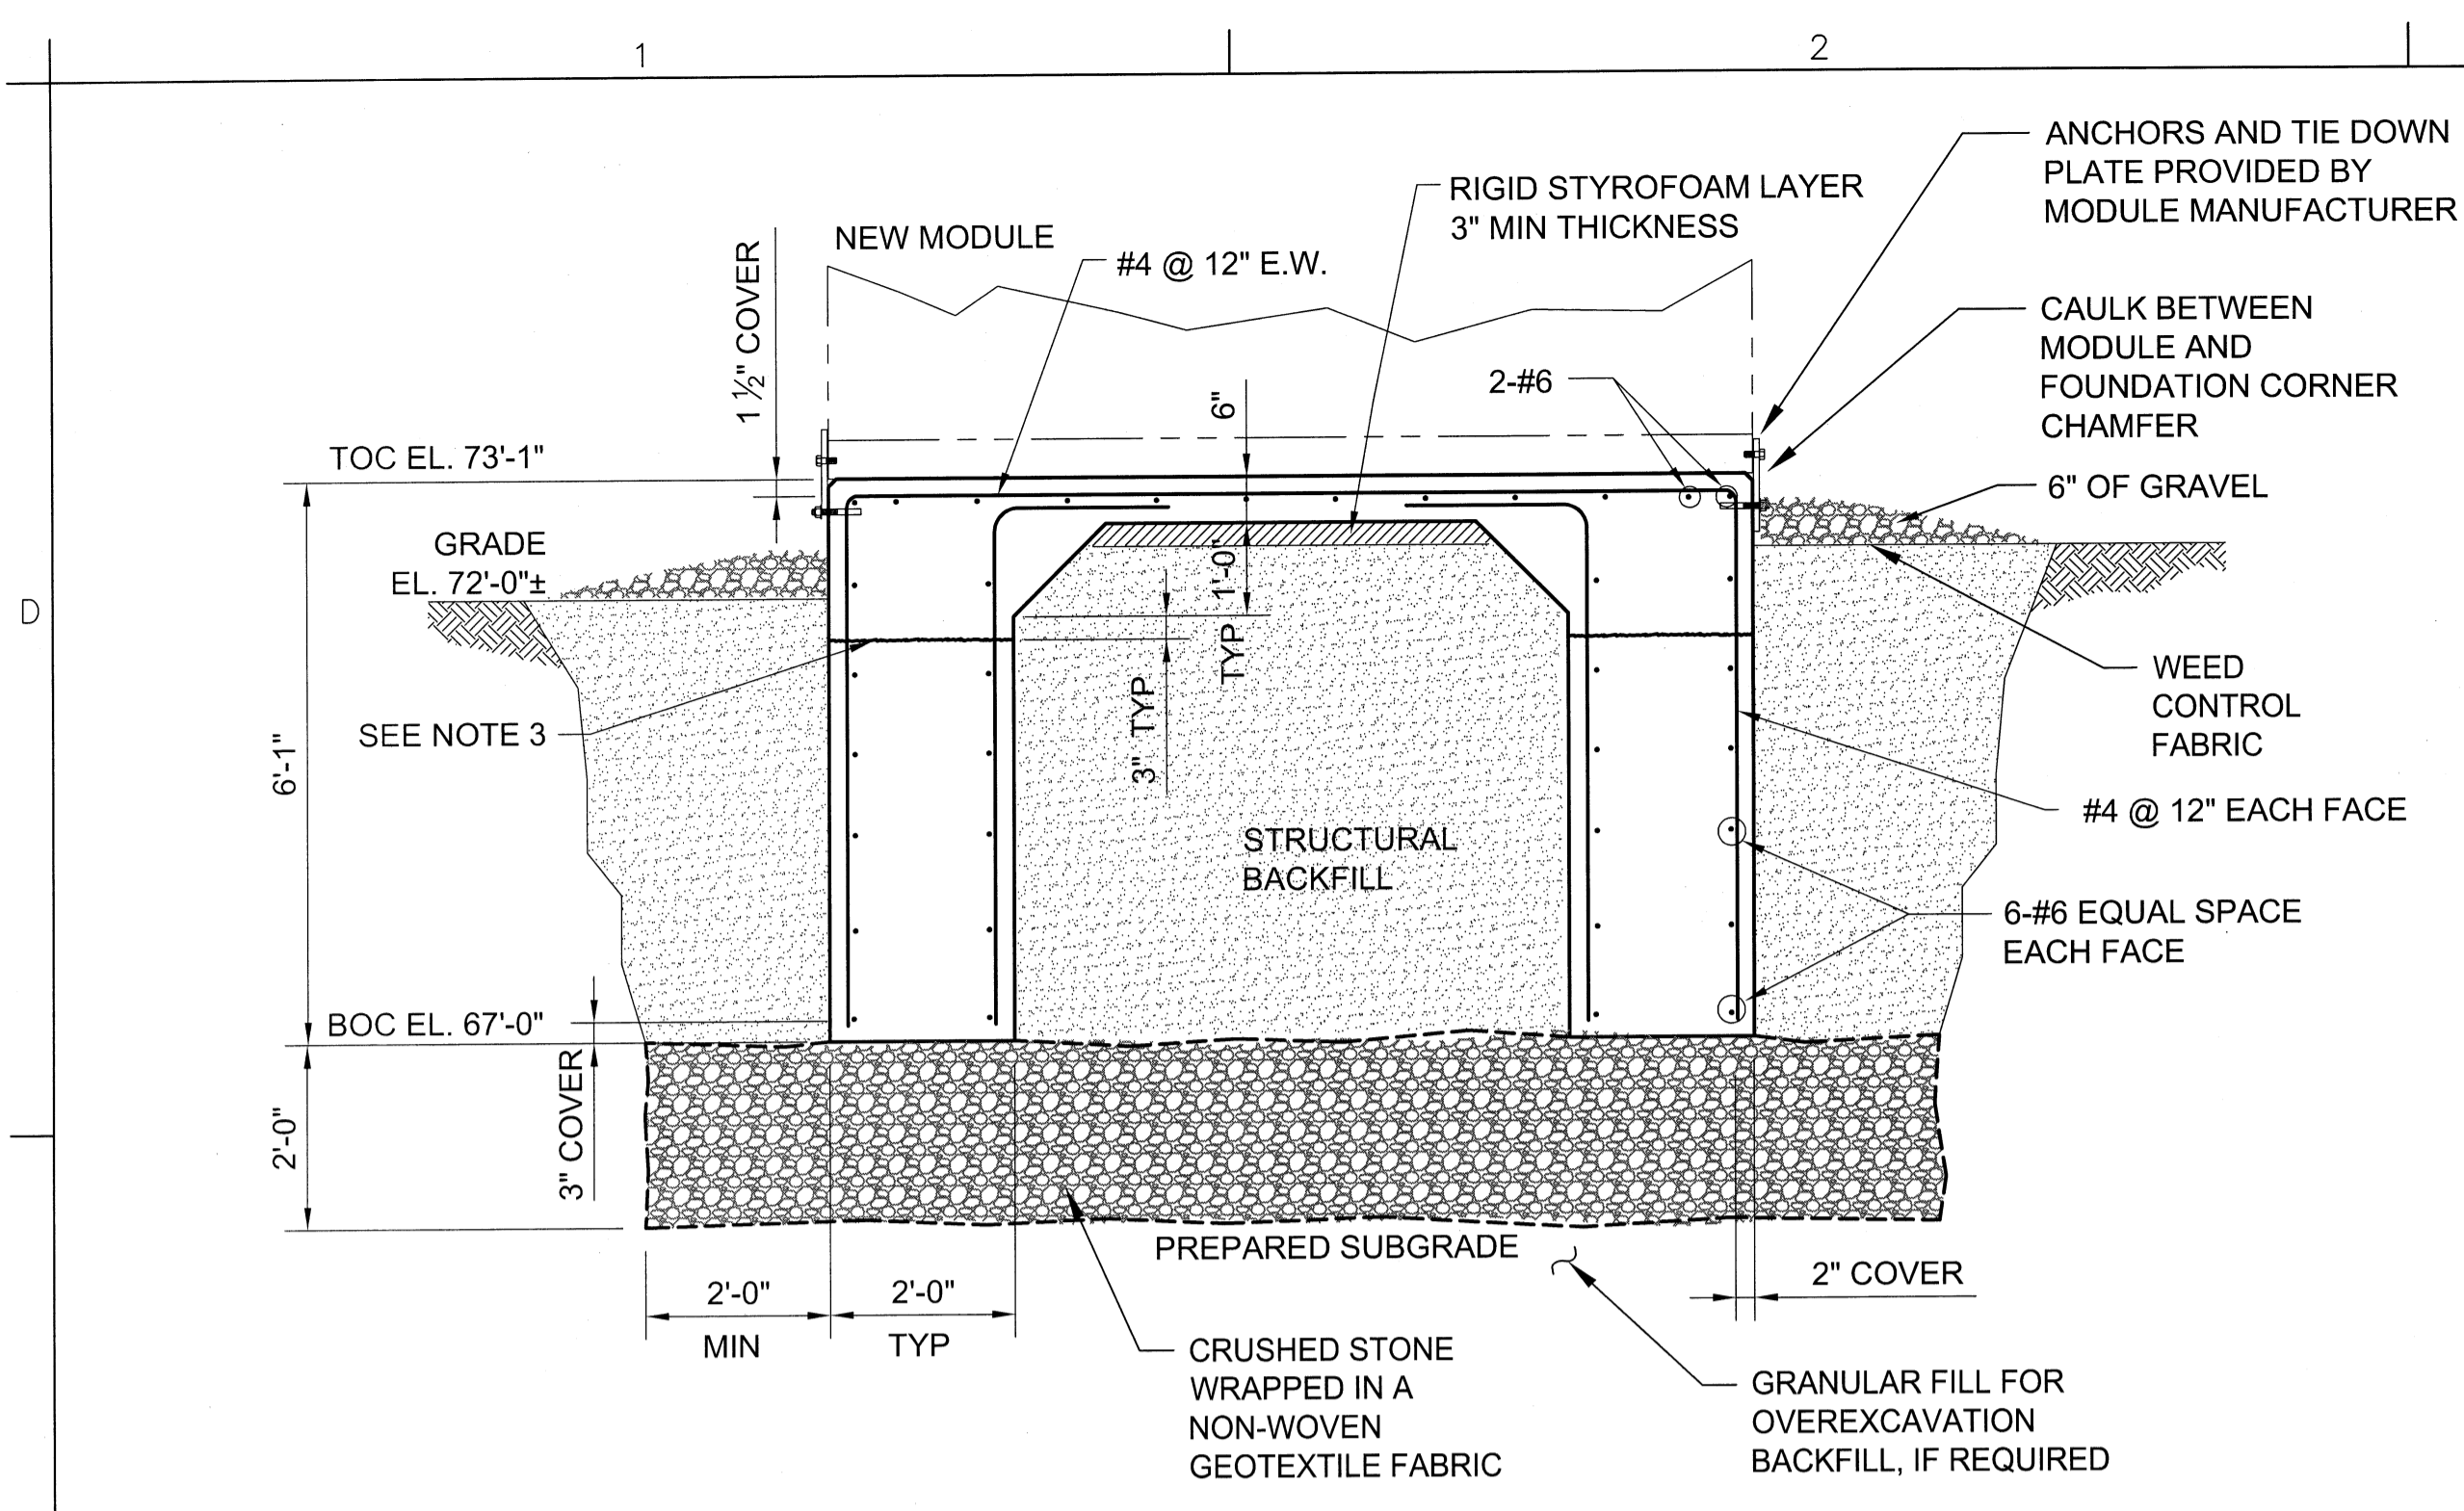


A SECTION
S-101 SCALE: 1/2"=1'-0"

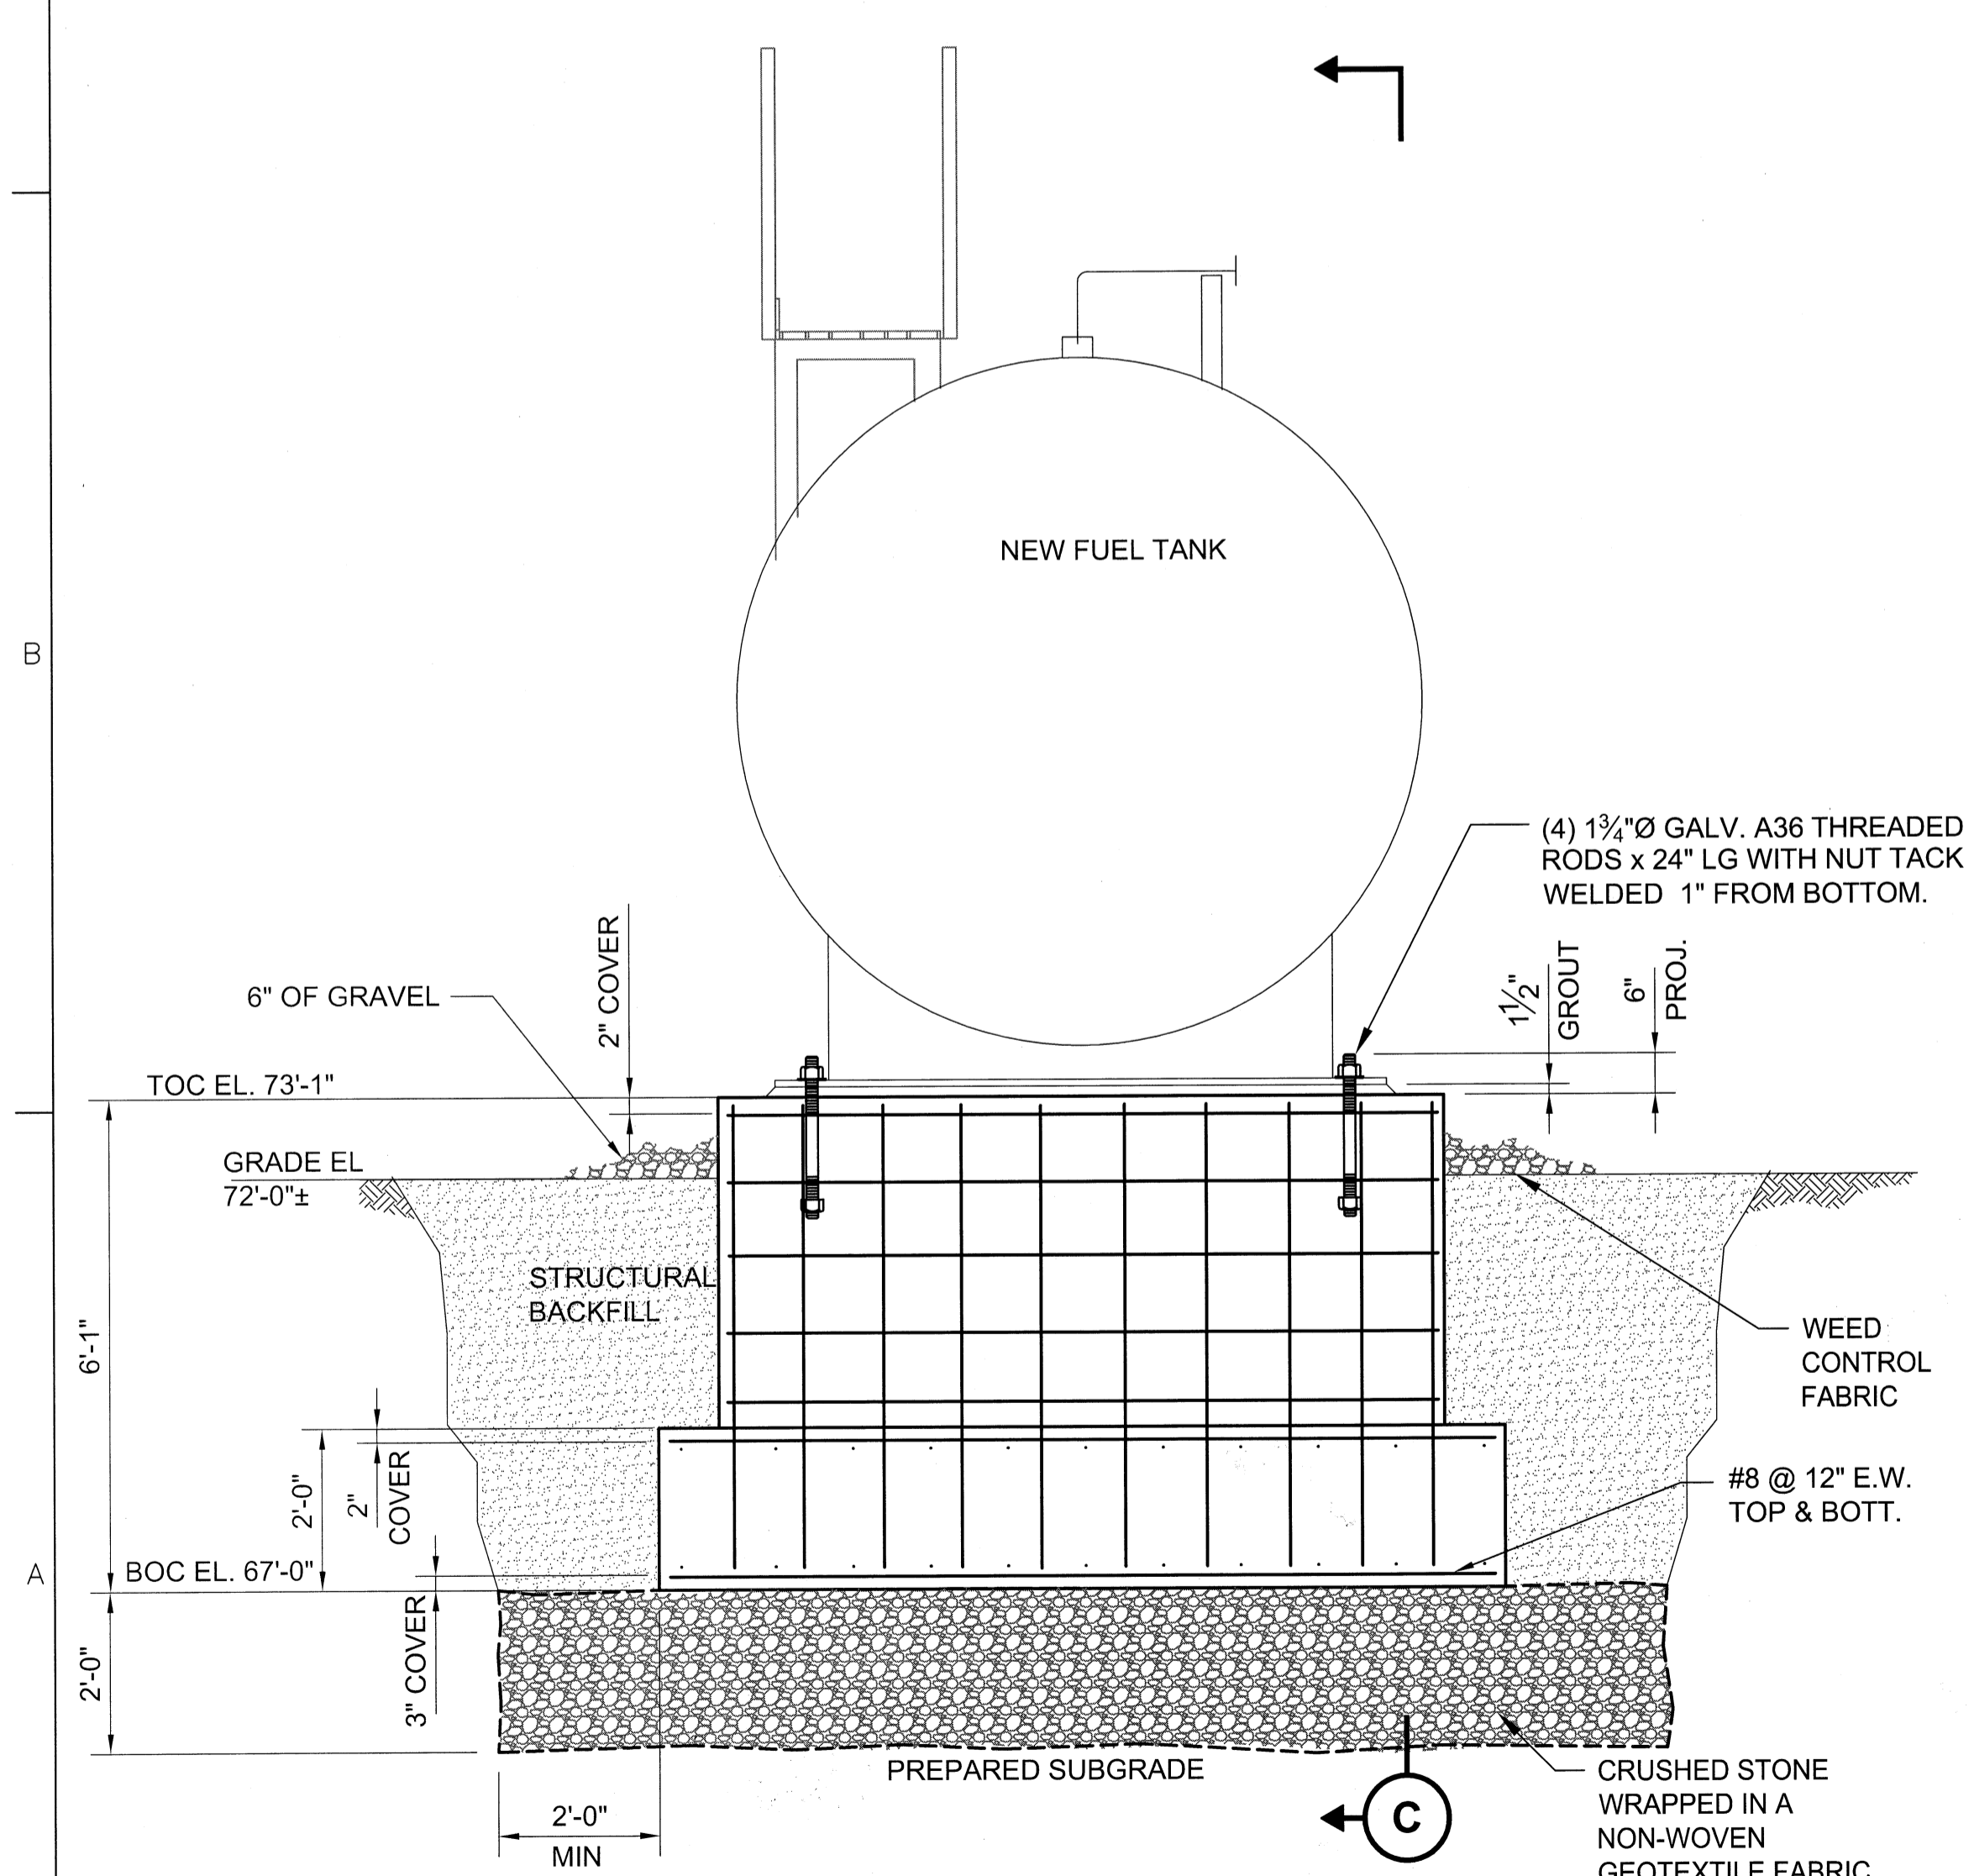


B SECTION
S-101 SCALE: 1/2"=1'-0"

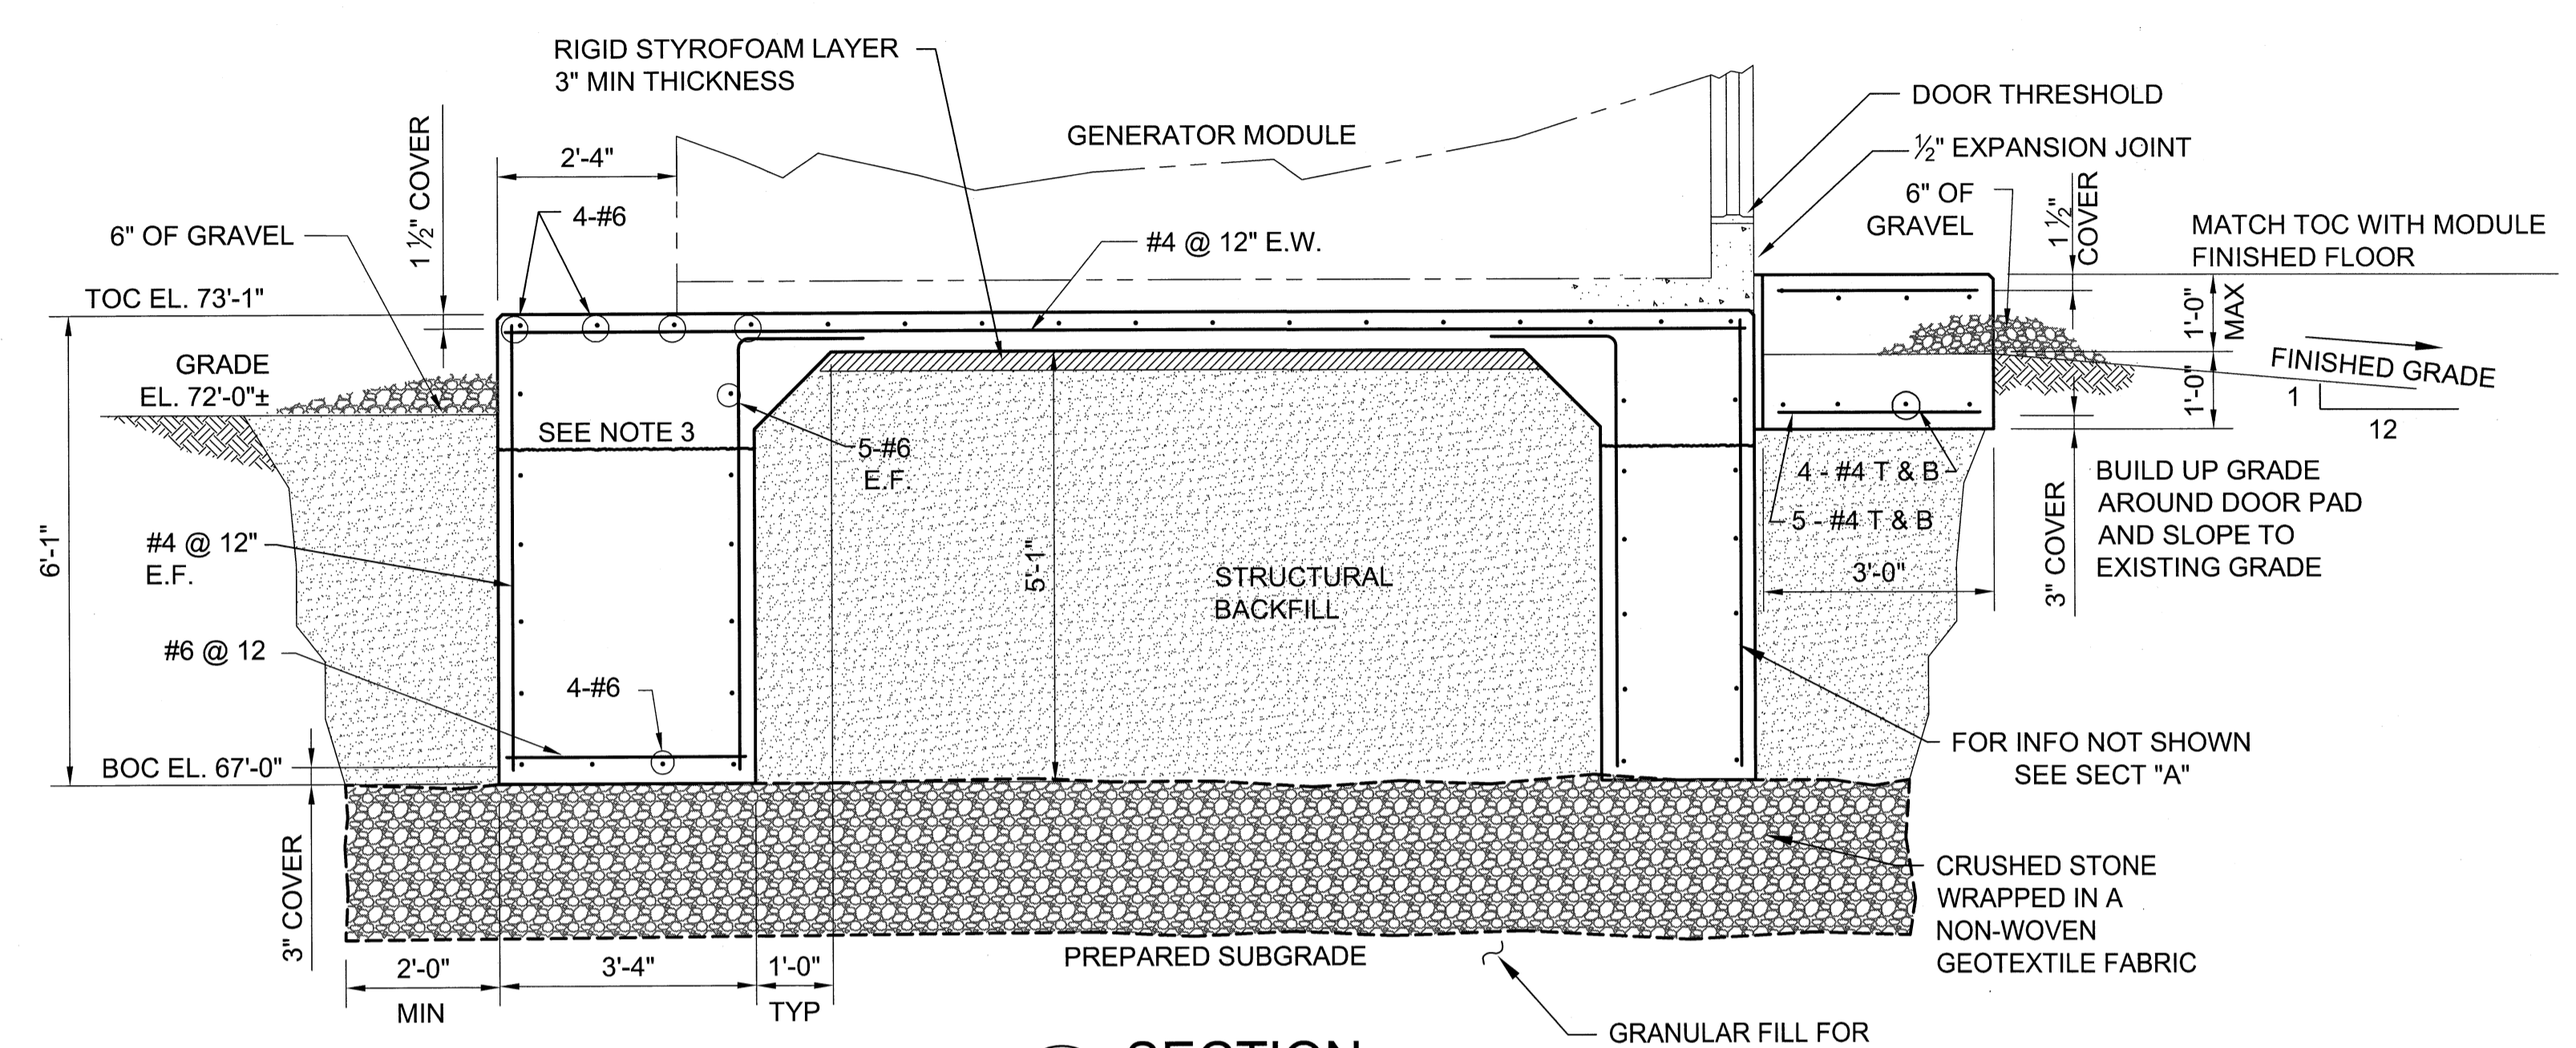

D SECTION
S-101 SCALE: 1/2"=1'-0"

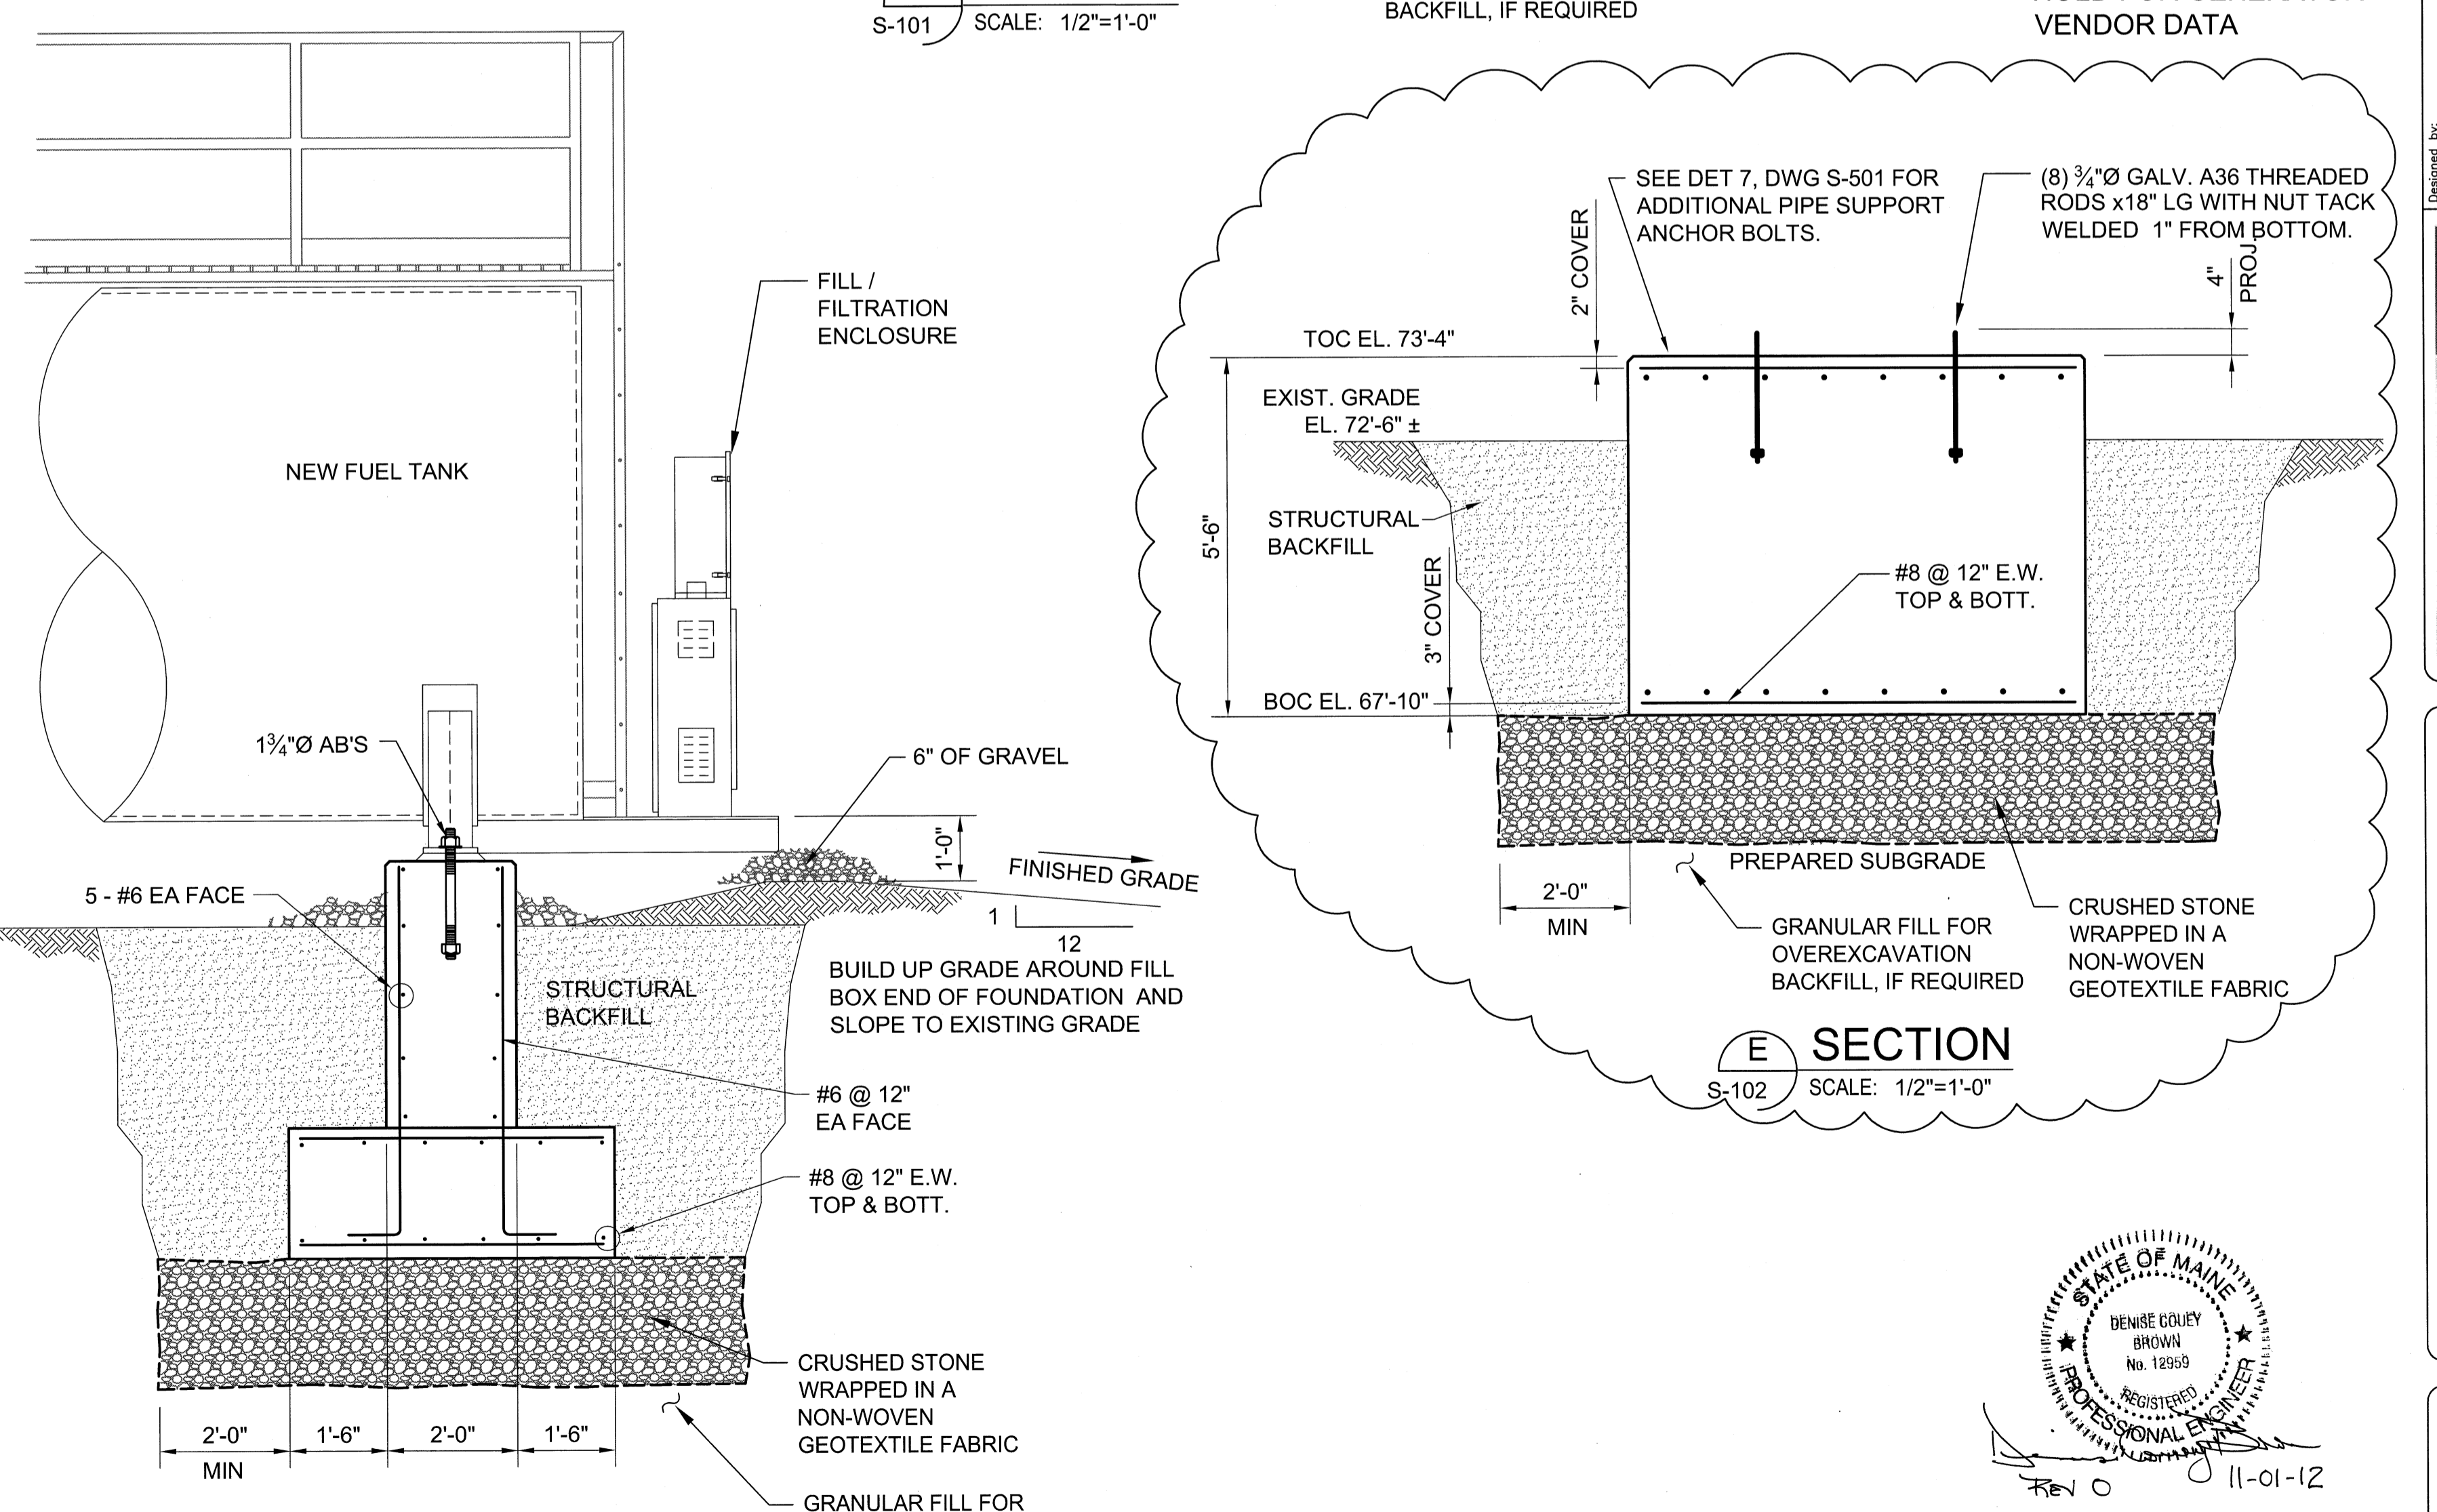

C SECTION
SCALE: 1/2"=1'-0"

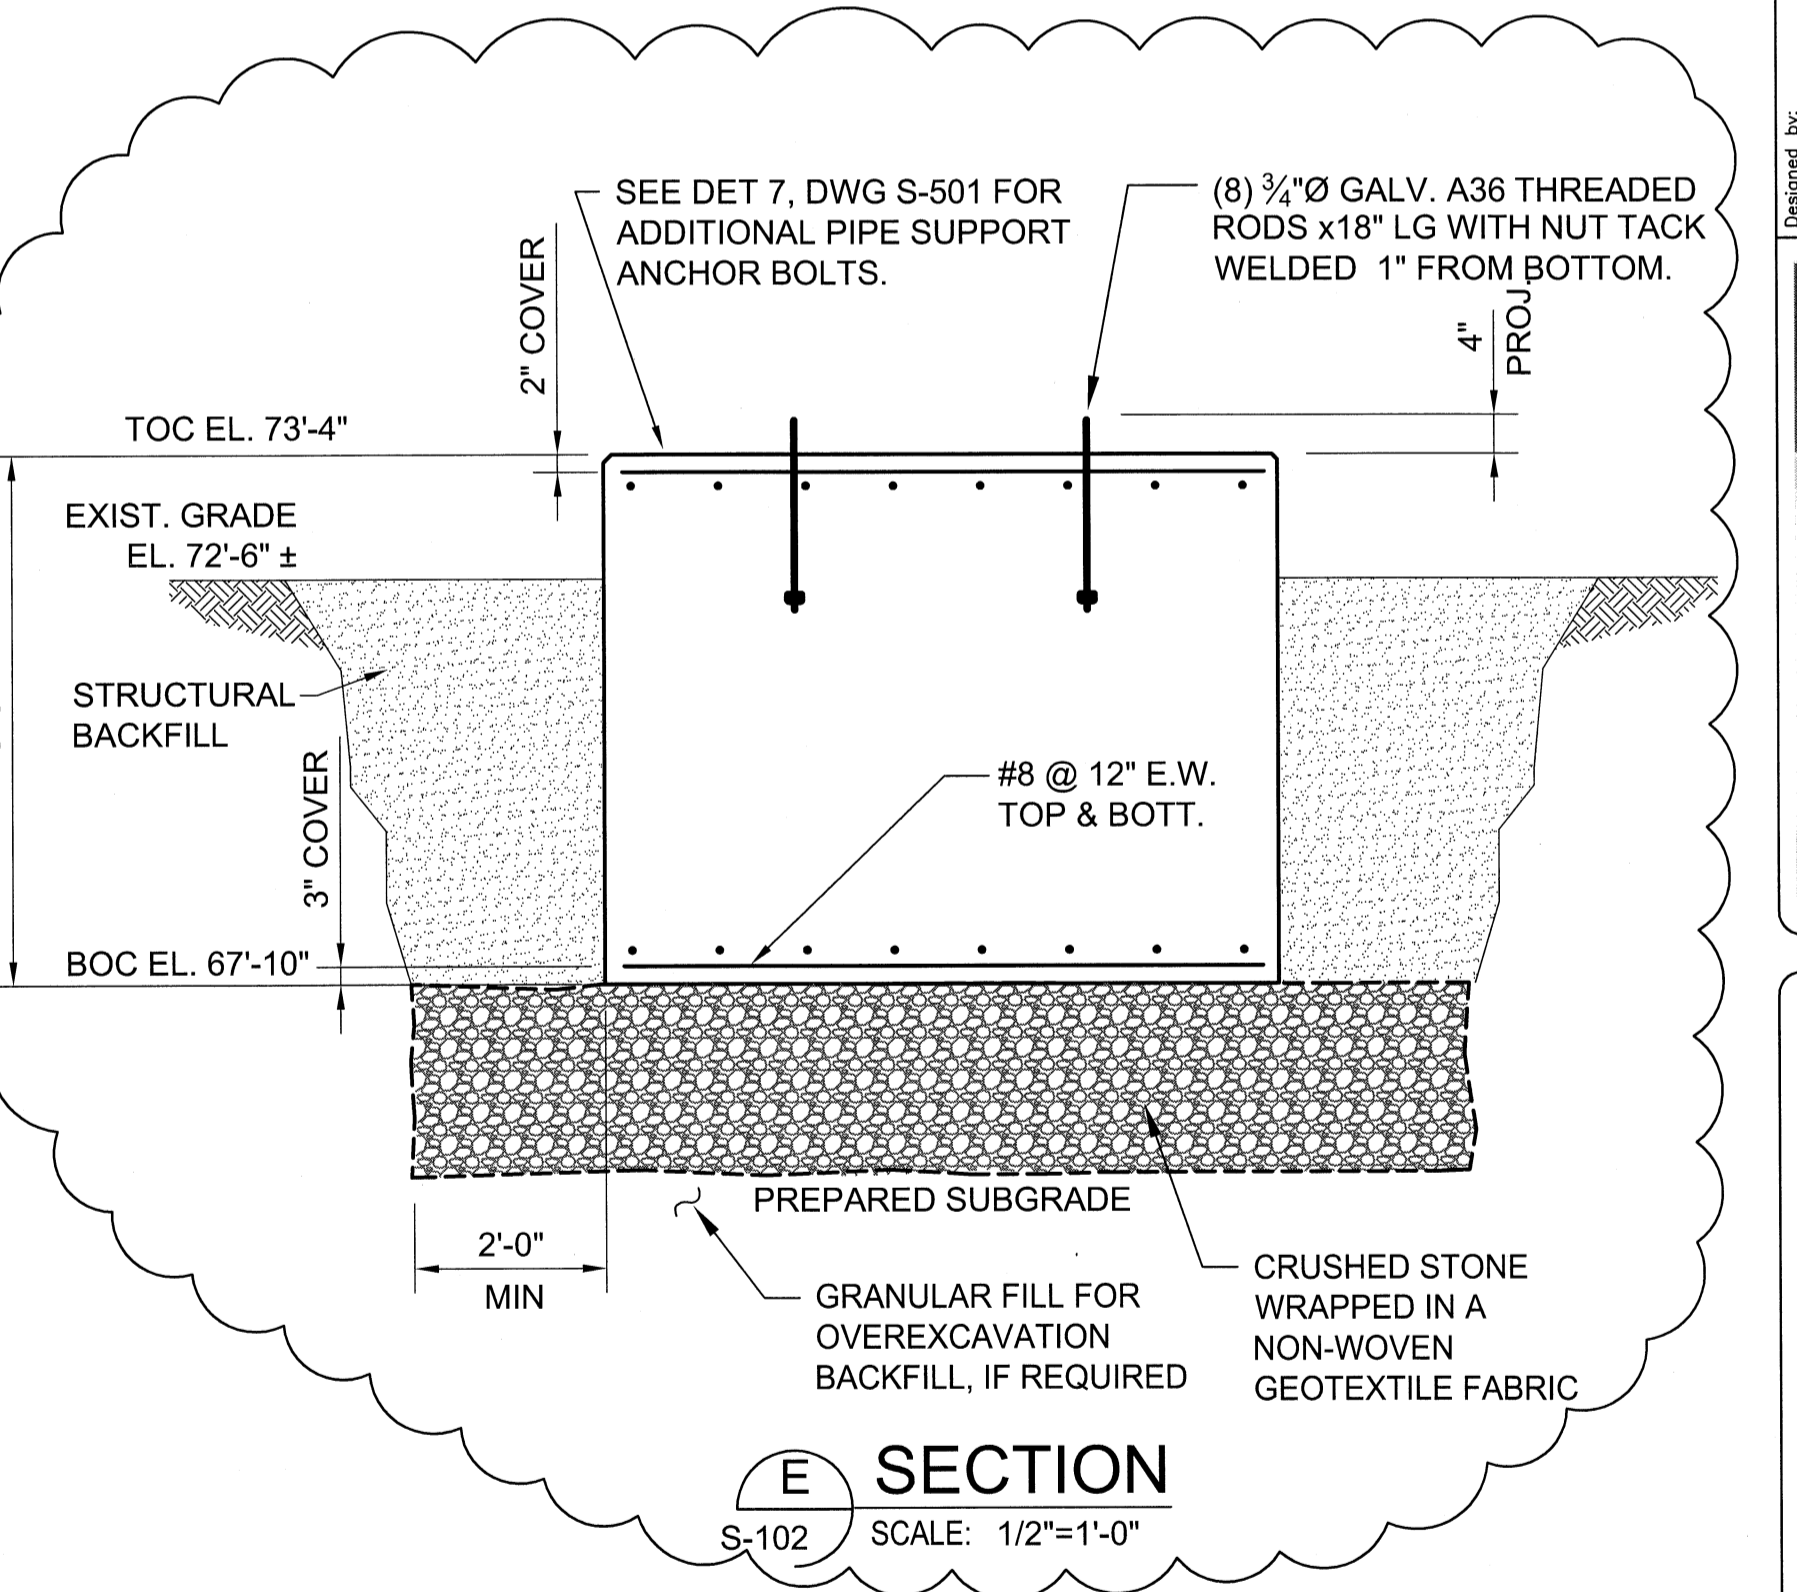

E SECTION
S-102 SCALE: 1/2"=1'-0"

NOTES:

1. GRAVEL LIMITS SHOWN ON DWG C-102 (SEE NOTE 5).
2. WEED CONTROL TO EXTEND TO LIMITS OF GRAVEL.
3. CONTRACTOR HAS THE OPTION TO BREAK FOUNDATION INTO TWO CONCRETE POURS. VERTICAL REBAR SHALL BE CONTINUOUS THROUGH JOINT. ROUGHEN AND APPLY EPOXY BONDING AGENT PER MANUFACTURER'S RECOMMENDATIONS PRIOR TO SECOND POUR.
4. FOR REBAR COVER, USE 2" WHEN CONCRETE POURED USING FORMS. USE 3" WHEN CONCRETE CAST AGAINST EARTH.
5. SEE ELECTRICAL DRAWINGS FOR GROUNDING ATTACHMENTS.
6. FOR EARTHWORK MATERIALS, SEE DWG C-102 AND SPECIFICATION 31 23 00.00 20.

<p>US Army Corps of Engineers OMAHA DISTRICT</p>	
Phase	Reviewed
Project Manager	DC Reviewer
DC Reviewer	Structural
Structural	Mechanical
Mechanical	Plumbing
Plumbing	Electrical
Electrical	Other
Date	11/7/12
App'd	
Date	
Description	
Issued For Construction	

Designed by: DCB
Checked by: MMLM
Drawn by: RAM
Reviewed by: DCB
Date: 2012


43 SOUTH ROVAL STREET SUITE 200
 PORTLAND, MAINE 04108
 PHONE: (207) 450-7600
 FAX: (207) 450-7888
 Engineering Services by
 KBR Engineering Co., LLC

FEMA EMERGENCY RADIO NETWORK
ON WGAN PORTLAND, MAINE


MISCELLANEOUS SECTIONS

DENISE GOUEY BROWN
 No. 12938
 REGISTERED PROFESSIONAL ENGINEER
 STATE OF MAINE
 REV 0 11-01-12


Drawing Number:
S-301

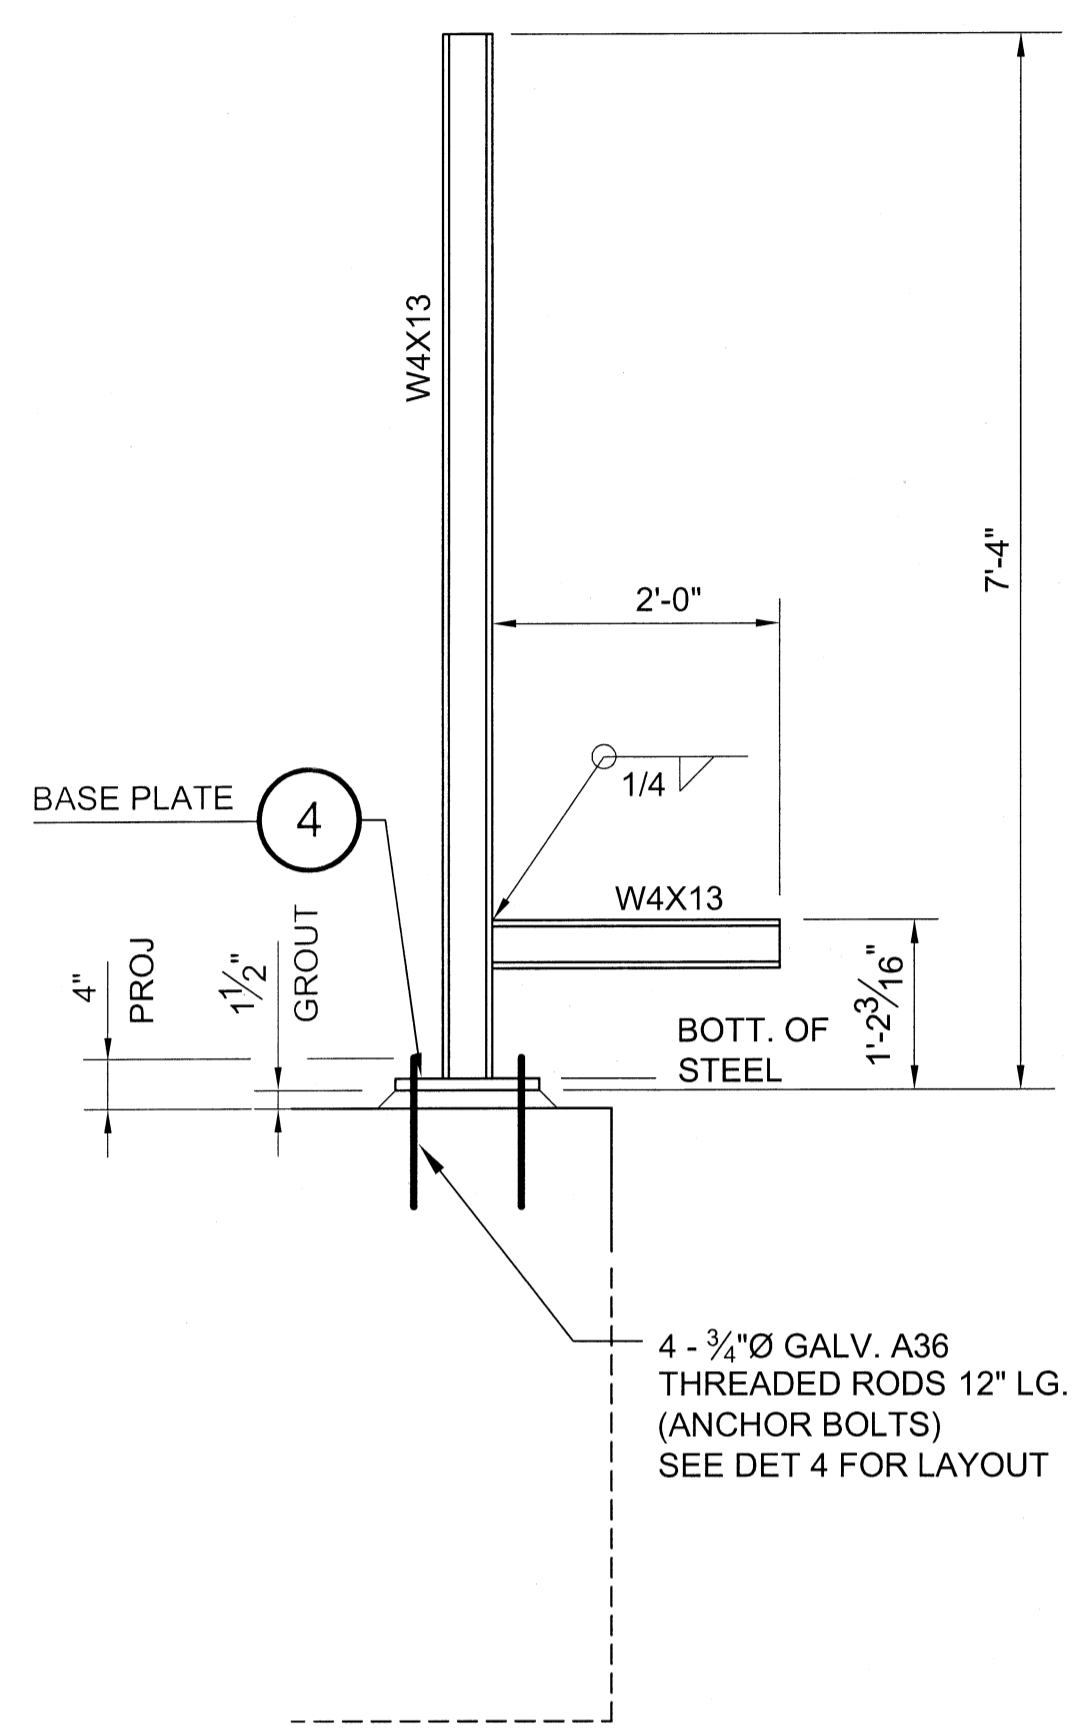


1 PIPE SUPPORT PS-1
S-101 SCALE: 3/4"=1'-0"

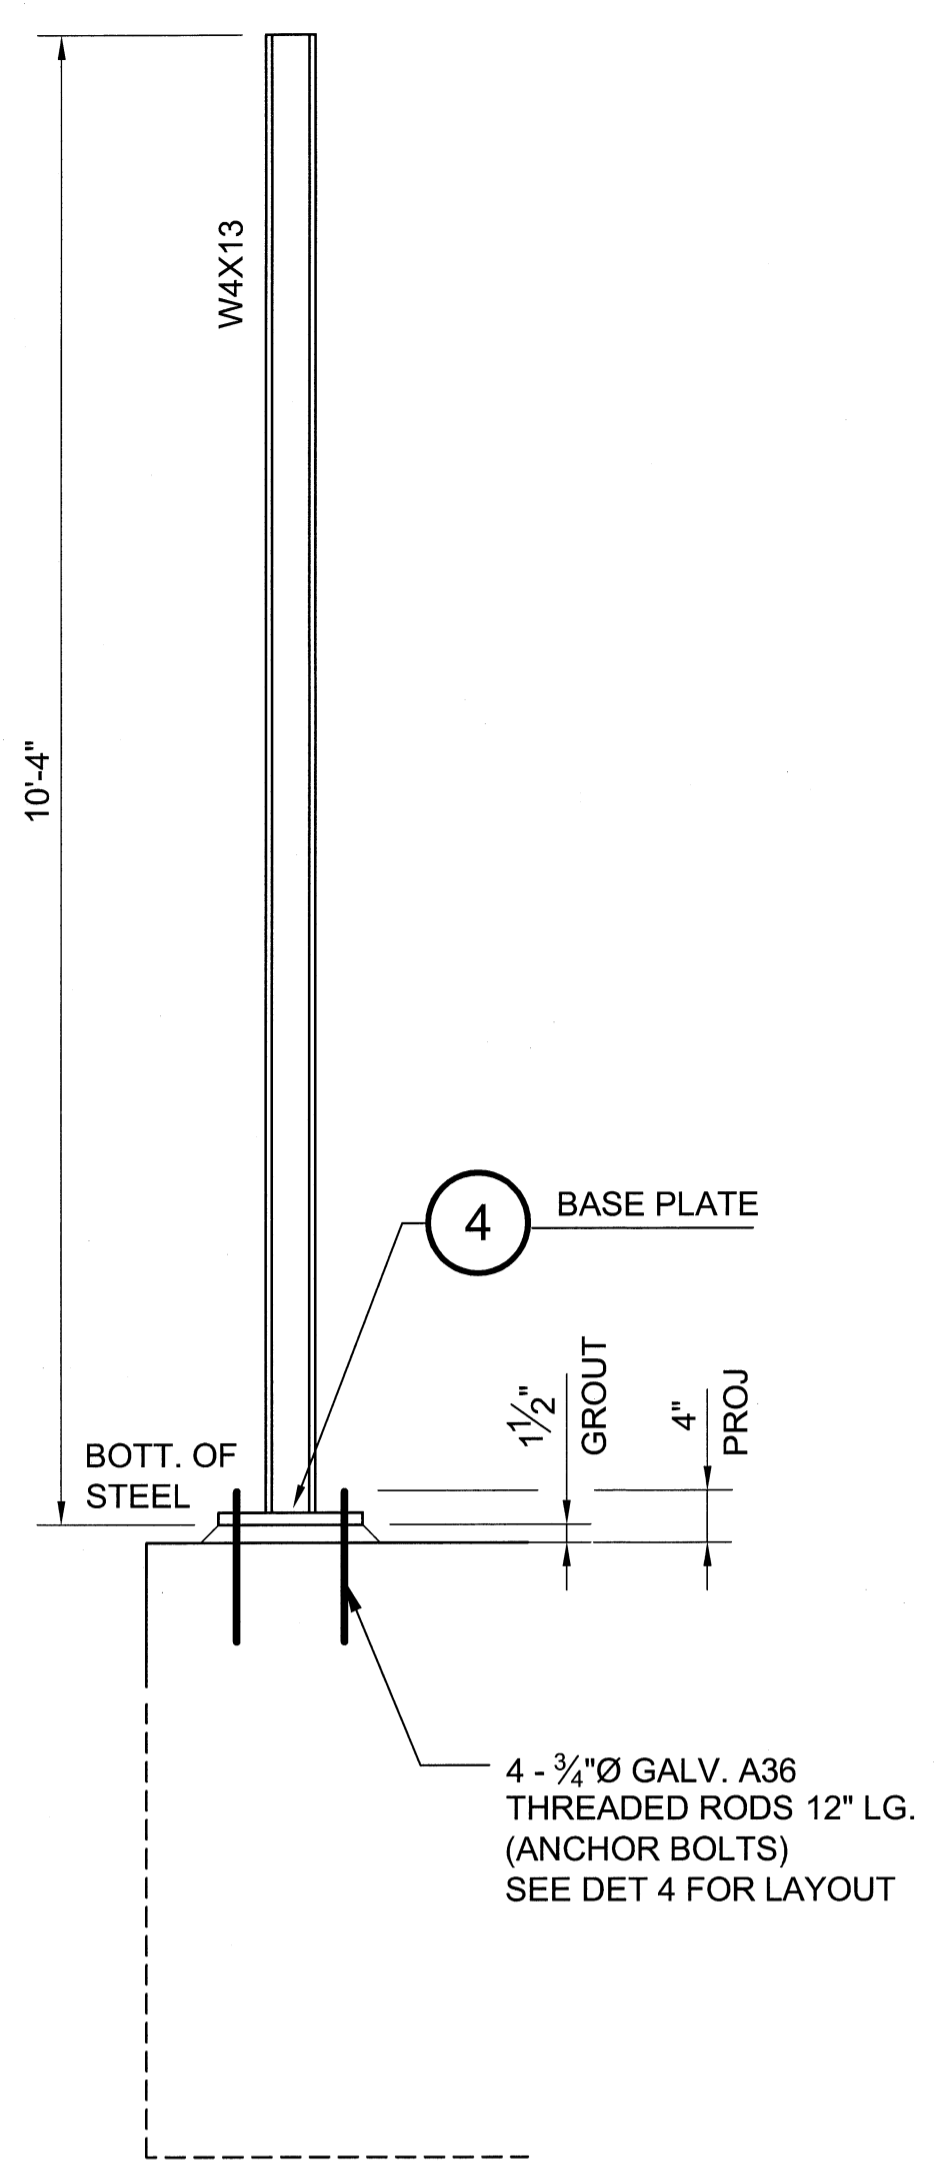


2 PIPE SUPPORT PS-2
S-101 SCALE: 3/4"=1'-0"

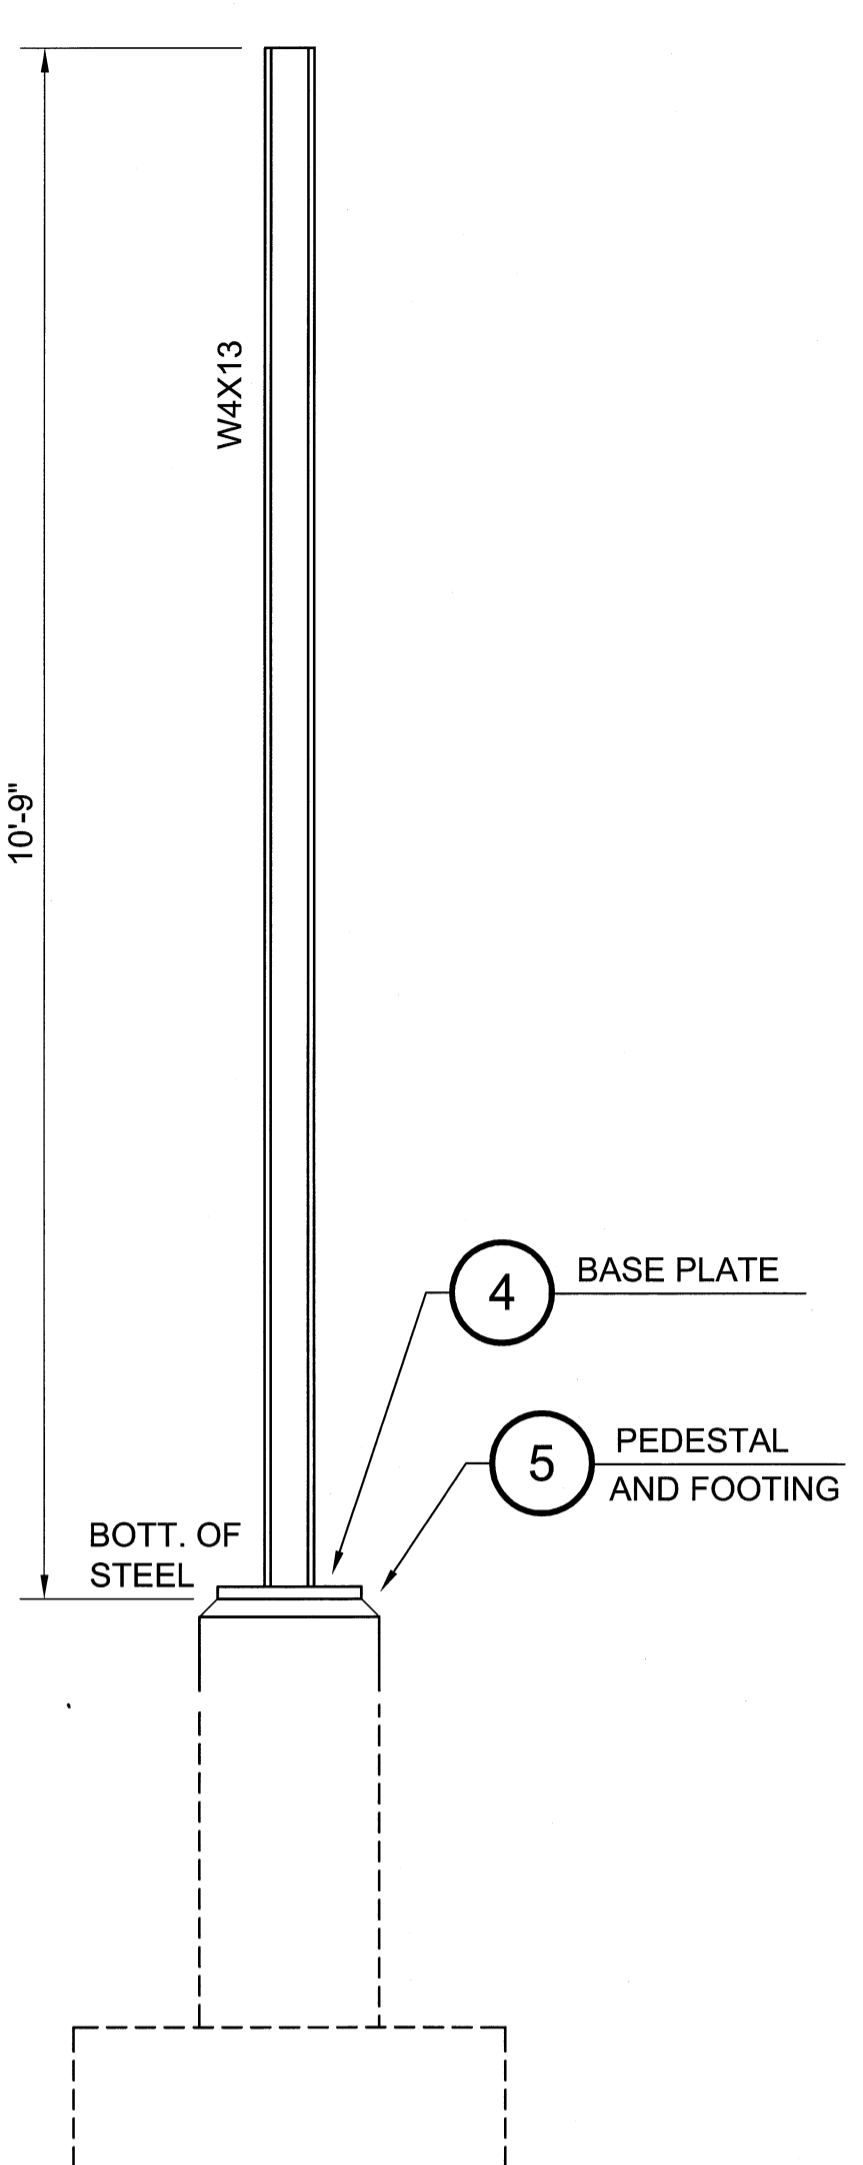


3 PIPE SUPPORT PS-3
S-101 SCALE: 3/4"=1'-0"

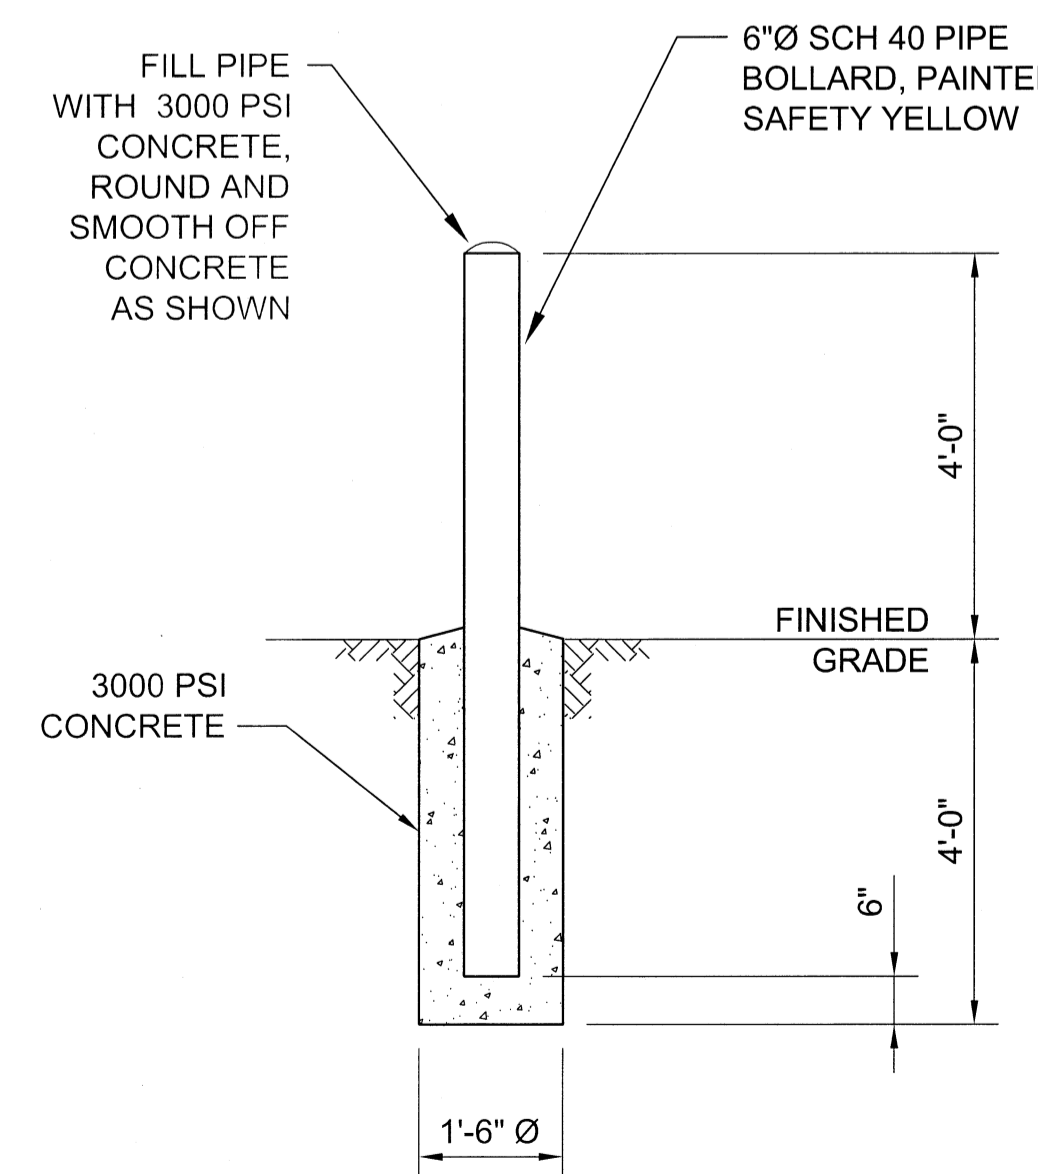


6 TYP BOLLARD DETAIL
S-102 SCALE: 1/2"=1'-0"

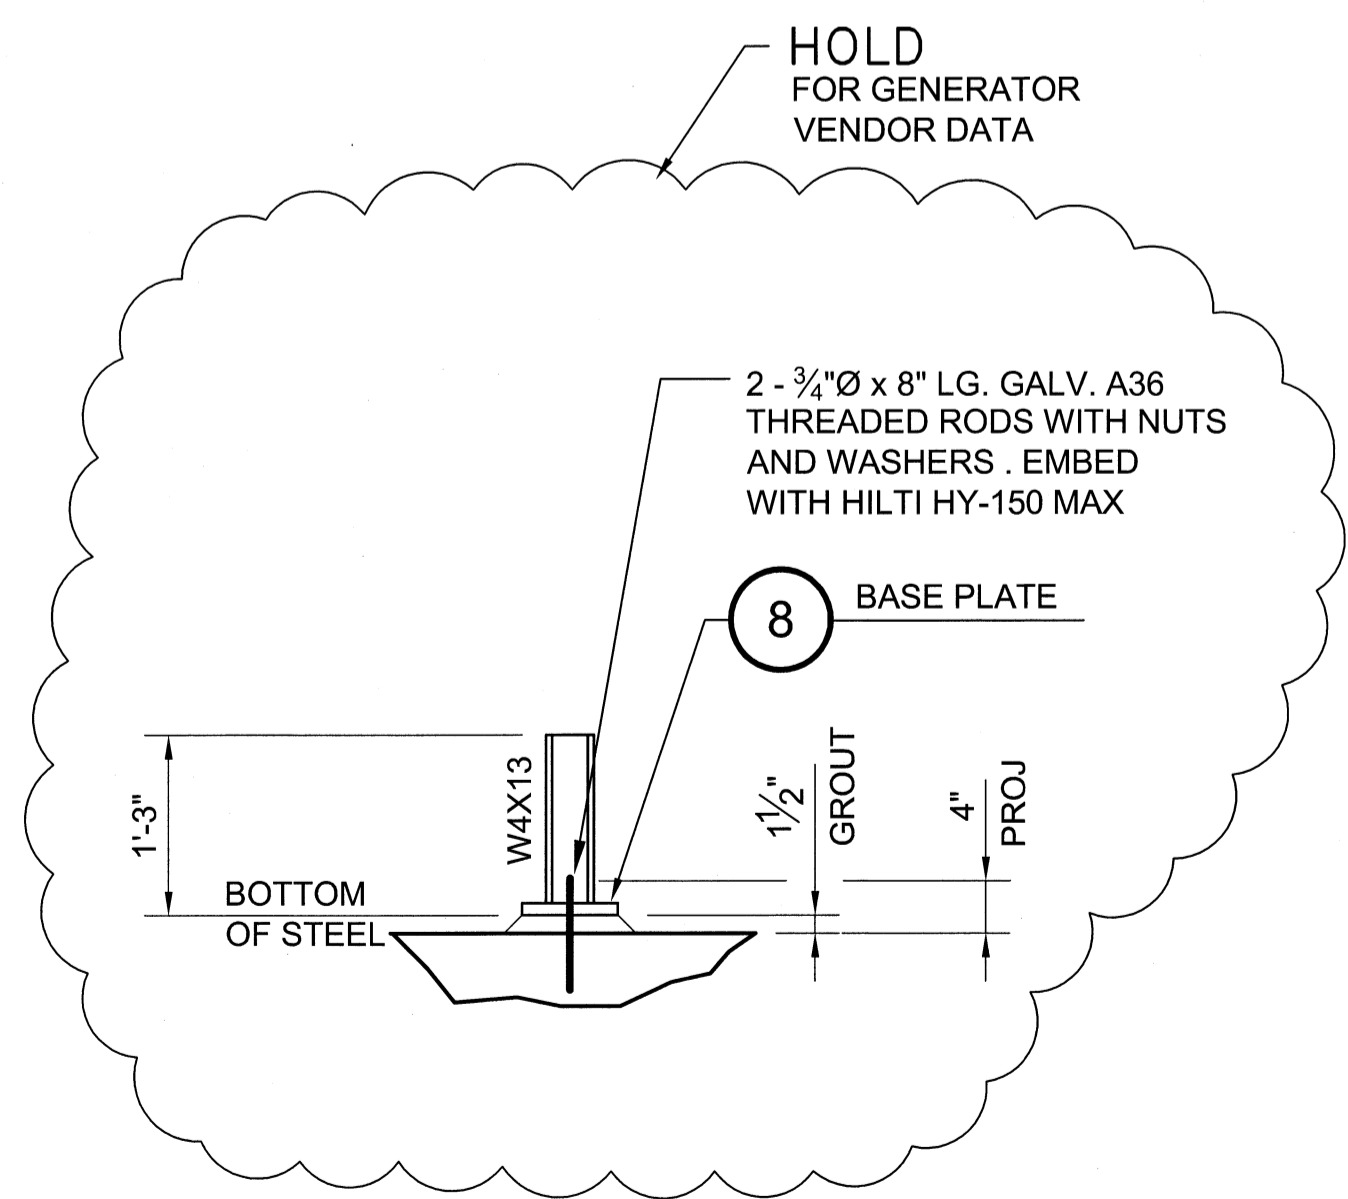


7 PIPE SUPPORT PS-4
S-102 SCALE: 3/4"=1'-0" 2 REQUIRED

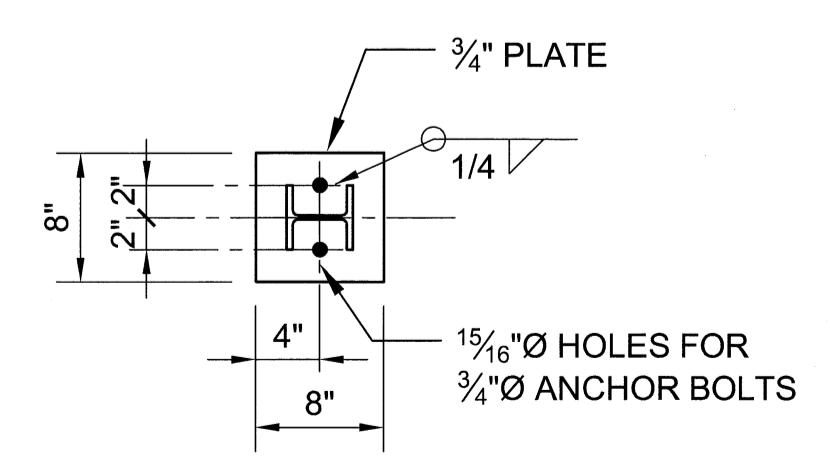




8 DETAIL
SCALE: 1"=1'-0"

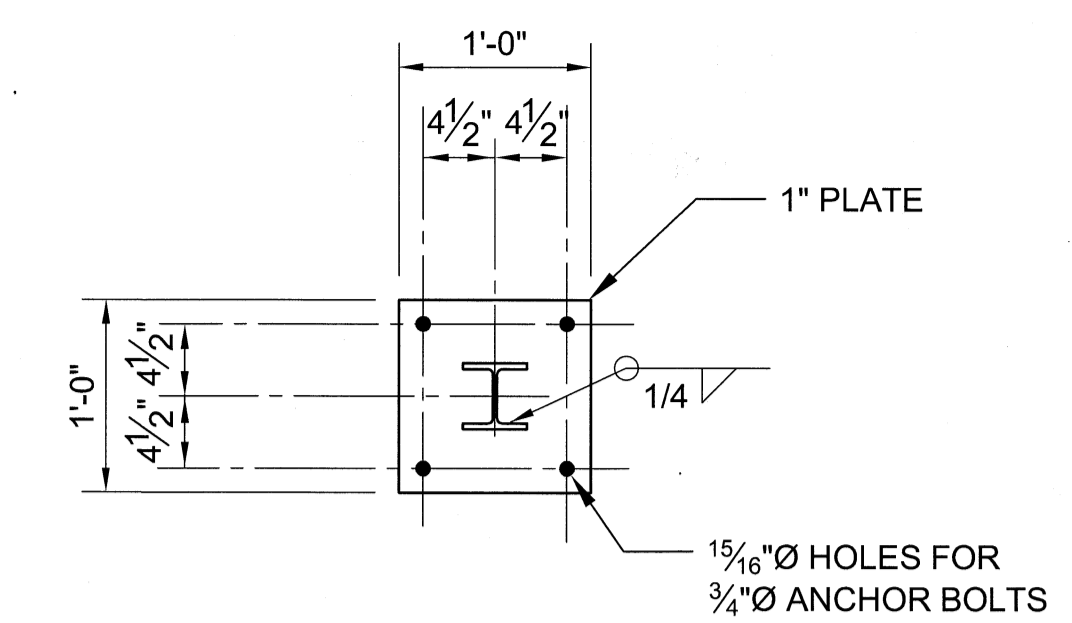

4 DETAIL
SCALE: 1"=1'-0"

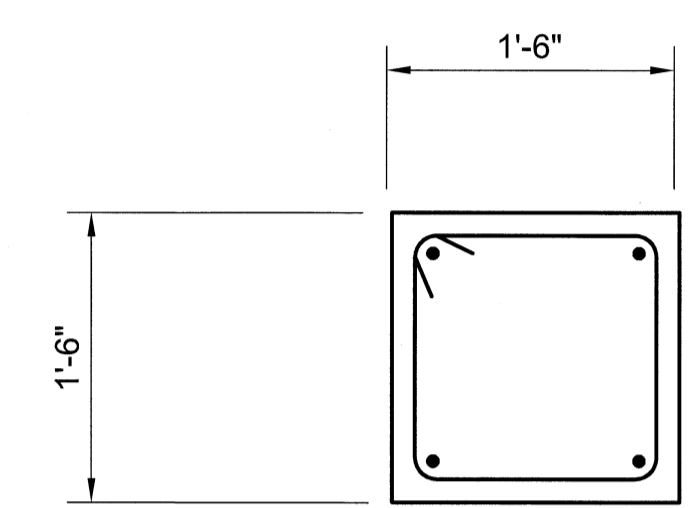

5 DETAIL
SCALE: 1"=1'-0"

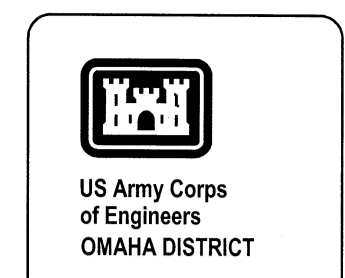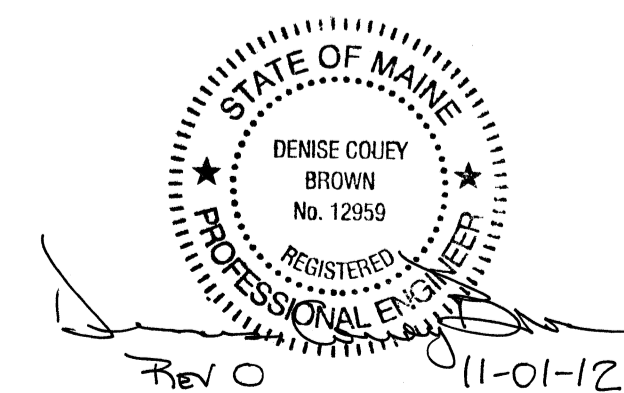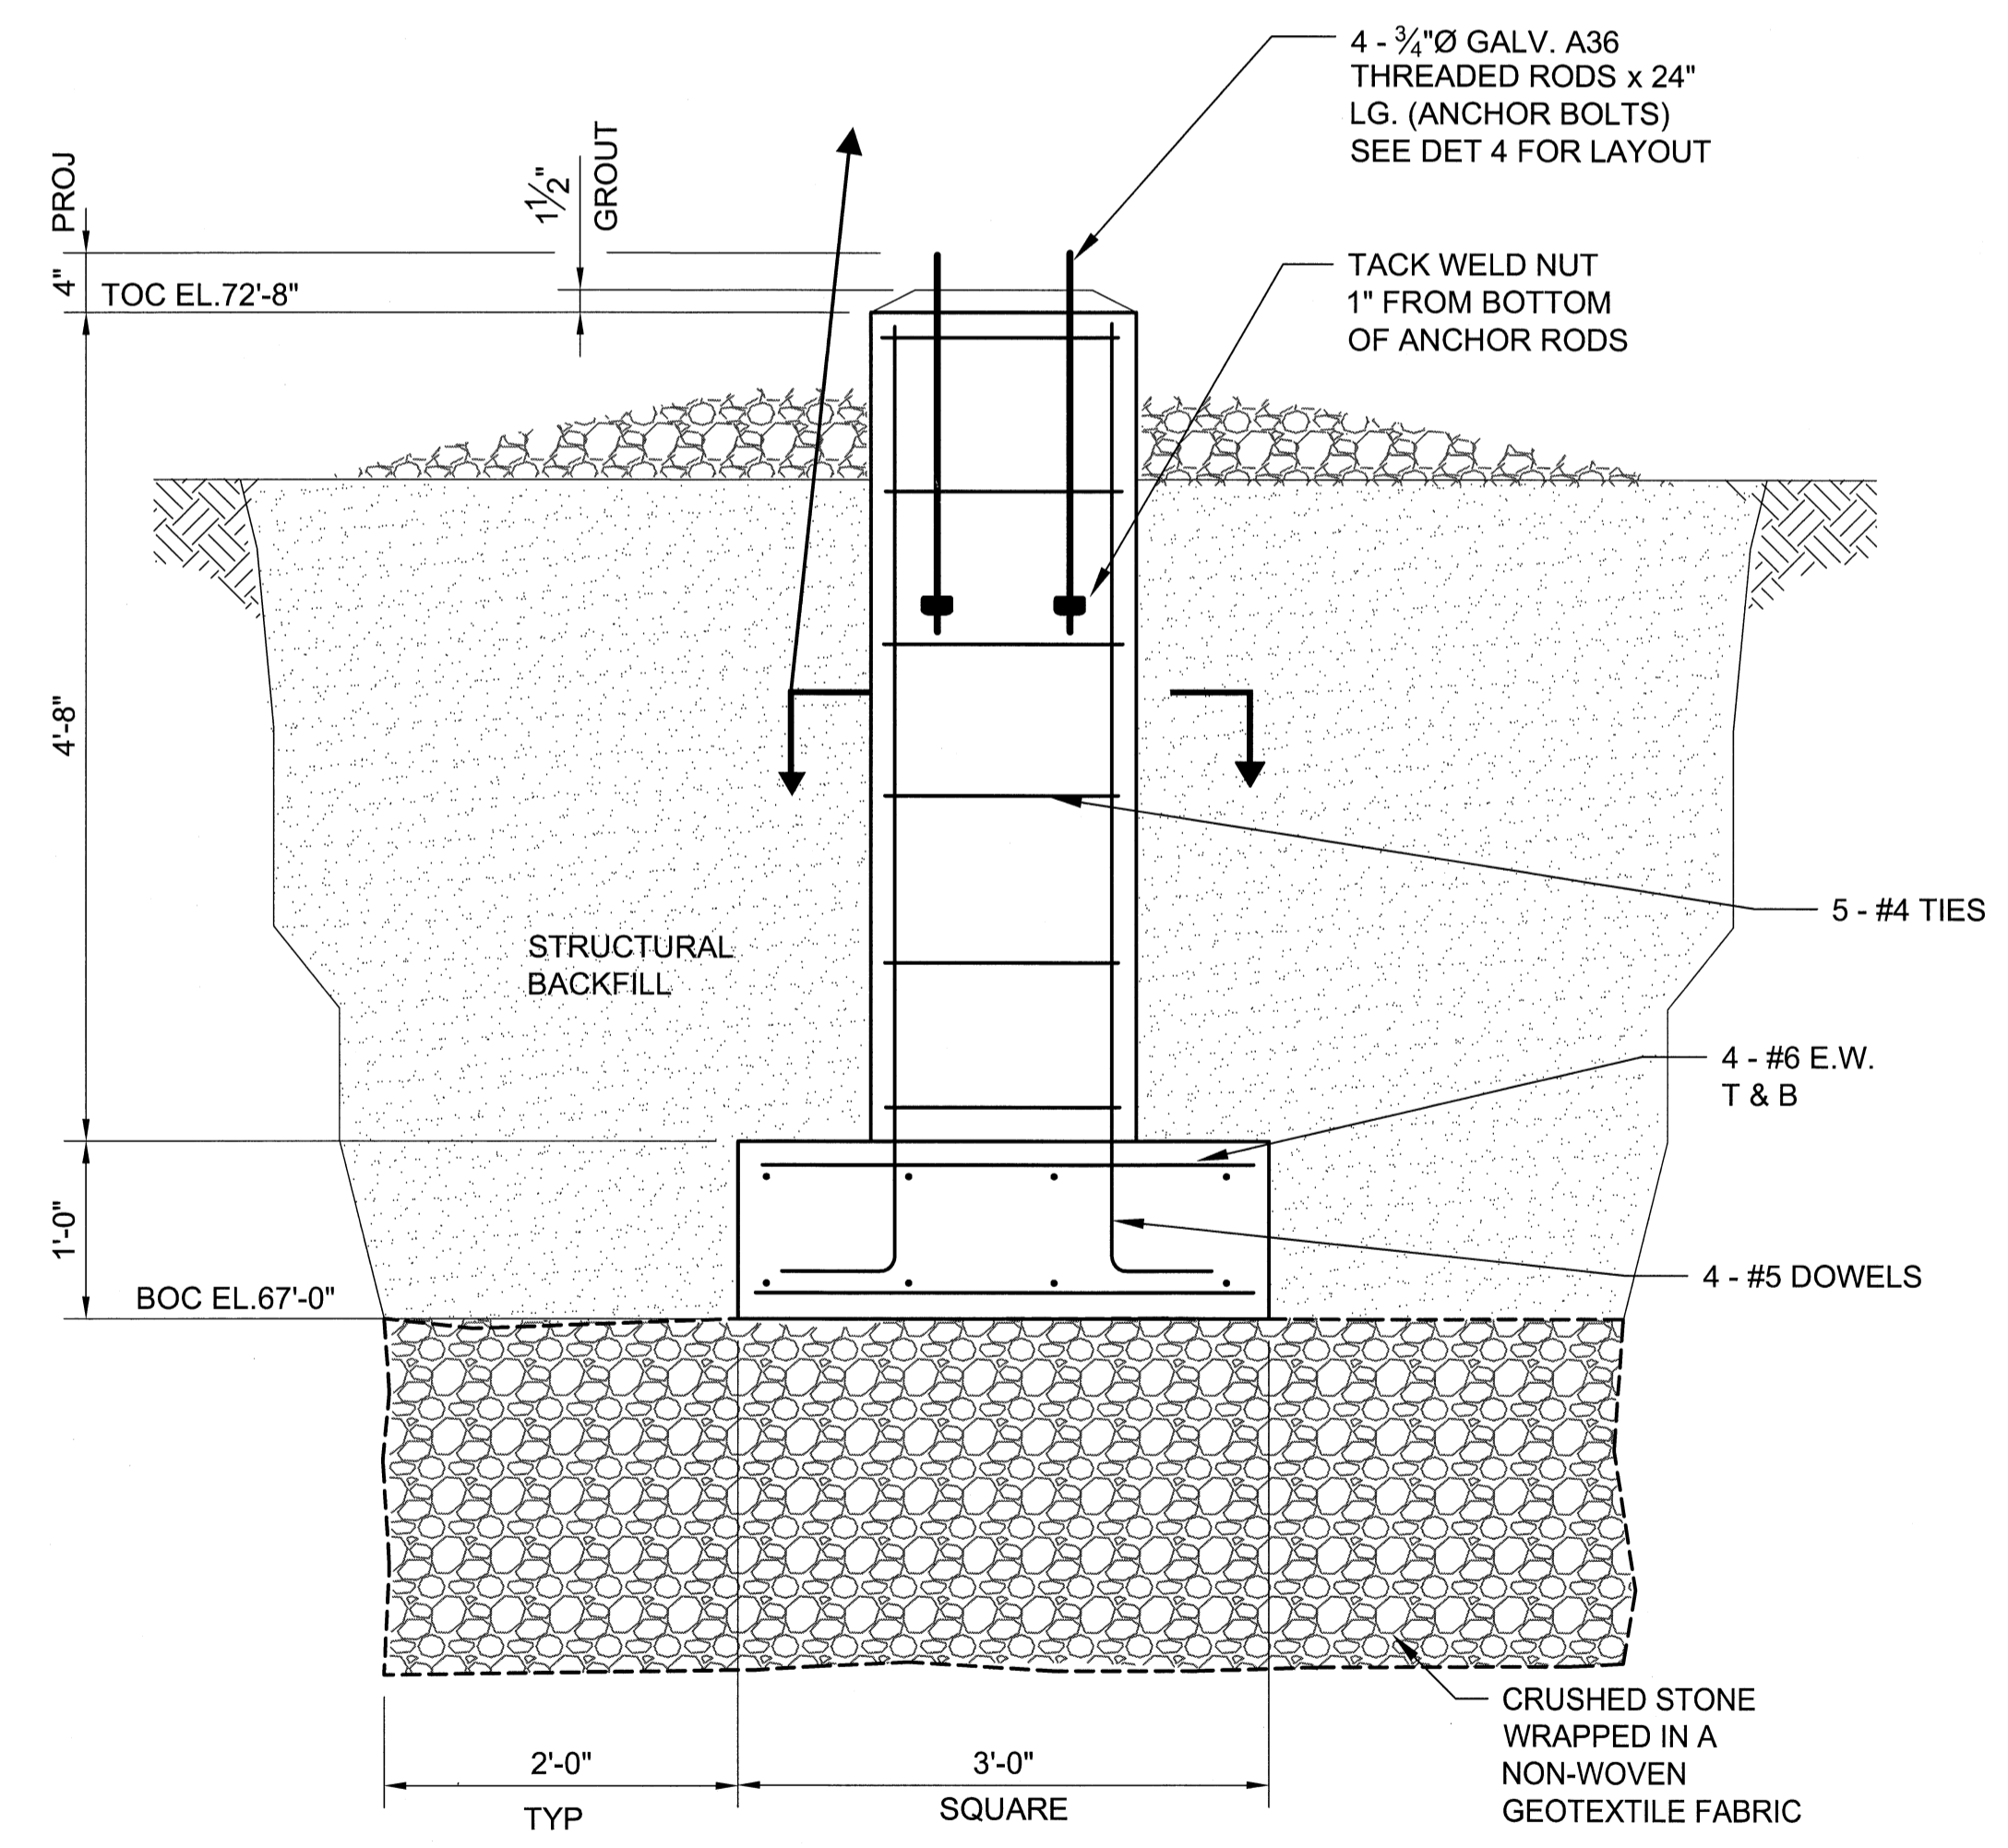

Project Manager	
DC Reviewer	
Architectural	
Structural	
Mechanical	
Plumbing	
Electrical	
Other	


Issued For Construction	11/1/12	Mark
Date		Approved
Description		

Designed by	DCB
Checked by	MLM
Drawn by	RAM
Reviewed by	DCB
Date	2012

FEMA
KBR
43 SOUTH ROYAL STREET SUITE 200
MOBILE, AL 36602
Phone: (251) 450-7000
Fax: (251) 450-7008
Engineering Services by
KBR Engineering Co. LLC



FEMA EMERGENCY RADIO NETWORK
ON WGAN PORTLAND, MAINE
MISCELLANEOUS DETAILS

Drawing Number:
S-501

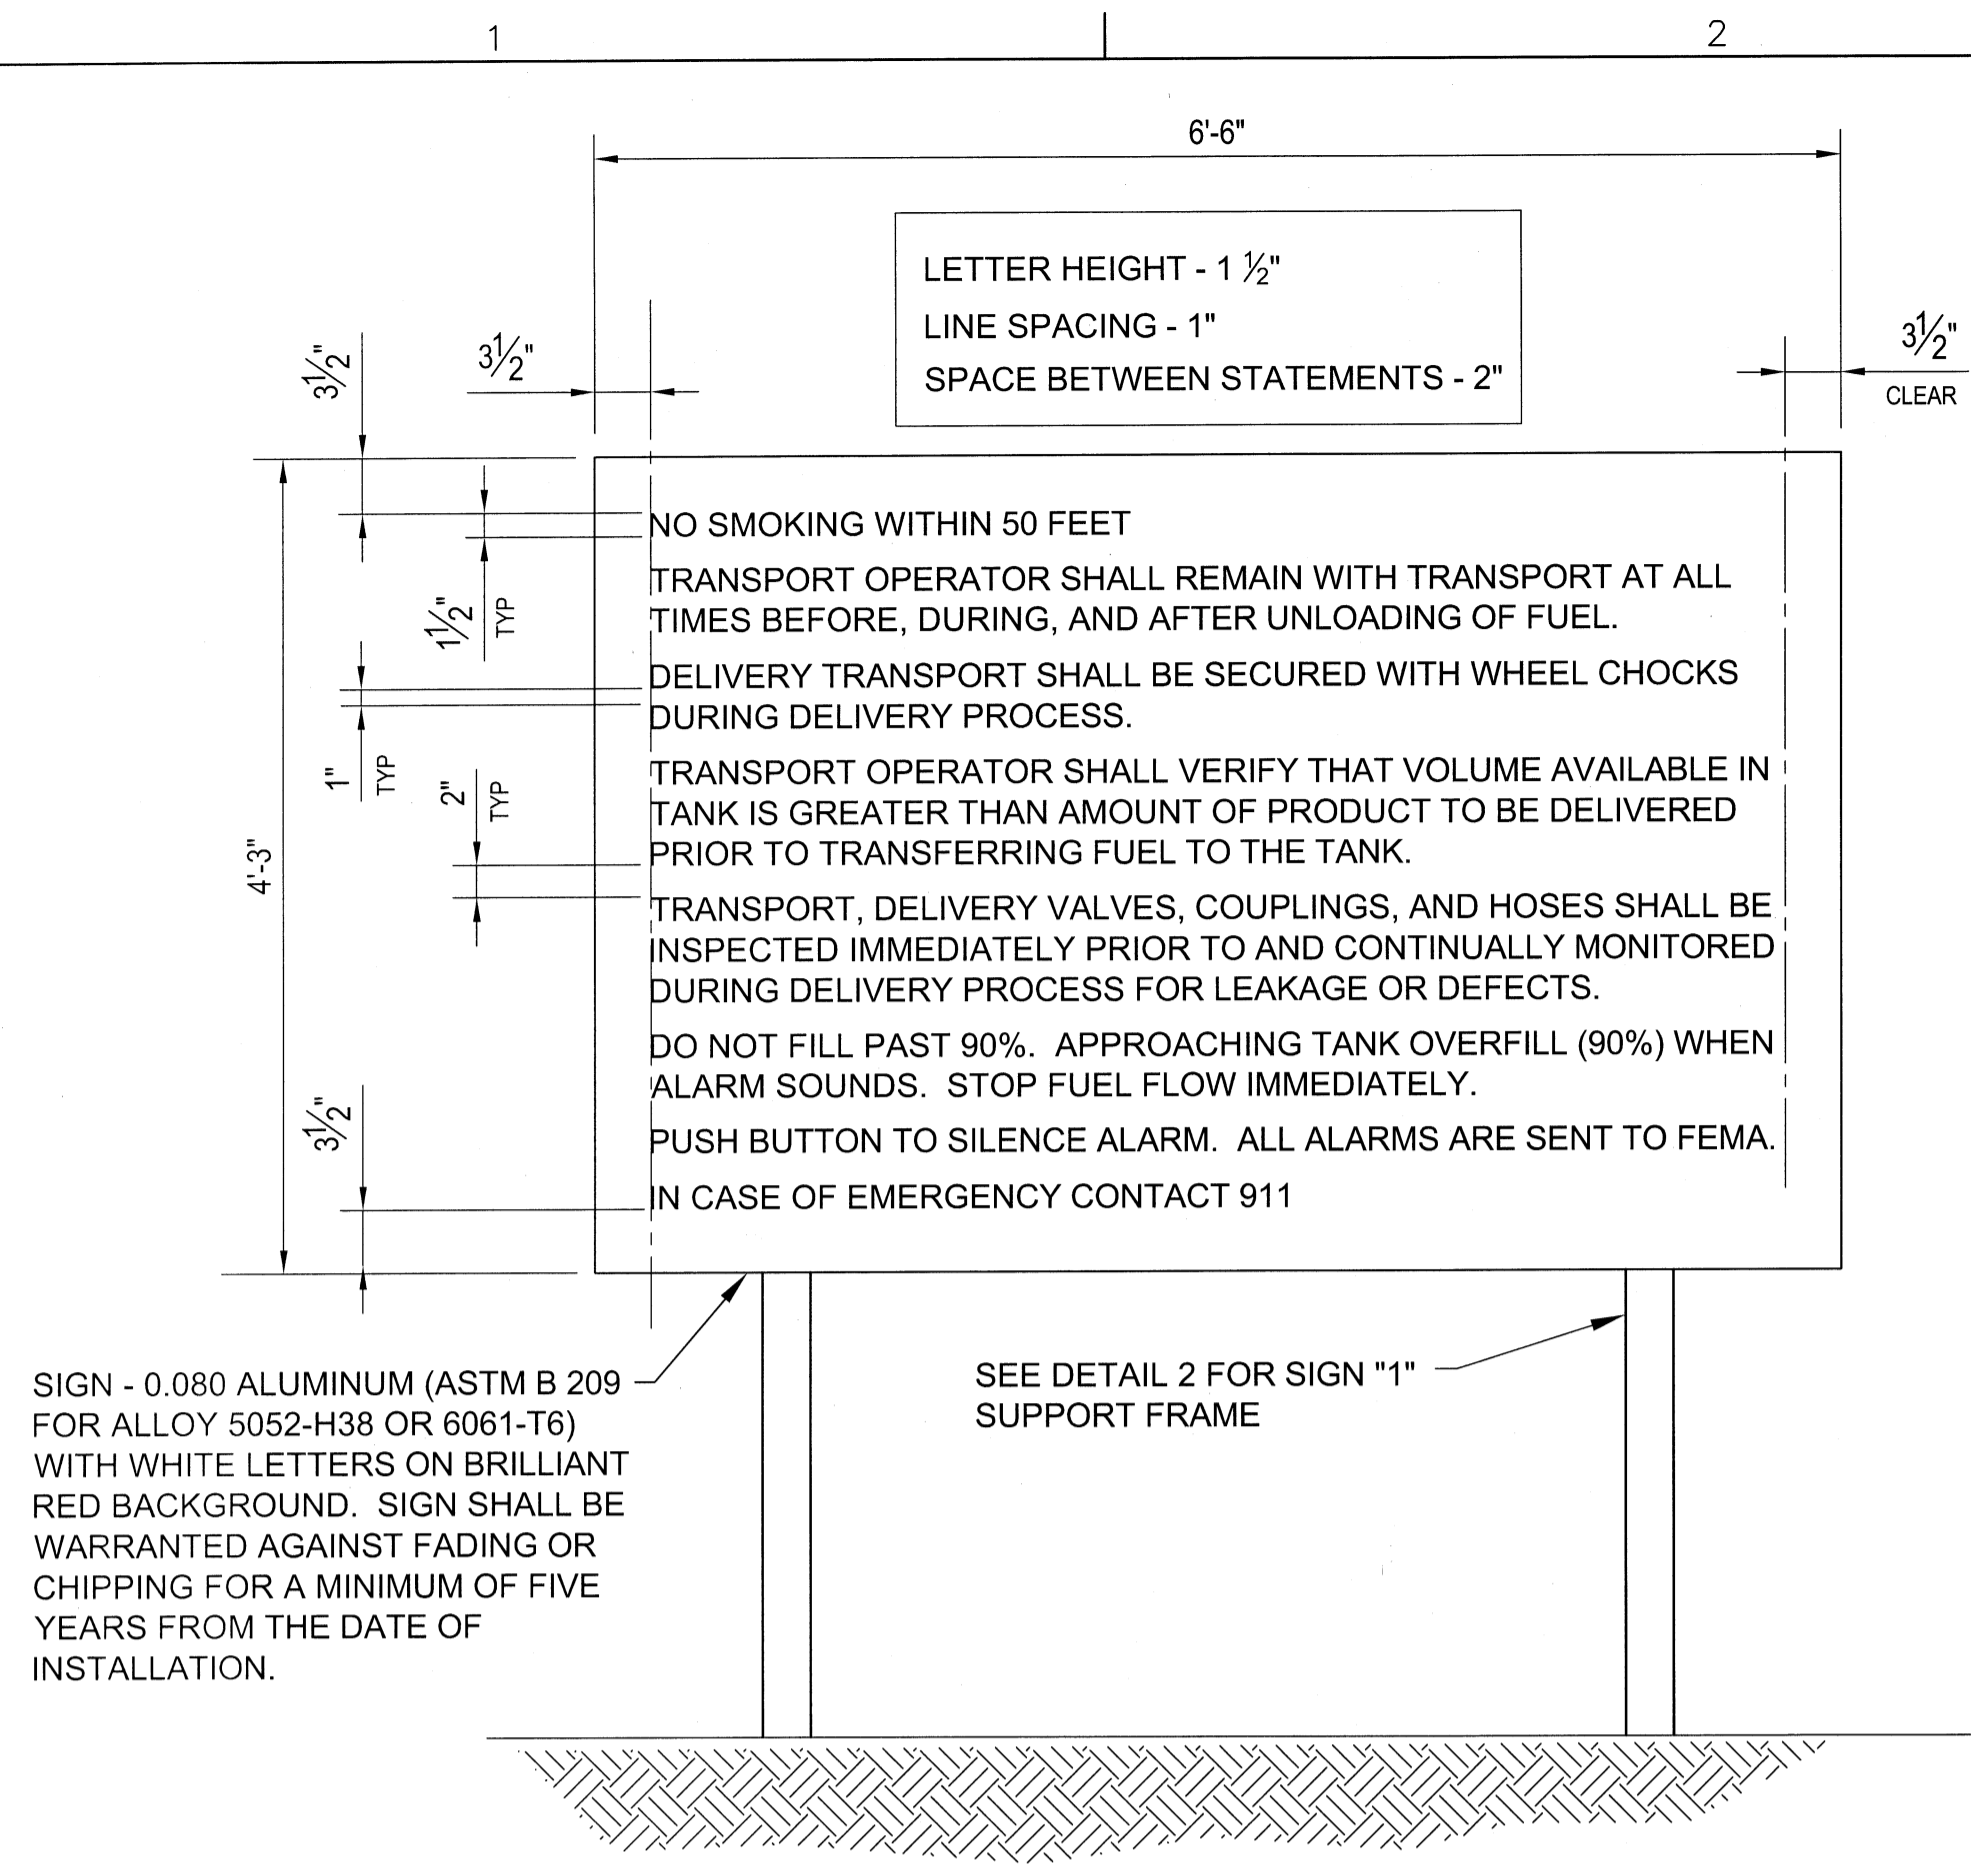


1 SIGN "1" DETAIL
M-101 SCALE: 1"=1'-0"

INSTALLATION CONTRACTOR TO TOUCH UP ALL DAMAGED GALVANIZING WITH ZRC COLD GALVANIZING COMPOUND, OR APPROVED EQUAL.

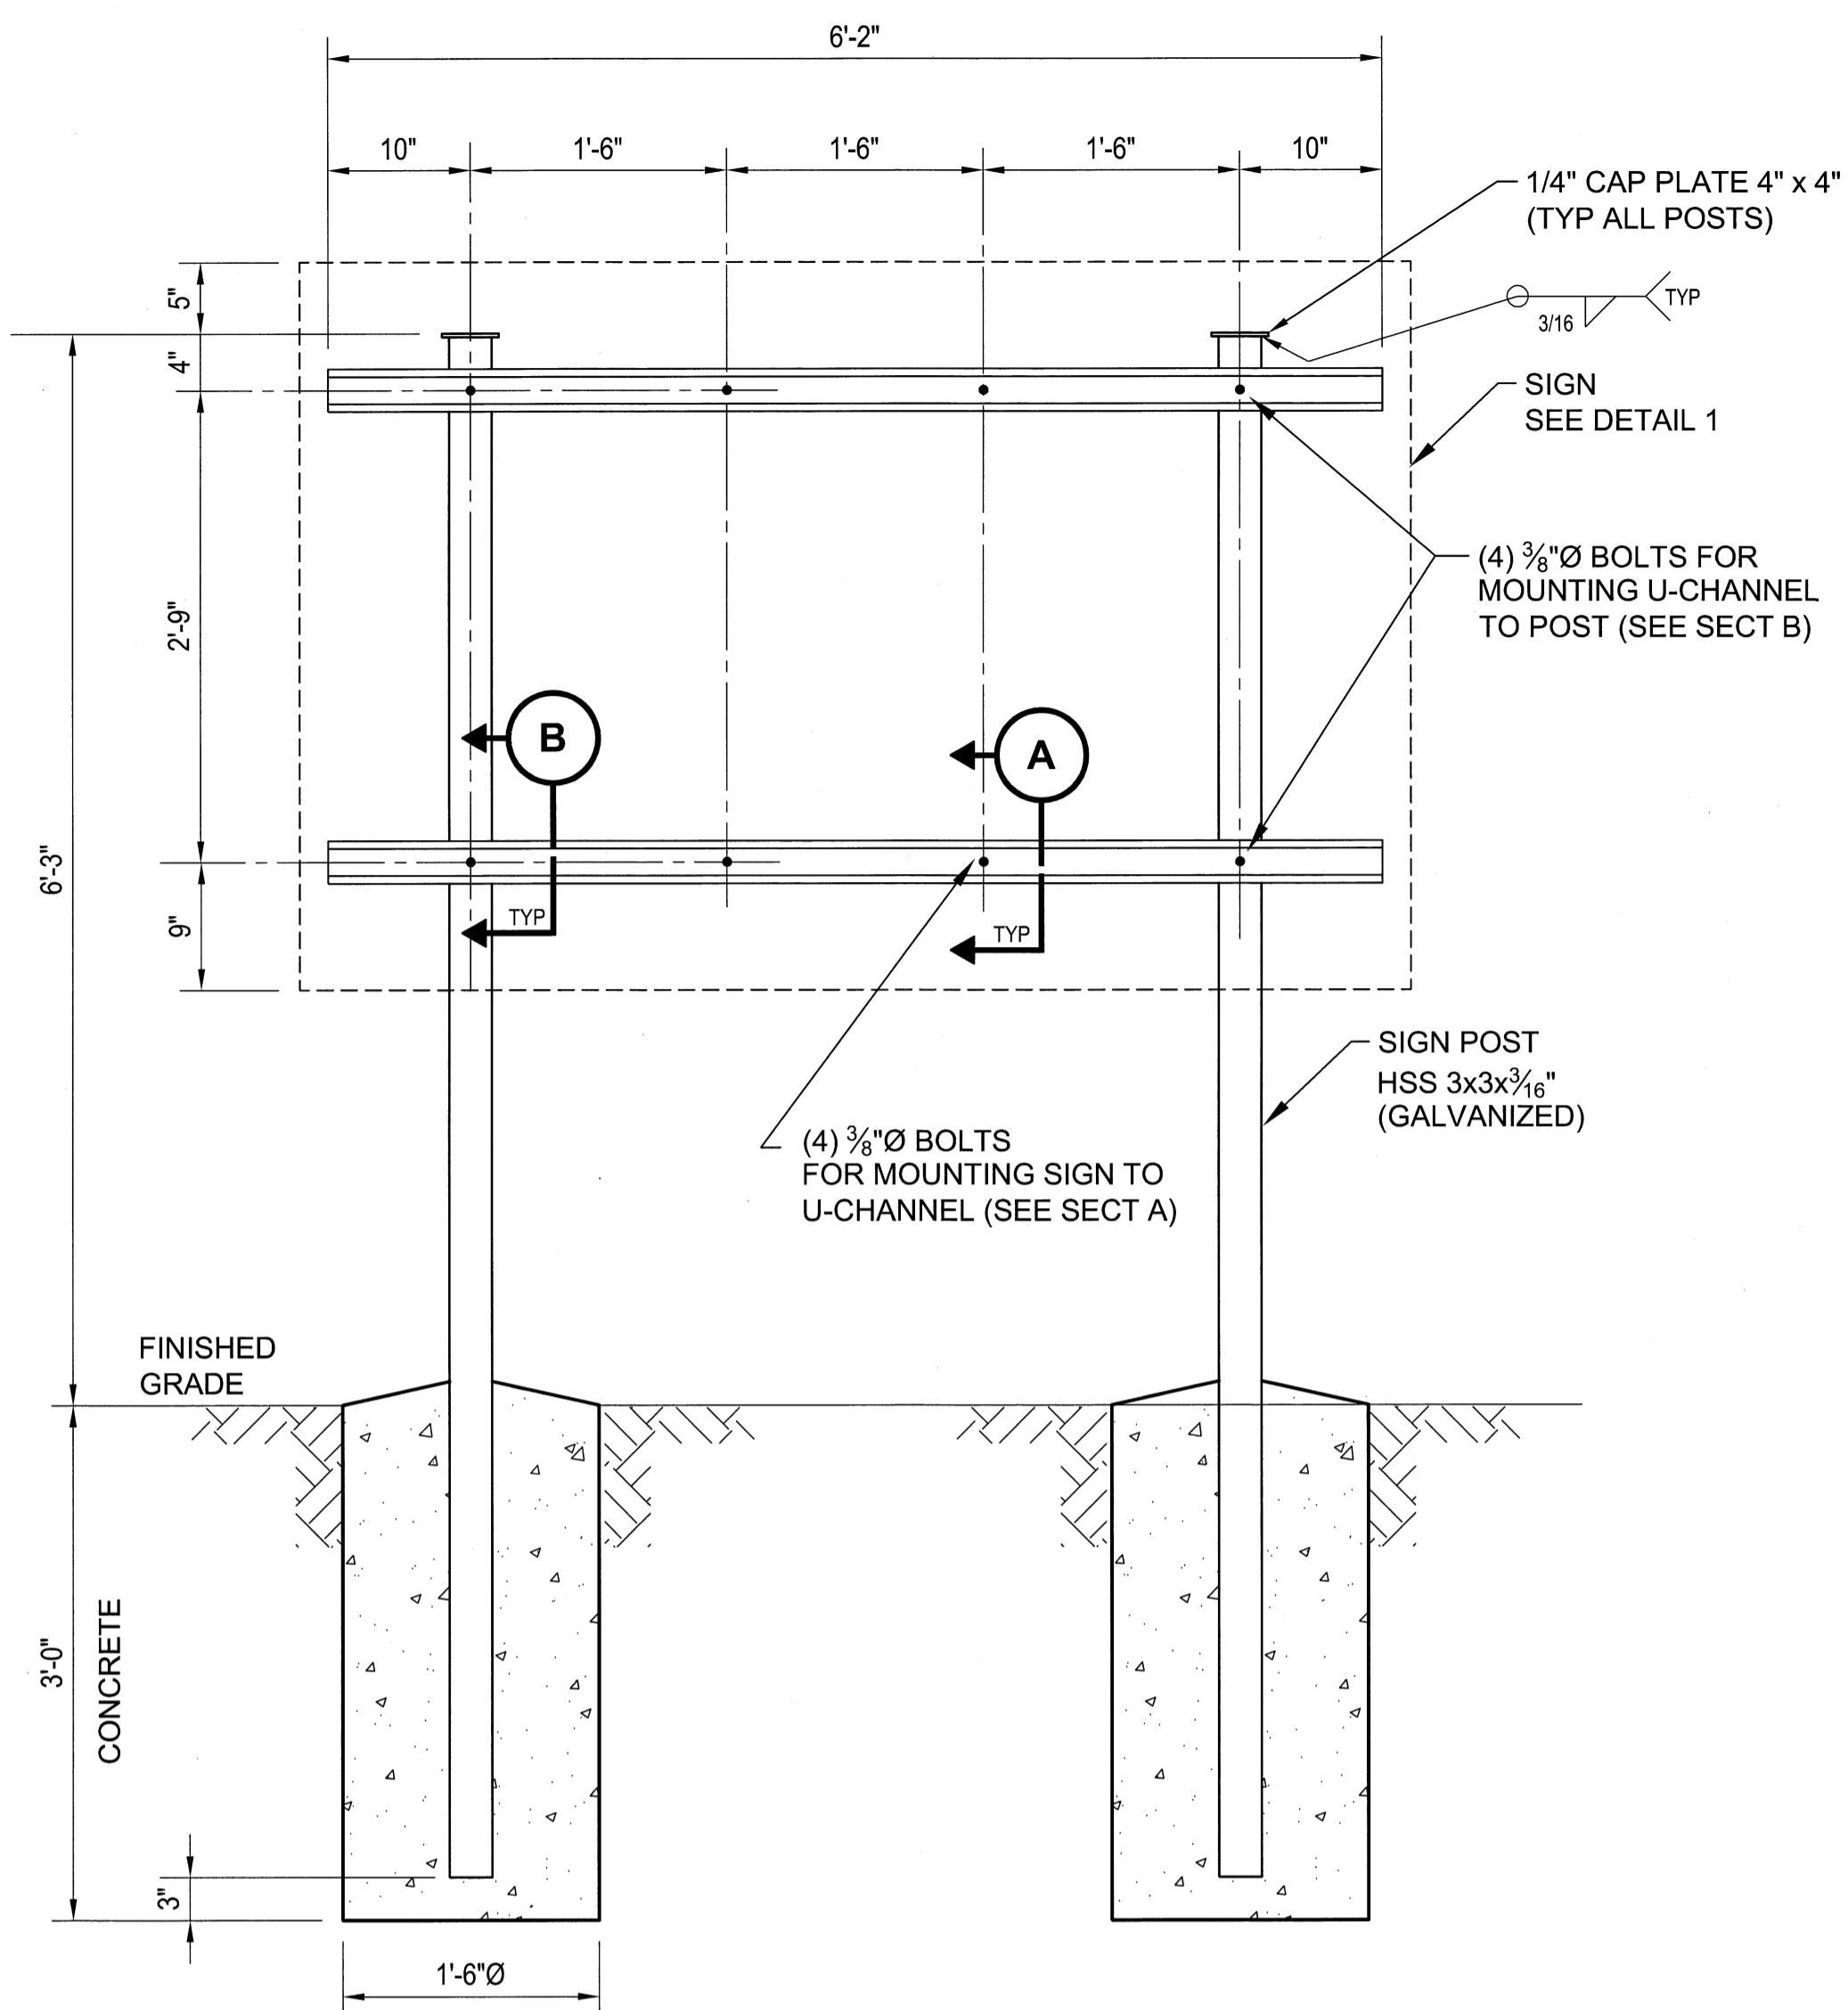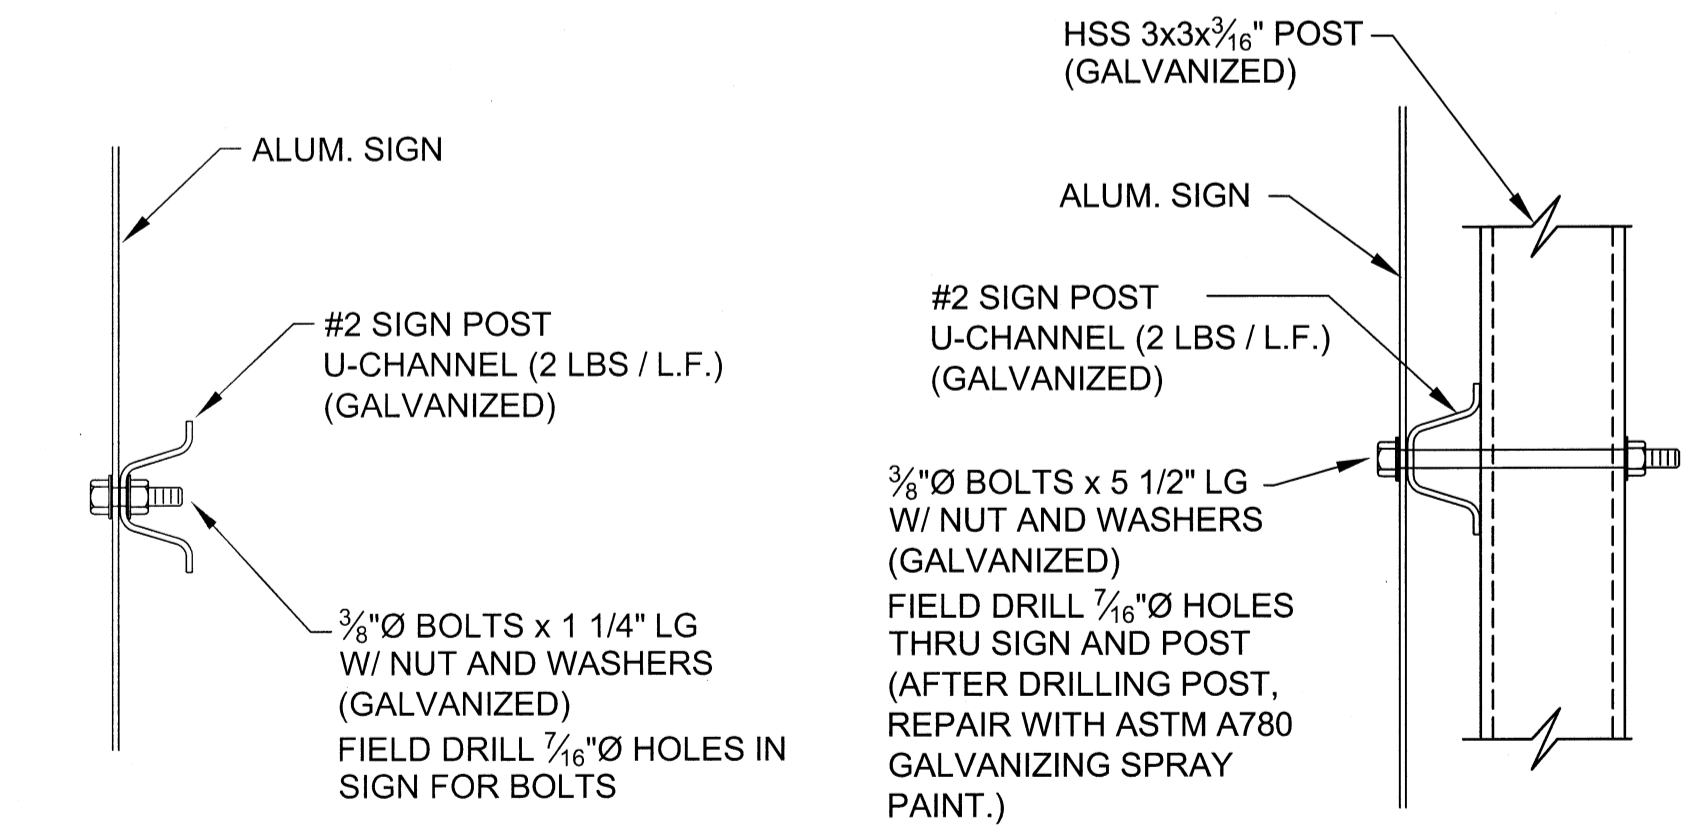


2 SIGN "1" SUPPORT FRAME DETAIL
SCALE: 1"=1'-0"

FOR SIGN LOCATION, SEE MECHANICAL DRAWINGS.

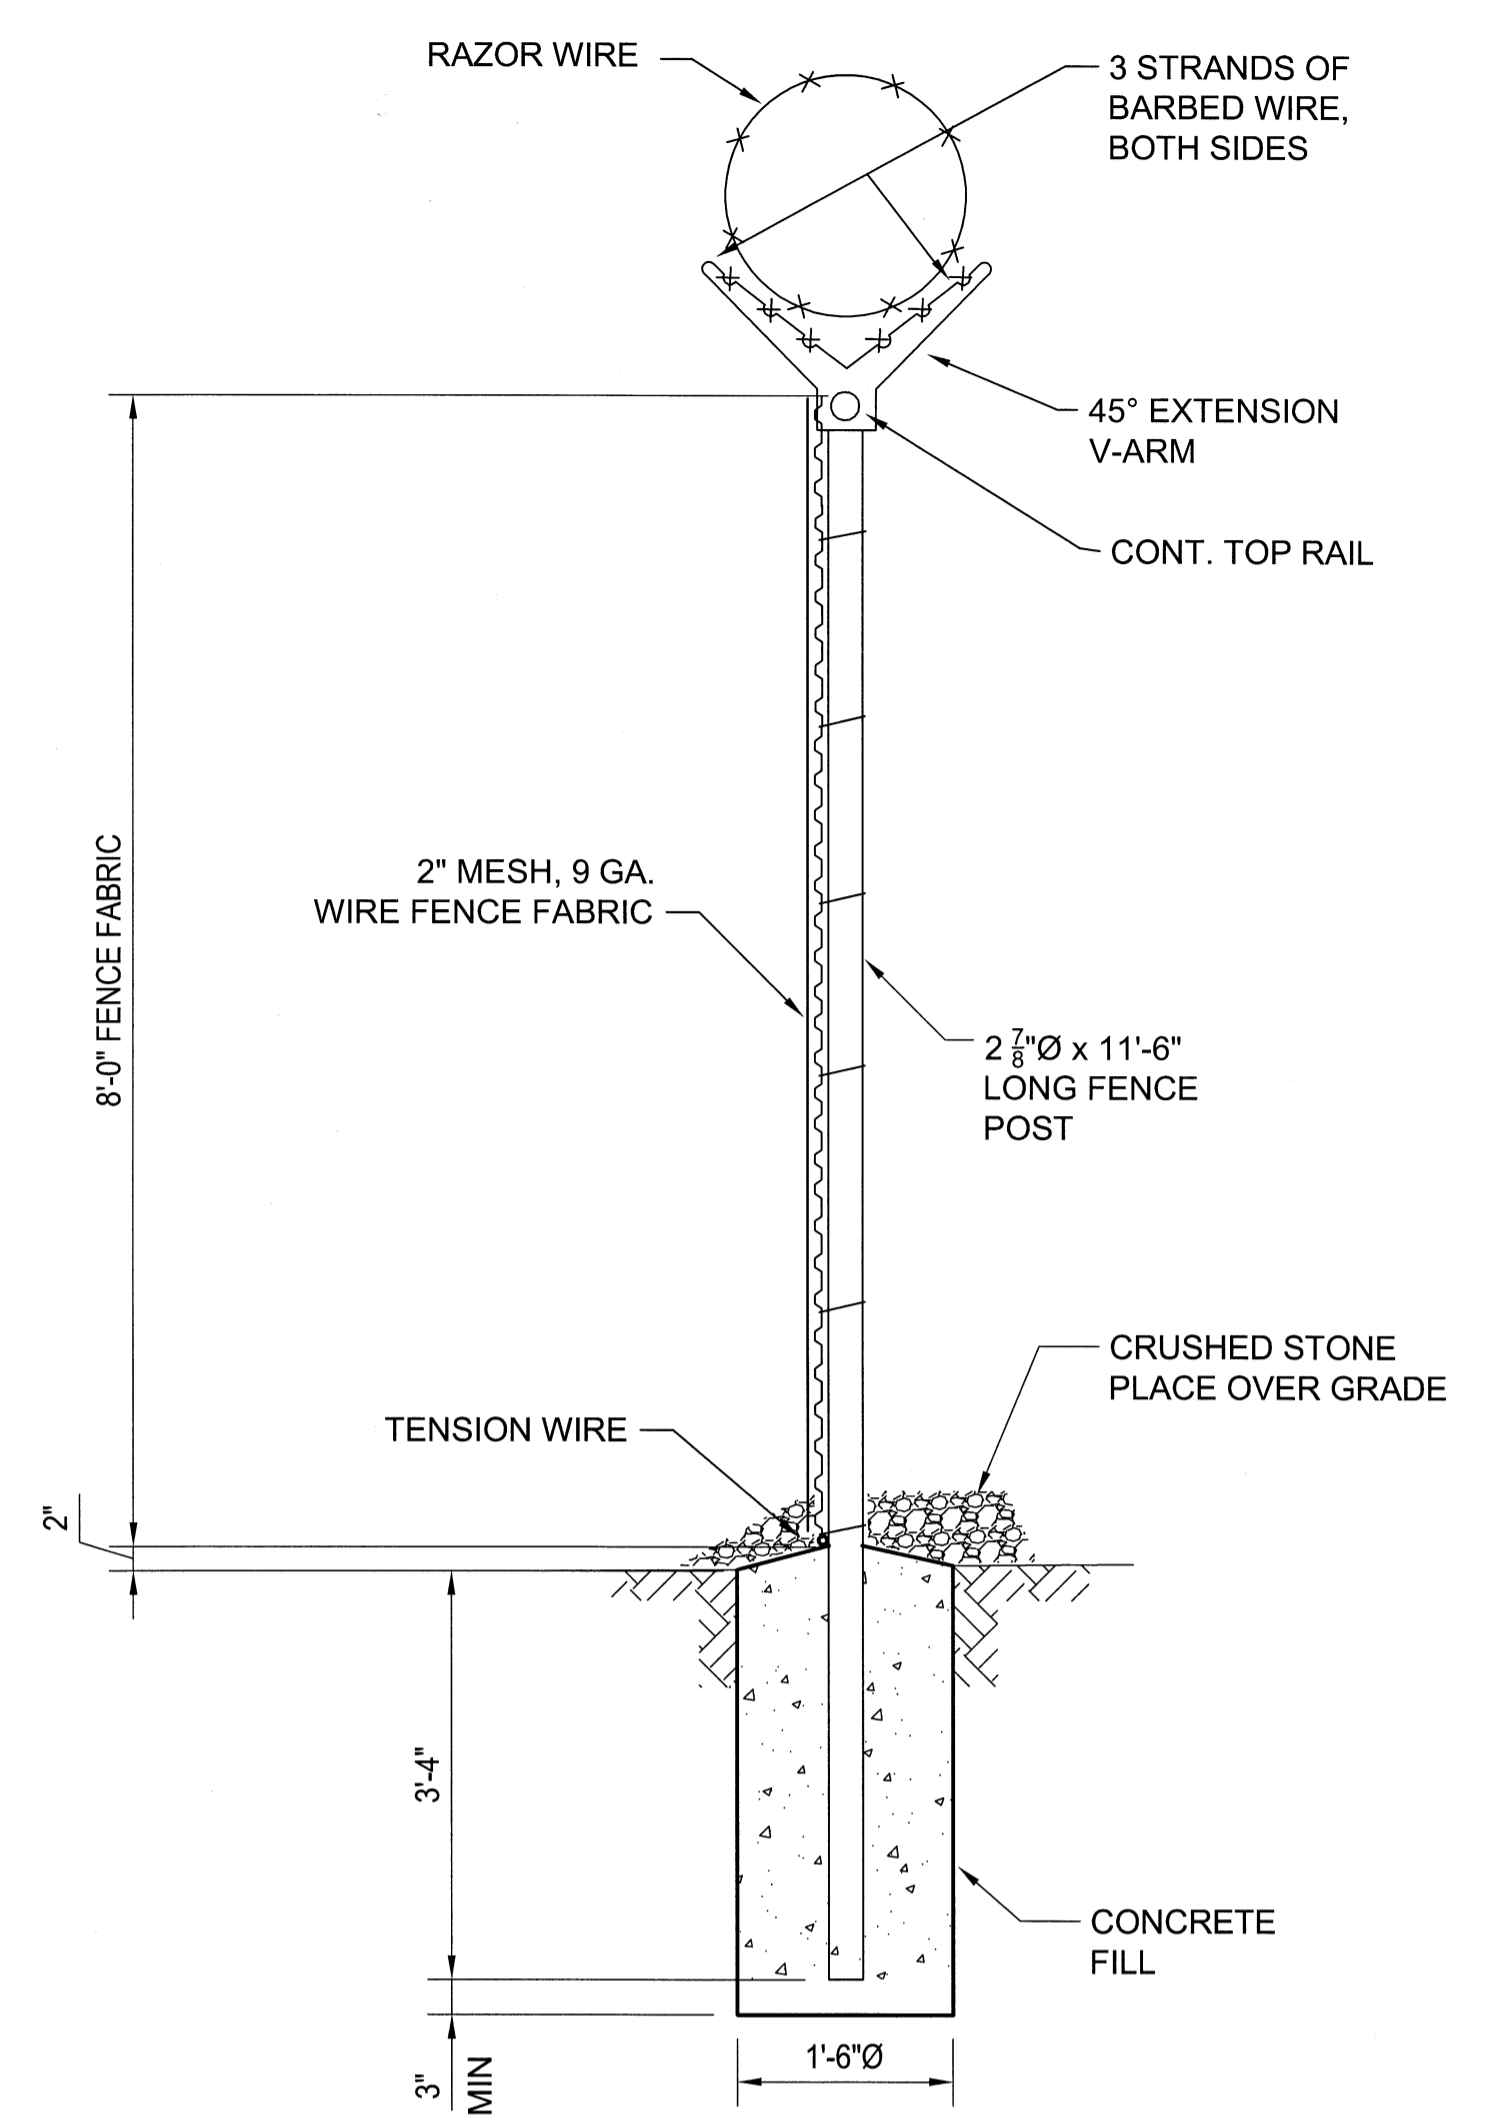

C TYP FENCE SECTION
S-101 SCALE: 3/4"=1'-0"

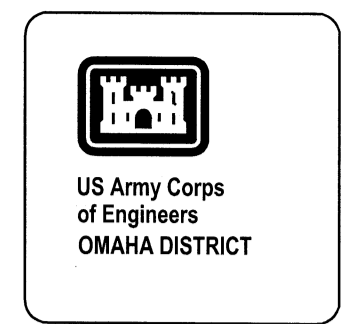

PHASE REVIEW	Project Manager	QC Reviewer	Architectural	Mechanical	Plumbing	Electrical	Civil

DATE	DESCRIPTION	APPROVED
11/17/12	ISSUED FOR CONSTRUCTION	


Designed by: MLM	Checked by: DCB
Drawn by: RAM	Reviewed by: CHB
Date: 2012	

KBR
63 SOUTH ROYAL STREET SUITE 200
MOBILE, AL 36602
Tel: (251) 462-7898
Fax: (251) 462-7898

FEMA
Engineering Services by
KBR Engineering Co. LLC

FEMA EMERGENCY RADIO NETWORK
ON WIGAN PORTLAND, MAINE


SIGN AND FENCE DETAILS

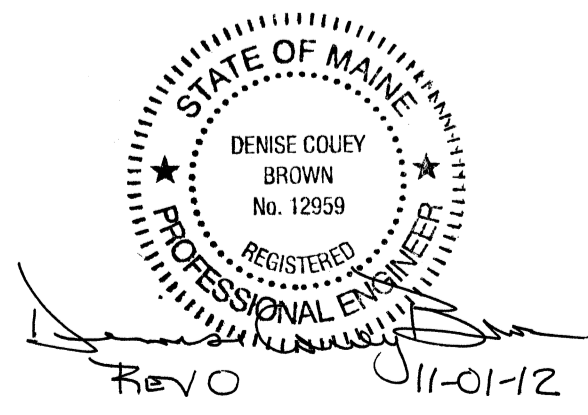

Drawing Number:
S-502

NOTES:

1. THE FUEL TANK, APPURTENANCES, AND ASSOCIATED PIPING SHALL MEET ALL U.S. EPA, STATE OF MAINE DEQ, STATE FIRE MARSHAL, NFPA, NEC, MANUFACTURER'S INSTRUCTIONS, LOCAL FIRE DEPARTMENT AND LOCAL REQUIREMENTS, CODES AND GUIDELINES.
2. ABOVEGROUND PIPING SHALL COMPLY WITH NFPA 30, "FLAMMABLE AND COMBUSTIBLE LIQUIDS CODE" AND ASME B31.9, "BUILDING SERVICES PIPING," FOR FUEL OIL PIPING MATERIALS, INSTALLATION, INSPECTION, AND TESTING. STAINLESS STEEL PIPING SHALL CONFORM TO ASTM A312, PIPE, 304L, STAINLESS STEEL, SCHEDULE 40S. STAINLESS STEEL PIPING SHALL HAVE SOCKET WELD FITTINGS AND SOCKET WELD 150# RF FLANGES. ON GEN-SET FUEL LINE CONNECTIONS WITH MNPT STUB-OUTS, CONTRACTOR SHALL INSTALL A THREADED 150# RF FLANGE OF THE SAME MATERIAL AS THE PIPING THE FLANGE IS BEING THREADED TO. FLANGE INSULATING GASKET KITS SHALL BE USED IN CASES WHERE A CARBON STEEL FLANGE IS BEING MATED TO A STAINLESS STEEL FLANGE. ANY REMAINING CARBON STEEL PIPING THAT IS EXPOSED SHALL BE PAINTED AS PER THE SPECIFICATION. GALVANIZED PIPE IS NOT PERMITTED FOR USE FOR FUEL OIL PIPING OR VENT PIPING.
3. (PS-1) PIPE SUPPORT DESIGNATOR. SEE DWG S-501.
4. SEE DRAWING M-601 AND SPECIFICATION SECTION 23 10 20 FOR FULL SCOPE OF WORK FOR THE FUEL OIL SYSTEM.
5. SEE DRAWING S-502 FOR SIGN DETAILS. INSTALLATION CONTRACTOR SHALL DETERMINE EXACT LOCATION TO CLEAR UNDERGROUND ELECTRICAL.
6. PROVIDE A 4A-40BC (MINIMUM RATING) 10 LB FIRE EXTINGUISHER CONFORMING TO NFPA 10, AND APPLICABLE SECTIONS OF NFPA 1, 13.6. PROVIDE LOCKABLE OUTDOOR CABINET WITH BREAKER BAR, SIGNS AND ACCESSORIES AS REQUIRED. VERIFY LOCAL REQUIREMENTS WITH FIRE MARSHAL PRIOR TO PURCHASE. INSTALL FIRE EXTINGUISHERS WHERE INDICATED ON THE DRAWING. COMPLY WITH THE MANUFACTURER'S RECOMMENDATIONS FOR ALL INSTALLATIONS. PROVIDE EXTINGUISHERS COMPLETE WITH MANUFACTURER'S WARRANTY WITH INSPECTION TAG ATTACHED. EXTINGUISHER SHALL BE INSTALLED, INSPECTED, AND TAGGED BY A LICENSED FIRE EXTINGUISHER COMPANY.
7. UNDERGROUND FLEXIBLE PIPING AND CONTAINMENT SYSTEM ARE IDENTIFIED WITH OPW FLEXWORKS MODEL NUMBERS. SYSTEM SHALL BE OPW FLEXWORKS OR APPROVED EQUAL.
8. UNDERGROUND DOUBLE CONTAINMENT SYSTEM SHALL BE PROVIDED BY CONTRACTOR AS A COMPLETE SYSTEM DESIGNED AND FABRICATED BY THE CONTAINMENT SYSTEM MANUFACTURER WITH RESPECT TO THE DRAWINGS, SPECIFICATIONS, AND THE CONDITIONS OF THE SITE. INSTALLATION OF UNDERGROUND DOUBLE CONTAINMENT SYSTEM SHALL BE IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.



Project Manager	
DC Designer	
Structural	
Mechanical	
Plumbing	
Electrical	
Check	

ISSUED FOR CONSTRUCTION	0	11/7/12	Approved
Description		Date	

Designed by	DBH
Checked by	DBH
Drawn by	RAM
Reviewed by	CHB
Date	2012



63 SOUTH ROYAL STREET SUITE 200
 PORTLAND, MAINE 04101
 PHONE: (207) 402-7600
 FAX: (207) 402-7888

KBR
 Engineering Co., LLC

FEMA EMERGENCY RADIO NETWORK
 ON WGAN PORTLAND, MAINE


MECHANICAL PLAN

Drawing Number:
M-101

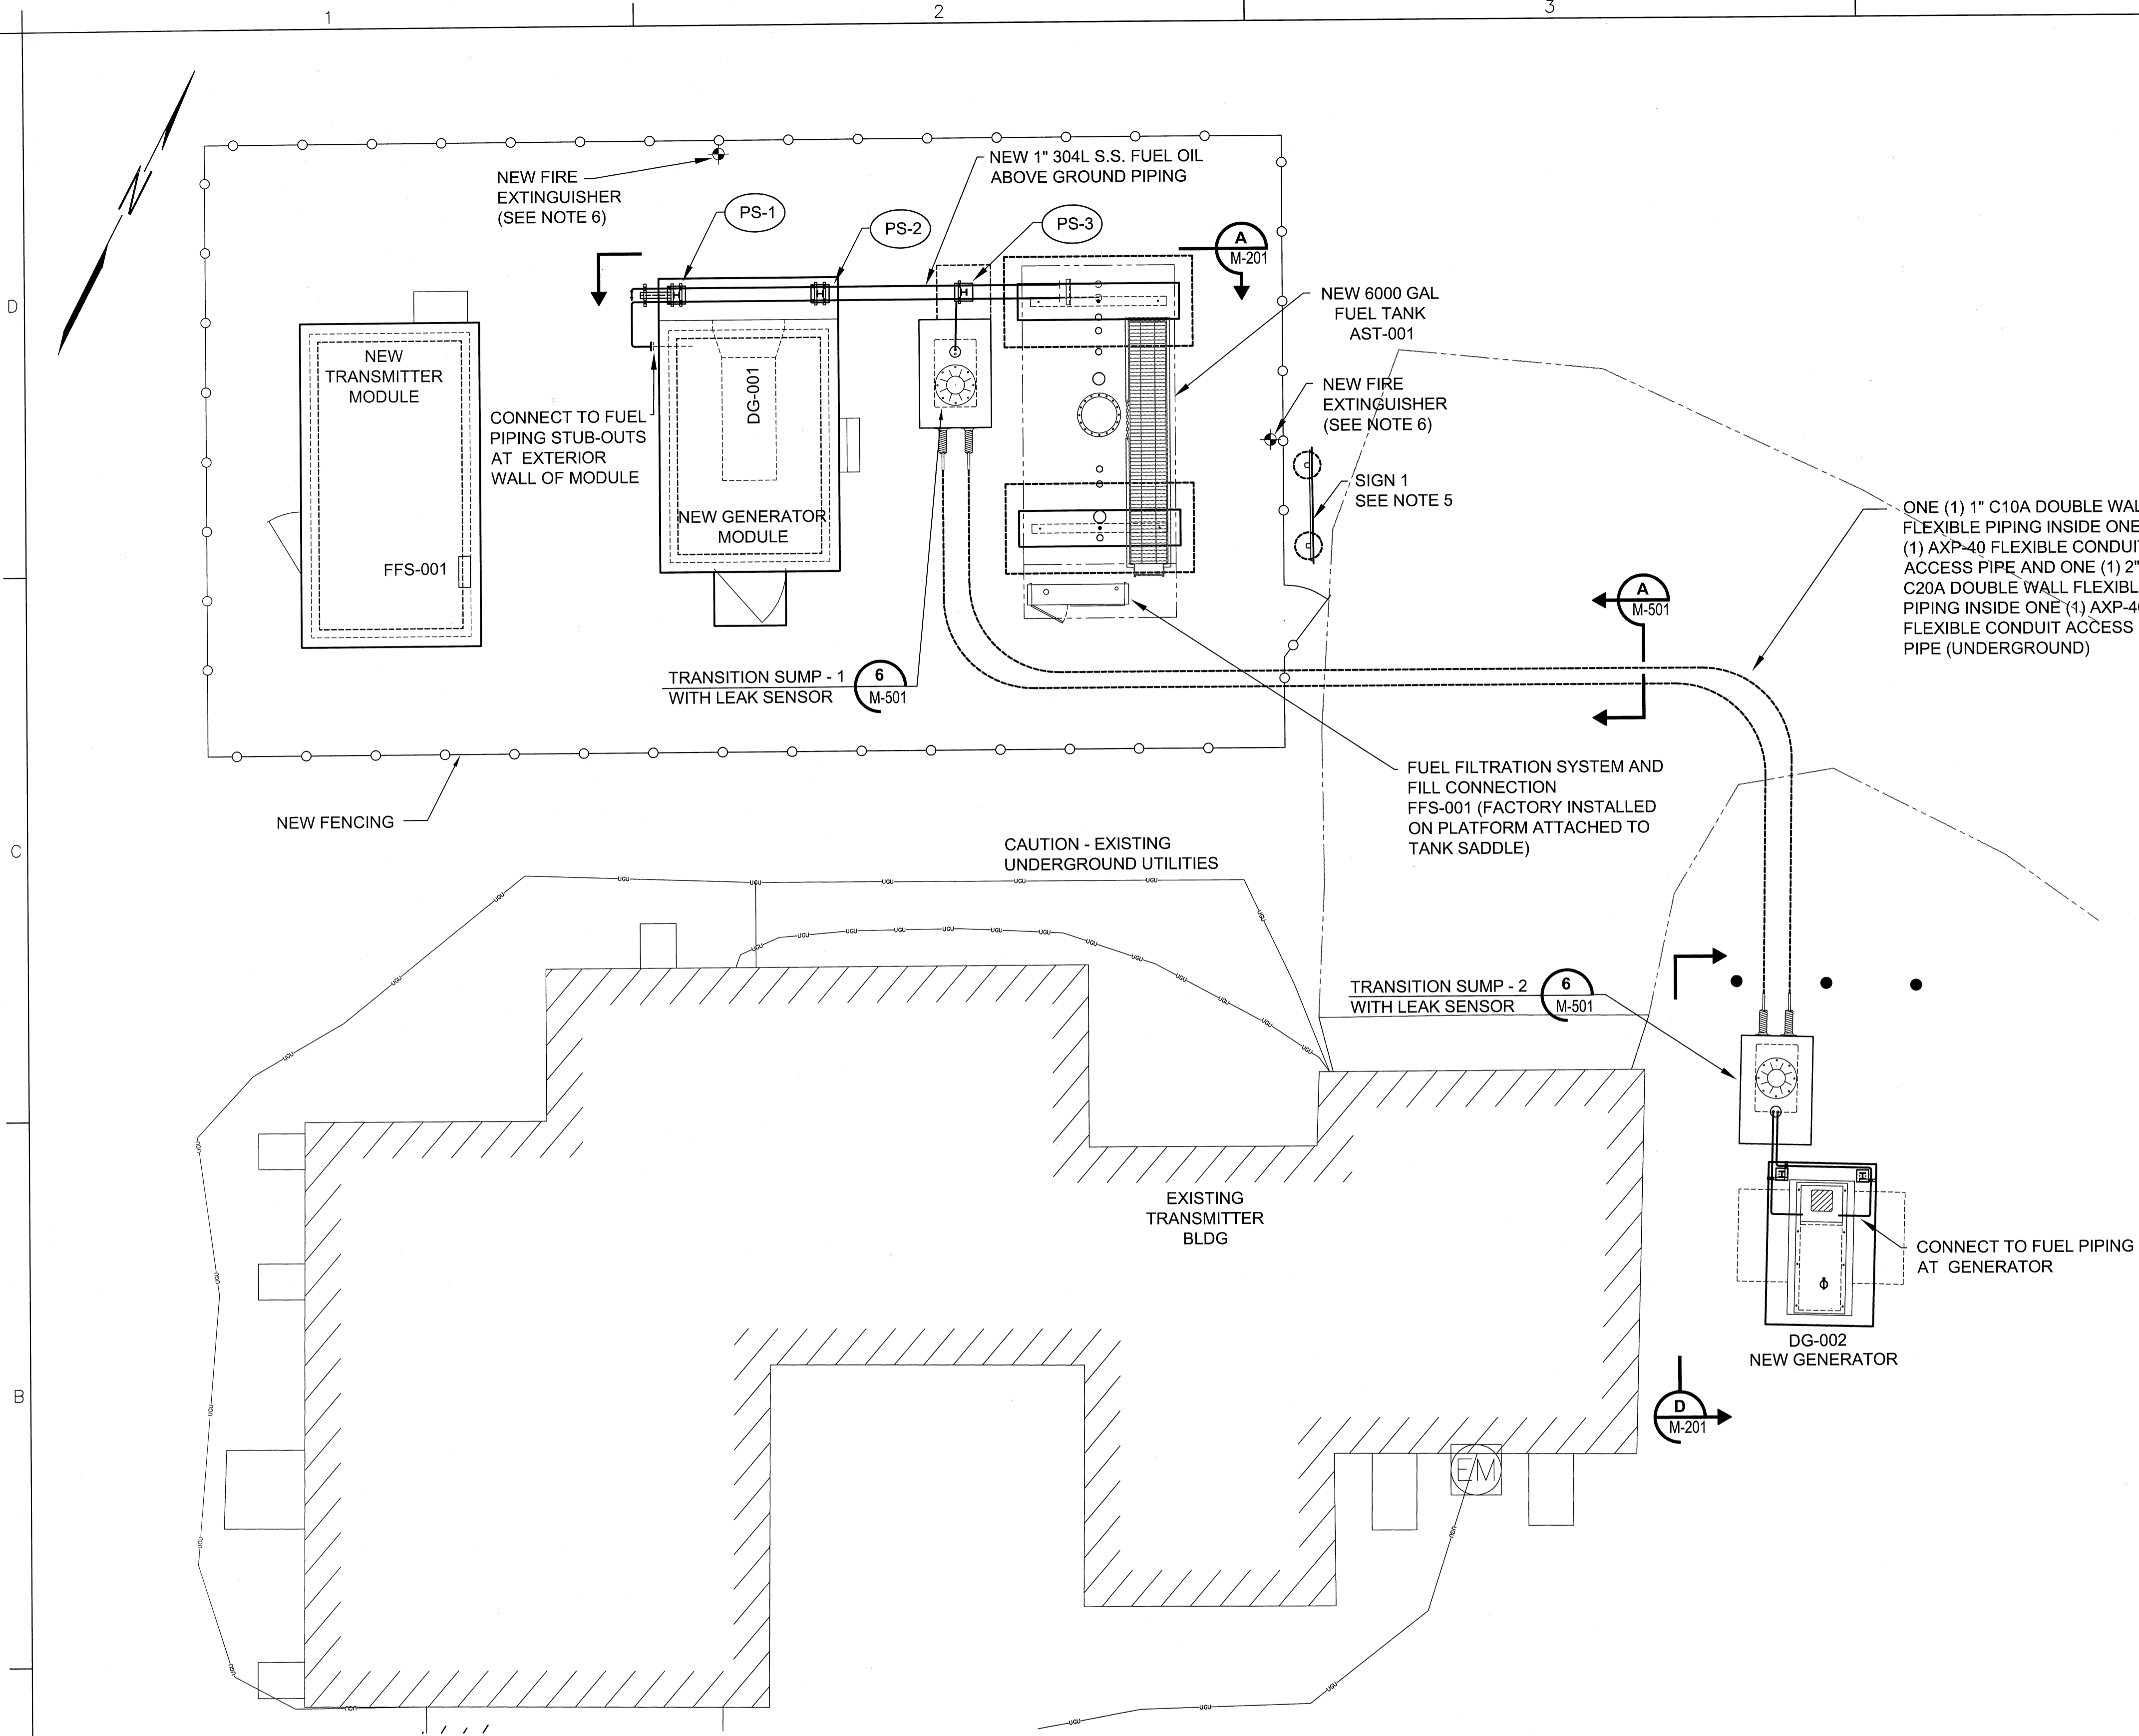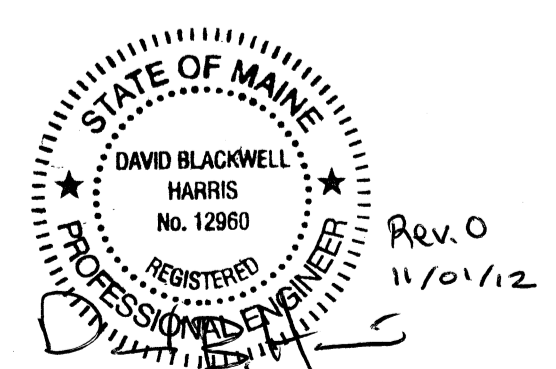


MECHANICAL PLAN
 SCALE: 3/16"=1'-0"
 0' 5' 10' 20'
 3/16"=1'-0"


EQUIPMENT SCHEDULE					
TAG	ITEM	FURNISHED BY	INSTALLED BY	DESCRIPTION	REMARKS
AST-001	ABOVEGROUND STORAGE TANK	OWNER	CONTRACTOR	6,000 GAL. DBL-WALL, UL-2085	PART OF FUEL SYSTEM PACKAGE
DG-001	FEMA GEN-SET	OWNER	OWNER	35 KW IN HEMP SHLD MODULE	PART OF HEMP MODULE PACKAGE
DG-002	NEW GEN-SET	OWNER	CONTRACTOR	75 KW W/ ENCLOSURE & SUB BASE TANK	OWNER TO FURNISH CONTRACTOR TO INSTALL
FFS-001	FUEL FILL/FILTRATION SYSTEM	OWNER	CONTRACTOR	FILL PORT W/ FILTRATION	PART OF FUEL SYSTEM PACKAGE (ON PLATFORM ATTACHED TO TANK)
FSCP-001	FUEL SYSTEM CONTROL PANEL	OWNER	OWNER (SEE ELECTRICAL DWGS & SPECS)	FUEL MONITORING SYSTEM	PART OF FUEL SYSTEM PKG (INSTALLED INSIDE TRANSMITTER MODULE)

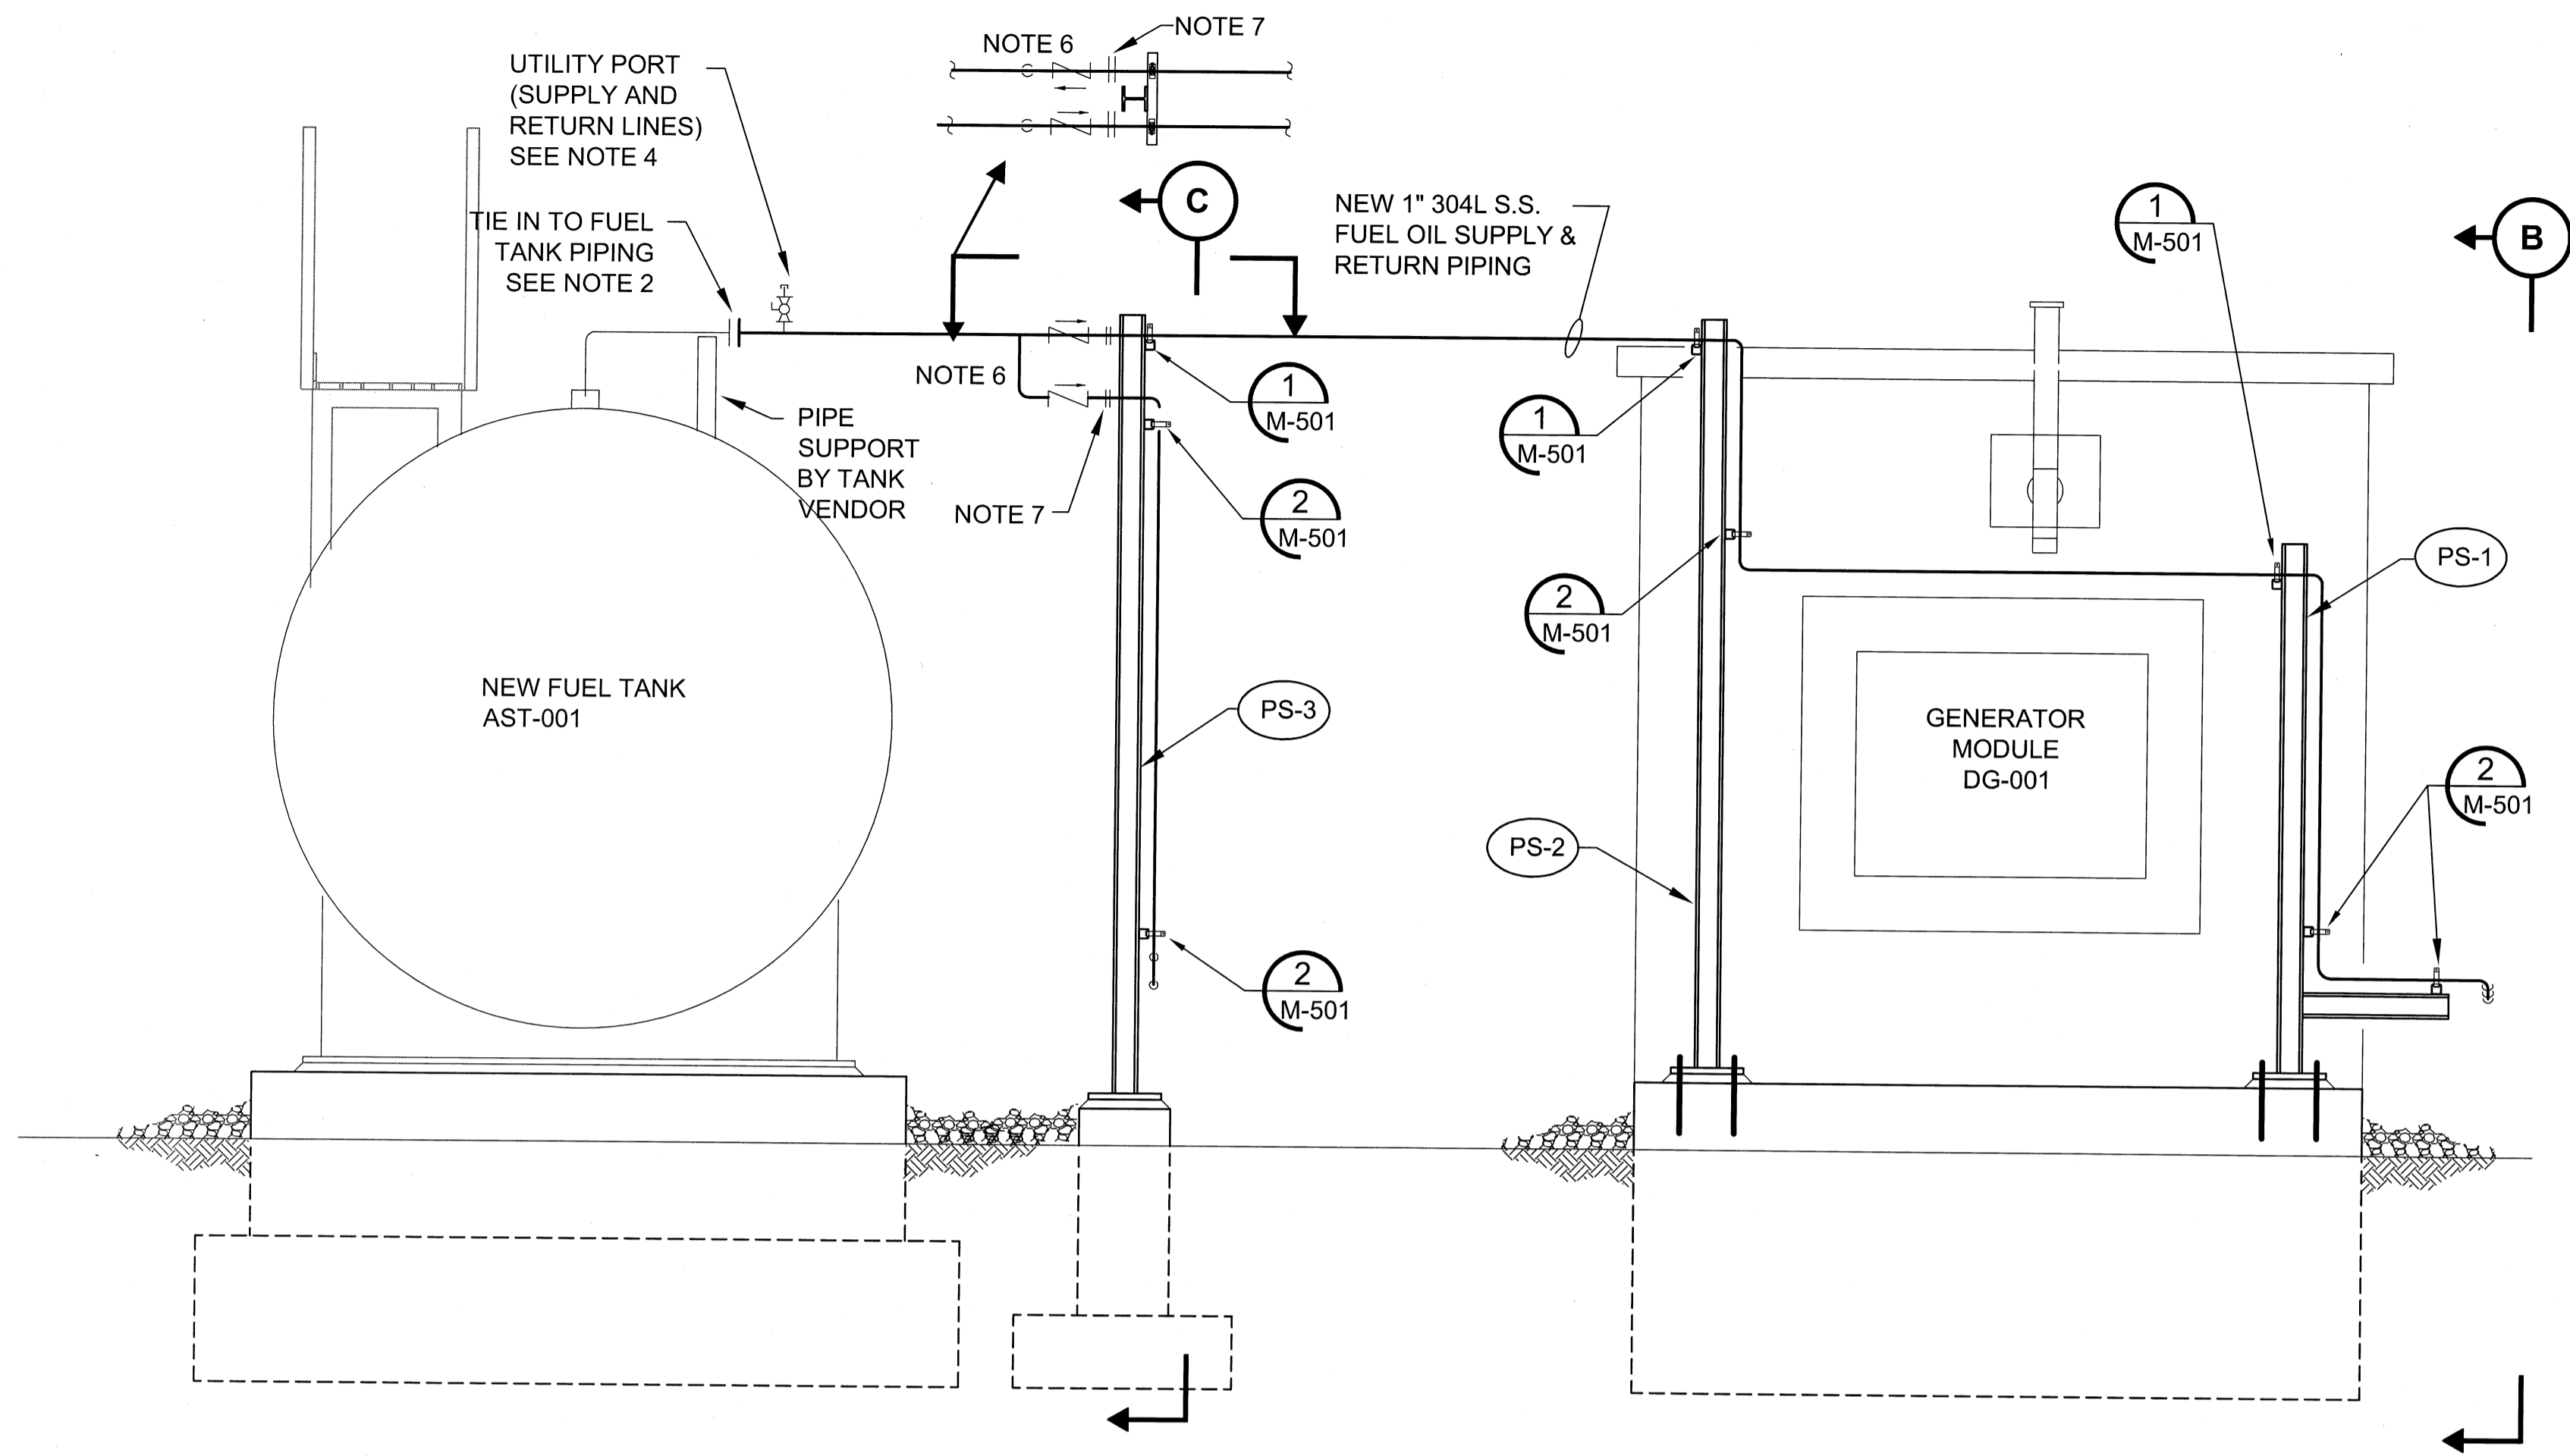


A FUEL PIPING ELEVATION
M-101 SCALE: 1/2"=1'-0"

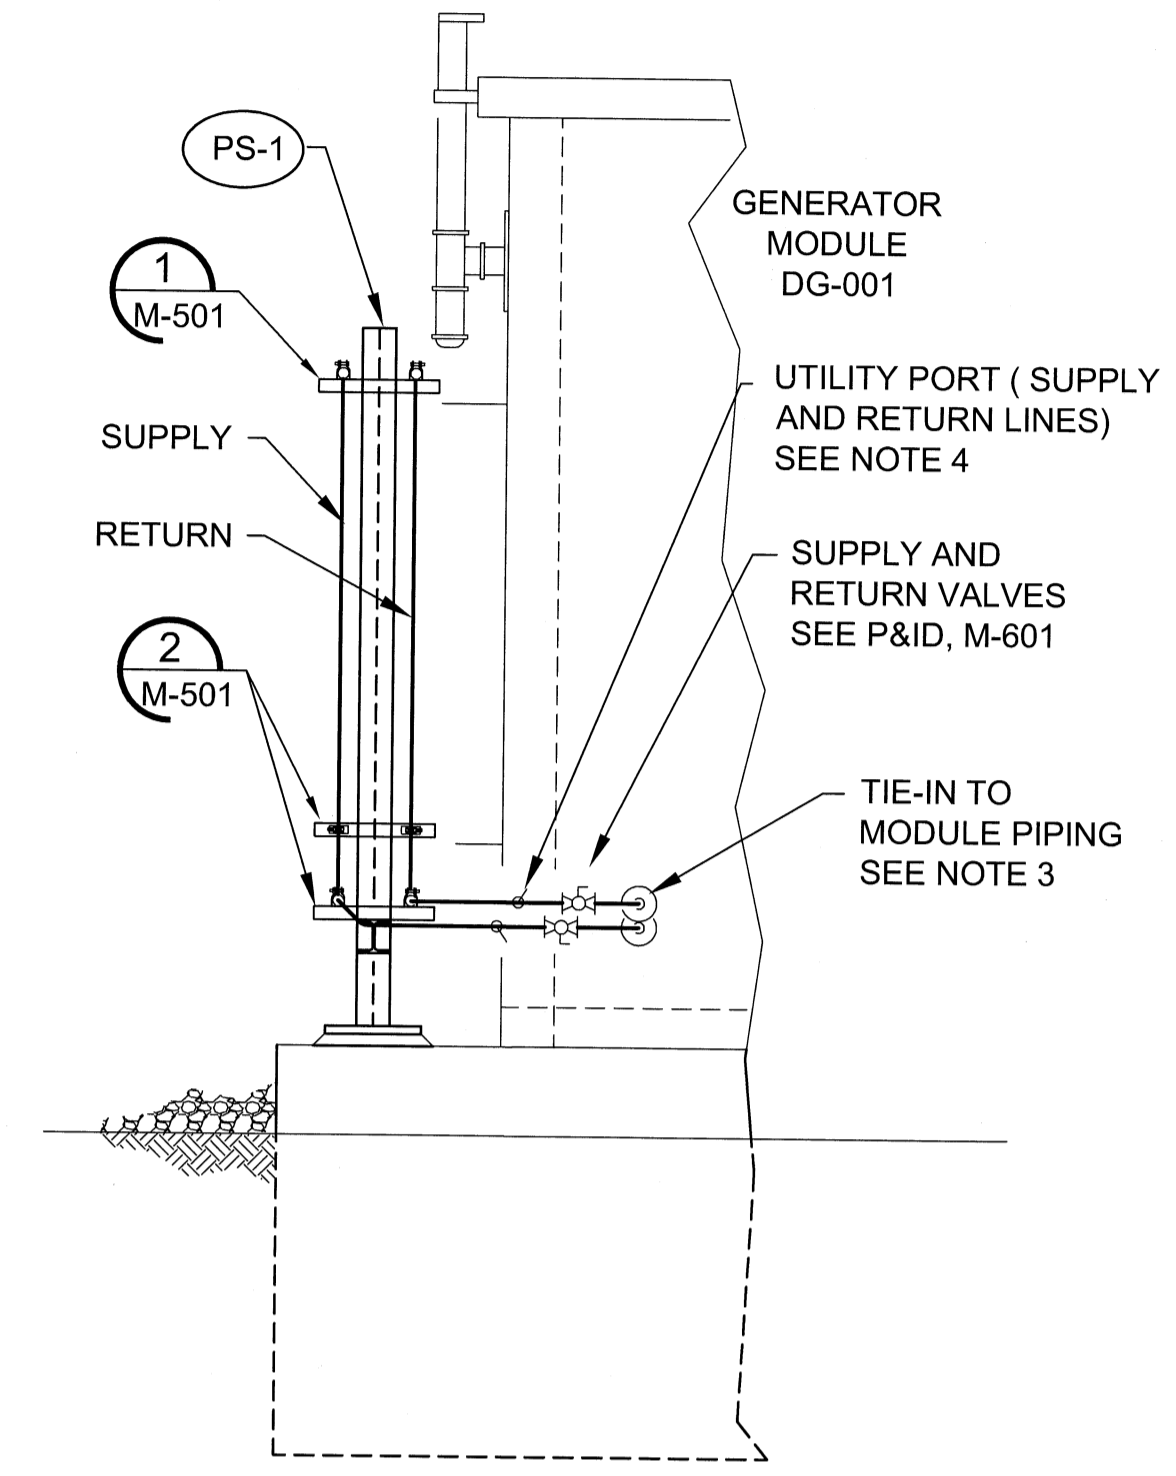


B ELEVATION
SCALE: 1/2"=1'-0"

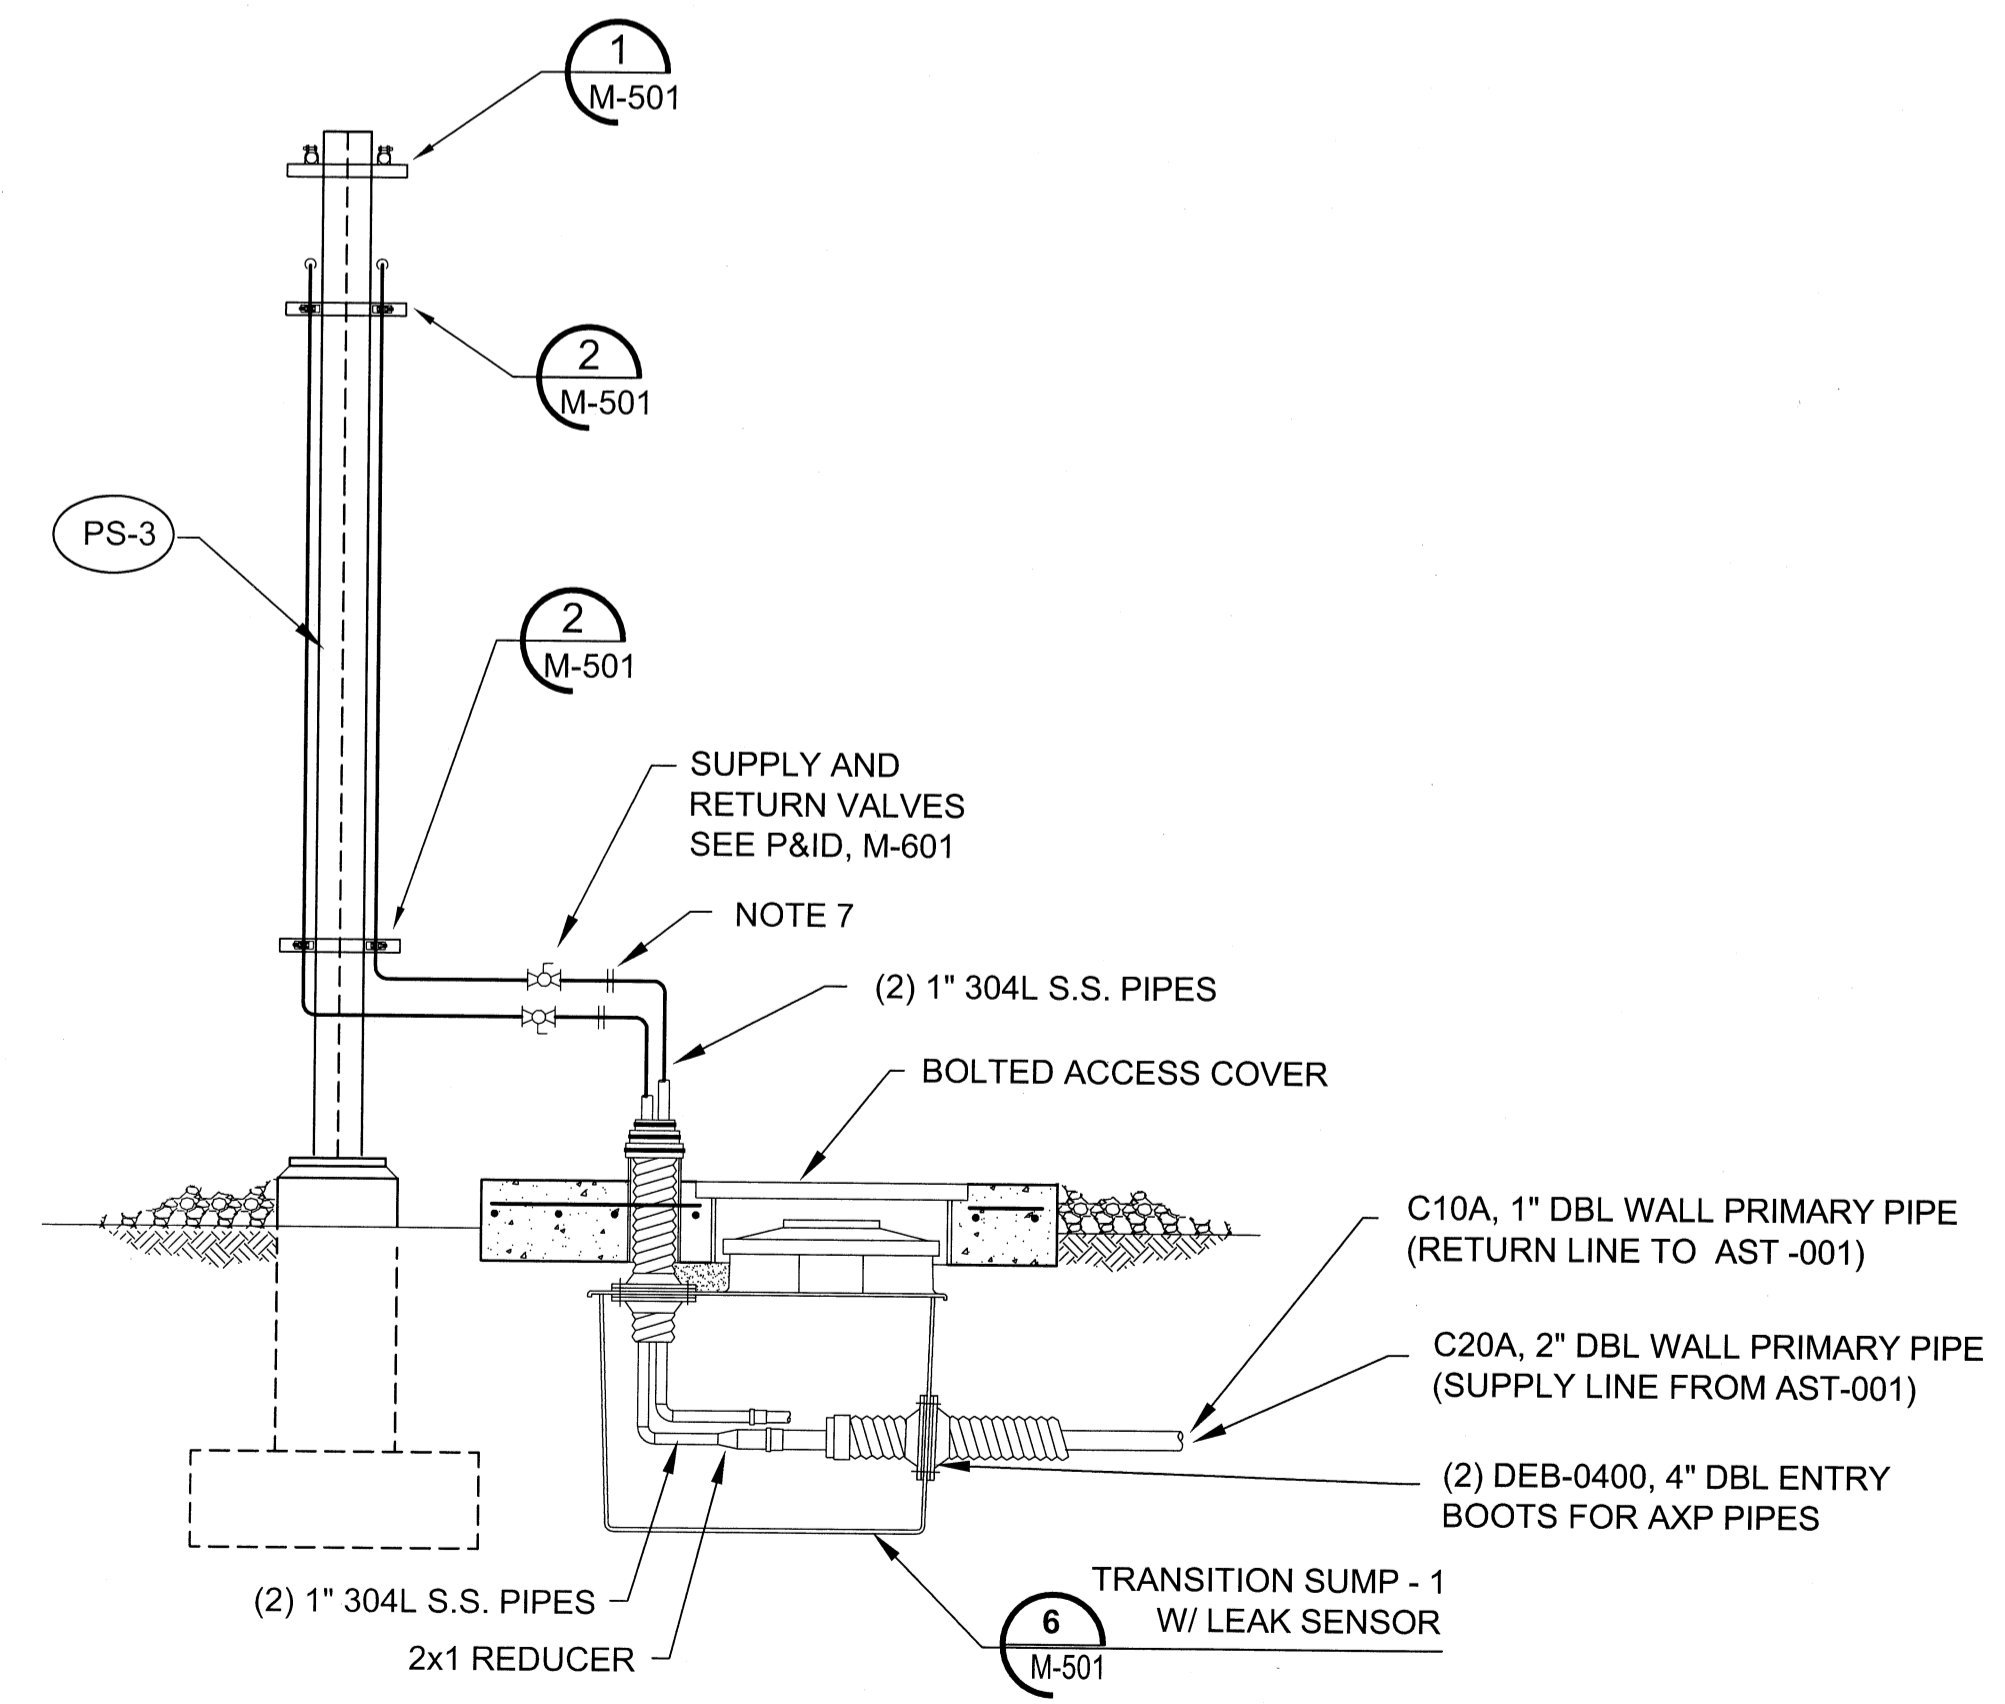

C ELEVATION
SCALE: 1/2"=1'-0"

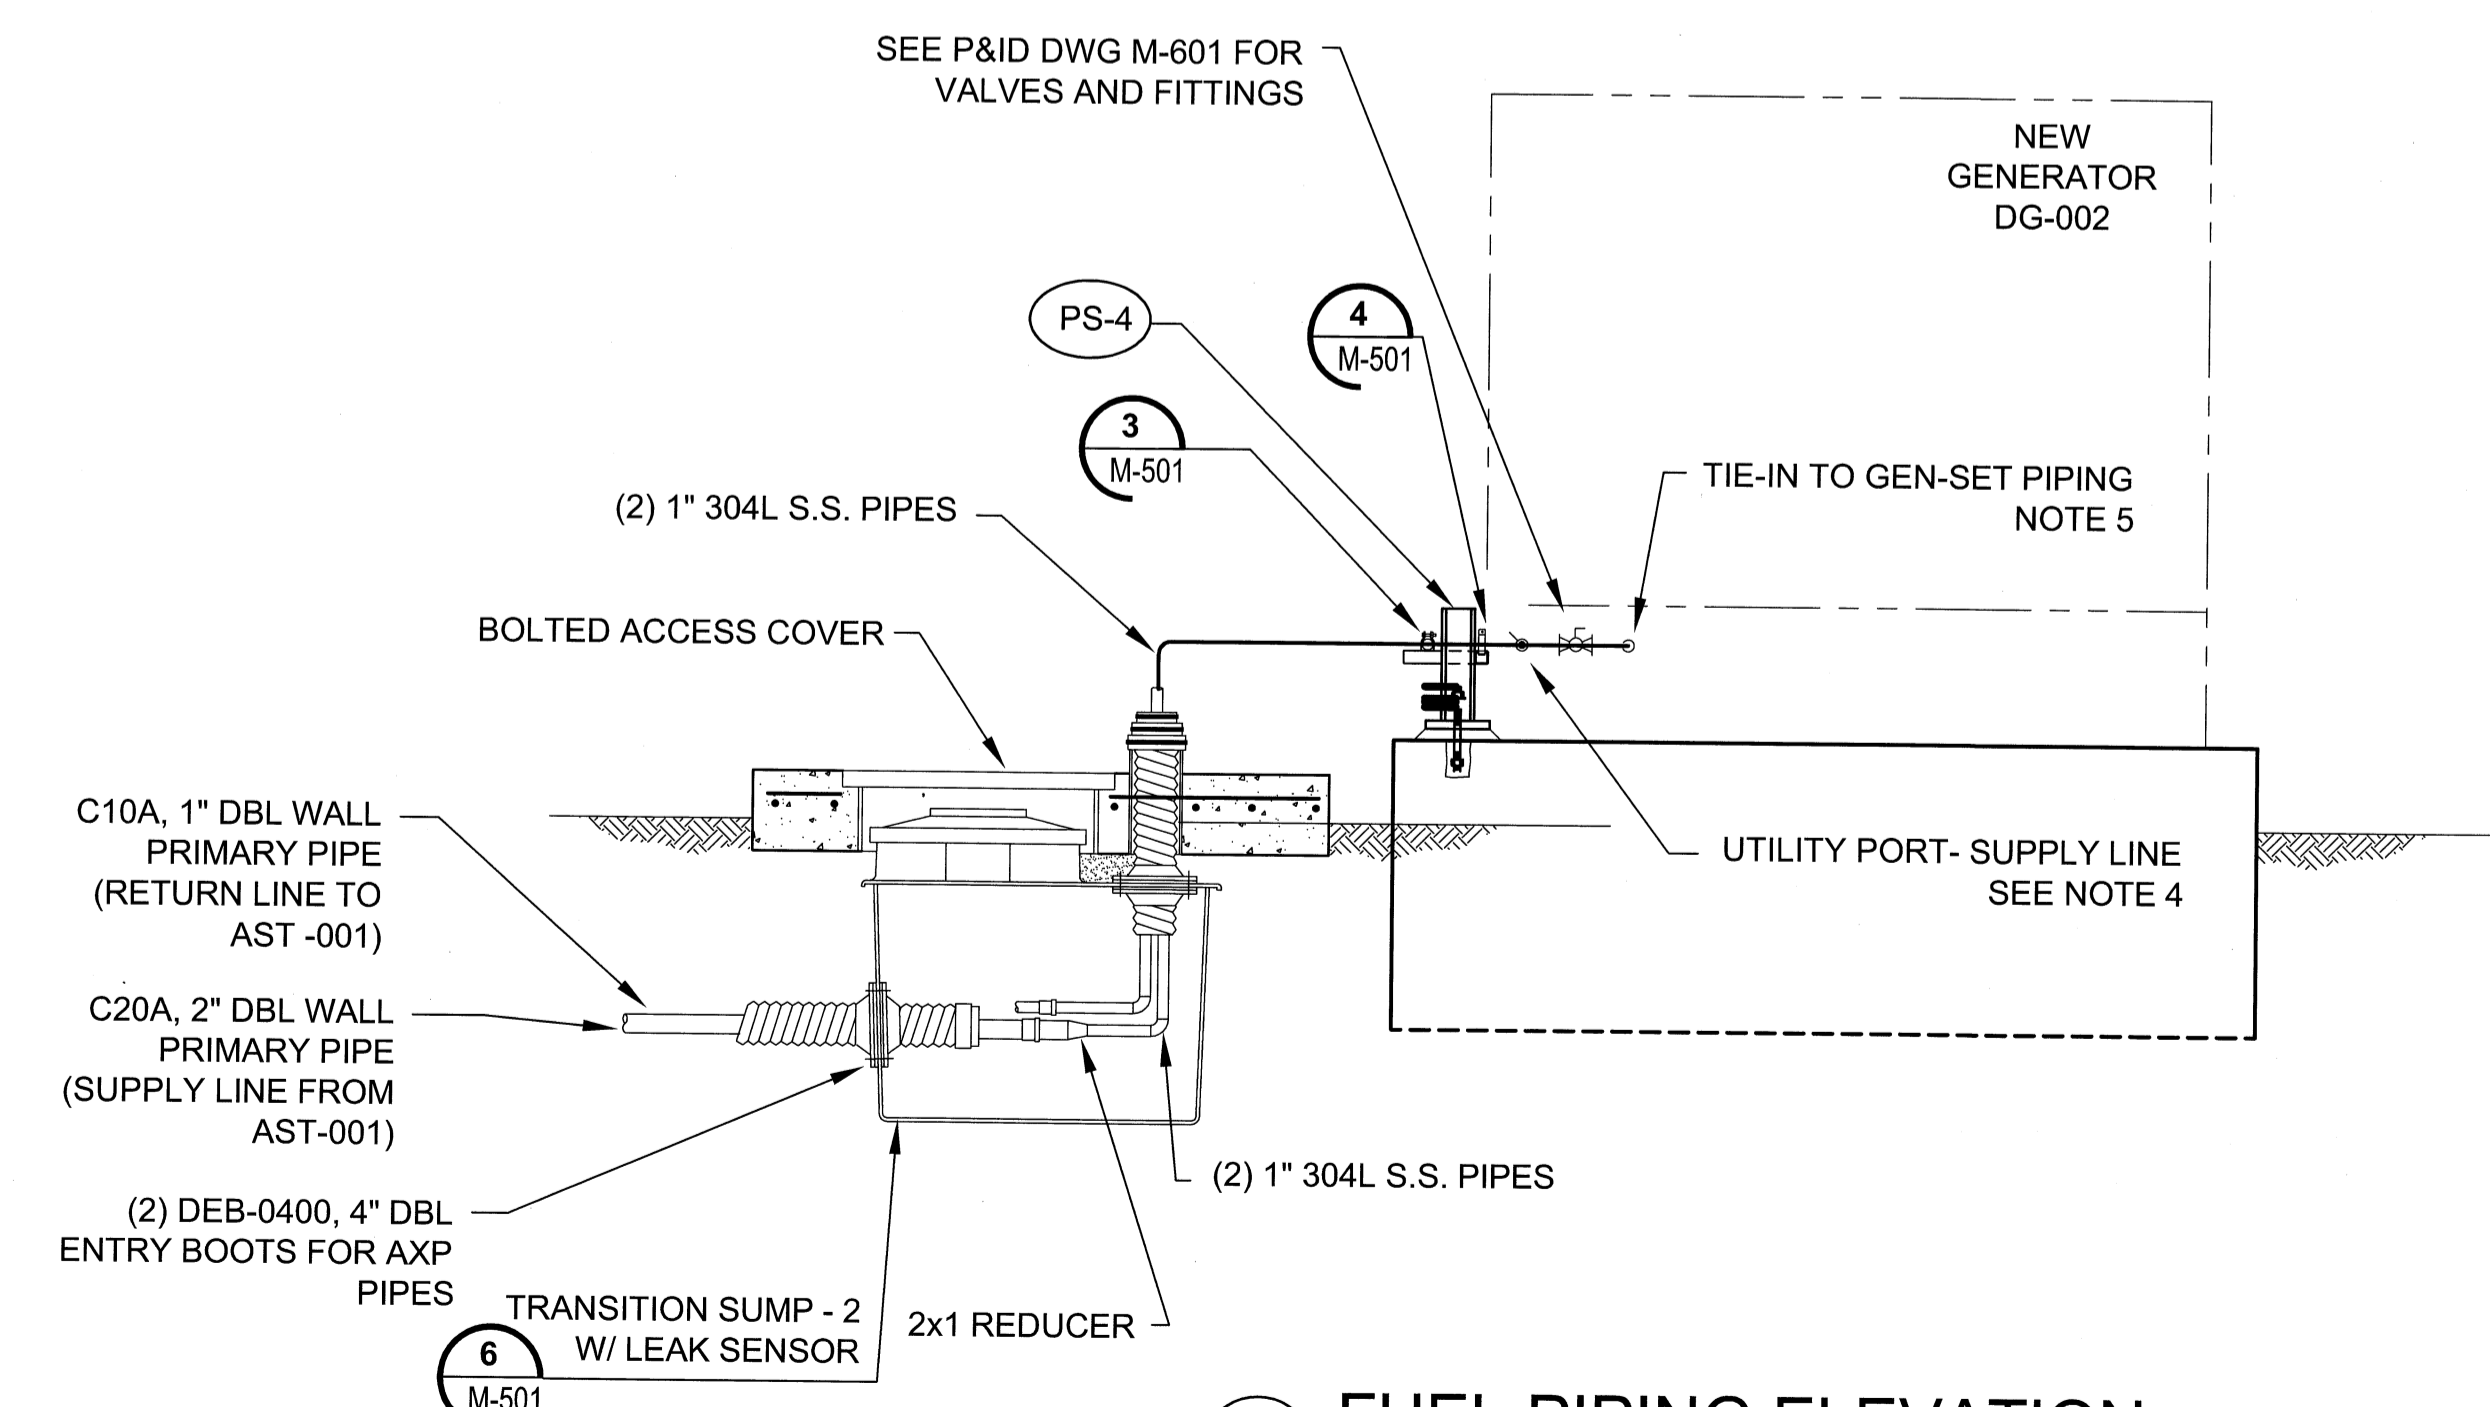


D FUEL PIPING ELEVATION
M-101 SCALE: 1/2"=1'-0"

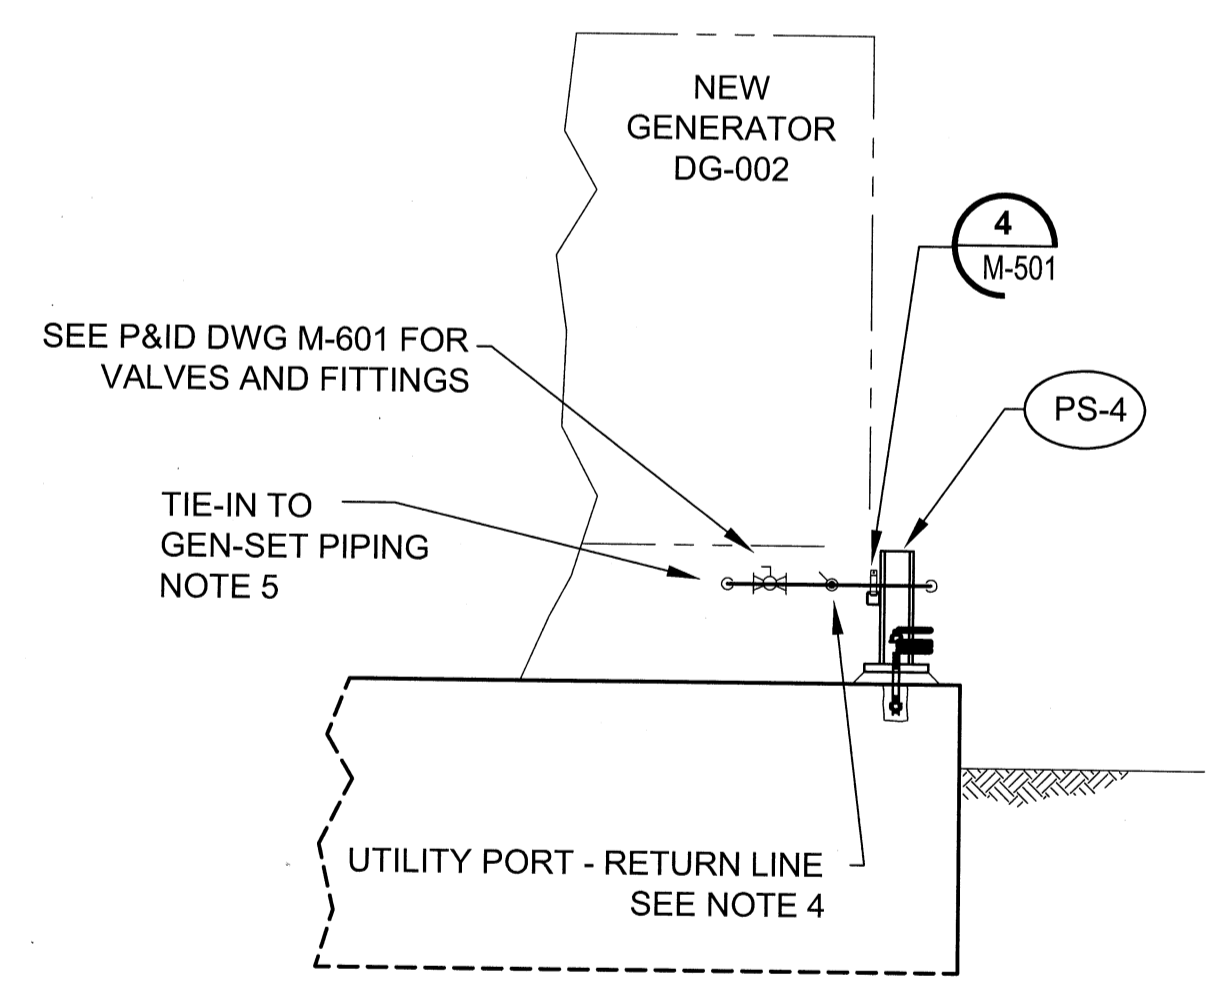

E FUEL PIPING ELEVATION
M-101 SCALE: 1/2"=1'-0"

NOTES:

- SEE NOTES DRAWING M-101.
- MAKE STAINLESS STEEL FLANGE TO FLANGE CONNECTIONS. INSTALL SOCKET WELD STAINLESS STEEL FLANGES ON PIPING SYSTEM SIDE. (TANK FUEL LINES COME EQUIPPED WITH STAINLESS STEEL FLANGES.)
- MAKE STAINLESS STEEL FLANGE TO FLANGE CONNECTIONS. INSTALL THREADED STAINLESS STEEL FLANGES ON THE MODULE GEN-SET FUEL LINE STUB-OUTS. IF NECESSARY TO ALLOW FOR PROPER CLEARANCES, INSTALL A COUPLING AND PIPE NIPPLE TO ONE OF THE STUB-OUTS TO STAGGER FLANGES. INSTALL SOCKET WELD STAINLESS STEEL FLANGES ON PIPING SYSTEM SIDE.
- UTILITY PORT SHALL CONSIST OF A SOCKET WELD TEE, POE/TOE PIPE NIPPLE, THREADED BALL VALVE (LOCKABLE) AND PLUG. ALL 1" 304L STAINLESS STEEL. UTILITY PORT TO BE USED AS A UTILITY CONNECTION FOR TESTING, PRIMING, DRAINING, AND VENTING. THE HIGH POINT PORTS SHALL BE INSTALLED IN THE VERTICAL POSITION, AND THE LOW POINT PORTS SHALL BE INSTALLED IN THE HORIZONTAL POSITION.
- MAKE FLANGE TO FLANGE CONNECTIONS. INSTALL THREADED CARBON STEEL FLANGES ON THE SITE GEN-SET FUEL LINE STUB-OUTS. IF NECESSARY TO ALLOW FOR PROPER CLEARANCES, INSTALL A COUPLING AND PIPE NIPPLE TO ONE OF THE STUB-OUTS TO STAGGER FLANGES. INSTALL SOCKET WELD STAINLESS STEEL FLANGES ON PIPING SYSTEM SIDE. USE FLANGE INSULATING GASKET KITS.
- LOCATE THESE CHECK VALVES IN SUPPLY AND RETURN LINES AND AS NEAR AS POSSIBLE TO THE TEE. CHECK VALVES TO BE OPW 175B WITH INTERNAL PRESSURE RELIEF, OR APPROVED EQUAL. CONTRACTOR SHALL VERIFY PROPER DIRECTION OF CHECK VALVES PRIOR TO INSTALLATION.
- FURNISH AND INSTALL SOCKET WELD STAINLESS STEEL FLANGES TO PROVIDE ACCESS FOR VALVE REMOVAL. ALSO SHOWN ON DRAWING M-601.

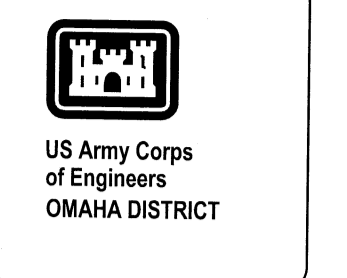

Project Manager	OC
DC Reviewer	Structural
MECHANICAL	Plumbing
Electrical	Electrical
Civil	Civil

Mark	D	11/7/12	Approved
Description	ISSUED FOR CONSTRUCTION	Date	


Designed by	DBH
Checked by	DBH
Drawn by	RAM
Reviewed by	CHB
Date	2012

KBR
Engineering Services by
KBR Engineering Co., LLC


43 SOUTH WIND STREET SUITE 200
MOBILE, AL 36602
PHONE: (251) 450-7800
FAX: (251) 450-7898

FEMA EMERGENCY RADIO NETWORK
ON WIGAN PORTLAND, MAINE

FUEL PIPING SYSTEM ELEVATIONS

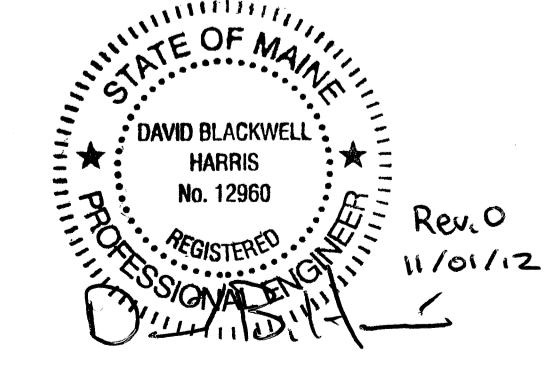

Drawing Number:
M-201

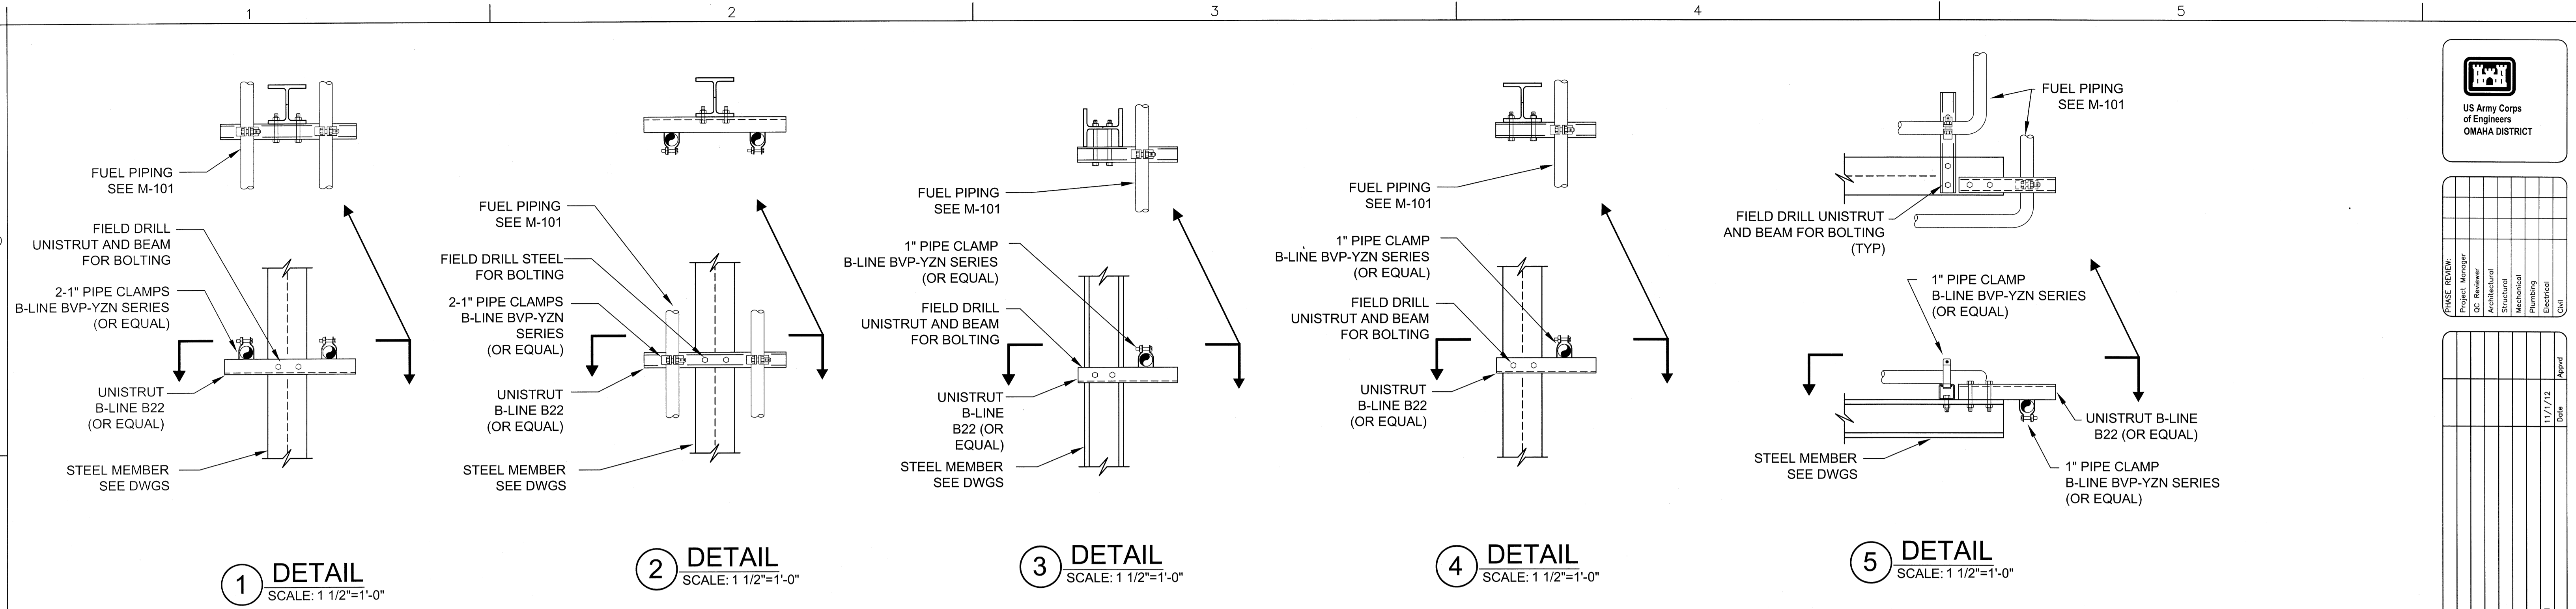


1 DETAIL
SCALE: 1 1/2"=1'-0"

2 DETAIL
SCALE: 1 1/2"=1'-0"


3 DETAIL
SCALE: 1 1/2"=1'-0"

4 DETAIL
SCALE: 1 1/2"=1'-0"


5 DETAIL
SCALE: 1 1/2"=1'-0"

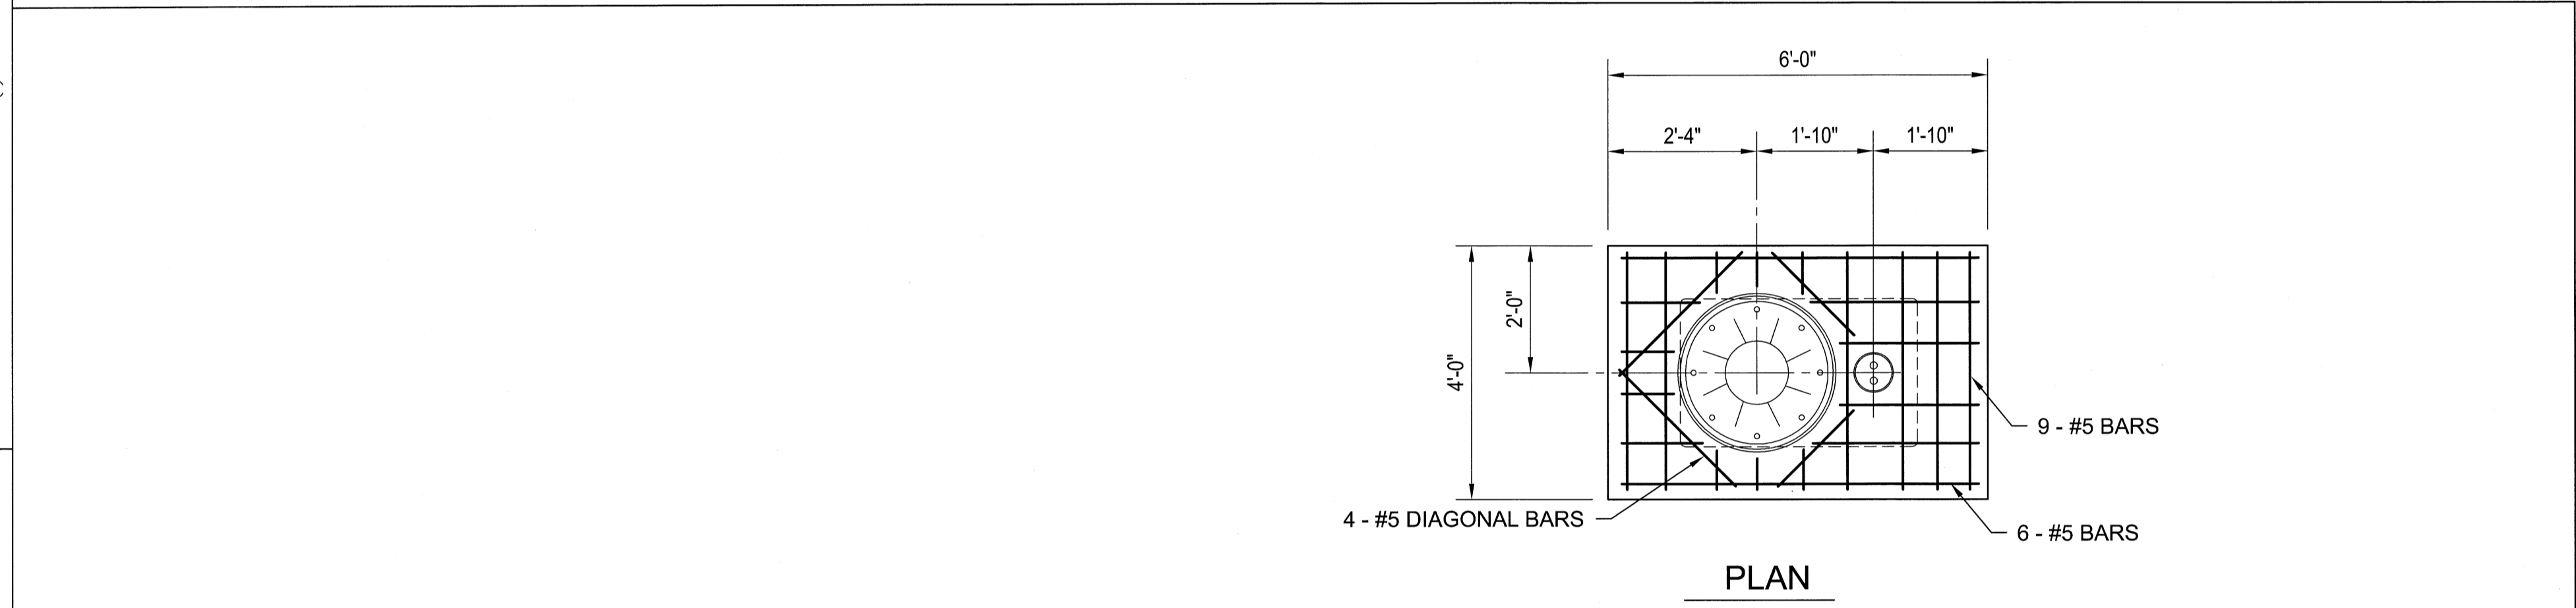

PLAN

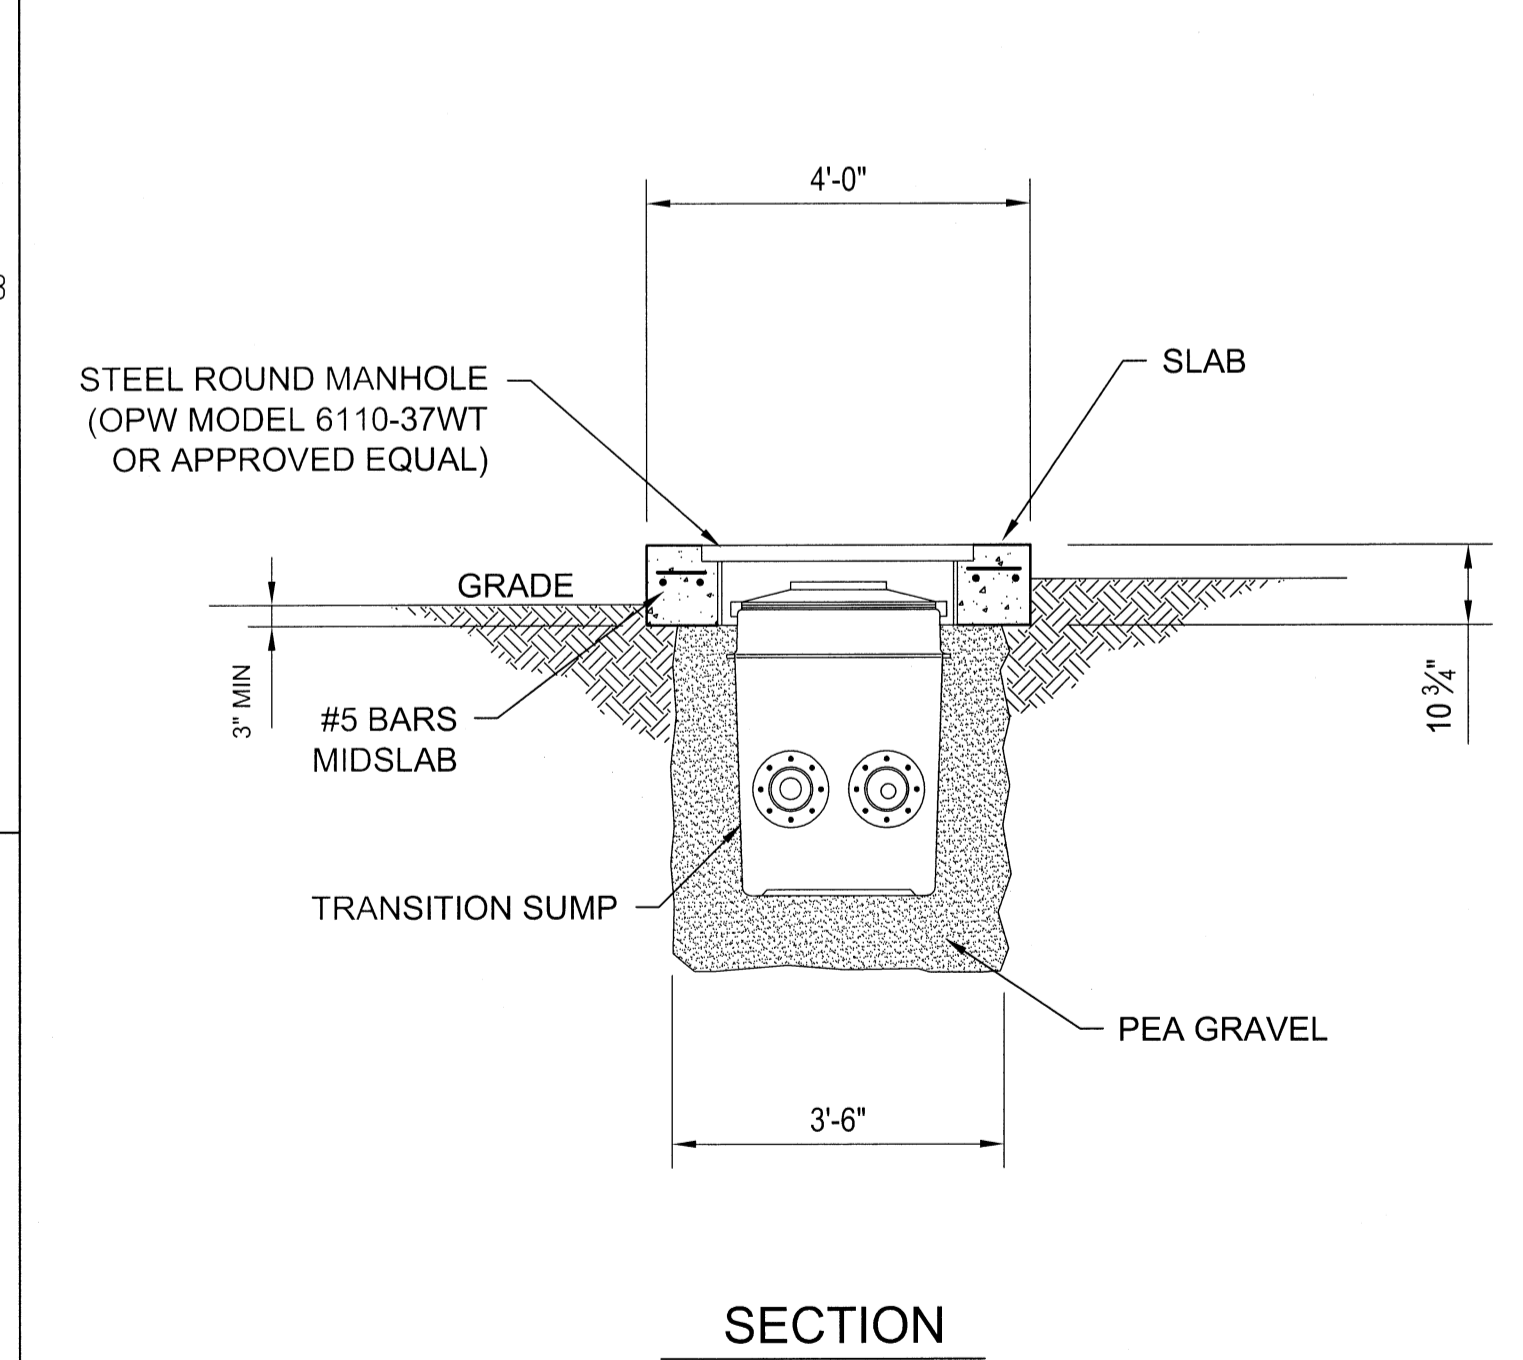


SECTION

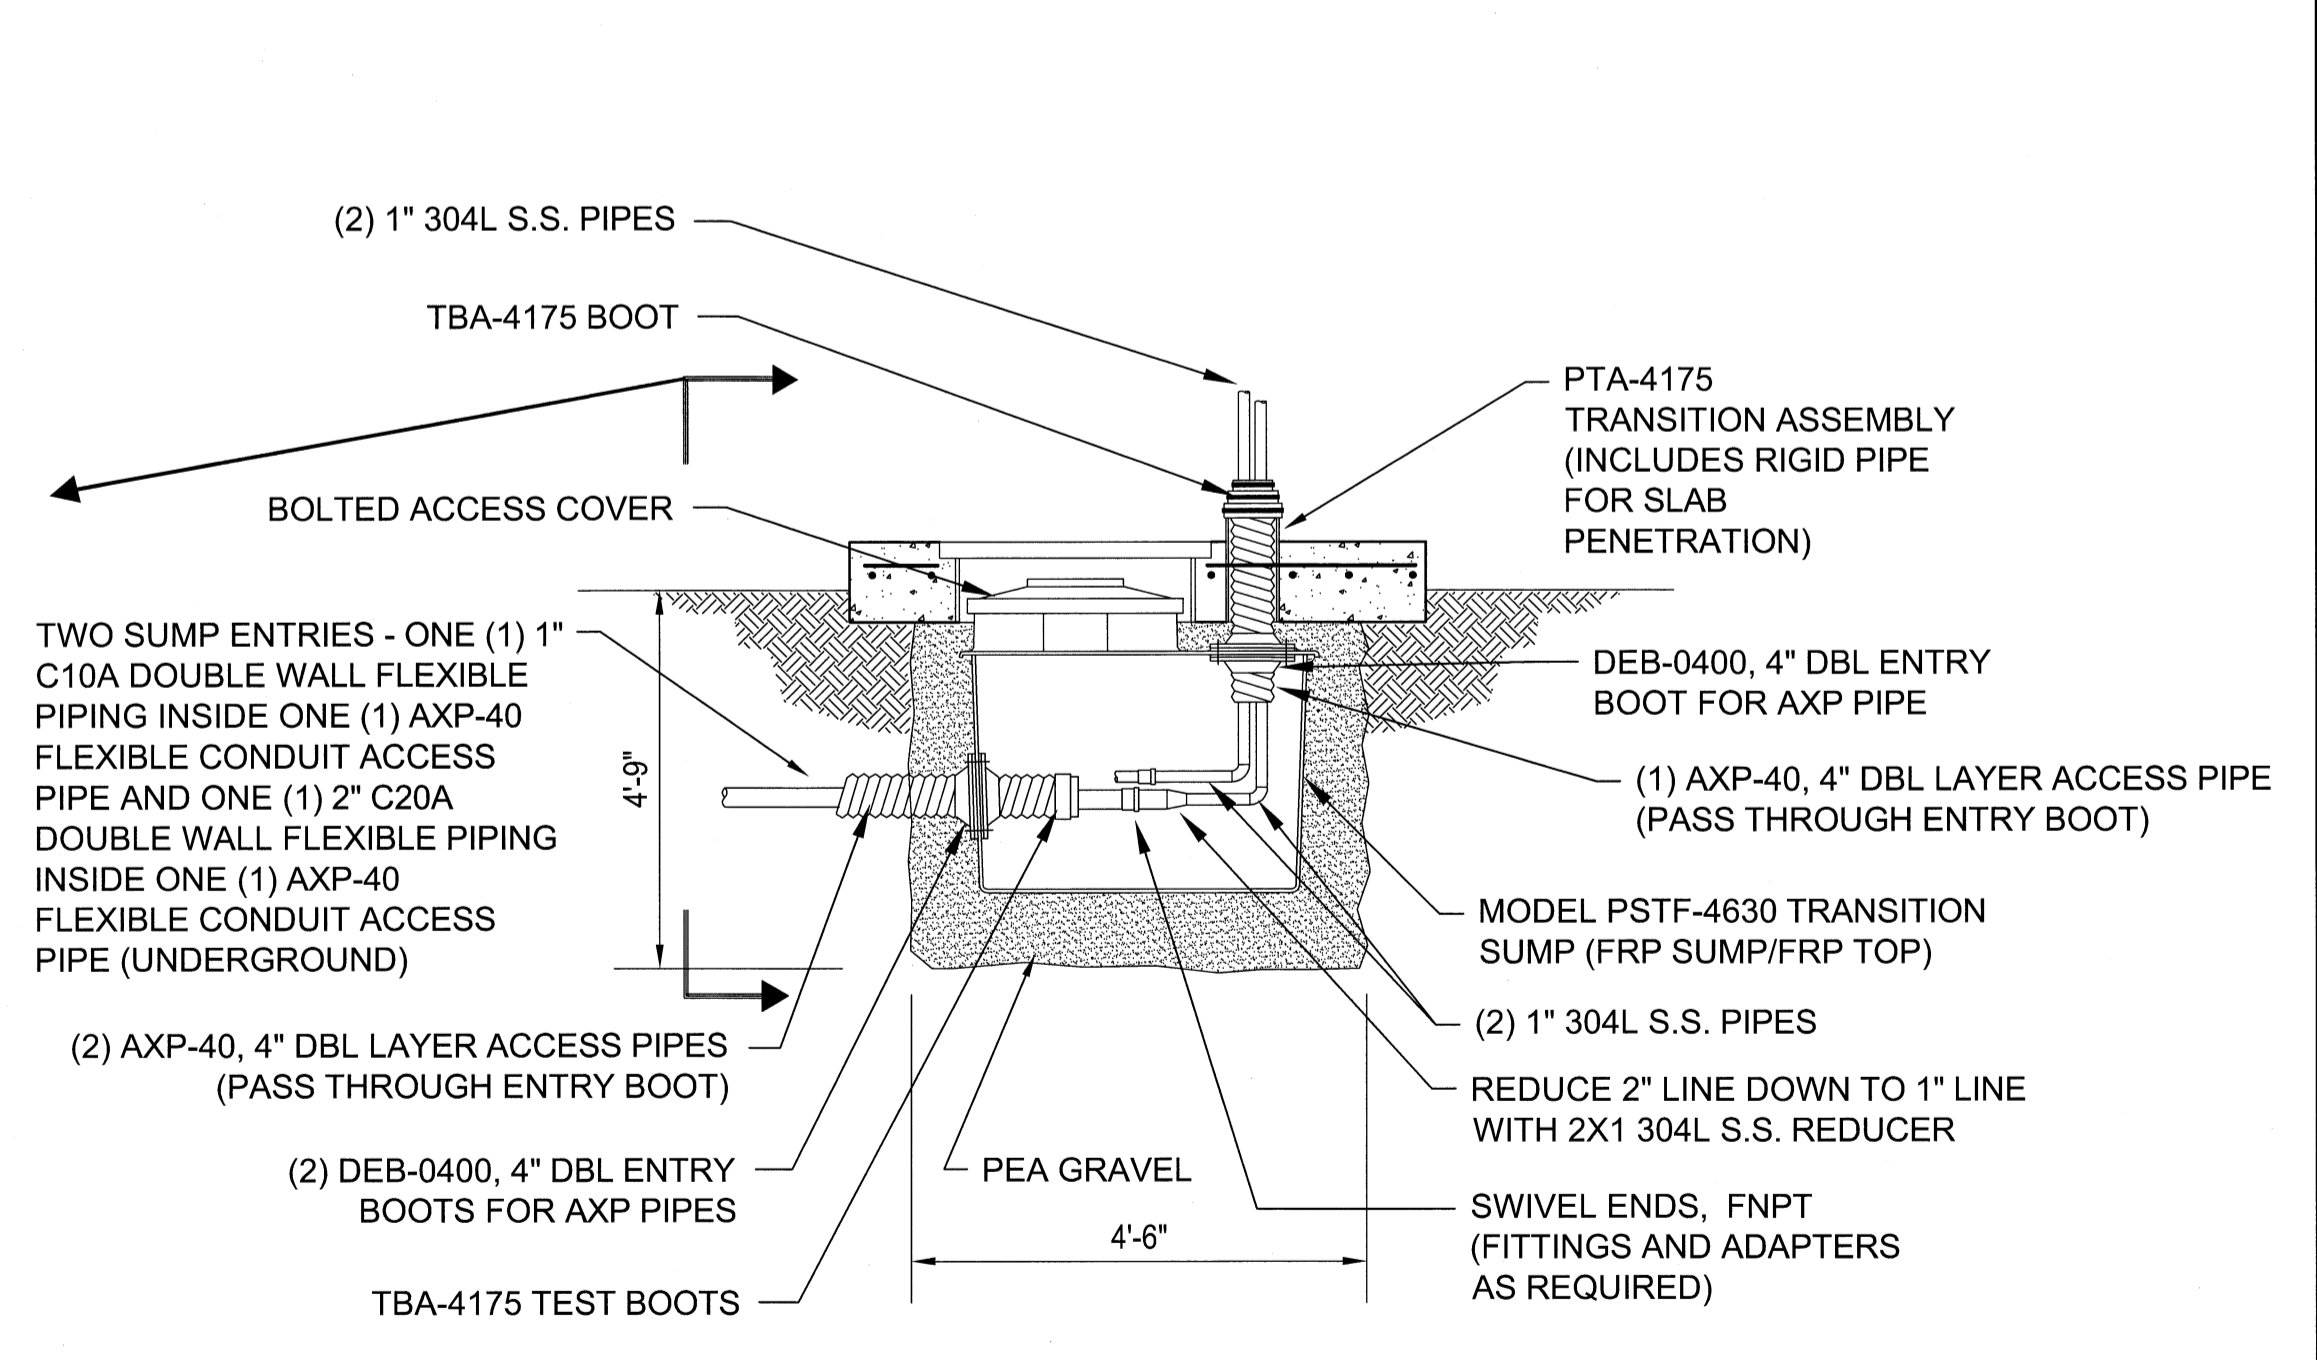

6 DETAIL
SCALE: 1/2"=1'-0"


TYPICAL TRANSITION SUMP INSTALLATION
PIPING MAY VARY FROM SITE TO SITE;
SEE DRAWINGS FOR ACTUAL PIPING

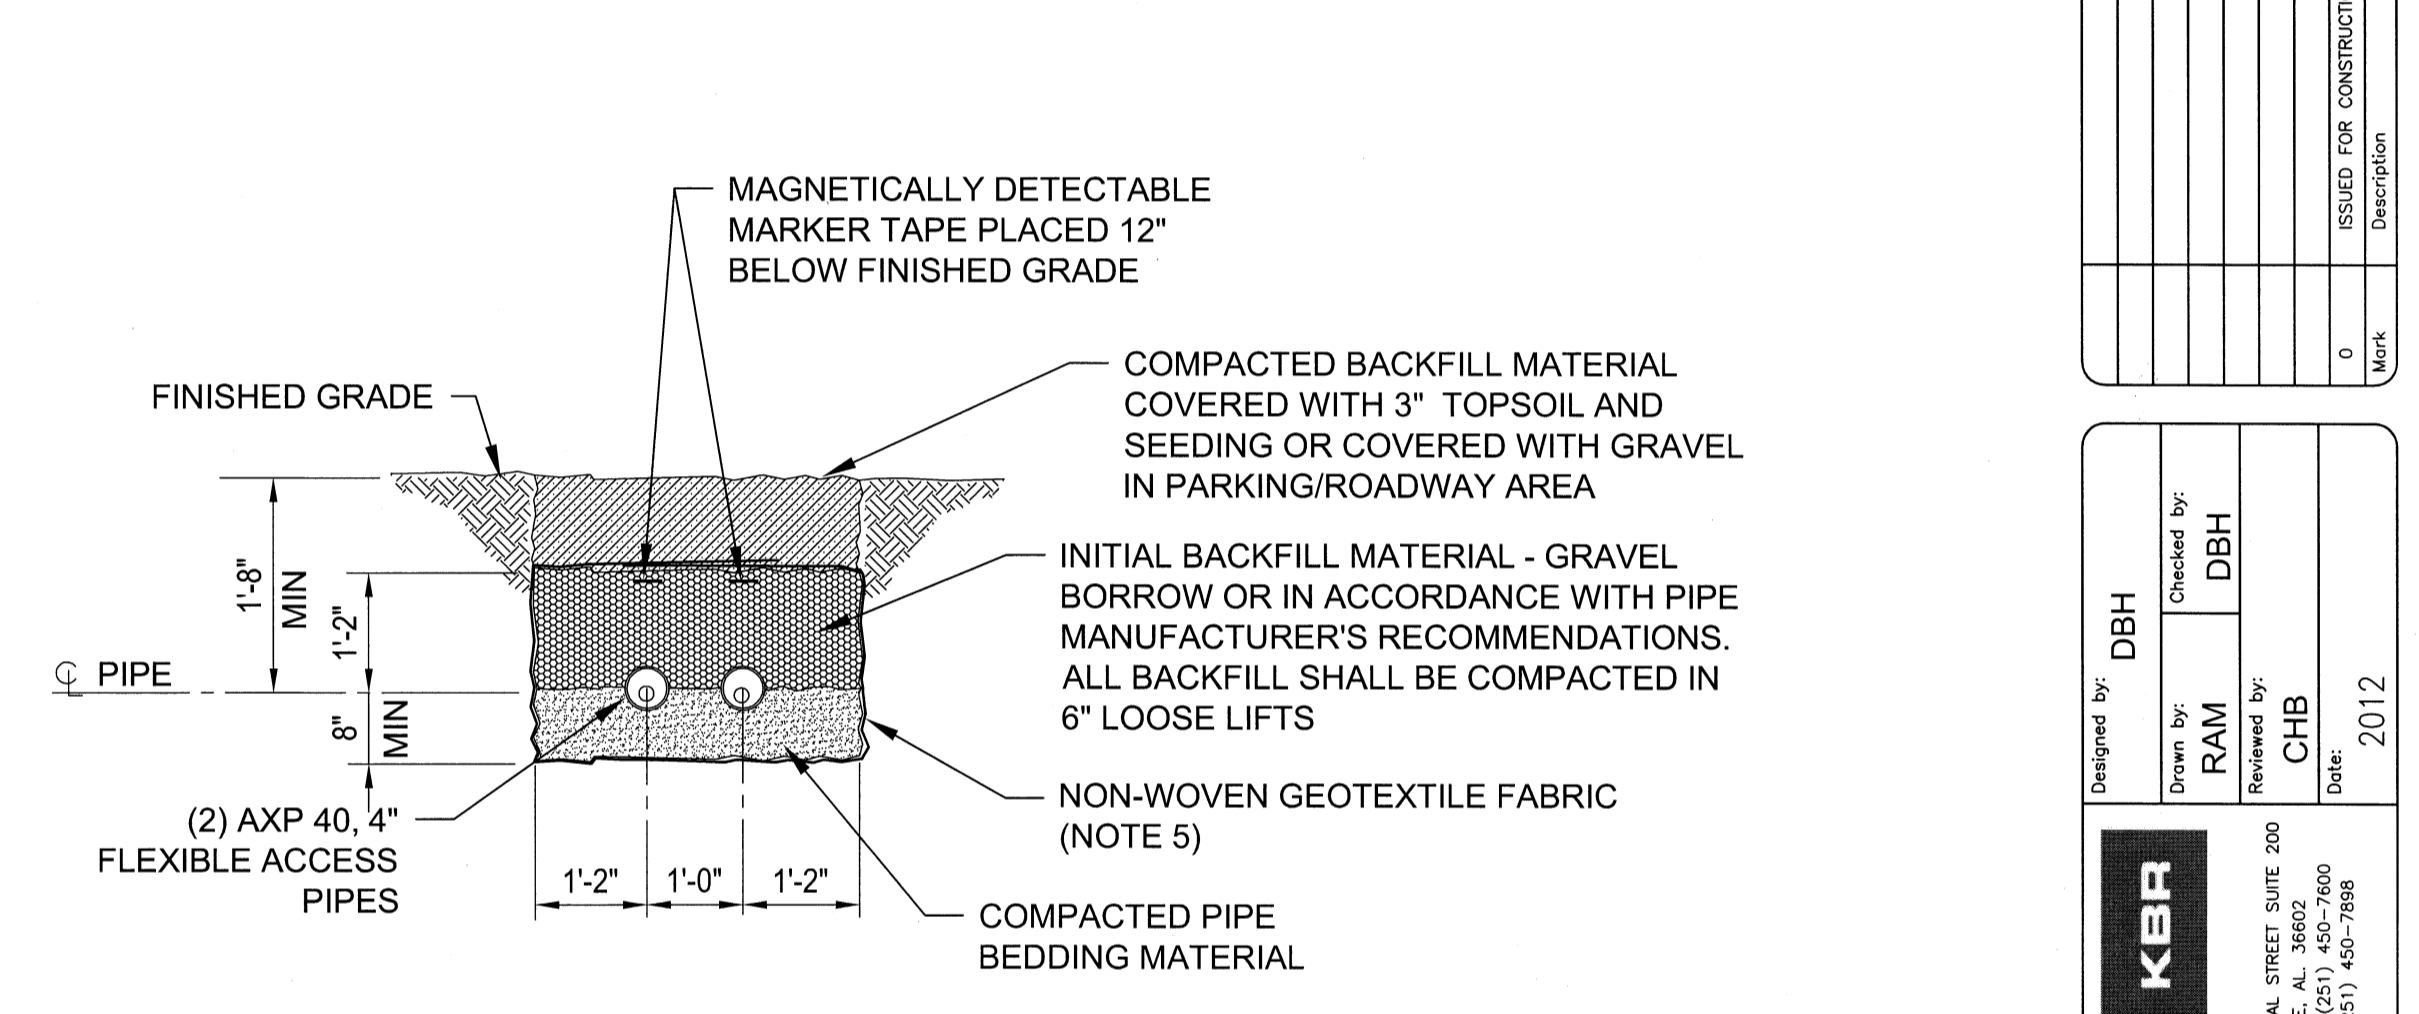

A TYP FUEL PIPING BEDDING
SCALE: 1/2"=1'-0"

BEDDING NOTES:

1. ALL BEDDING AND BACKFILL MATERIALS SHALL BE IN ACCORDANCE WITH PIPE MANUFACTURER'S SPECIFICATIONS AND INSTRUCTIONS.
2. COMPACTION SHALL BE IN ACCORDANCE WITH PROJECT SPECIFICATIONS.
3. MAINTAIN 12" MINIMUM SEPARATION FROM UNDERGROUND POWER AND COMMUNICATION LINES OR AS REQUIRED BY NATIONAL ELECTRIC SAFETY CODE AND LOCAL CODES.
4. CONTRACTOR SHALL SOD OR SEED ALL DISTURBED AREAS OR INSTALL GRAVEL AS DIRECTED ON DRAWING C-102.
5. DUE TO FROST SUSCEPTIBLE SOILS, GRANULAR BEDDING MATERIALS MUST BE SEPARATED FROM SURROUNDING SOILS BY A NON-WOVEN GEOTEXTILE FABRIC.

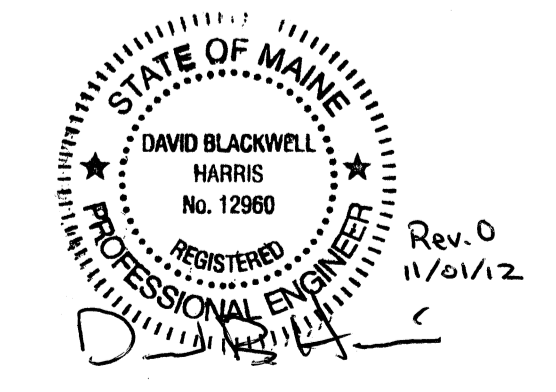

US Army Corps of Engineers
OMAHA DISTRICT

Project Manager	
QC Reviewer	
Structural	
Mechanical	
Plumbing	
Electrical	
Civil	

0	ISSUED FOR CONSTRUCTION	11/17/12	Rev.
	Description	Date	Revised

Designed by: DBH
Checked by: DBH
Drawn by: RAM
Reviewed by: CHB
Date: 2012

63 SOUTH BAYVIEW STREET SUITE 200
WAGANVILLE, AL 36822
PHONE: (251) 450-7600
FAX: (251) 450-7898


FEMA
KBR
Engineering Services by
KBR Engineering Co., LLC

FEMA EMERGENCY RADIO NETWORK
ON WGAN PORTLAND, MAINE

MECHANICAL
FUEL PIPING DETAILS

Drawing Number:
M-501

LEGEND

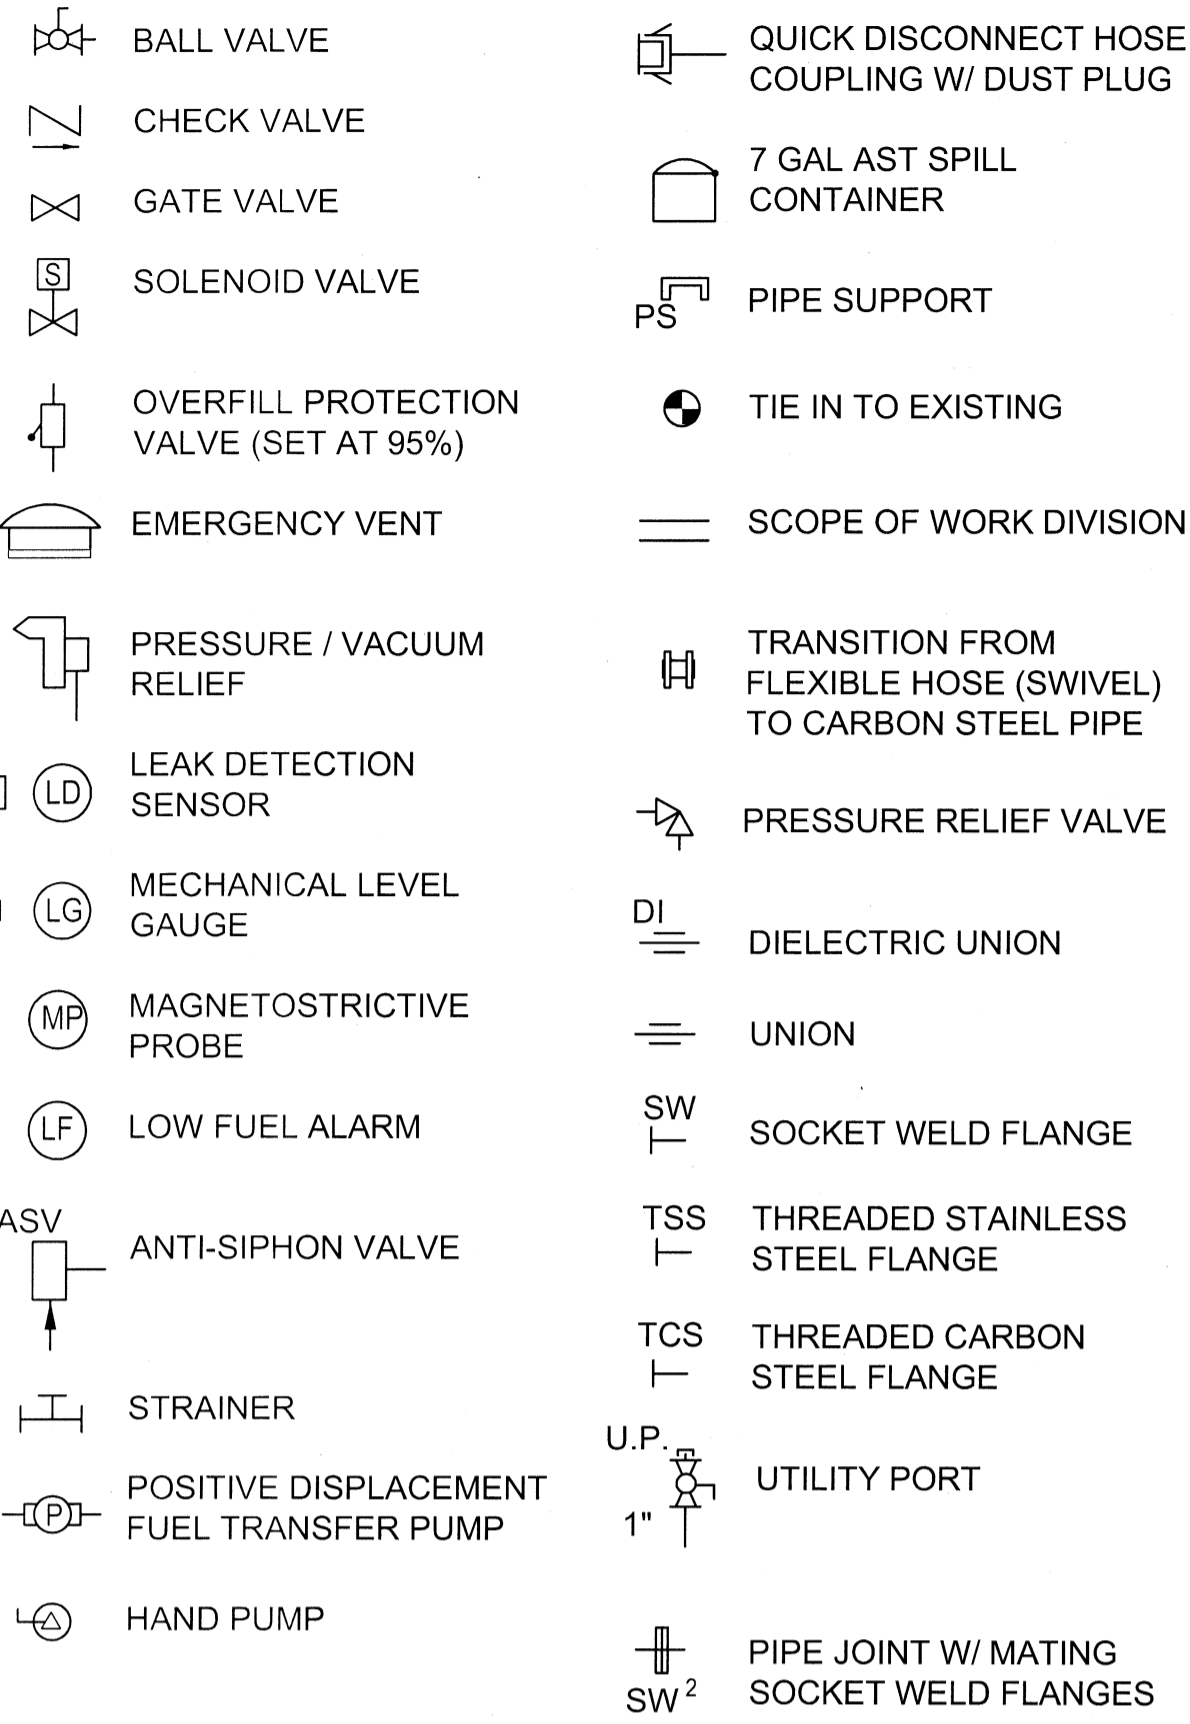

CONTRACTOR SCOPE OF WORK NOTES

- A. FURNISHED UNDER FUEL STORAGE SYSTEM PACKAGE BY OWNER. RECEIVED AND INSTALLED BY SITE CONTRACTOR.
- B. FURNISHED AND INSTALLED BY SITE CONTRACTOR.
- C. FURNISHED AND INSTALLED UNDER HEMP SHIELDED MODULE PACKAGE BY OWNER.
- D. FURNISHED BY OWNER. RECEIVED AND INSTALLED BY SITE CONTRACTOR.


FUEL MONITORING SYSTEM SCHEDULE

INPUT	REMOTE MONITOR REPORTING
LD-1	LEAK DETECTION GENERATOR MODULE FLOOR
LD-2	LEAK DETECTION MODULE SUBBASE TANK
LD-3	LEAK DETECTION PRIMARY TANK
LD-4	LEAK DETECTION UG PIPING SUMP - 1
LD-5	LEAK DETECTION SUB-BASE TANK - SITE GENSET
LD-6	LEAK DETECTION UG PIPING SUMP - 2
LF-1	LOW FUEL ALARM SUBBASE TANK - MODULE GEN-SET
LF-2	LOW FUEL ALARM SUB-BASE TANK - SITE GENSET
LAH-1	LEVEL ALARM HIGH - LOCAL
MP	TANK LOW-LOW FUEL LEVEL (50%)
	TANK LOW FUEL LEVEL (60% - ORDER FUEL)
	TANK HIGH FUEL LEVEL (90% - TANK FULL / STOP FILL)
	TANK HIGH-HIGH LEVEL (92.5% - ALARM MESSAGE SENT)
	TANK FUEL VOLUME
	TANK WATER VOLUME
CA-1	COMMON ALARM FUEL FILTRATION SYS. CABINET

AST NOZZLE SCHEDULE

NOZZLE TAG	SIZE (INCH)	DESCRIPTION
A	4"	SUPPLY TO FUEL PURIFIER WITH ANTI-SIPHON VALVE
B	4"	SERVICE POINT FOR MANUAL CLEANING AND FILTRATION WITH 7 GALLON SPILL CONTAINER WITH LOCKABLE HINGED COVER
C	2"	INTERSTITIAL LEAK DETECTION
D	4"	MECHANICAL LEVEL GAUGE
E	4"	ELECTRONIC LEVEL SENSOR
F	8"	PRIMARY - EMERGENCY RELIEF
G	8"	SECONDARY - EMERGENCY RELIEF (INTERSTITIAL)
H	4"	FUEL FILL / RETURN FROM FUEL PURIFIER DROP TUBE WITH ANTI-SYPHON BLEED HOLE AND OVERFILL PROTECTION VALVE
I	4"	PRIMARY - NORMAL VENT (PRESSURE / VACUUM RELIEF)
J	4"	SPARE WITH PIPE NIPPLE AND LOCKABLE INSPECTION CAP
K	4"	RETURN FROM DAY TANK
L	4"	SUPPLY TO DAY TANK
M	24"	MANWAY WITH COVER PLATE, BOLTS AND GASKET



- NOTES:
1. ALL NOZZLES SHALL BE FPT COUPLINGS EXCEPT FOR THE FLANGED MANWAY.

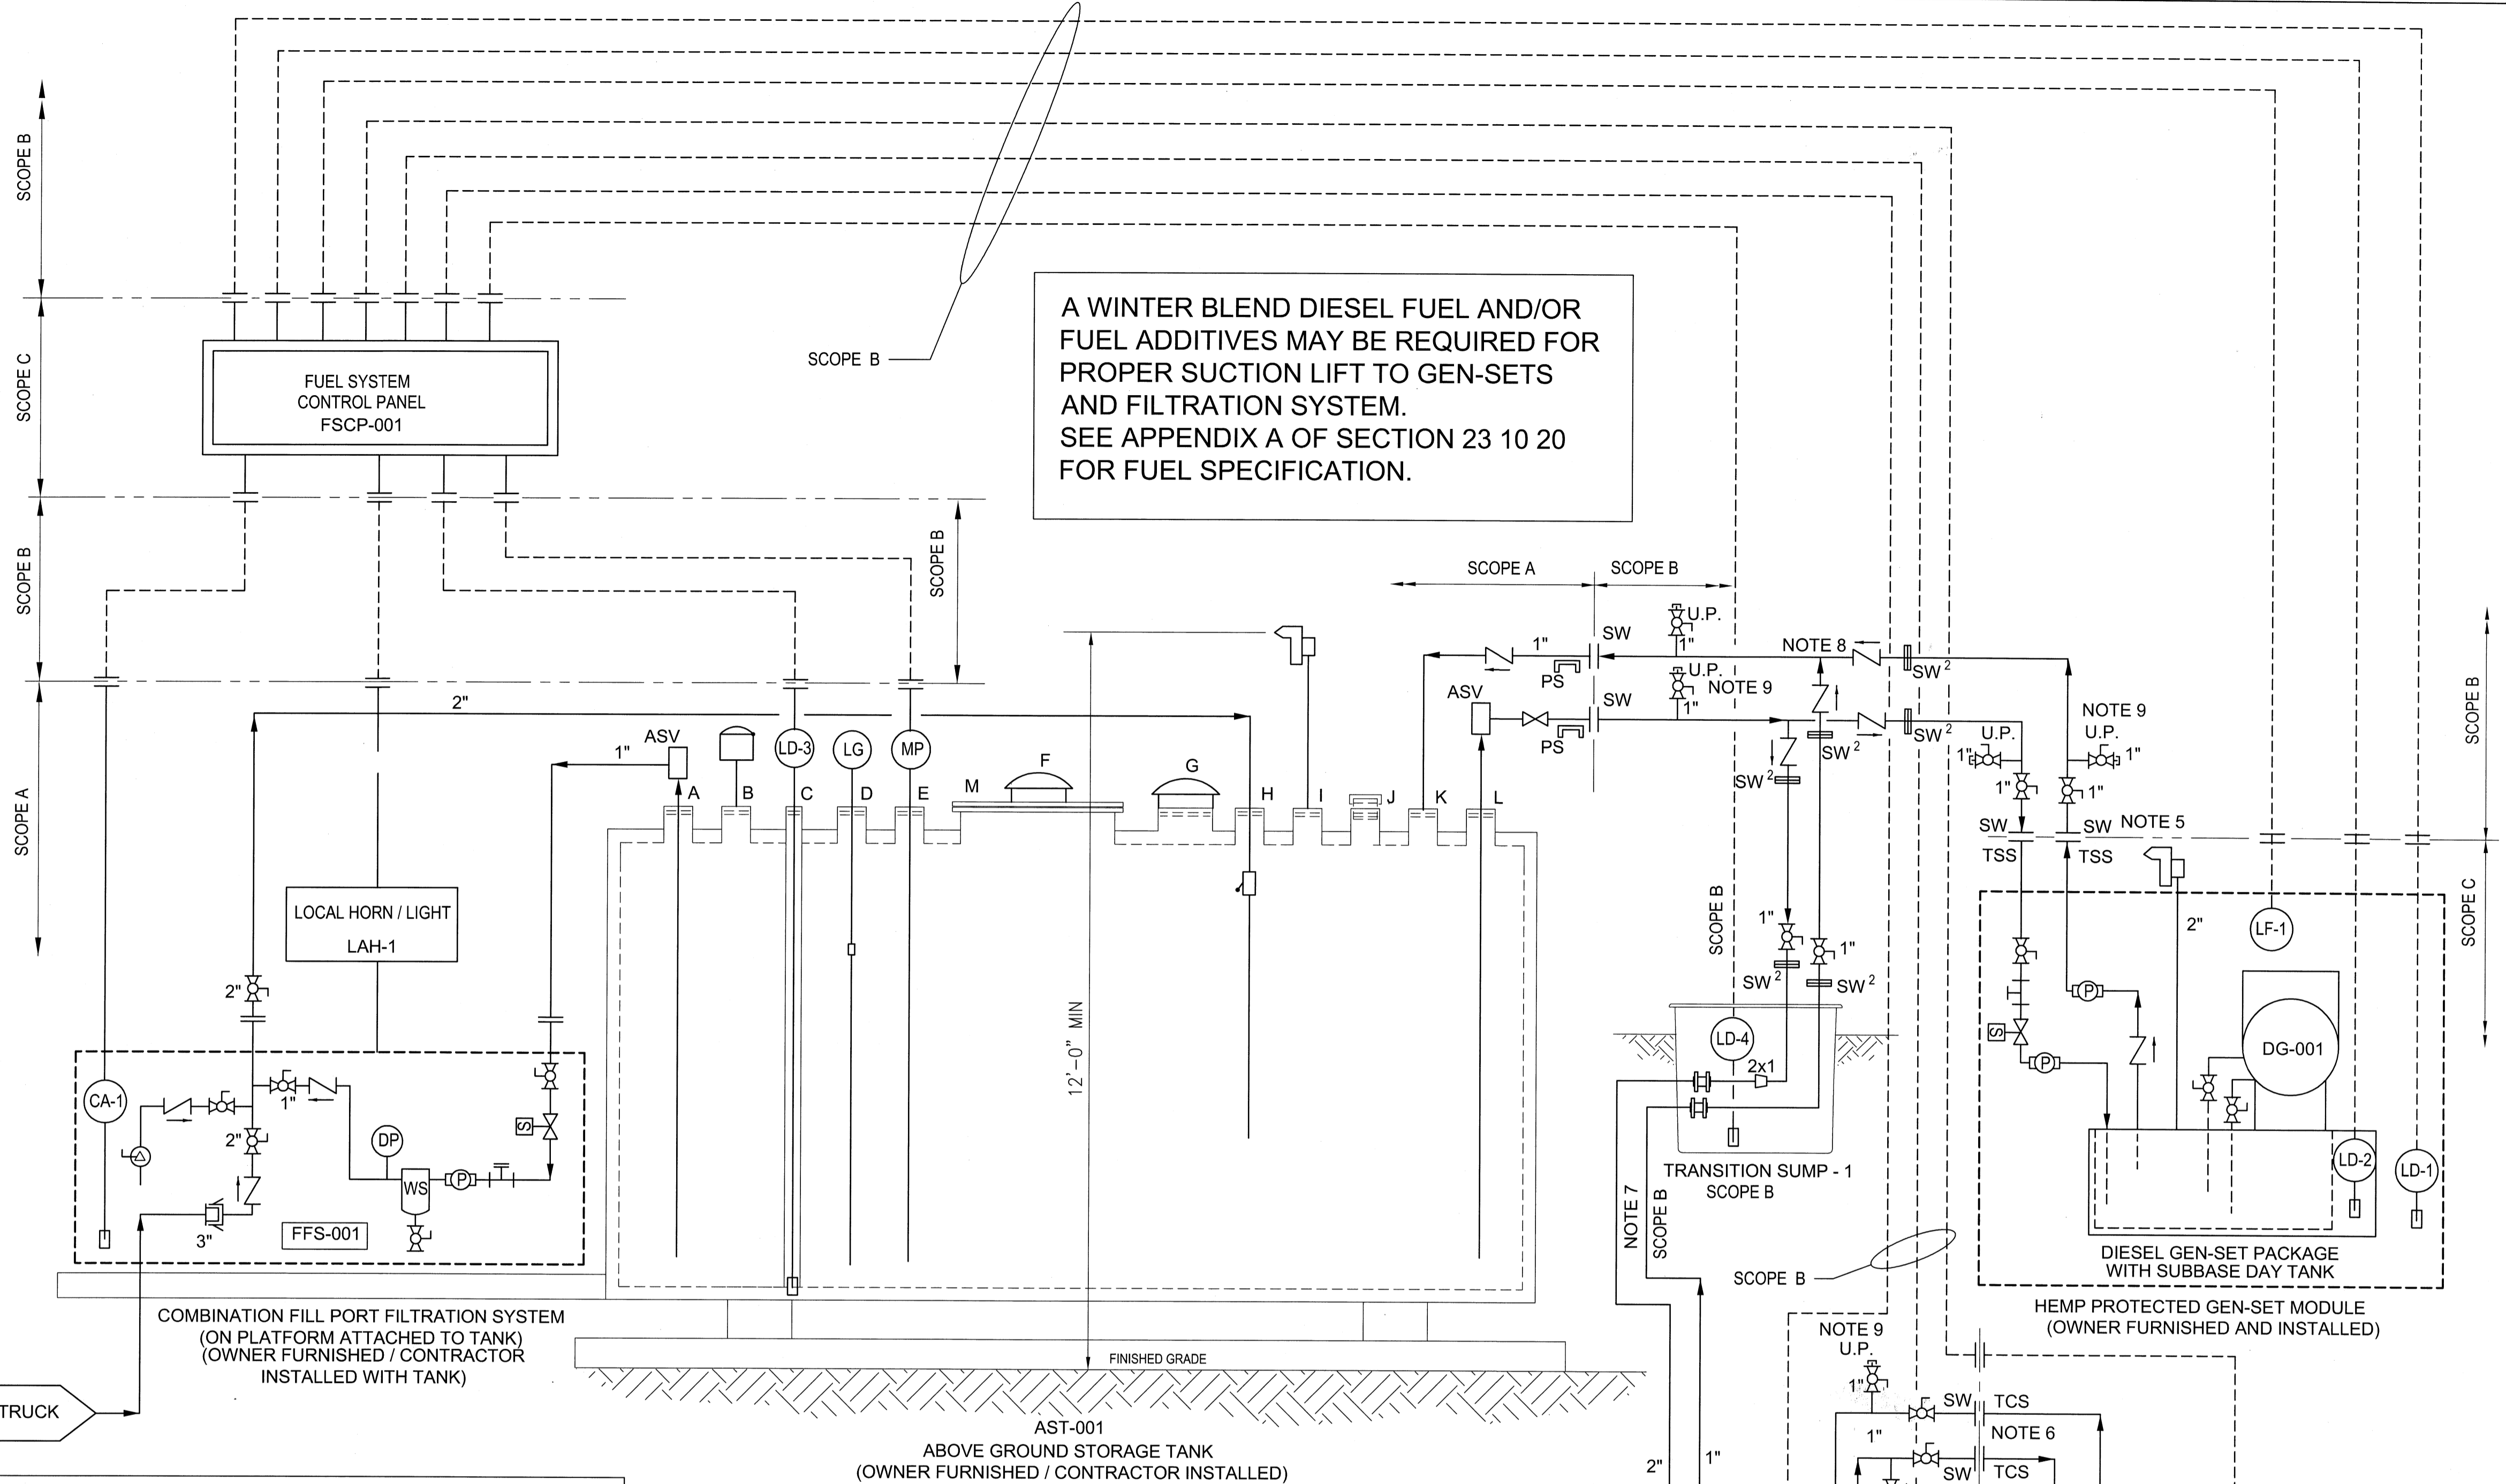

A WINTER BLEND DIESEL FUEL AND/OR FUEL ADDITIVES MAY BE REQUIRED FOR PROPER SUCTION LIFT TO GEN-SETS AND FILTRATION SYSTEM. SEE APPENDIX A OF SECTION 23 10 20 FOR FUEL SPECIFICATION.

NOTES:

- REFERENCE SUPPLIER SUBMITTAL DATA FOR INFORMATION REGARDING THE FUEL STORAGE SYSTEM, THE HEMP PROTECTED GEN-SET MODULE, AND THE SITE GEN-SET. THESE ITEMS WILL BE OWNER FURNISHED AS INDICATED.
- THE FUEL STORAGE SYSTEM SHALL BE FACTORY ASSEMBLED BY SUPPLIER AND THEN SHIPPED TO SITE. SITE INSTALLATION CONTRACTOR SHALL INSTALL THE SYSTEM AT THE SITE IN ACCORDANCE WITH SYSTEM SUPPLIER'S INSTRUCTIONS.
- PROVIDE INTERCONNECTING FUEL OIL PIPING AND SIGNAL CABLES AS INDICATED. (SEE ELECTRICAL DRAWINGS)
- SEE DRAWING M-101 AND SPECIFICATION SECTION 23 10 20, FOR FULL SCOPE OF WORK FOR THE FUEL OIL SYSTEM.
- CONNECT FUEL PIPING TO HEMP PROTECTED GEN-SET USING FLANGES. FURNISH AND INSTALL THREADED STAINLESS STEEL FLANGES ON EQUIPMENT FUEL LINE STUB-OUTS.
- CONNECT FUEL PIPING TO SITE GEN-SET USING FLANGES. FURNISH AND INSTALL THREADED CARBON STEEL FLANGES ON EQUIPMENT FUEL LINE STUB-OUTS. USE FLANGE INSULATING GASKET KIT.
- ONE (1) 1" C10A DOUBLE WALL FLEXIBLE PIPING INSIDE ONE (1) AXP-40 FLEXIBLE CONDUIT ACCESS PIPE AND ONE (1) 2" C20A DOUBLE WALL FLEXIBLE PIPING INSIDE ONE (1) AXP-40 FLEXIBLE CONDUIT ACCESS PIPE (UNDERGROUND)
- LOCATE ALL FOUR OF THESE CHECK VALVES AS NEAR AS POSSIBLE TO TEES. CHECK VALVES TO BE OPW 175B WITH INTERNAL PRESSURE RELIEF, OR APPROVED EQUAL.
- UTILITY PORT (U.P.) SHALL CONSIST OF A SOCKET WELD TEE, POE/TOE PIPE NIPPLE, THREADED BALL VALVE (LOCKABLE) AND PLUG. ALL 1" 304L STAINLESS STEEL. UTILITY PORT TO BE USED AS A UTILITY CONNECTION FOR TESTING, PRIMING, DRAINING, AND VENTING. THE HIGH POINT PORTS SHALL BE INSTALLED IN THE VERTICAL POSITION, AND THE LOW POINT PORTS SHALL BE INSTALLED IN THE HORIZONTAL POSITION.

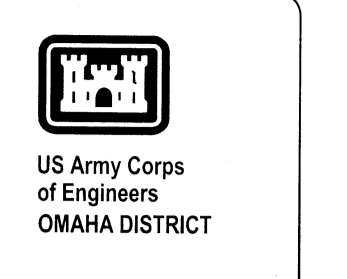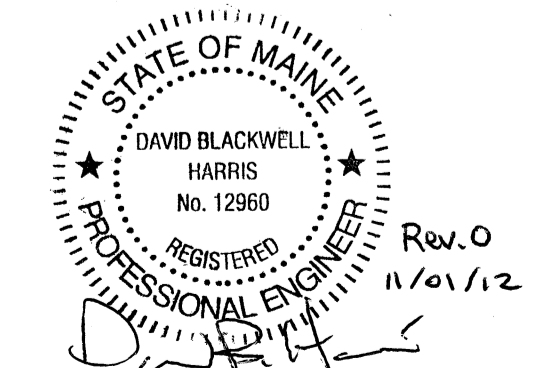

Project Manager	OC
Reviewer	Architectural
Reviewer	Mechanical
Reviewer	Plumbing
Reviewer	Electrical
Reviewer	Civil

Designed by	DBH
Checked by	DBH
Drawn by	RAM
Reviewed by	CHB
Date	2012

33 SOUTH FERRY ROAD, SUITE 200
WALTON, AL 36692
PHONE: (251) 450-7900
FAX: (251) 450-7888

KBR
Engineering Services by
KBR Engineering Co., LLC


FEMA EMERGENCY RADIO NETWORK
ON WIGAN PORTLAND, MAINE

FUEL SYSTEM P&ID


Drawing Number:
M-601

NOTES:

1. ALL ELECTRICAL INSTALLATIONS SHALL BE IN ACCORDANCE WITH THE 2011 EDITION OF THE NATIONAL ELECTRICAL CODE (NEC NFPA 70) AND THE OCCUPATIONAL SAFETY AND HEALTH ACT (OSHA) AND PROJECT SPECIFICATIONS AND APPLICABLE CODES AND STANDARDS.
2. ALL BUILDING PENETRATIONS SHALL BE SEALED WITH A FIRE BLOCK SEALANT TO PREVENT WATER FROM ENTERING THE INTERIOR. ALL PANEL ENTRY PENETRATIONS SHALL UTILIZE MYERS HUBS WITH GROUNDING BUSHINGS.
3. ALL CONDUIT / CABLE ROUTING IS SHOWN DIAGRAMMATIC, CONTRACTOR SHALL VERIFY LOCATION AND ROUTING BEFORE INSTALLATION. COORDINATE INSTALLATION WITH OTHER CRAFTS BEFORE INSTALLING CONDUITS, PULL BOXES AS REQUIRED, PANELS, AND DEVICES.
4. ALL SHUT DOWN WORK REQUIRED SHALL BE PLANNED AND APPROVED BY THE STATION BEFORE PROCEEDING. PROVISIONS SHALL BE PROVIDED FOR ELECTRICAL POWER DURING SHUTDOWN PERIODS, INCLUDING TEMPORARY GENERATOR, DAY TANK, REQUIRED FUEL AND OPERATOR TECHNICIAN AS REQUIRED.
5. AFTER ALL TERMINATIONS, SOLDERING AND TESTING ALL EXPOSED COPPER CONDUCTORS SHALL BE PAINTED TO MATCH SURFACES ON WHICH THEY ARE INSTALLED. WHERE PAINT IS NOT PRACTICAL THE COPPER CONDUCTOR SHALL BE COVERED IN ELECTRICAL TAPE.
6. CONTRACTOR SHALL VERIFY ELECTRICAL PHASE ARRANGEMENTS / CONNECTIONS, MAKING ADJUSTMENTS AS REQUIRED, MATCHING THE NEW INSTALLED SYSTEM(S) TO THE EXISTING FACILITIES SYSTEM. NEW PANEL CONNECTIONS TO EXISTING EQUIPMENT SHALL BE VERIFIED BEFORE APPLICATION OF POWER. FACILITIES ENGINEER SHALL BE PRESENT UPON ENERGIZING EQUIPMENT.
7. CONDUITS INSTALLED UNDERGROUND SHALL BE PVC COATED RIGID GALVANIZED STEEL. ABOVE GRADE EXTERIOR CONDUITS SHALL BE RIGID GALVANIZED STEEL (RGS), INTERIOR CONDUITS MAY BE ELECTRICAL METALLIC TUBING (EMT).
8. CONTRACTOR SHALL COVER COPPER ELECTRICAL GROUNDING BUS BARS AND EXPOSED GROUNDING CABLES ON THE OUTSIDE OF PRECAST MODULES AND THE EXISTING TRANSMITTER BUILDING WITH FIELD FABRICATED SHROUDS. CONTRACTOR SHALL PAINT SHROUDS TO MATCH THE COLOR OF THE BUILDING ON WHICH IT IS MOUNTED. SEE DETAIL 9 ON SHEET E-503.
9. CONTRACTOR SHALL INSTALL SURFACE MOUNTED CONDUIT AND WIRING FROM ALL EXTERIOR MODULE LIGHTING FIXTURES TO A SINGLE WIRING POINT PER MODULE. CONDUITS SHALL BE PAINTED TO MATCH THE MODULE COLOR. THE SINGLE POINT CONNECTION FOR THE GENERATOR MODULE SHALL NOT BE LOCATED BELOW THE EMP POWER FILTER ENCLOSURE.
10. DEMO EXISTING AUTOMATIC TRANSFER SWITCH, SERVICE ENTRANCE DISCONNECT SWITCH, AND TVSS UNIT. SEE DRAWING E-401. REMOVE CONDUITS AND WIRE BACK TO SOURCE(S) INSTALLING NEW CONDUIT AND WIRE ARE SHOWN ON E-401 AND E-403.
11. INSTALL NEW 400 AMPERES ATS WITH INTERNAL TVS. INSTALL A NEW 400 AMPERE DISTRIBUTION POWER PANEL ON REAR WALL AS SHOWN INSURING PROPER CLEARANCES.
12. ON THE EXTERIOR REMOVE THE EXISTING SERVICE ENTRANCE CONDUIT BOXES AND CABLING. INSTALL A NEW RISER CONDUIT FOR A 400 AMPERE SERVICE INSTALLING A CT CABINET AND ADJOINING METER BASE. INSTALL A NEW 400 AMPERE SERVICE ENTRANCE DISCONNECT SWITCH

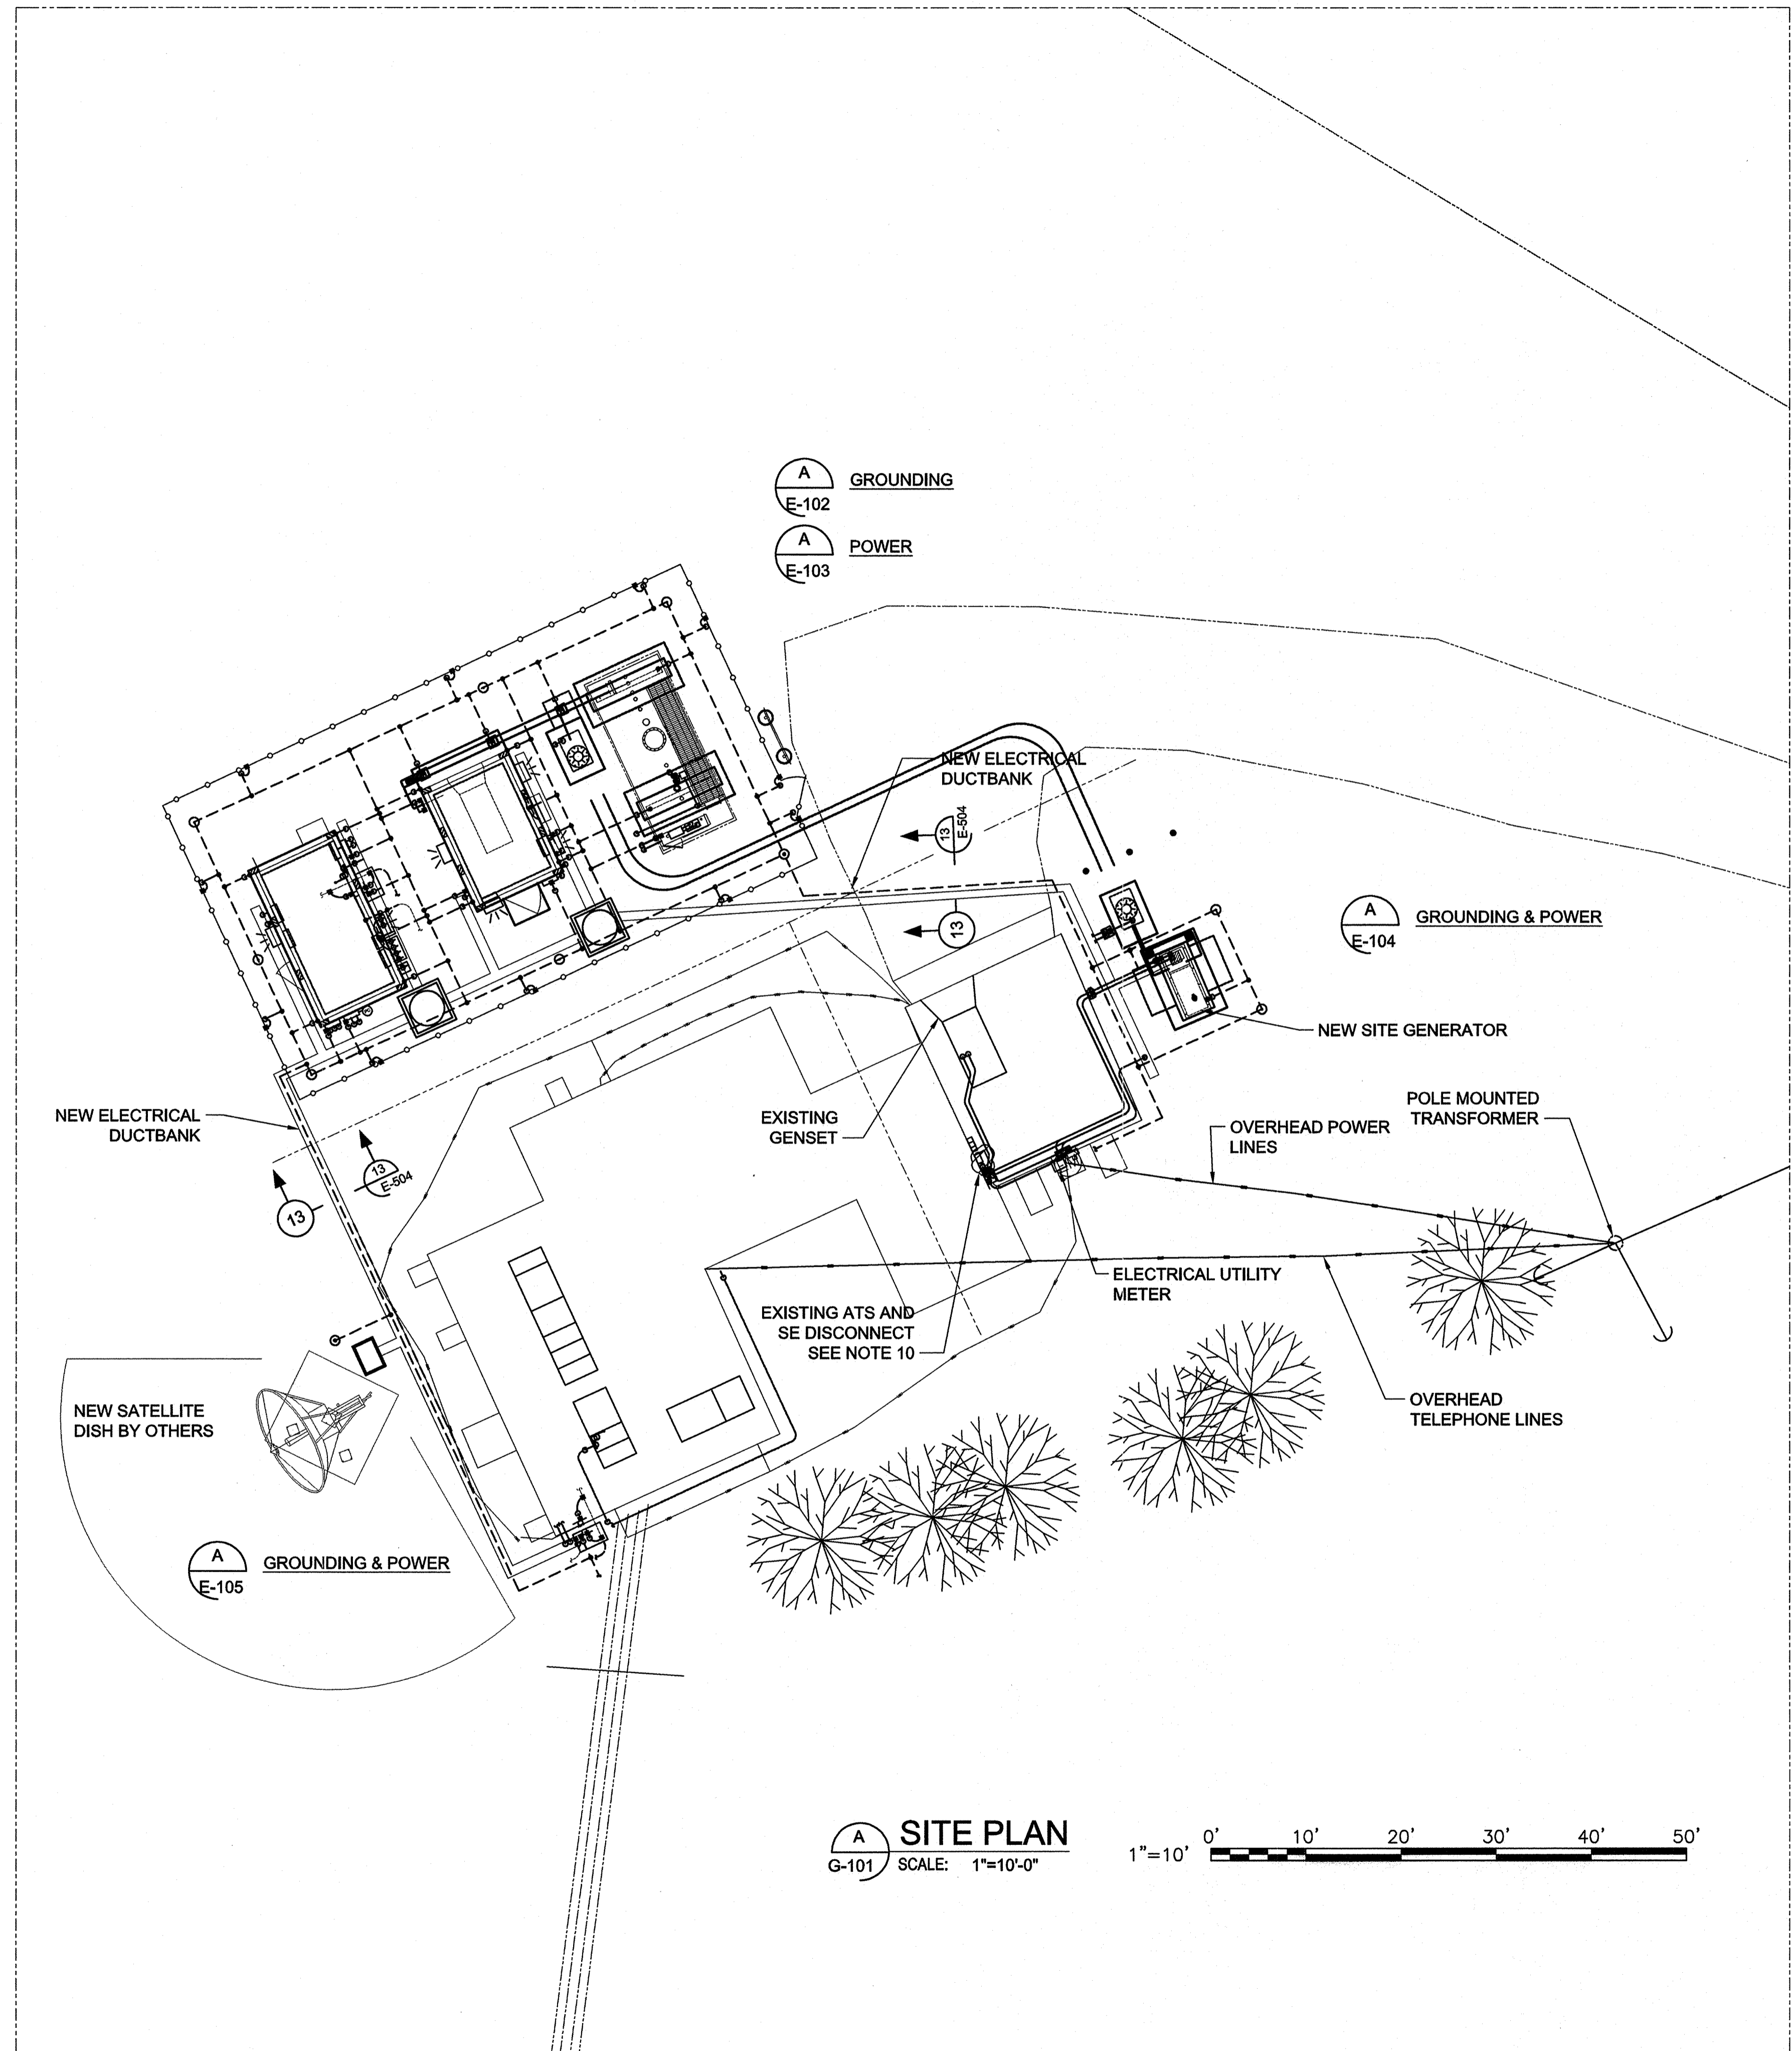

SITE PLAN
G-101 SCALE: 1"=10'-0"




DATE REVISION	PROJECT MANAGER	DESIGNER	DRAWN	CHECKED	IN CHARGE	DATE

Designed by:	Drawn by:	Checked by:	Reviewed by:	Date:
				2012

KBR
43 SOUTH ROYAL STREET SUITE 200
MOBILE, AL 36620
PHONE: (205) 462-7000
FAC: (205) 462-7000


FEMA
Engineering Services by
KBR Engineering Co., LLC

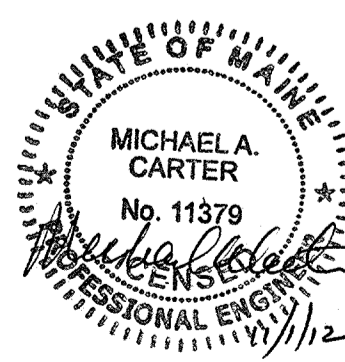

FEMA EMERGENCY RADIO NETWORK
ON WGAN PORTLAND, MAINE

ELECTRICAL SITE PLAN

Drawing Number:
E-101

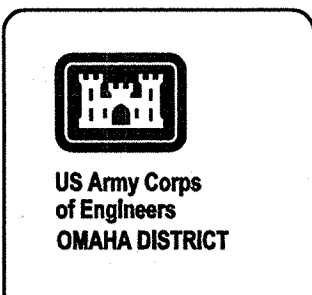

Project Manager	
CC Reviewer	
Architectural	
Structural	
Mechanical	
Electrical	
Other	

Date	
11/7/12	

Mark	
0	
1	
2	
3	
4	
5	
6	
7	
8	
9	
10	
11	
12	

Designed by	
Drawn by	
Checked by	
Reviewed by	
Date	2012

KBR
 63 SOUTH BOW STREET SUITE 200
 MOBILE, AL 36602
 PHONE (205) 450-7000
 FAX (205) 450-7000

FEMA
 FEDERAL EMERGENCY MANAGEMENT AGENCY

KBR
 Engineering Services by
 KBR Engineering Co. LLC

FEMA EMERGENCY RADIO NETWORK
 ON WIGAN PORTLAND, MAINE

**ELECTRICAL
 GROUNDING PLAN**

MICHAEL A. CARTER
 No. 11379
 PROFESSIONAL ENGINEER

Drawing Number:
E-102

NOTES:

- ALL ELECTRICAL INSTALLATIONS SHALL BE IN ACCORDANCE WITH THE 2011 EDITION OF THE NATIONAL ELECTRICAL CODE (NEC NFPA 70) AND THE OCCUPATIONAL SAFETY AND HEALTH ACT (OSHA) AND PROJECT SPECIFICATIONS AND APPLICABLE CODES AND STANDARDS.
- GROUND CONDUCTORS / TOWER GROUND RADIALS DAMAGED OR CUT DURING CONSTRUCTION SHALL BE REPAIRED BEFORE CONTINUING CONSTRUCTION ACTIVITIES. REROUTING OF GROUND CONDUCTORS AROUND IMPACTED AREAS SHALL BE COMPLETED BEFORE CONTINUING.
- ALL GROUNDING CONNECTIONS SHALL BE EXOTHERMIC, NO COMPRESSION CONNECTIONS PERMITTED. MECHANICAL CONNECTIONS SHALL BE PERMITTED FOR EQUIPMENT UTILIZING BOLTED TYPE CONNECTIONS WHICH MAY REQUIRE REMOVAL FOR MAINTENANCE.
- MODULE GROUND CONNECTIONS SHALL BE LOCATED AT ALL PENETRATION AREAS IN ADDITION TO THE PROVIDED GROUNDING PADS AT THE GENERATOR MODULE CORNERS. A MECHANICAL CONNECTION SHALL BE ATTACHED TO THE CONDUIT / PIPING EXITING THE MODULE UTILIZING A BURNDY CONNECTOR TYPE GAR-BU OR APPROVED EQUAL. SIZE AS REQUIRED.
- CONTRACTOR SHALL TIE INTO EXISTING GROUND LOOP TO ENSURE CONTINUITY OF THE OVERALL GROUNDING SYSTEM.
- CONTRACTOR SHALL CONNECT THE INTERIOR RF 4" COPPER BONDING TAPE (PROVIDED BY SABRE INDUSTRIES) TO THE RF GROUND TAPE ROUTED WITH THE RF COAXIAL CABLE (PROVIDED BY SITE CONTRACTOR). SILVER SOLDER ALL RF 4" WIDE TAPE CONNECTIONS.
- WHERE THE GROUNDING ELECTRODE CONDUCTOR EXITS FROM BELOW GRADE IT SHALL BE ROUTED IN A SCHEDULE 80 PVC CONDUIT FROM 18" BELOW GRADE UP TO 8'-0" ABOVE GRADE.
- THE RF COAX CABLE SHALL BE BONDED TO THE GROUNDING BUS BARS BELOW THE BULK HEAD PENETRATION BOTH EXTERIOR AND INTERIOR. ANDREWS GROUNDING KIT(S) NO. 241088-2 OR APPROVED EQUAL
- CONTRACTOR SHALL CONNECT THE EXTERIOR RF GROUND BUS BAR TO THE GROUND LOOP UTILIZING A # 4/0 AWG INSULATED GROUNDING CONDUCTOR.
- MODULE GROUND CONNECTIONS ARE LOCATED ON THE SIDES OF THE MODULE BUILDING. SEE CELLXION DRAWINGS FOR EXACT LOCATIONS FOR GROUNDING STUB-UPS. TYPICAL BOTH MODULES


LEGEND:

- UNDERGROUND CONDUIT
- ABOVE GROUND CONDUIT
- ⊙ GROUND ROD, 3/4" X 10' SECTIONAL COPPER CLAD
- EXOTHERMIC WELD, SEE DETAIL FOR TYPE
- MECHANICAL GROUND CONNECTION, SEE DETAIL FOR TYPE
- ⊙ GROUNDING TEST WELL
- GROUNDING CONDUCTOR (BURIAL DEPTH 30")
- 4" WIDE (.016" TO .022") COPPER RF BONDING TAPE
- 3" 7/8" RF COAXIAL CABLE
- ⊔ CONDUIT / CABLE TURNED DOWN
- ⊕ CONDUIT / CABLE TURNED UP
- TT GROUNDING BUS BAR
- ⊔ GROUND CONNECTION TO FOUNDATION REBAR LOCATION AT LOWEST LEVEL (UFER GROUND)





DETAIL/SHEET #

DRAWING LIMITS

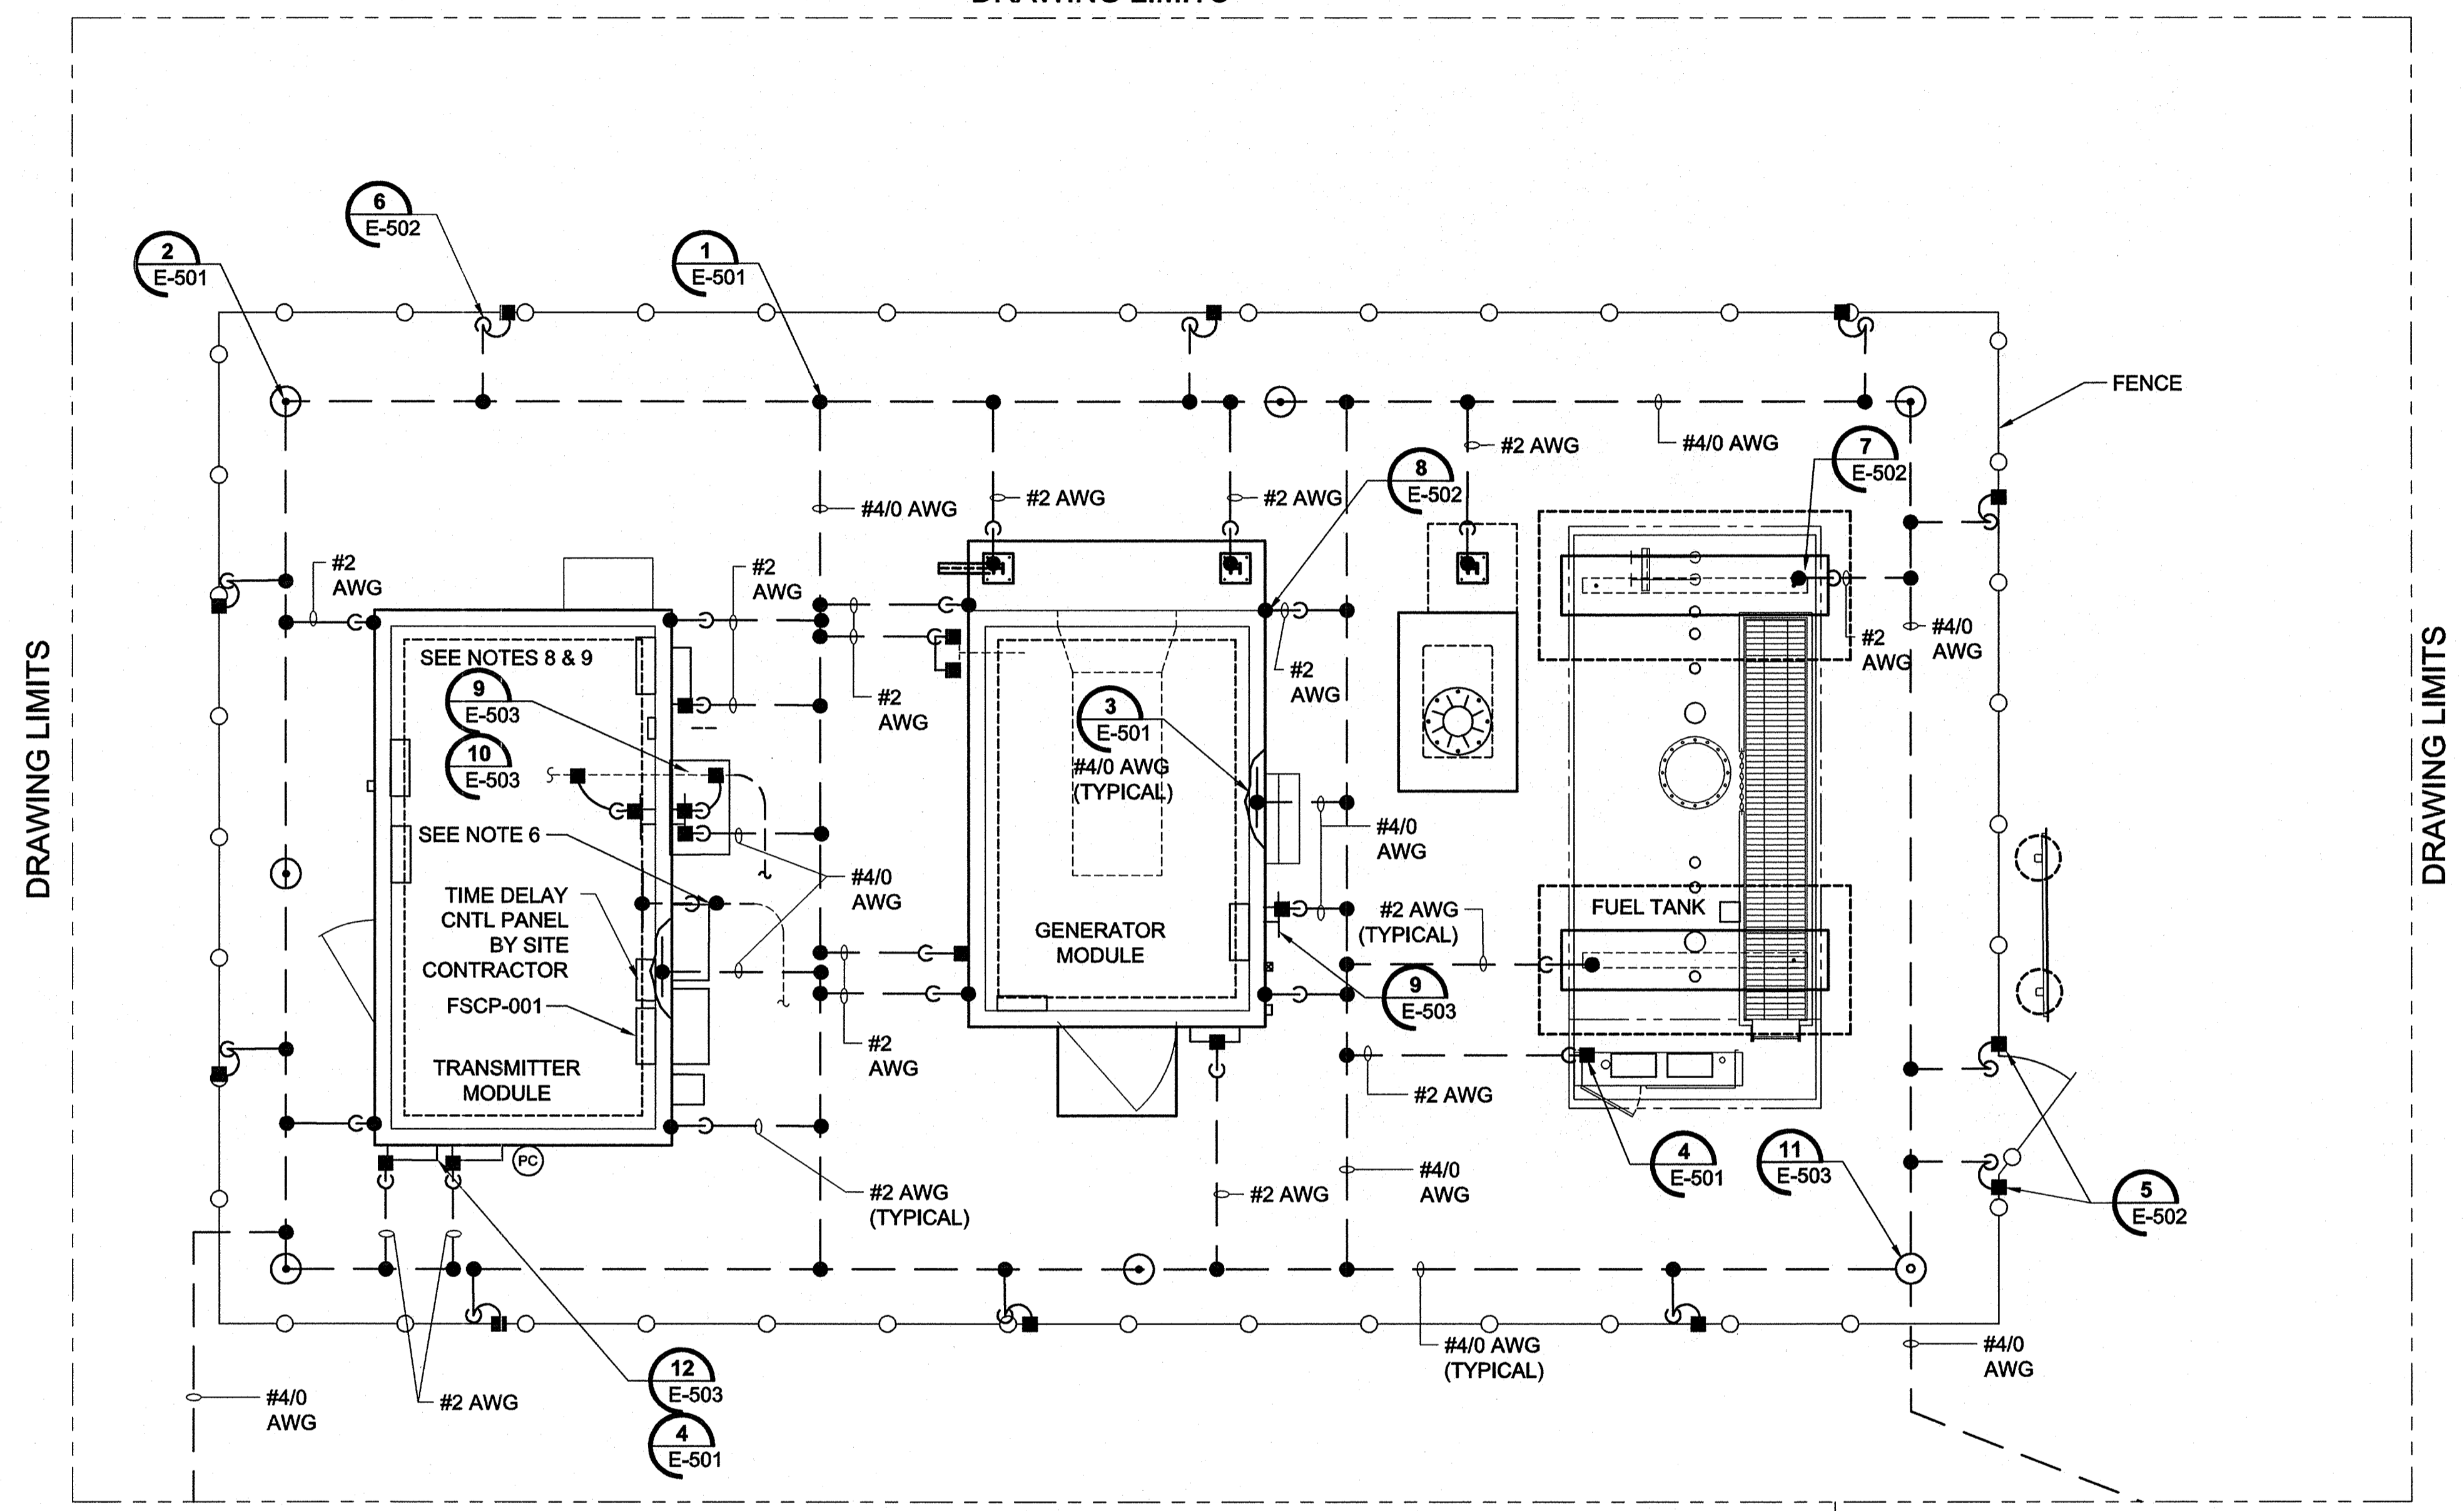


CONTINUED ON DRAWING E-105 CONTINUED ON DRAWING E-104

A
 E-101 **GROUNDING PLAN**
 SCALE: 1/4"=1'-0"

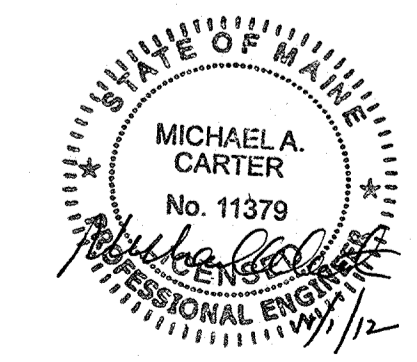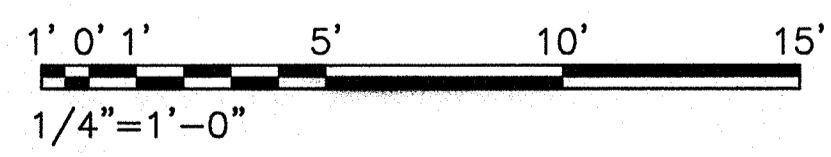


DRAWING LIMITS

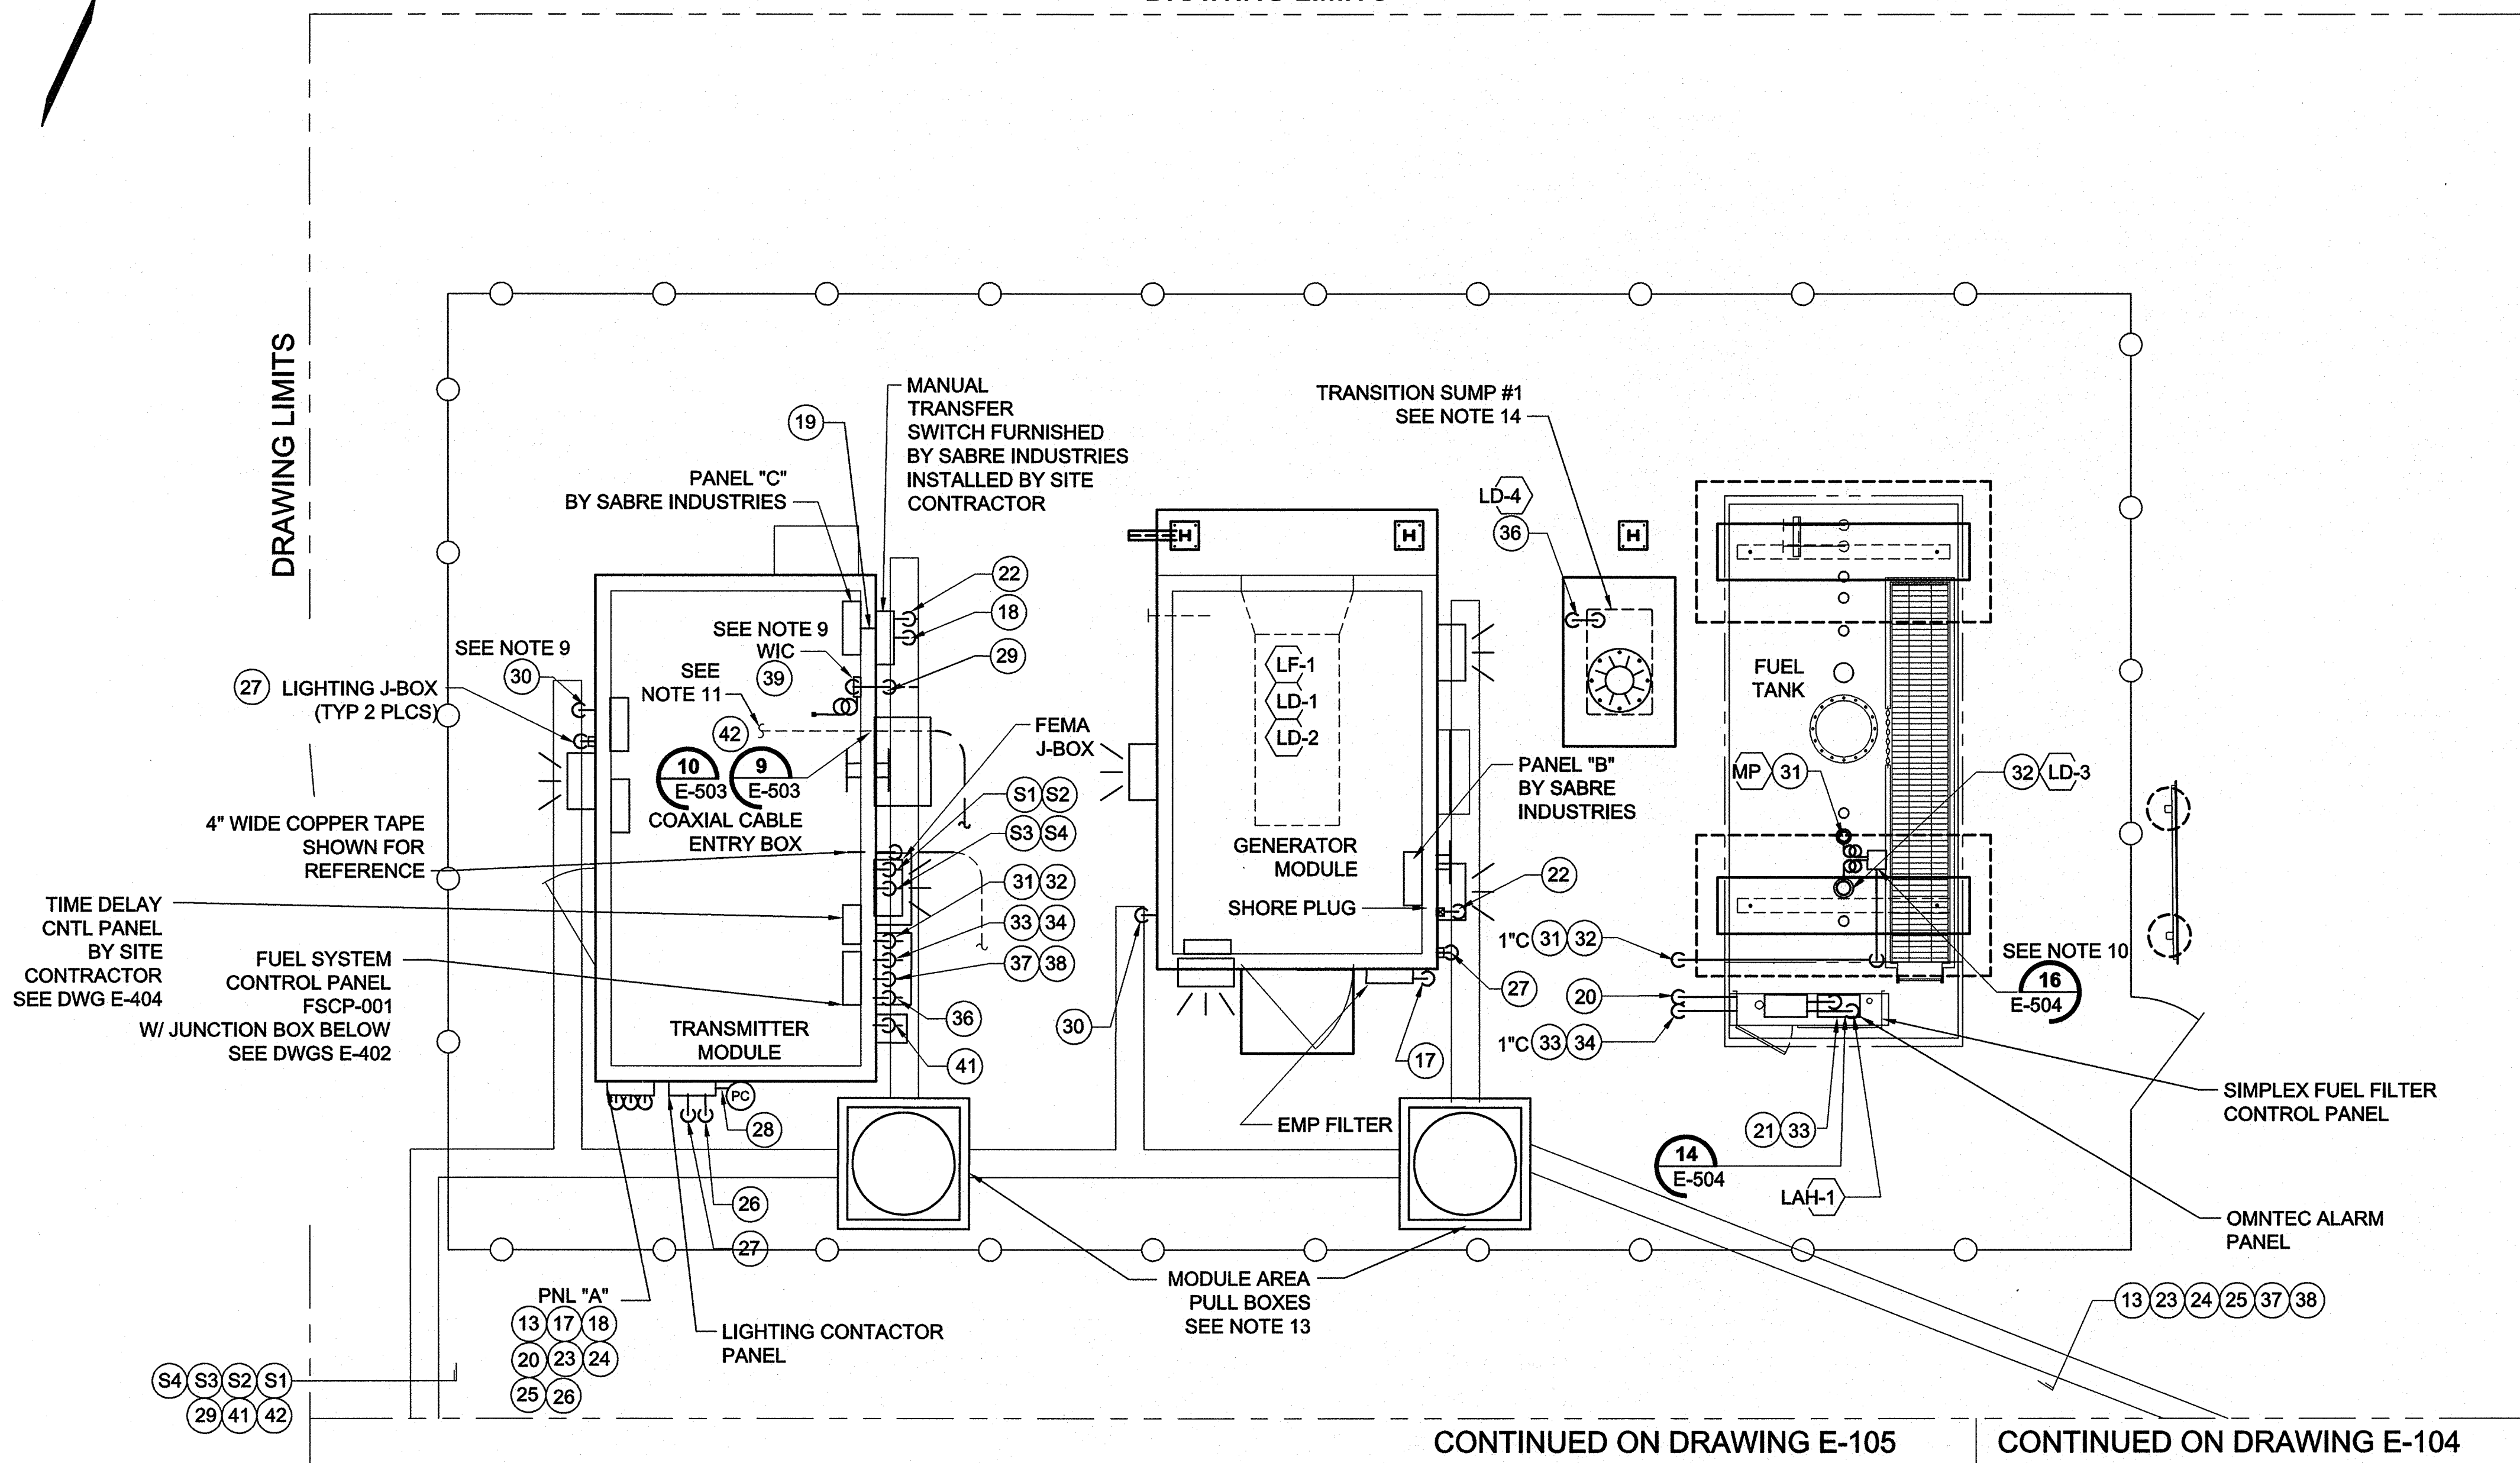

CONTINUED ON DRAWING E-105

CONTINUED ON DRAWING E-104

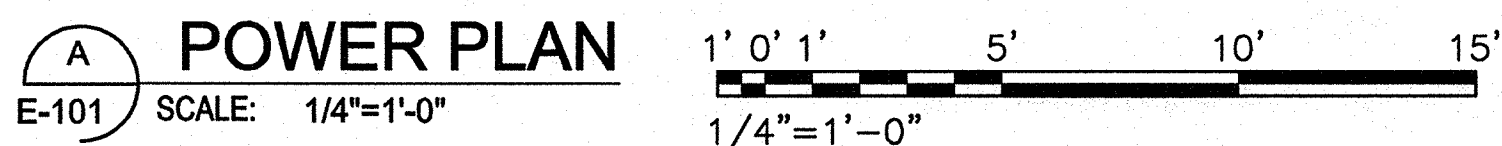

NOTES CONTINUED:


11. CONTRACTOR SHALL INSTALL A COAXIAL EIA FLANGE CONNECTOR (ANDREWS CAT NO. AL5E78-PS) ON THE NEW CABLE WITH THE CABLE END LOCATED ABOVE THE NEW TRANSMITTER CABINET. A MINIMUM OF 12 LF EXCESS CABLE SHALL BE PROVIDED TO FACILITATE CONNECTION WITH THE CABINET DOOR REMOVED.
12. CONTRACTOR SHALL TERMINATE ALL 25 PAIRS OF THE OSP COMMUNICATION CABLE IN THE TRANSMITTER MODULE TO THE PROVIDED PUNCH DOWN BLOCK. ALL WIRING FROM WITHIN THE MODULE TO THE PUNCH DOWN BLOCK IS BY OTHERS. TWO PAIRS OF THE 25 PAIR CABLE SHALL BE IDENTIFIED BY THE CONTRACTOR FOR SIGNALS FROM THE TRANSMITTER MODULE. THE FIRST PAIR IS FOR THE ENDEC PROGRAMMING EQUIPMENT. THE SECOND PAIR WILL SERVE ALL REMAINING DEVICES IN THE TRANSMITTER BUILDING; PHONE OUTLETS, INCON FUEL SYSTEM, AND VIKING AUTO DIALER.
13. CONTRACTOR SHALL PROVIDE PULL BOXES OR MANHOLES AS REQUIRED TO MEET NEC REQUIREMENTS FOR PULL POINTS. PULL BOX / MANHOLE SHALL HAVE A TRAFFIC RATING "H20" DUE TO GROUNDS MAINTENANCE EQUIPMENT. HUBBLE QUAZITE #PG4848BA48 W/ COVER #PG4848HH00 OR APPROVED EQUAL.
14. CONDUIT ENTERING THE TRANSITION SUMP SHALL BE MADE UTILIZING A STTB TYPE BULK HEAD FITTING. A SEALED FITTING SHALL BE UTILIZED ABOVE THE CONCRETE CAP TO PREVENT THE ENTRANCE OF WATER INTO THE SUMP WHEN ENTERING THE TOP OF THE SUMP. COORDINATE CONDUIT PLACEMENT WITH MECHANICAL AND STRUCTURAL DRAWINGS.

NOTES:

1. ALL ELECTRICAL INSTALLATIONS SHALL BE IN ACCORDANCE WITH THE 2011 EDITION OF THE NATIONAL ELECTRICAL CODE (NEC NFPA 70) AND THE OCCUPATIONAL SAFETY AND HEALTH ACT (OSHA) AND PROJECT SPECIFICATIONS AND APPLICABLE CODES AND STANDARDS.
2. ALL BUILDING PENETRATIONS SHALL BE SEALED WITH A FIRE BLOCK SEALANT TO PREVENT WATER FROM ENTERING THE INTERIOR. ALL PANEL ENTRY PENETRATIONS SHALL UTILIZE MYERS HUBS WITH GROUNDING BUSHINGS.
3. ALL CONDUIT/DUCTBANK ROUTING IS SHOWN DIAGRAMMATIC. CONTRACTOR SHALL VERIFY LOCATION, ROUTING, AND PULL BOX REQUIREMENTS BEFORE INSTALLATION. COORDINATE INSTALLATION WITH OTHER CRAFTS BEFORE INSTALLING CONDUITS, PULL BOXES AS REQUIRED, PANELS, AND DEVICES.
4. ALL SHUT DOWN WORK REQUIRED SHALL BE PLANNED AND APPROVED BY THE STATION BEFORE PROCEEDING. PROVISIONS SHALL BE PROVIDED FOR ELECTRICAL POWER DURING SHUTDOWN PERIODS, INCLUDING TEMPORARY GENERATOR, DAY TANK, REQUIRED FUEL AND OPERATOR TECHNICIAN AS REQUIRED.
5. CONTRACTOR SHALL VERIFY ELECTRICAL PHASE ARRANGEMENTS / CONNECTIONS, MAKING ADJUSTMENTS AS REQUIRED, MATCHING THE NEW INSTALLED SYSTEM(S) TO THE EXISTING FACILITIES SYSTEM. NEW PANEL CONNECTIONS TO EXISTING EQUIPMENT SHALL BE VERIFIED BEFORE APPLICATION OF POWER. FACILITIES ENGINEER SHALL BE PRESENT UPON ENERGIZING EQUIPMENT.
6. CONDUITS INSTALLED UNDERGROUND SHALL BE PVC COATED RIGID GALVANIZED STEEL. ABOVE GRADE EXTERIOR CONDUITS SHALL BE RIGID GALVANIZED STEEL (RGS), INTERIOR CONDUITS MAY BE ELECTRICAL METALLIC TUBING (EMT).
7. CONTRACTOR SHALL INSTALL SURFACE MOUNTED CONDUIT AND WIRING FROM ALL EXTERIOR MODULE LIGHTING FIXTURES TO A SINGLE WIRING POINT PER MODULE. CONDUITS SHALL BE PAINTED TO MATCH THE MODULE COLOR. THE SINGLE POINT CONNECTION FOR THE GENERATOR MODULE SHALL NOT BE LOCATED BELOW THE EMP POWER FILTER ENCLOSURE. SEE CELLXION DRAWINGS FOR FIXTURE LOCATIONS.
8. SEE CELLXION MODULE DRAWINGS SKBR01 & SKBR02 FOR BUILDING PENETRATION LOCATIONS TO COORDINATE CONDUITS STUB-UPS CONNECTIONS.
9. CONTRACTOR SHALL PROVIDE FIBER OPTIC JUMPERS (PIGTAILS) AS REQUIRED FOR CONNECTION TO THE PROGRAMMING EQUIPMENT. CONNECTING TO THE OSP FIBER OPTIC CABLING TO THE FIBER OPTIC WALL MOUNT INTERCONNECTION CENTER BY SABRE INDUSTRIES. CONTRACTOR SHALL FURNISH ST STYLE CONNECTORS INSTALLING FAN OUT KITS AS REQUIRED FOR THE 6 FIBER 62.5 / 125 MULTI-MODE OUTSIDE PLANT RATED F/O CABLE.
10. CONTRACTOR SHALL INSTALL THE INSTRUMENT JUNCTION BOX ON TOP OF THE FUEL TANK BETWEEN THE FIELD DEVICES TO ALLOW FOR INSTALLATION / CHECKING OF INSTRUMENT CONNECTIONS. JUNCTION BOX SHOULD BE LOCATED ADJACENT TO THE CATWALK.

LEGEND:

- UNDERGROUND CONDUIT
- _____ ABOVE GROUND CONDUIT
- 3\"/>

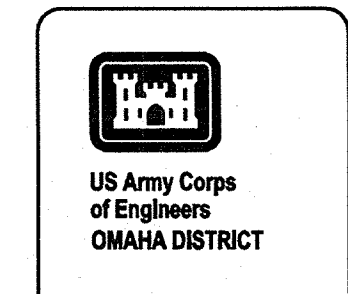

Project Manager	
DC Reviewer	
Architectural	
Mechanical	
Plumbing	
Electrical	
Other	

Mark					
0	ISSUED FOR CONSTRUCTION	11/7/12	Date	Approved	

Designed by	Checked by
Drawn by	Reviewed by
Date	2012

63 SOUTH BROAD STREET SUITE 200

 MOBILE, AL 36602

 PHONE (251) 462-7600

 FAX (251) 462-7601

KBR

 Engineering Services by

 KBR Engineering Co., LLC


FEMA EMERGENCY RADIO NETWORK

 ON WIGAN PORTLAND, MAINE

ELECTRICAL POWER PLAN



Drawing Number: **E-103**

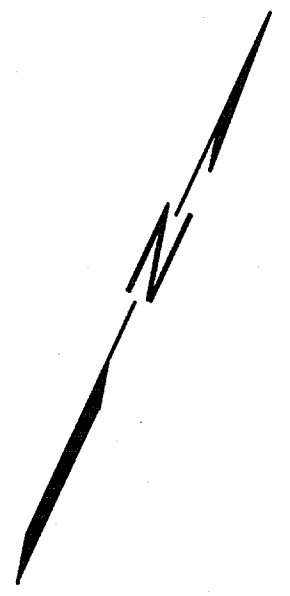

NOTES:

- ALL ELECTRICAL INSTALLATIONS SHALL BE IN ACCORDANCE WITH THE 2011 EDITION OF THE NATIONAL ELECTRICAL CODE (NEC NFPA 70) AND THE OCCUPATIONAL SAFETY AND HEALTH ACT (OSHA) AND PROJECT SPECIFICATIONS AND APPLICABLE CODES AND STANDARDS..
- ALL BUILDING PENETRATIONS SHALL BE SEALED WITH A FIRE BLOCK SEALANT TO PREVENT WATER FROM ENTERING THE INTERIOR. ALL PANEL ENTRY PENETRATIONS SHALL UTILIZE MYERS HUBS WITH GROUNDING BUSHINGS.
- ALL CONDUIT ROUTING IS SHOWN DIAGRAMMATIC. CONTRACTOR SHALL VERIFY LOCATION AND ROUTING BEFORE INSTALLATION. COORDINATE INSTALLATION WITH OTHER CRAFTS BEFORE INSTALLING CONDUITS, PULL BOXES AS REQUIRED, PANELS, AND DEVICES.
- ALL SHUT DOWN WORK REQUIRED SHALL BE PLANNED AND APPROVED BY THE STATION BEFORE PROCEEDING. PROVISIONS SHALL BE PROVIDED TO MAINTAIN SERVICE DURING SHUTDOWN PERIODS.
- CONTRACTOR SHALL VERIFY ELECTRICAL PHASE ARRANGEMENTS / CONNECTIONS, MAKING ADJUSTMENTS AS REQUIRED, MATCHING THE NEW INSTALLED SYSTEM(S) TO THE EXISTING FACILITIES SYSTEM. NEW PANEL CONNECTIONS TO EXISTING EQUIPMENT SHALL BE VERIFIED BEFORE APPLICATION OF POWER. FACILITIES ENGINEER SHALL BE PRESENT UPON ENERGIZING EQUIPMENT.
- CONDUITS INSTALLED UNDERGROUND SHALL BE PVC COATED RIGID GALVANIZED STEEL. ABOVE GRADE EXTERIOR CONDUITS SHALL BE RIGID GALVANIZED STEEL (RGS), INTERIOR CONDUITS MAY BE ELECTRICAL METALLIC TUBING (EMT).
- DUE TO UNDERGROUND INSTALLATION OBSTRUCTIONS HAND EXCAVATION IS REQUIRED FOR AREA ADJACENT TO THE STATION BUILDING. NO EXCAVATORS OR POWERED EQUIPMENT SHALL BE UTILIZED.



Project Manager	
DC Designer	
Architectural	
Mechanical	
Plumbing	
Electrical	
Other	

Mark	
Date	11/7/12
Approval	

ISSUED FOR CONSTRUCTION	
Description	

Designed by	
Drawn by	
Checked by	
Reviewed by	
Date	2012


KBR
 63 SOUTH ROYAL STREET, SUITE 200
 PORTLAND, ME 04106
 PHONE (207) 462-7800
 FAX (207) 462-7808

FEMA
 Engineering Services by
 KBR Engineering Co., LLC

FEMA EMERGENCY RADIO NETWORK
 ON WIGAN PORTLAND, MAINE

GROUNDING & POWER PLAN

Drawing Number:
E-104

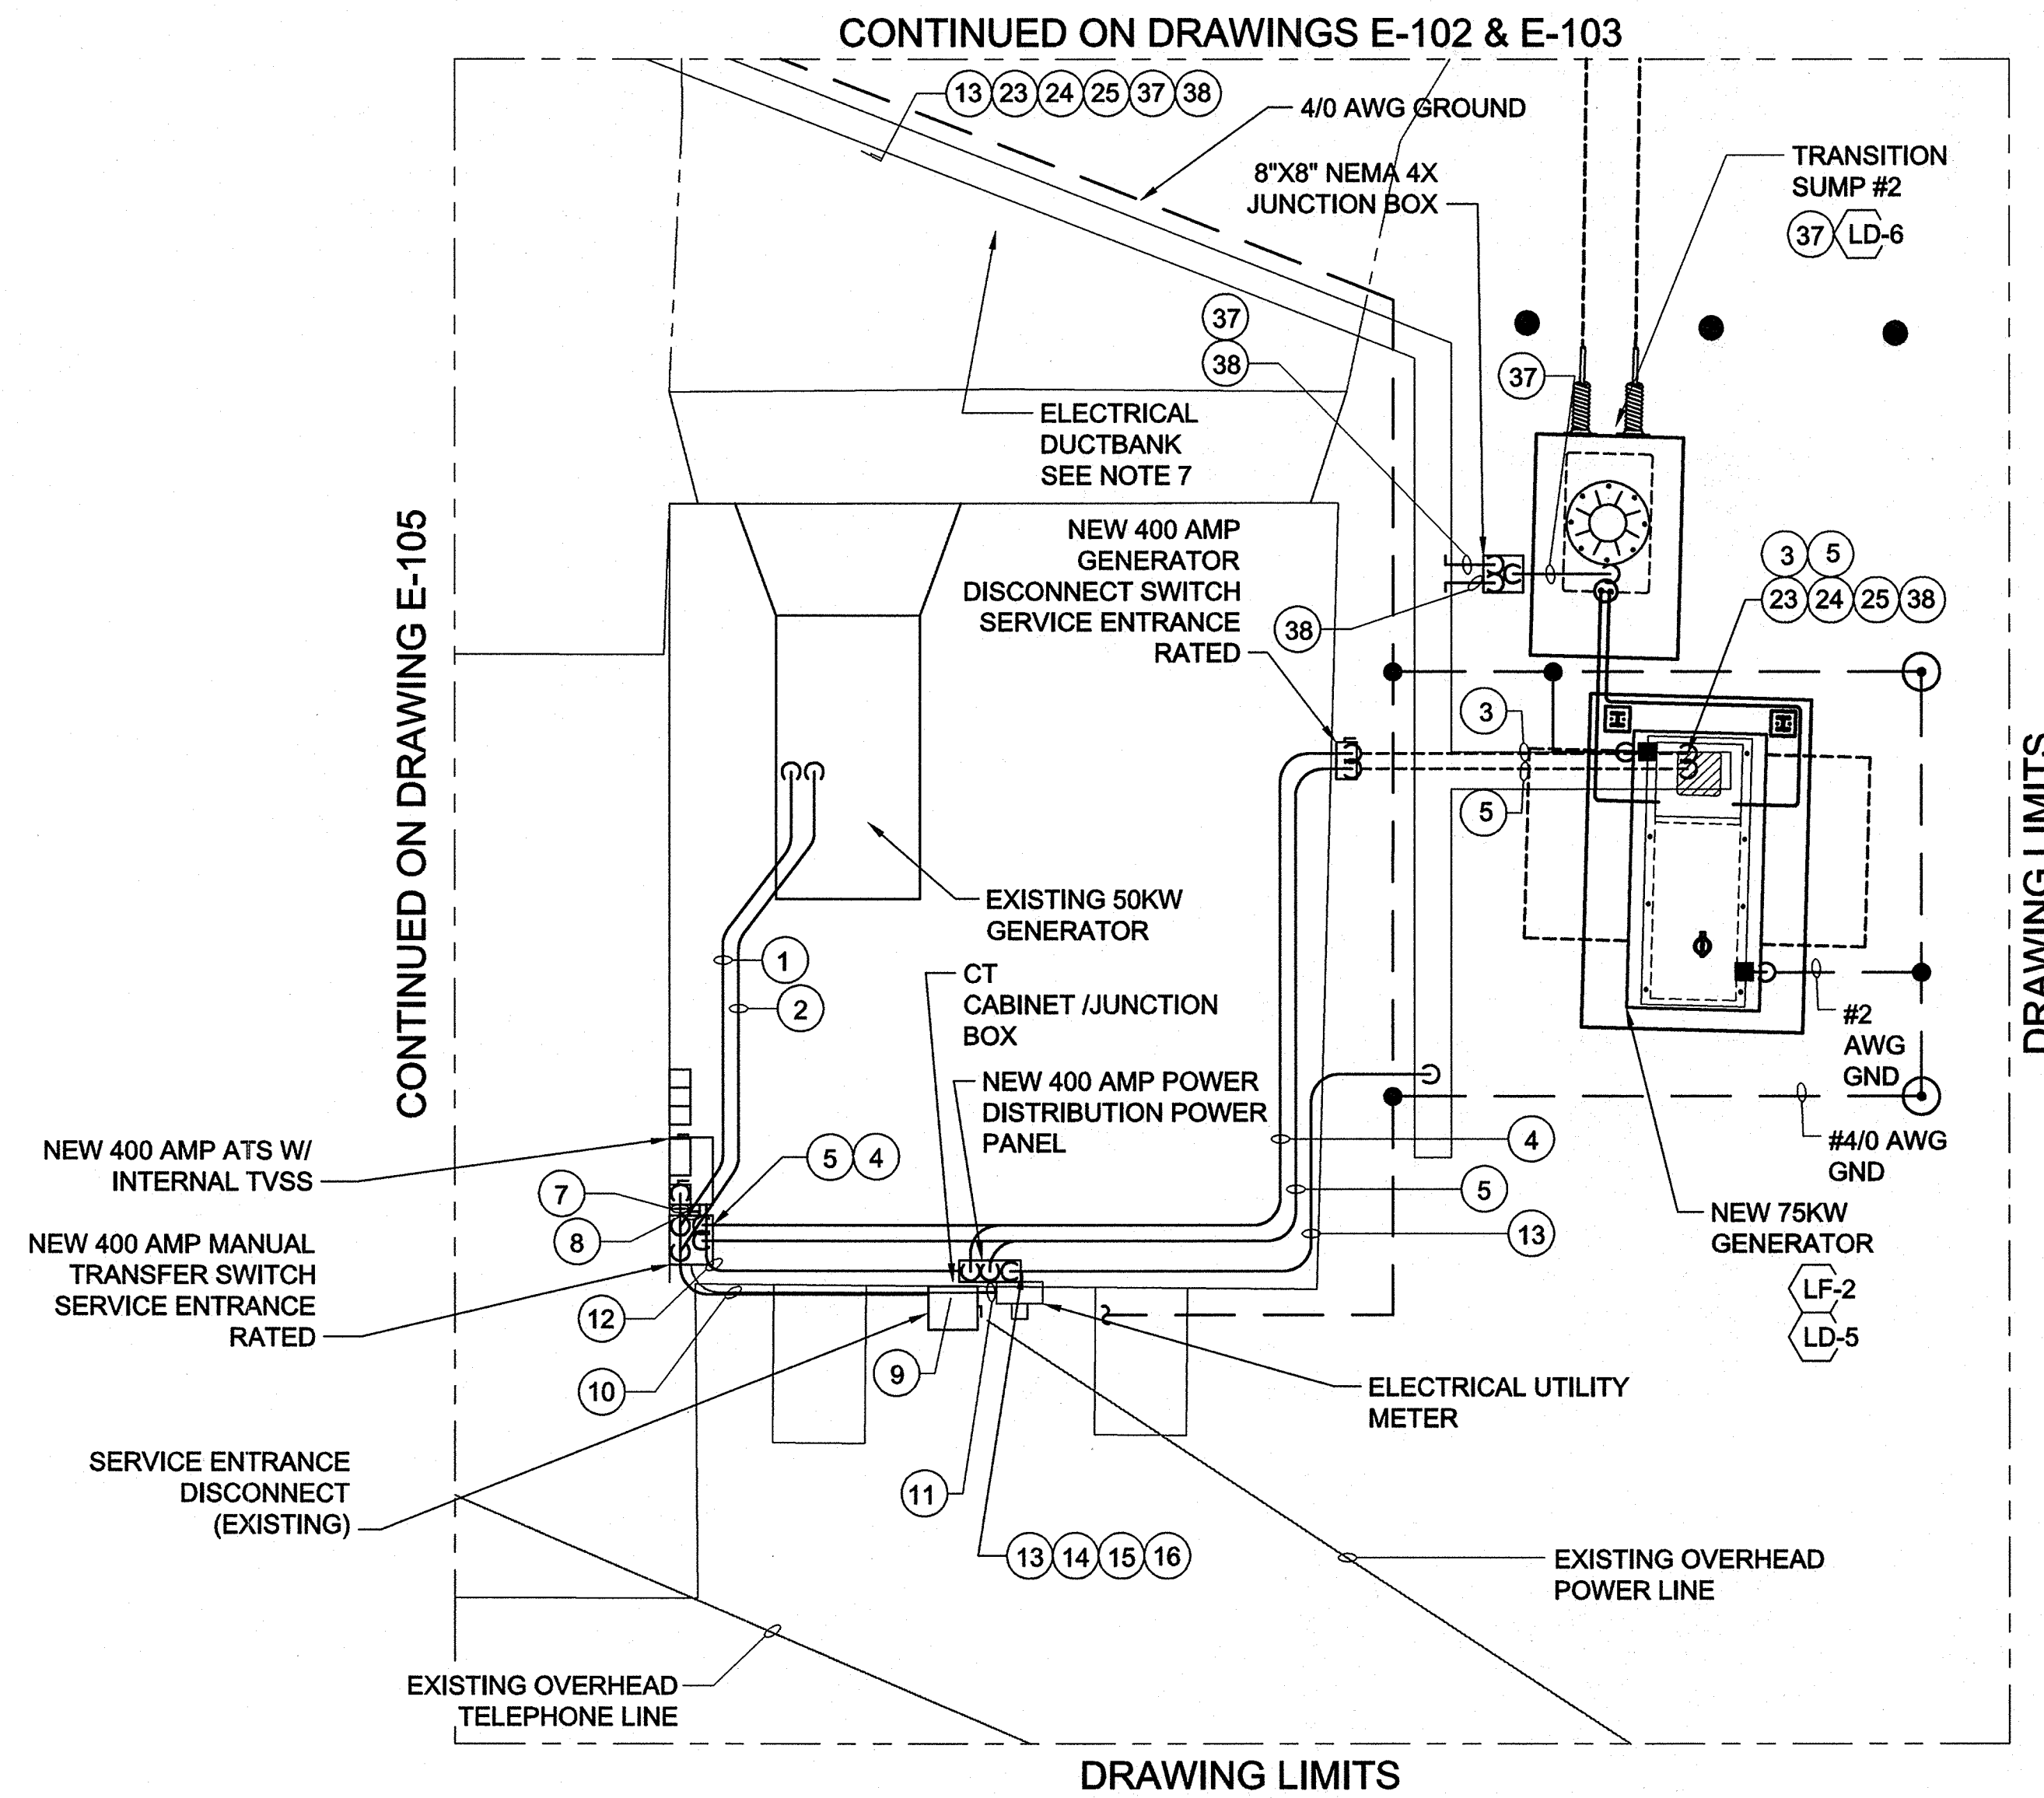


LEGEND:

- UNDERGROUND CONDUIT
- ABOVE GROUND CONDUIT
- ⊙ GROUND ROD, 3/4" X 10' SECTIONAL COPPER CLAD
- EXOTHERMIC WELD, SEE DETAIL FOR TYPE
- MECHANICAL GROUND CONNECTION, SEE DETAIL FOR TYPE
- ⊙ GROUNDING TEST WELL
- GROUNDING CONDUCTOR (BURIAL DEPTH 30")
- 4" WIDE (.016" TO .022") COPPER RF BONDING TAPE
- 3"C 7/8" RF COAXIAL CABLE
- CONDUIT / CABLE TURNED DOWN
- CONDUIT / CABLE TURNED UP
- TT GROUNDING BUS BAR
- GROUND CONNECTION TO FOUNDATION REBAR LOCATION AT LOWEST LEVEL (UFER GROUND)
- HIGH PRESSURE SODIUM WALL MOUNTED FIXTURE, 70 WATT, 120 VAC, FURNISHED WITH MODULES. CONTRACTOR SHALL MOUNT LIGHTS AND DISCONNECT THE INTERGAL PHOTO ELECTRIC CELL(S). T.O.F. ELEVATION 9'-0" A.F.G.
- XX CABLE NUMBER (SEE E-403)
- XXX-X INSTRUMENT TAG
- XX E-5XX DETAIL/SHEET #

GROUNDING & POWER PLAN

E-101 SCALE: 1/4"=1'-0"

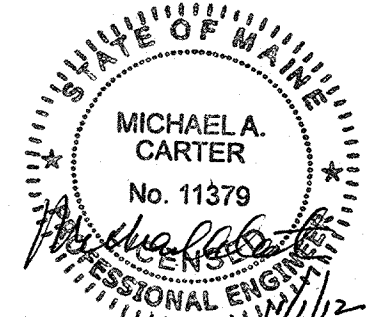

NOTES:

- ALL ELECTRICAL INSTALLATIONS SHALL BE IN ACCORDANCE WITH THE 2011 EDITION OF THE NATIONAL ELECTRICAL CODE (NEC NFPA 70) AND THE OCCUPATIONAL SAFETY AND HEALTH ACT (OSHA) AND PROJECT SPECIFICATIONS AND APPLICABLE CODES AND STANDARDS..
- ALL BUILDING PENETRATIONS SHALL BE SEALED WITH A FIRE BLOCK SEALANT TO PREVENT WATER FROM ENTERING THE INTERIOR. ALL PANEL ENTRY PENETRATIONS SHALL UTILIZE MYERS HUBS WITH GROUNDING BUSHINGS.
- ALL CONDUIT ROUTING IS SHOWN DIAGRAMMATIC, CONTRACTOR SHALL VERIFY LOCATION AND ROUTING BEFORE INSTALLATION. COORDINATE INSTALLATION WITH OTHER CRAFTS BEFORE INSTALLING CONDUITS, PULL BOXES AS REQUIRED, PANELS, AND DEVICES.
- ALL SHUT DOWN WORK REQUIRED SHALL BE PLANNED AND APPROVED BY THE STATION BEFORE PROCEEDING. PROVISIONS SHALL BE PROVIDED FOR ELECTRICAL POWER DURING SHUTDOWN PERIODS, INCLUDING TEMPORARY GENERATOR, DAY TANK, REQUIRED FUEL AND OPERATOR TECHNICIAN AS REQUIRED.
- CONTRACTOR SHALL VERIFY ELECTRICAL PHASE ARRANGEMENTS / CONNECTIONS, MAKING ADJUSTMENTS AS REQUIRED, MATCHING THE NEW INSTALLED SYSTEM(S) TO THE EXISTING FACILITIES SYSTEM. NEW PANEL CONNECTIONS TO EXISTING EQUIPMENT SHALL BE VERIFIED BEFORE APPLICATION OF POWER. FACILITIES ENGINEER SHALL BE PRESENT UPON ENERGIZING EQUIPMENT.
- CONDUITS INSTALLED UNDERGROUND SHALL BE PVC COATED RIGID GALVANIZED STEEL. ABOVE GRADE EXTERIOR CONDUITS SHALL BE RIGID GALVANIZED STEEL (RGS), INTERIOR CONDUITS MAY BE ELECTRICAL METALLIC TUBING (EMT).
- CONTRACTOR SHALL PROVIDE FIBER OPTIC JUMPERS (PIGTAILS) AS REQUIRED FOR CONNECTION TO THE PROGRAMMING EQUIPMENT. CONNECTING TO THE OSP FIBER OPTIC CABLING TO THE FIBER OPTIC WALL MOUNT INTERCONNECTION CENTER BY SABRE INDUSTRIES. CONTRACTOR SHALL FURNISH ST STYLE CONNECTORS INSTALLING FAN OUT KITS AS REQUIRED FOR THE 6 FIBER 62.5 / 125 MULTI-MODE OUTSIDE PLANT RATED F/O CABLE.
- CONTRACTOR SHALL INSTALL A NEW COMMUNICATION BACKBOARD UTILIZING 3/4" PLYWOOD. ROUTE THE 25 PAIR OSP COMMUNICATION CABLE TO THE NEW COMMUNICATION BACKBOARD AND SHALL PROVIDE AND INSTALL A NEW SURGE PROTECTED 66 BLOCK (CIRCA TELECOM 2625QC-3B1E OR EQUAL) WITH ANALOG GAS TUBE SURGE PROTECTORS IN THE TELEPHONE CLOSET. ALL 25 PAIRS SHALL BE TERMINATED TO THE 66 BLOCK WITH THE (2) UTILIZED PAIRS IDENTIFIED/NOTED. CONTRACTOR SHALL INSTALL ALL JUMPERS /CROSS CONNECTION FOR THE TWO UTILIZED LINES AS REQUIRED FOR TERMINATION TO THE PHONE COMPANY DEMARCATION POINT. CONTRACTOR SHALL BOND THE 66 BLOCK TO THE EXISTING GROUNDING TERMINAL, WHERE THIS ISNT IN PLACE THE CONTRACTOR SHALL ROUTE A INSULATED #4 AWG GROUND CONDUCTOR TO THE NEAREST GROUNDING POINT.
- CONTRACTOR SHALL ROUTE A 4-PAIR TELEPHONE CABLE IN THE EXISTING FLOOR TRENCH TO THE TELEPHONE DEMARCATION BOX.
- ROUTE COAX RF CABLE INTO PHASOR ROOM. STATION ENGINEER WILL TERMINATE CABLE.
- THE RF COAX CABLE SHALL BE BONDED TO THE GROUNDING BUS BARS BELOW THE BULK HEAD PENETRATION BOTH EXTERIOR AND INTERIOR. ANDREWS GROUNDING KIT(S) NO. 241088-2 OR APPROVED EQUAL.
- CONTRACTOR SHALL CONNECT TO THE EXTERIOR GROUND BUS BAR TO THE GROUND LOOP WITH A #4/0 AWG INSULATED GROUND CONDUCTOR.
- DUE TO UNDERGROUND INSTALLATION OBSTRUCTIONS HAND EXCAVATION IS REQUIRED FOR AREA ADJACENT TO THE STATION BUILDING. NO EXCAVATORS OR POWERED EQUIPMENT SHALL BE UTILIZED.



PHASE	REVIEW	DATE
Project Manager		
GC Reviewer		
Structural		
Mechanical		
Plumbing		
Electrical		
Other		

ISSUED FOR CONSTRUCTION	DATE	APPROVED
0	11/7/12	
1		
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		
19		
20		
21		
22		
23		
24		
25		
26		
27		
28		
29		
30		
31		
32		
33		
34		
35		
36		
37		
38		
39		
40		
41		
42		
43		
44		
45		
46		
47		
48		
49		
50		

Designed by:	Checked by:
Drawn by:	Reviewed by:
2012	

63 SOUTH BOWEN STREET, SUITE 200

 MOBILE, AL 36602

 PHONE: (205) 462-7000

 FAX: (205) 462-7000

KBR

 Engineering Services by

 KBR Engineering Co., LLC


FEMA EMERGENCY RADIO NETWORK
 ON WIGAN PORTLAND, MAINE

GROUNDING & POWER PLAN

Drawing Number:
E-105

CONTINUED ON DRAWINGS E-102 & E-103


CONTINUED ON DRAWING E-104

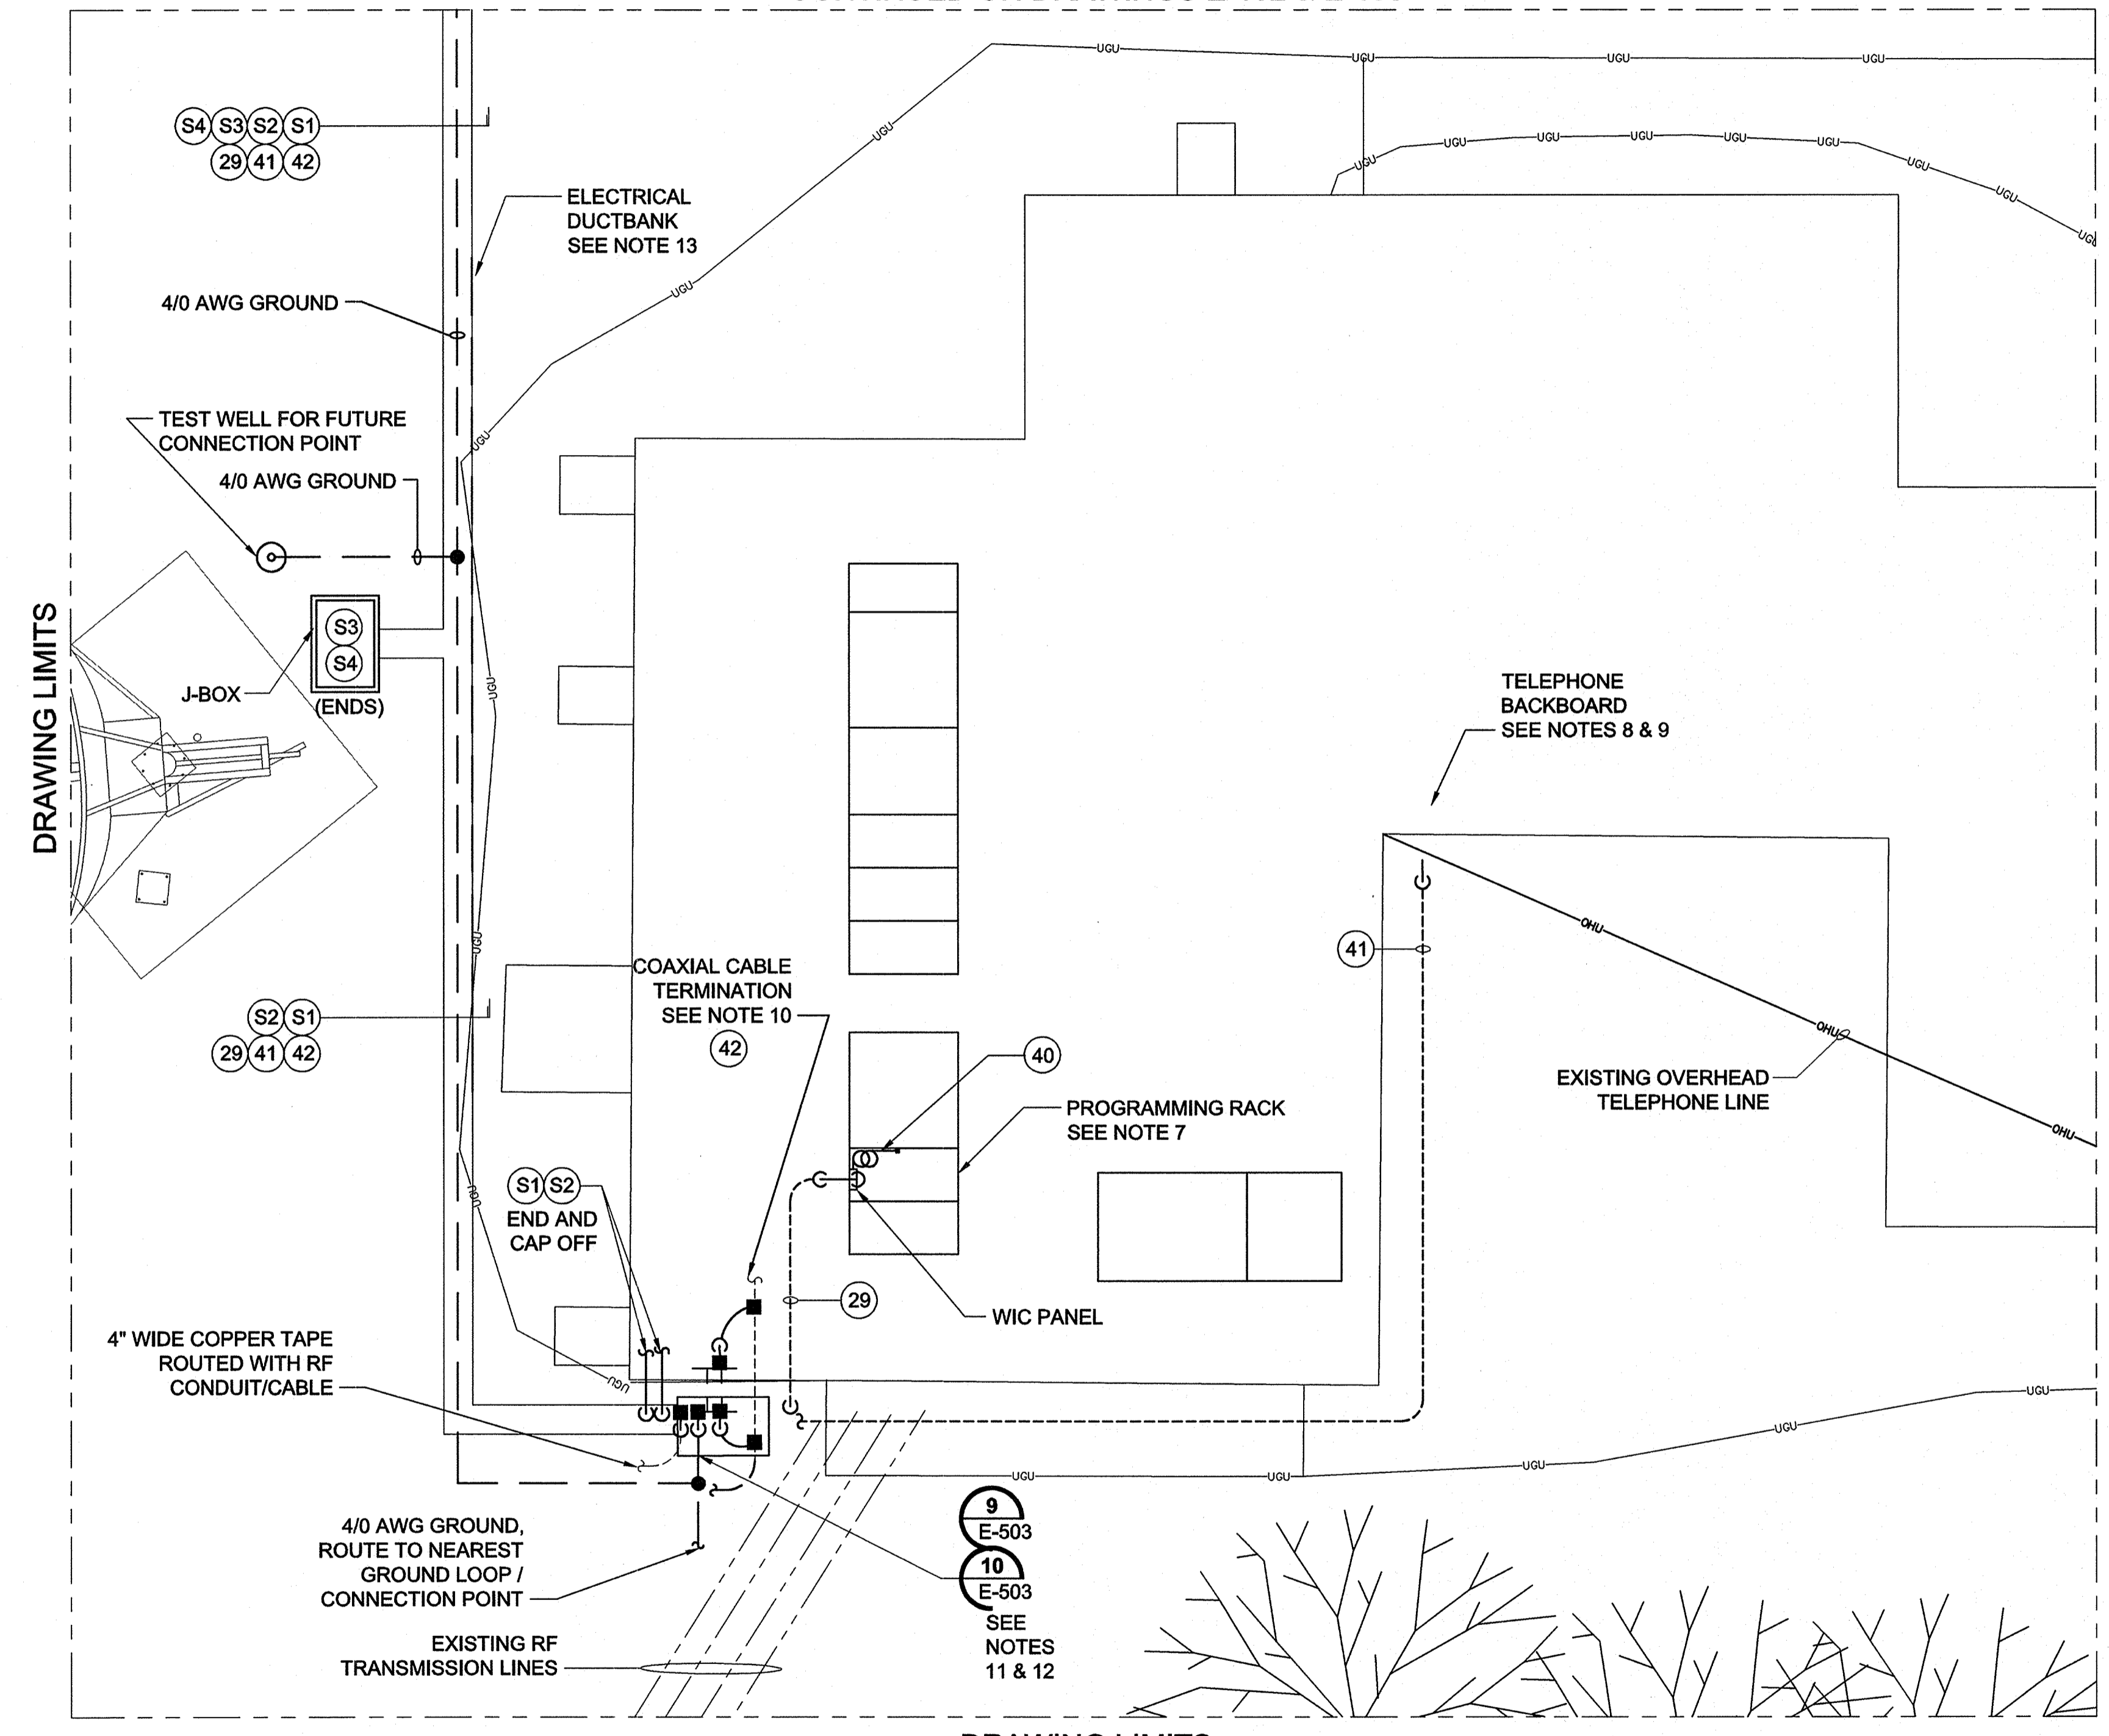


LEGEND:


- UNDERGROUND CONDUIT
- ABOVE GROUND CONDUIT
- ⊙ GROUND ROD, 3/4" X 10' SECTIONAL COPPER CLAD
- EXOTHERMIC WELD, SEE DETAIL FOR TYPE
- MECHANICAL GROUND CONNECTION, SEE DETAIL FOR TYPE
- ⊙ GROUNDING TEST WELL
- 4" WIDE (.016" TO .022") COPPER RF BONDING TAPE
- 3" C 7/8" RF COAXIAL CABLE
- G CONDUIT / CABLE TURNED DOWN
- O CONDUIT / CABLE TURNED UP
- TT GROUNDING BUS BAR
- ⊕ GROUND CONNECTION TO FOUNDATION REBAR LOCATION AT LOWEST LEVEL (UFER GROUND)
- ⊞ HIGH PRESSURE SODIUM WALL MOUNTED FIXTURE, 70 WATT, 120 VAC, FURNISHED WITH MODULES. CONTRACTOR SHALL MOUNT LIGHTS AND DISCONNECT THE INTERGAL PHOTO ELECTRIC CELL(S). T.O.F. ELEVATION 9'-0" A.F.G.
- ⊗ CABLE NUMBER (SEE E-403)
- ⊗⊗⊗-X INSTRUMENT TAG
- ⊗⊗⊗ E-5XX DETAIL/SHEET #

A GROUNDING & POWER PLAN
 E-101 SCALE: 3/8"=1'-0"
 1' 0' 1' 5' 10'
 3/8"=1'-0"

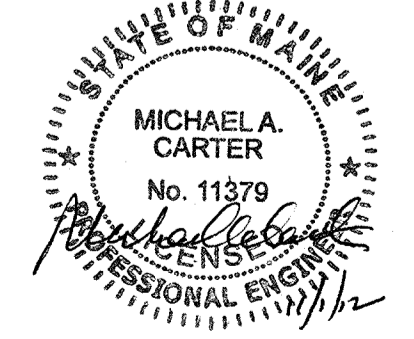

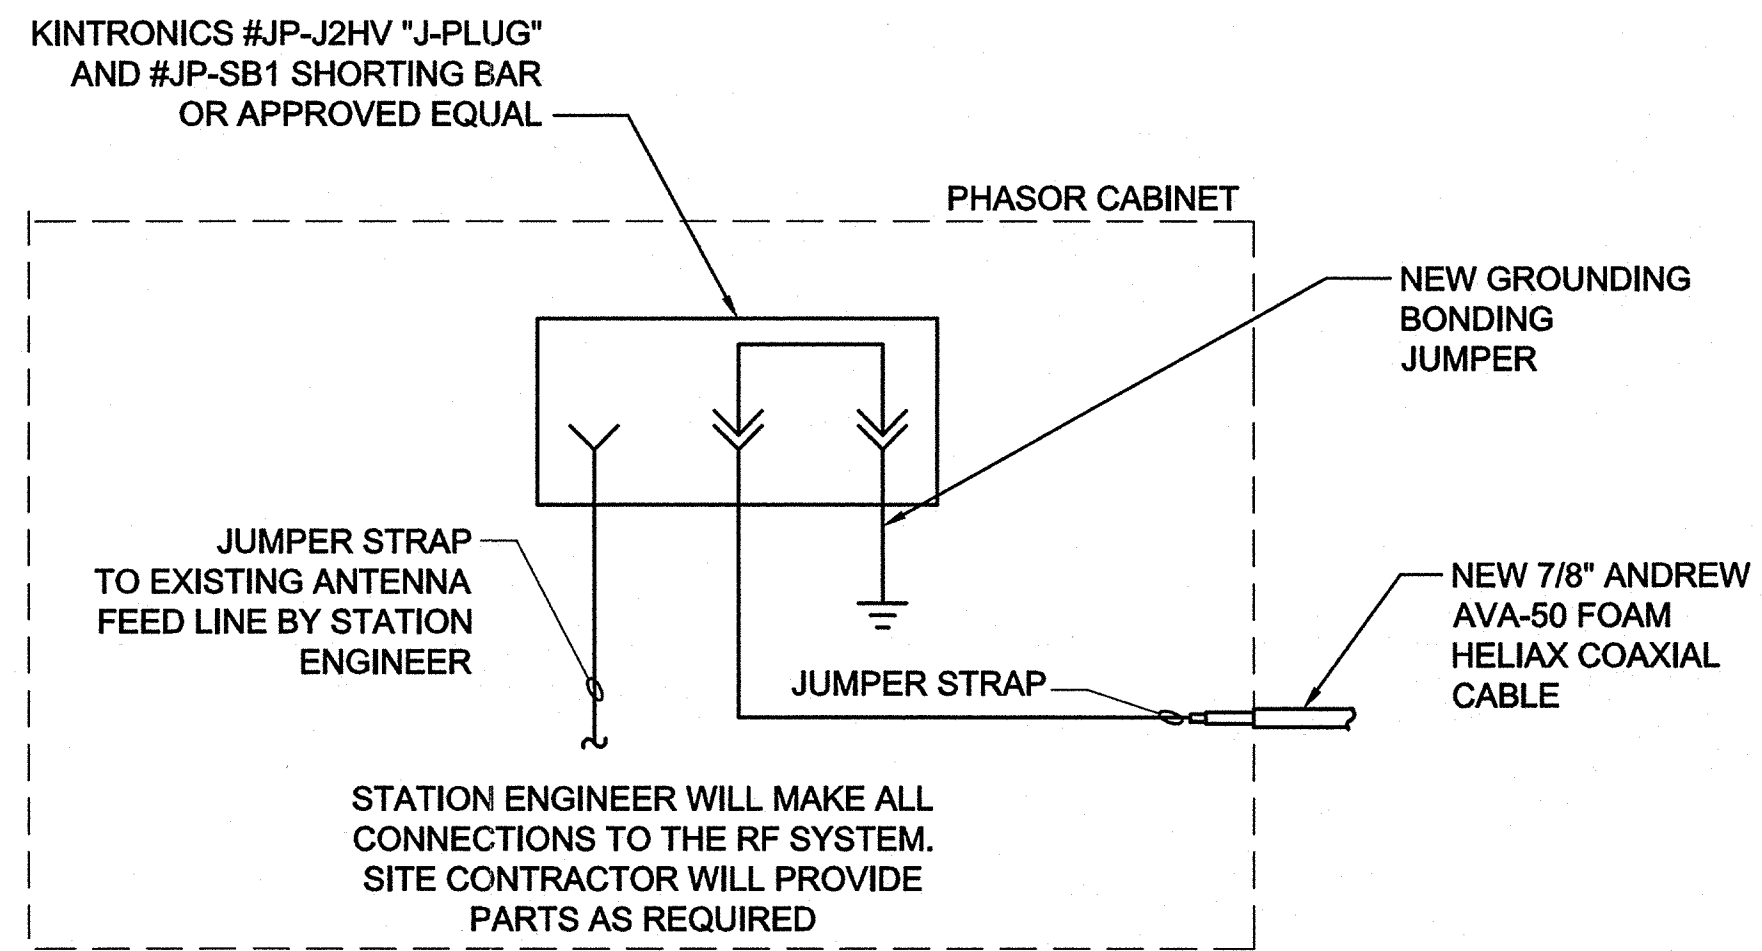

RF CONNECTION DIAGRAM

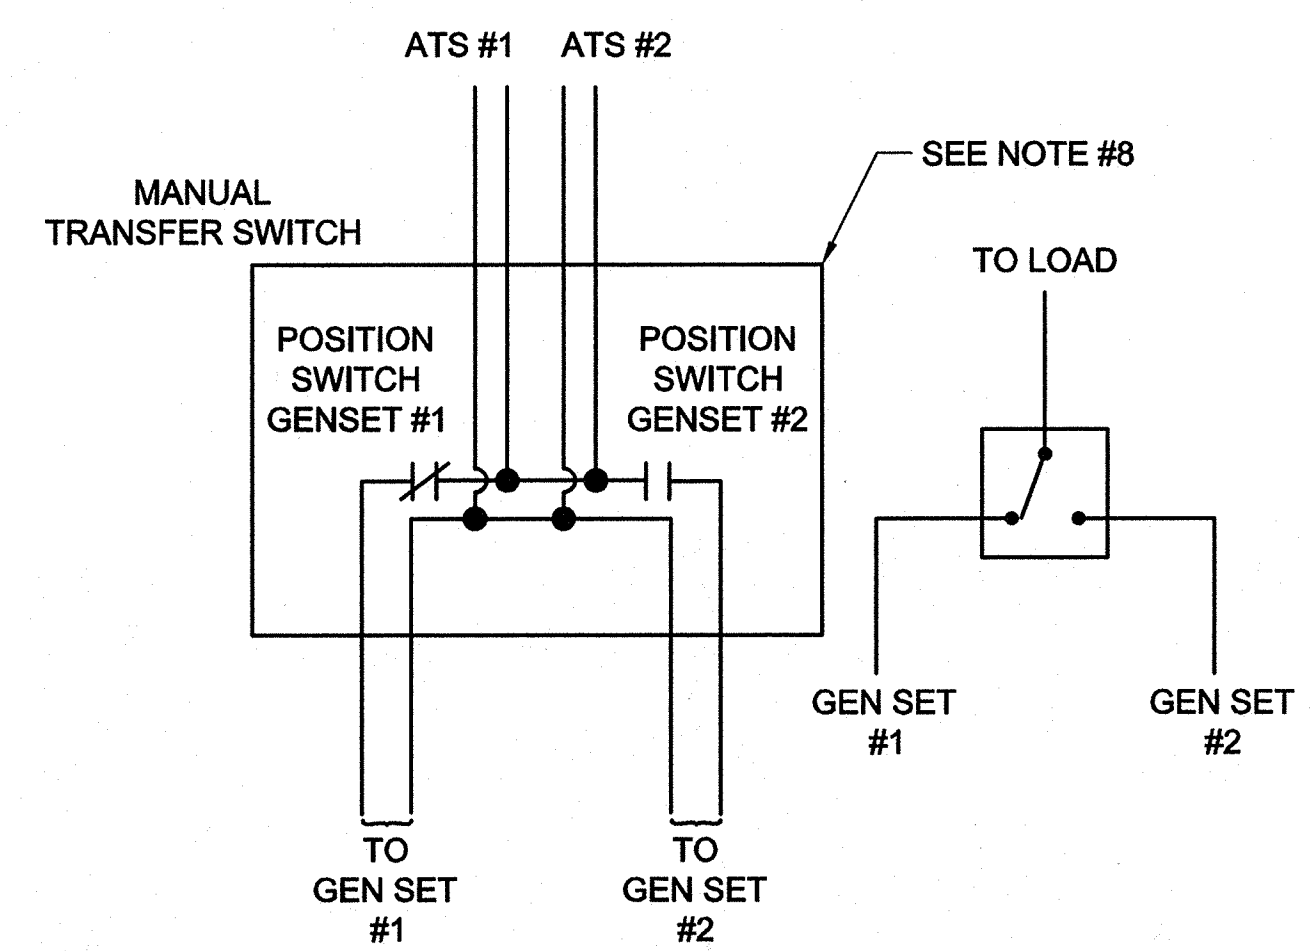


GENERATOR RUN SIGNAL MODIFICATION

NOTES:


1. ALL ELECTRICAL INSTALLATIONS SHALL BE IN ACCORDANCE WITH THE 2011 EDITION OF THE NATIONAL ELECTRICAL CODE (NEC NFPA 70) AND THE OCCUPATIONAL SAFETY AND HEALTH ACT (OSHA) AND PROJECT SPECIFICATIONS AND APPLICABLE CODES AND STANDARDS.
2. POWER PLUG FED FROM GENERATOR MODULE POWER PANEL "B". SEE CELLXION DRAWINGS FOR SHORE PLUG /RECEPTACLE CIRCUIT AND CONNECTIONS.
3. ALL SHUT DOWN WORK REQUIRED SHALL BE PLANNED AND APPROVED BY THE STATION ENGINEER BEFORE PROCEEDING. PROVISIONS SHALL BE PROVIDED TO MAINTAIN SERVICE DURING SHUTDOWN PERIODS.
4. CONTRACTOR SHALL PROVIDE AND INSTALL TVSS-SURGE SUPPRESSOR INC. ADVANTAGE MODEL CDLA3Y1-XS OR APPROVED EQUAL.
5. THE NEUTRAL BONDING JUMPER FURNISHED WITH THE GENERATOR SHALL BE REMOVED. THE GENERATOR SHALL NOT BE CONSIDERED A SEPARATELY DERIVED SYSTEM.
6. CONTRACTOR SHALL VERIFY POSITION OF BY-PASS SWITCH HANDLE MATCHING POSITIONS WITH THE GENERATOR MODULE TRANSFER SWITCH.
7. THE AUTOMATIC START/RUN SIGNAL TO THE EXISTING GENERATOR SHALL BE MODIFIED AND ROUTED THROUGH THE NEW MANUAL TRANSFER SWITCH POSITION SWITCHES.
8. CONTRACTOR SHALL FURNISH AND INSTALL A DOUBLE THROW SWITCH 600 VAC 400 AMP NEMA 12 SIEMENS CAT NO. NF355HDTR WITH HN678 NEUTRAL KIT, HG656 GROUND KIT, AND 2 EACH HA165678 AUX CONTACTS. SWITCH SHALL BE SERVICE ENTRANCE RATED.
9. CONTRACTOR SHALL PROVIDE AND INSTALL A NEW 400 AMPERE AUTOMATIC TRANSFER SWITCH 208Y/120 VAC SERVICE ENTRANCE RATED WITH INTERNAL TVSS 3 PHASE 4 WIRE. ASCO CATALOG NUMBER 3AUS-B-3-400-C-1-X-C-11BG-14AA-14BA-73A-208V/60 OR APPROVED EQUAL. CONTRACTOR SHALL VERIFY LUG SIZE AND CAPACITY DURING PURCHASE TO ENSURE COMPATABILITY WITH SYSTEM DESIGN REQUIREMENTS.
10. CONTRACTOR SHALL FURNISH AND INSTALL SERVICE ENTRANCE RATED DISCONNECT SWITCHES, 240VAC, 400 AMP, 3 PHASE, 4 WIRE, FUSABLE, NEMA 3R/3S ENCLOSURES WITH 400 AMP FUSES. EATON CAT NO. DH325NRK-N OR APPROVED EQUAL.

LEGEND:




- * DENOTES WIRE / CABLE ONLY (EXISTING CONDUIT)
- EXISTING SYSTEM
- NEW MODIFICATION(S)

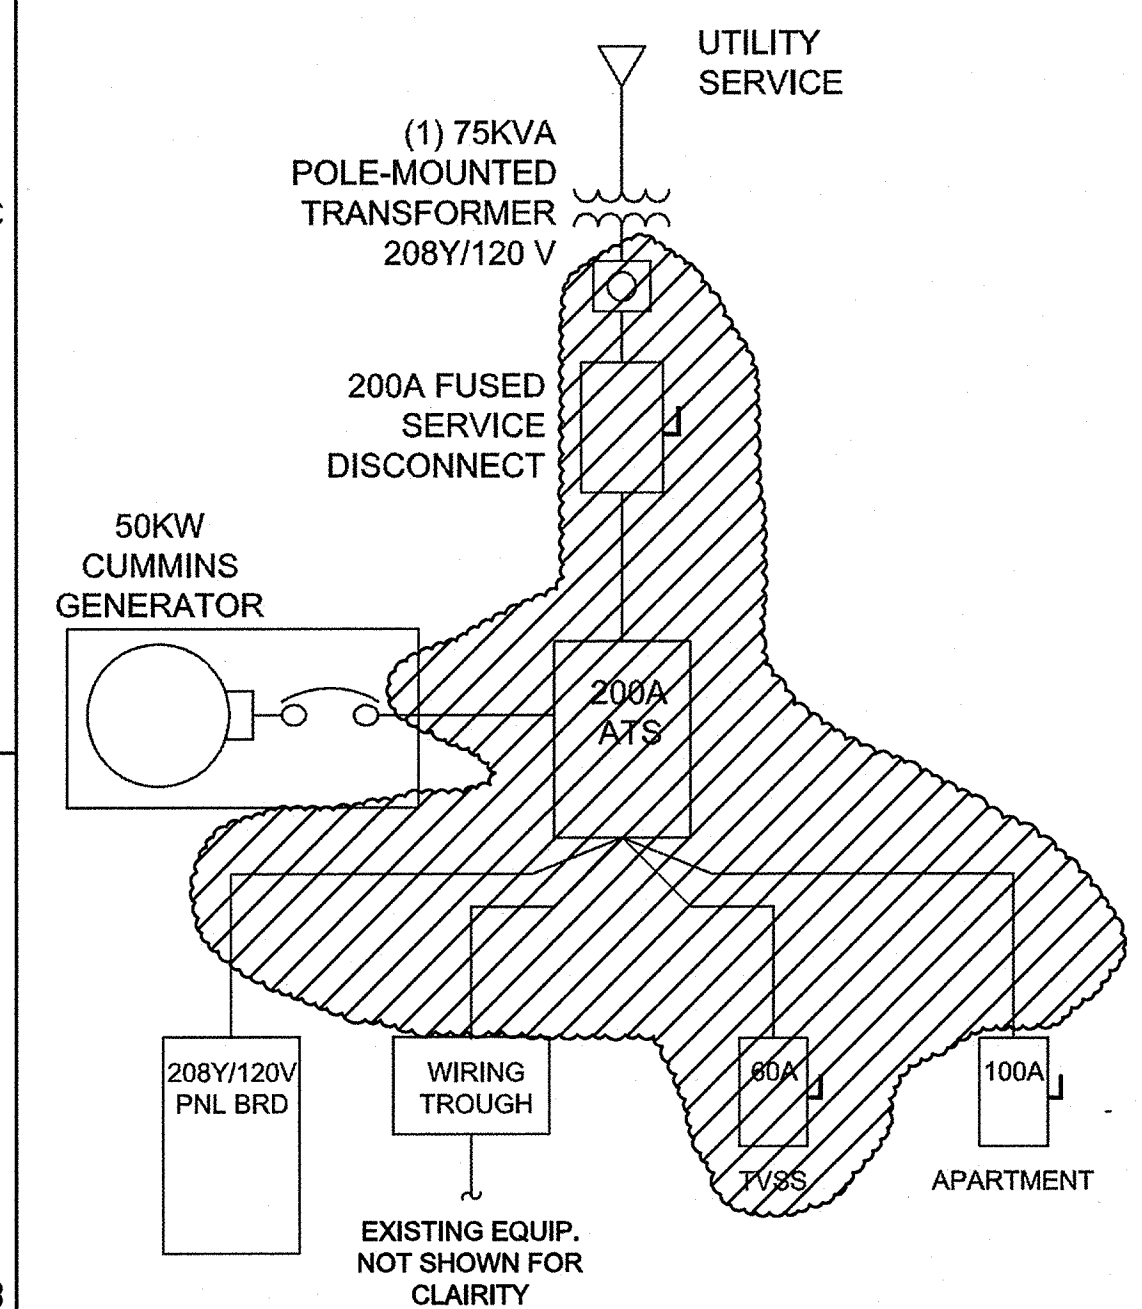

EXISTING POWER RISER DIAGRAM

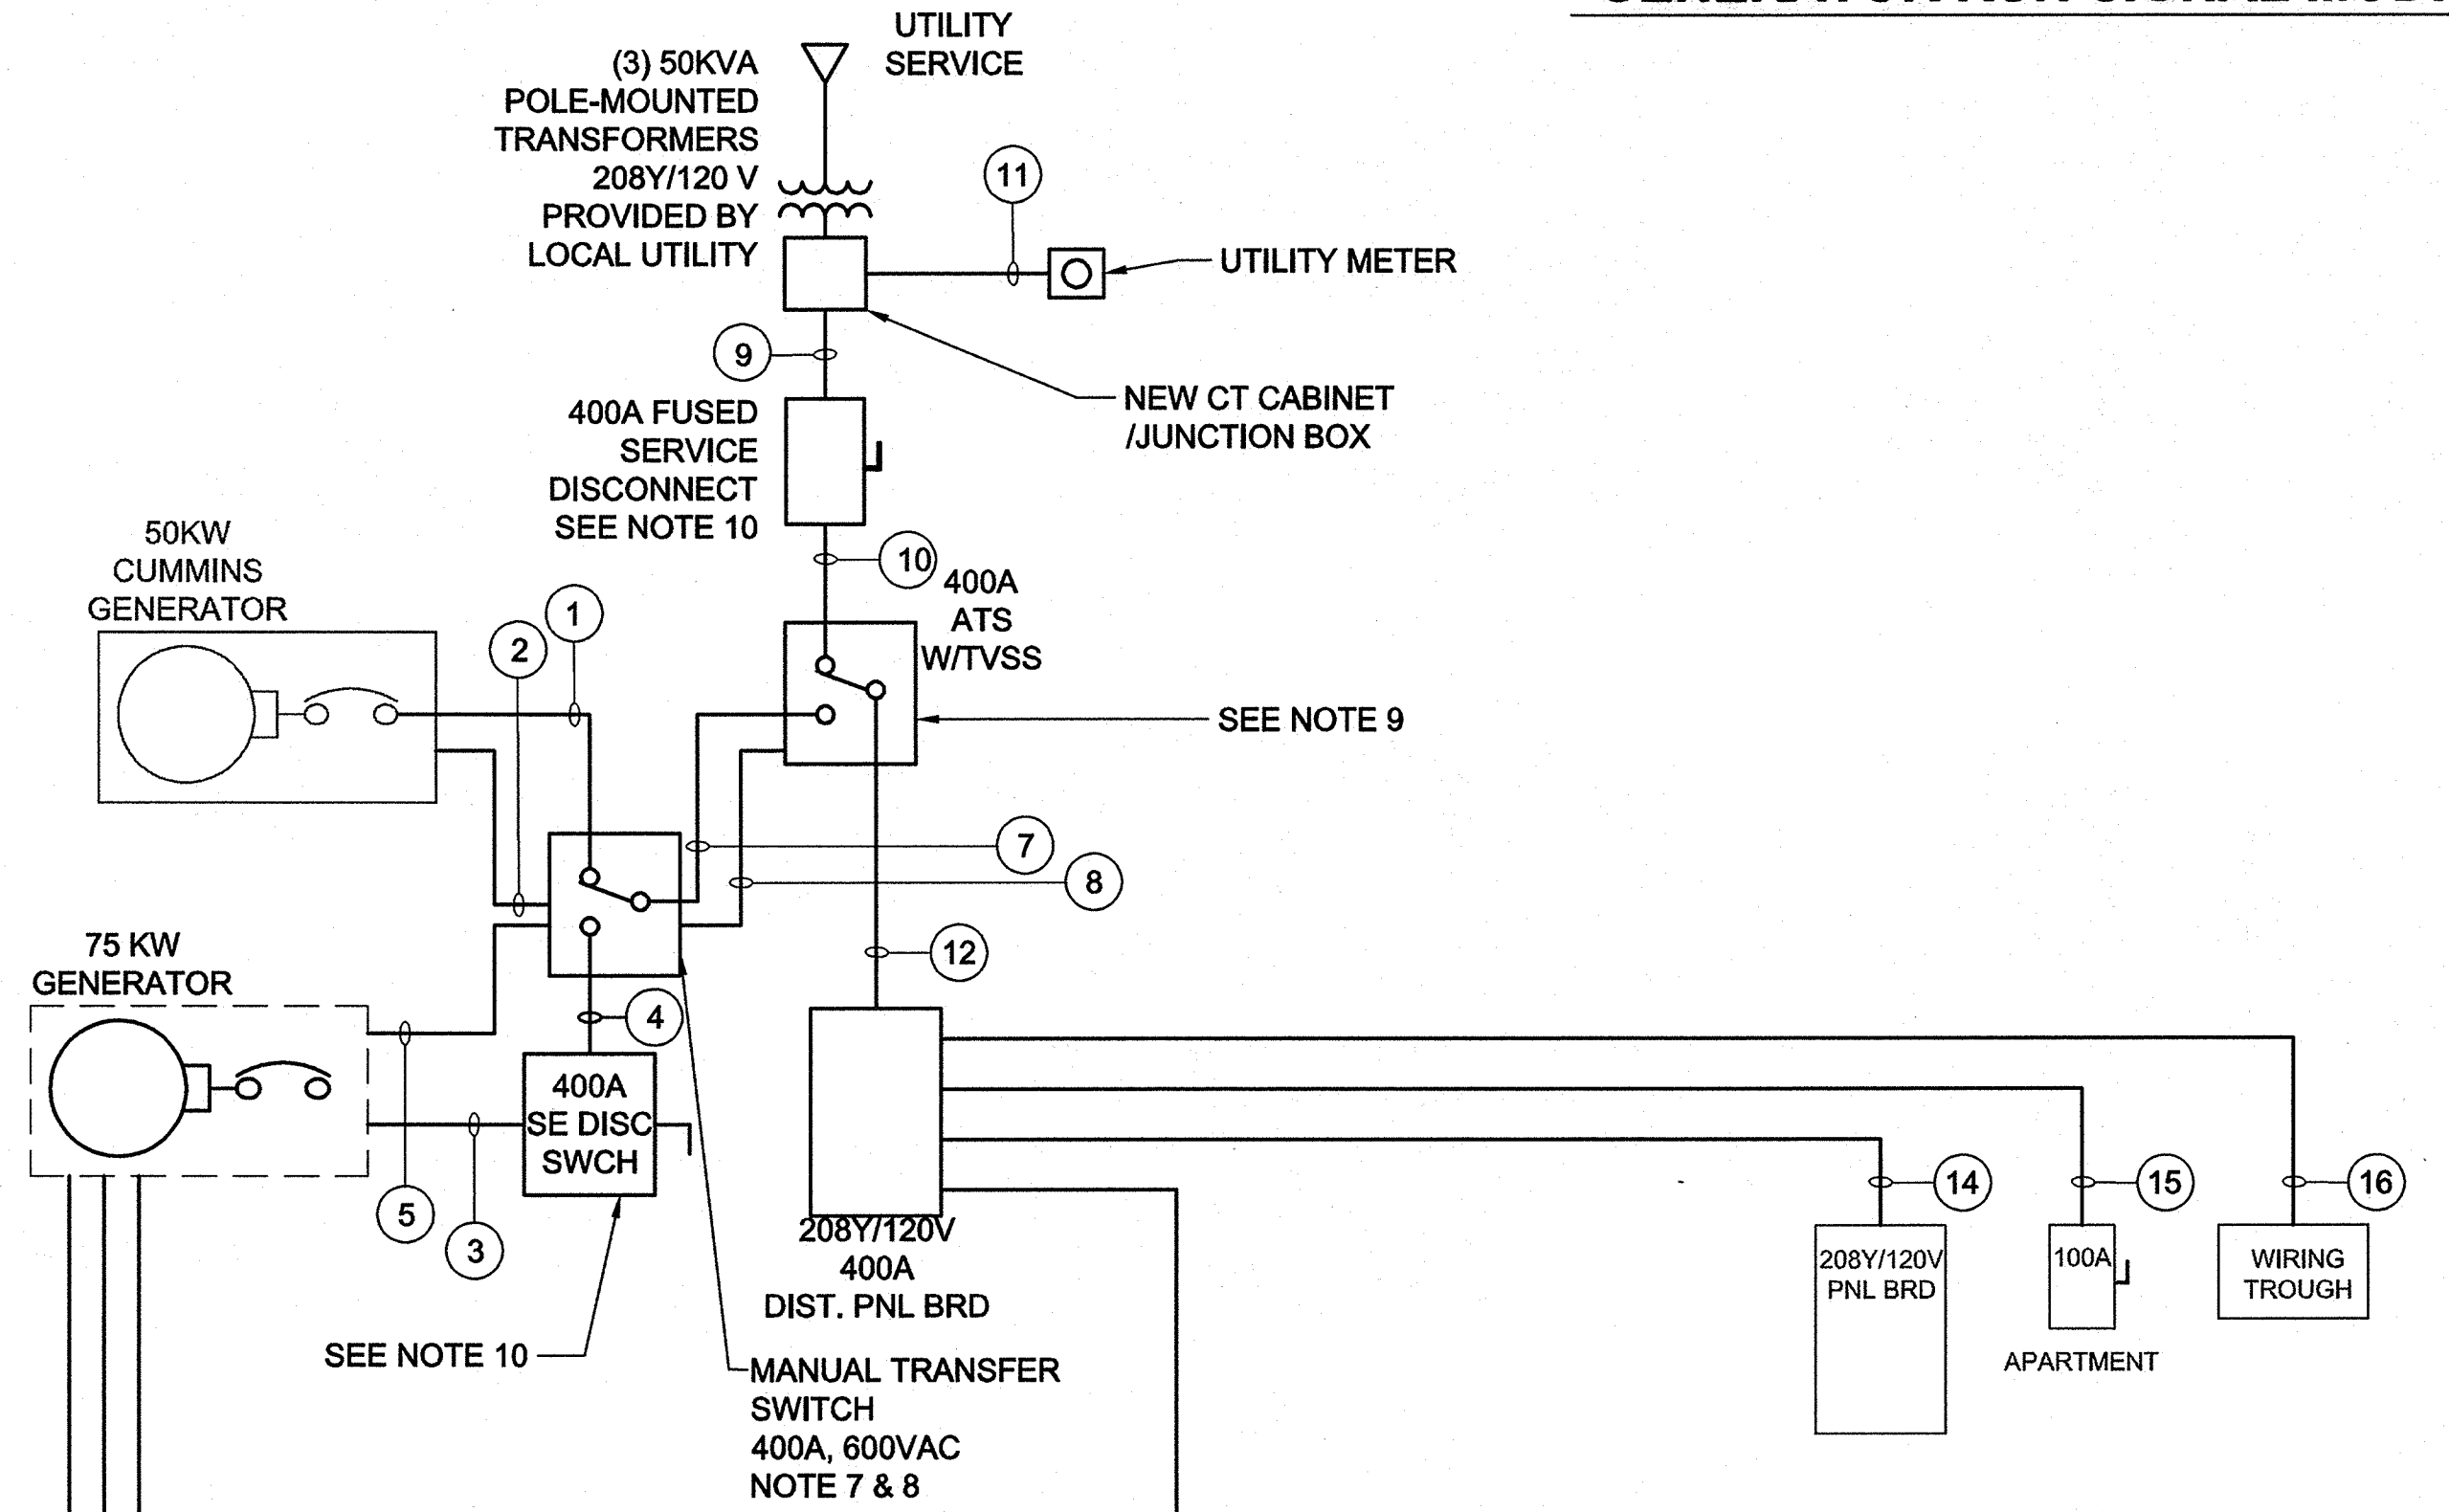

MODIFIED POWER RISER DIAGRAM

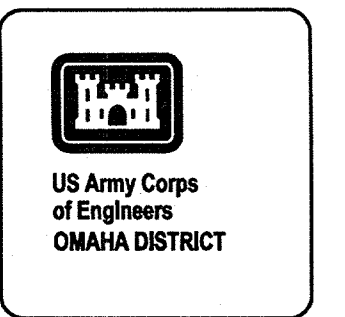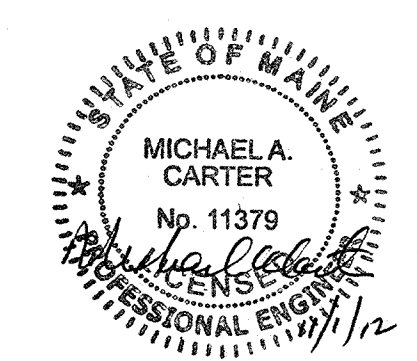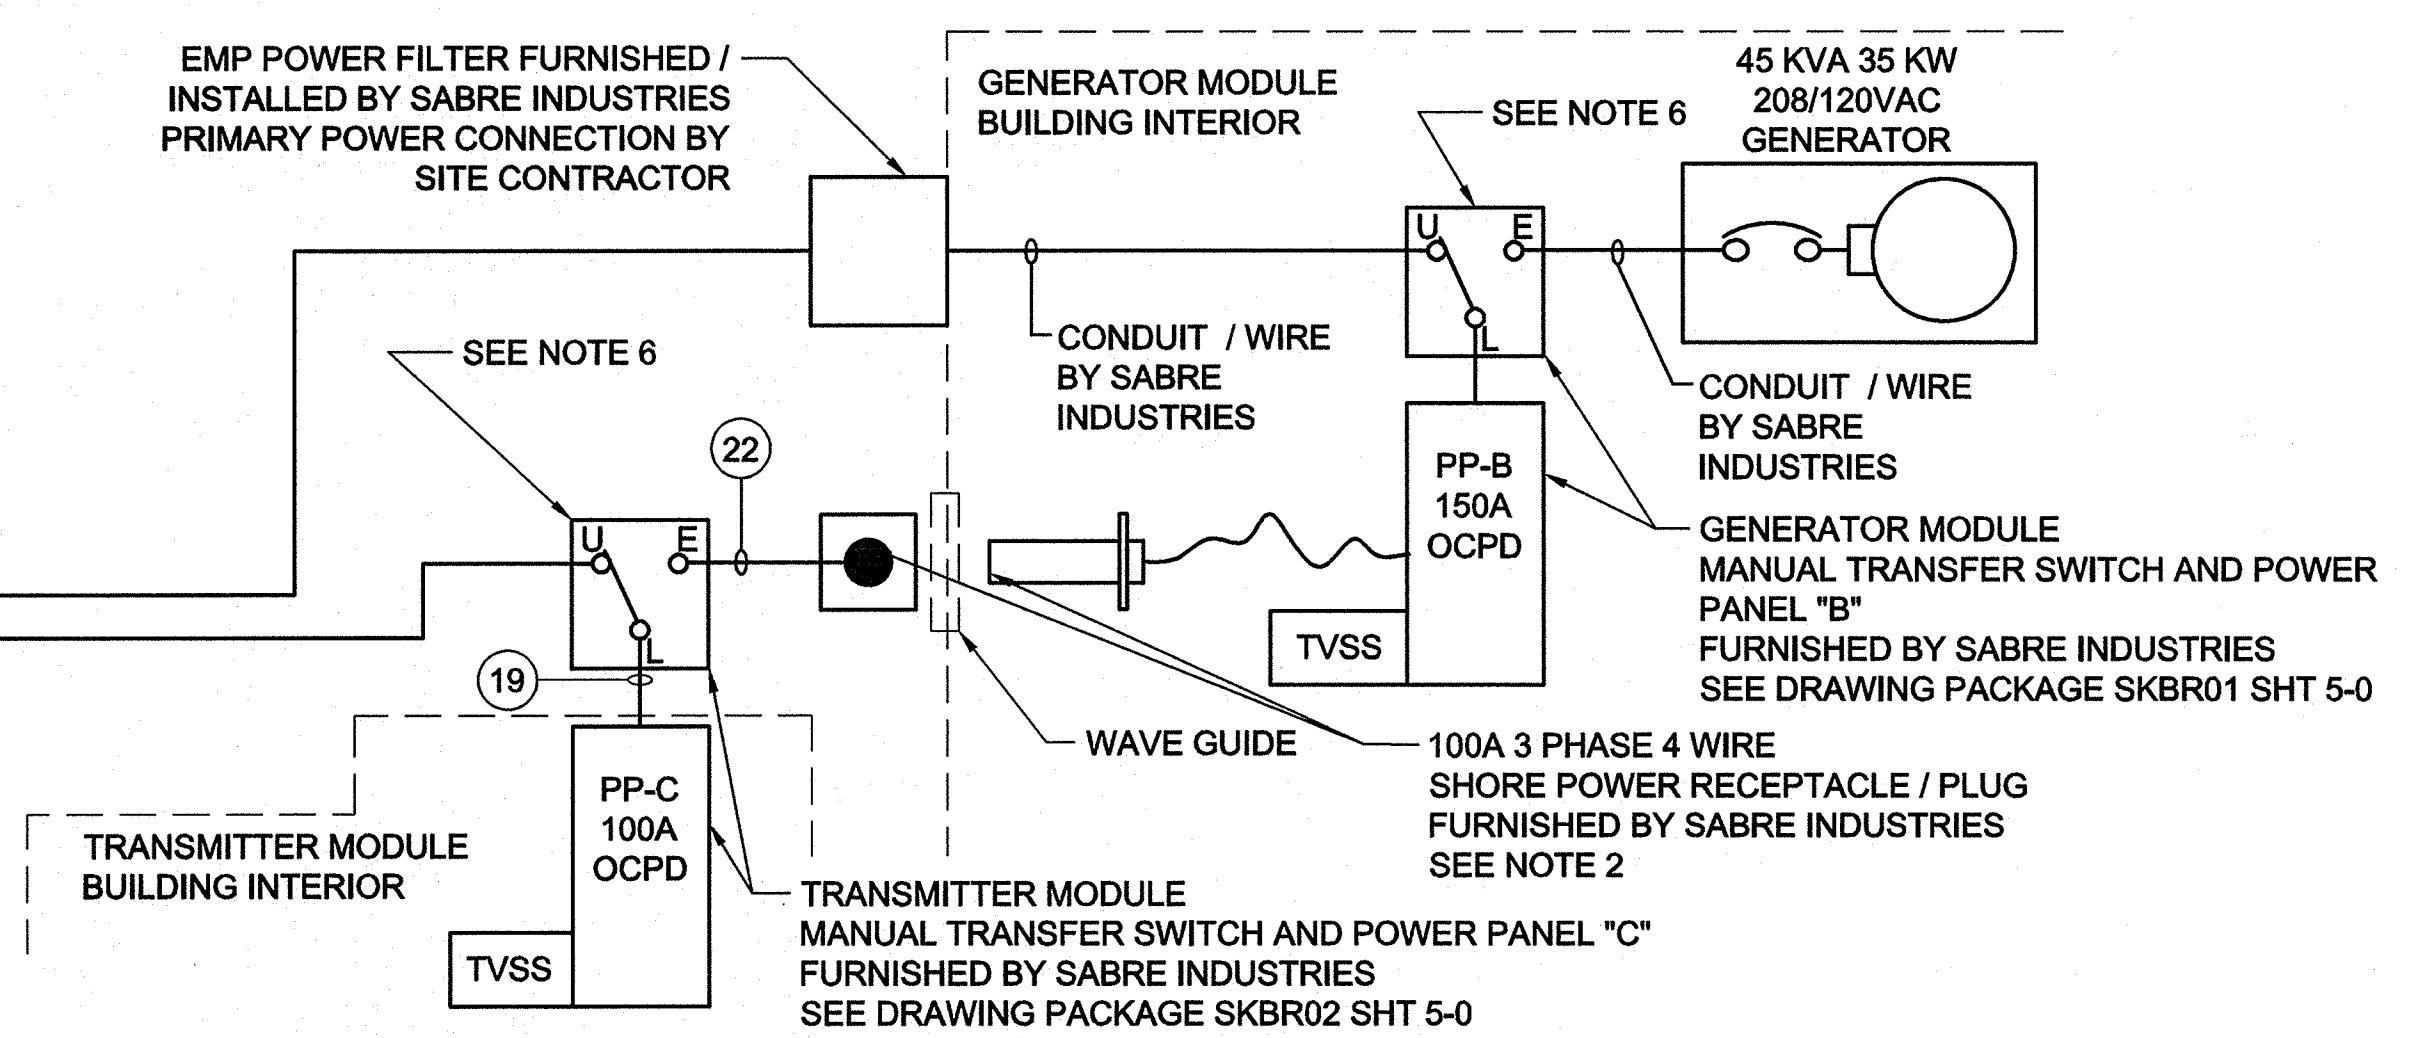

Project Manager	DC Reviewer	Structural	Mechanical	Plumbing	Electrical	Other


Mark	0	11/7/12	Approved
Description	ISSUED FOR CONSTRUCTION		

Designed by	SDJ	Checked by	TCG
Drawn by	SDJ	Reviewed by	TCG
Date	2012		

FEMA KBR Engineering Services by KBR Engineering Co., LLC
 63 SOUTH NOVA STREET, SUITE 200
 MOBILE, AL 36602
 PHONE: (251) 467-1000
 FAX: (251) 467-1001

TRANSMITTER / GENERATOR ELECTRICAL PANEL SCHEDULES


Drawing Number:
E-401

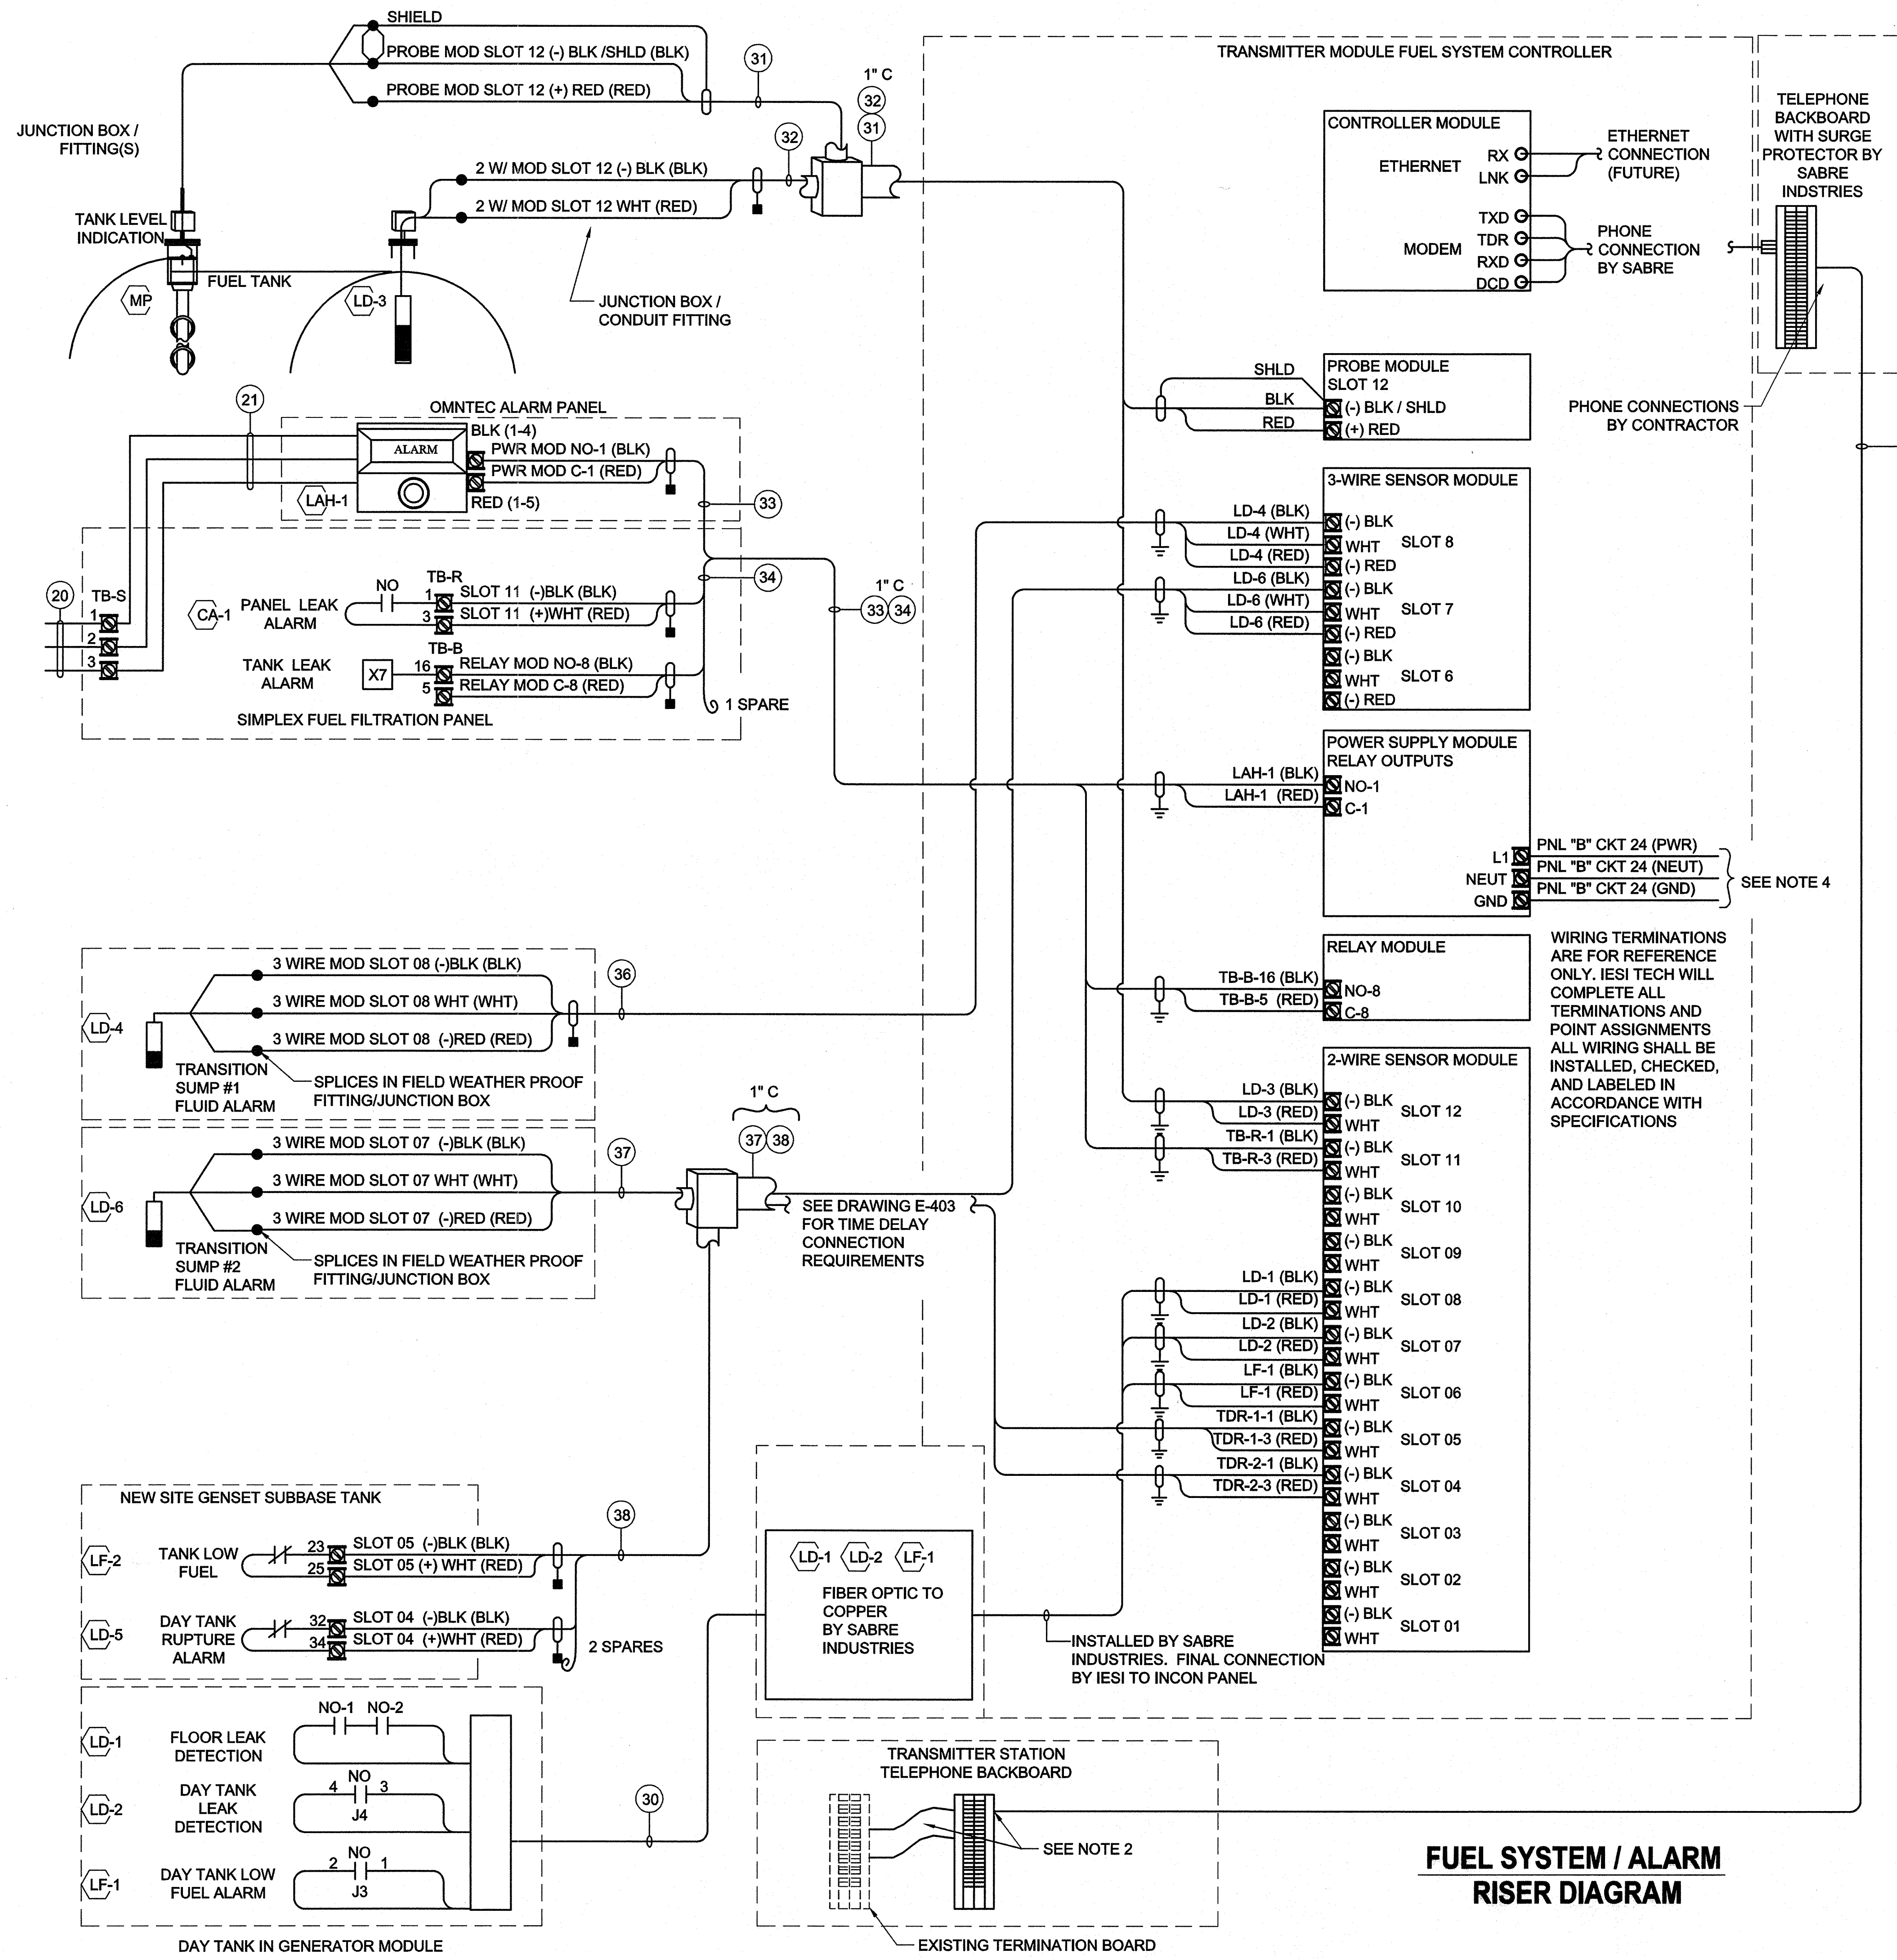

NOTES:


- ALL ELECTRICAL INSTALLATIONS SHALL BE IN ACCORDANCE WITH THE 2011 EDITION OF THE NATIONAL ELECTRICAL CODE (NEC NFPA 70) AND THE OCCUPATIONAL SAFETY AND HEALTH ACT (OSHA) AND PROJECT SPECIFICATIONS AND APPLICABLE CODES AND STANDARDS.
- CONTRACTOR SHALL ROUTE A 25 PAIR OSP COMMUNICATION CABLE TO THE EXISTING COMMUNICATION BACKBOARD INSTALLING A NEW SURGE PROTECTED 66 BLOCK CIRCA TELECOM 2625QC-3B1E OR EQUAL WITH ANALOG GAS TUBE SURGE PROTECTORS IDENTIFYING CONDUCTORS TO BE UTILIZED FOR CROSS CONNECTION. ALL PAIRS SHALL BE TERMINATED TO THE 66 BLOCKS WITH UTILIZED PAIRS IDENTIFIED / NOTED. SEE NOTE 8 ON DRAWING E-105 AND SABRE INDUSTRIES DRAWING SKBR02 SHT 5-4 FOR UTILIZED PAIR NUMBERS.
- ALL INSTRUMENT / CONTROL CABLES SHALL BE INDIVIDUALLY SHIELDED DUE TO HIGH RF SIGNALS. SHIELDS SHALL BE BONDED AT THE CONTROLLER AND TAPED AT THE DEVICES. UNLESS SHOWN DIFFERENTLY BY MANUFACTURER TERMINATION DRAWINGS.
- SEE CONTROLLER SUPPLIER DRAWINGS FOR WIRING TERMINATIONS AND WIRING REQUIREMENTS. FUEL SYSTEM RISER DIAGRAM IS DIAGRAMMATIC CABLING SIZE AND QUANTITY MAY VARY DEPENDING ON FURNISHED EQUIPMENT REQUIREMENTS.
- ALL CONTACTS ARE SHOWN IN DE-ENERGIZED POSITIONS CONSIDERED "FAIL SAFE" WHICH WILL ALSO INDICATED AN ALARM STATE OF THE DEVICE.
- CONTRACTOR SHALL INSTALL WIRING FROM TERMINAL BLOCK TB-S IN THE SIMPLEX CONTROLLER TO THE OMNTEC ANNUNCIATOR.
- FIBER OPTIC FAN OUT KITS SHALL BE INSTALLED AT TERMINATION POINTS FOR FIELD TERMINATIONS. TYE-RAPS SHALL BE LEFT LOOSE AND LONG RADIUS LOOPS FORMED FOR ROUTING THE FIBERS WITHIN THE PANELS. CONNECTOR SHALL BE INSTALLED ON ALL FIBERS AND OPTICAL LOSE TEST PERFORMED ON THE SYSTEM AT A MINIMUM.

FIBER OPTIC RISER DIAGRAM

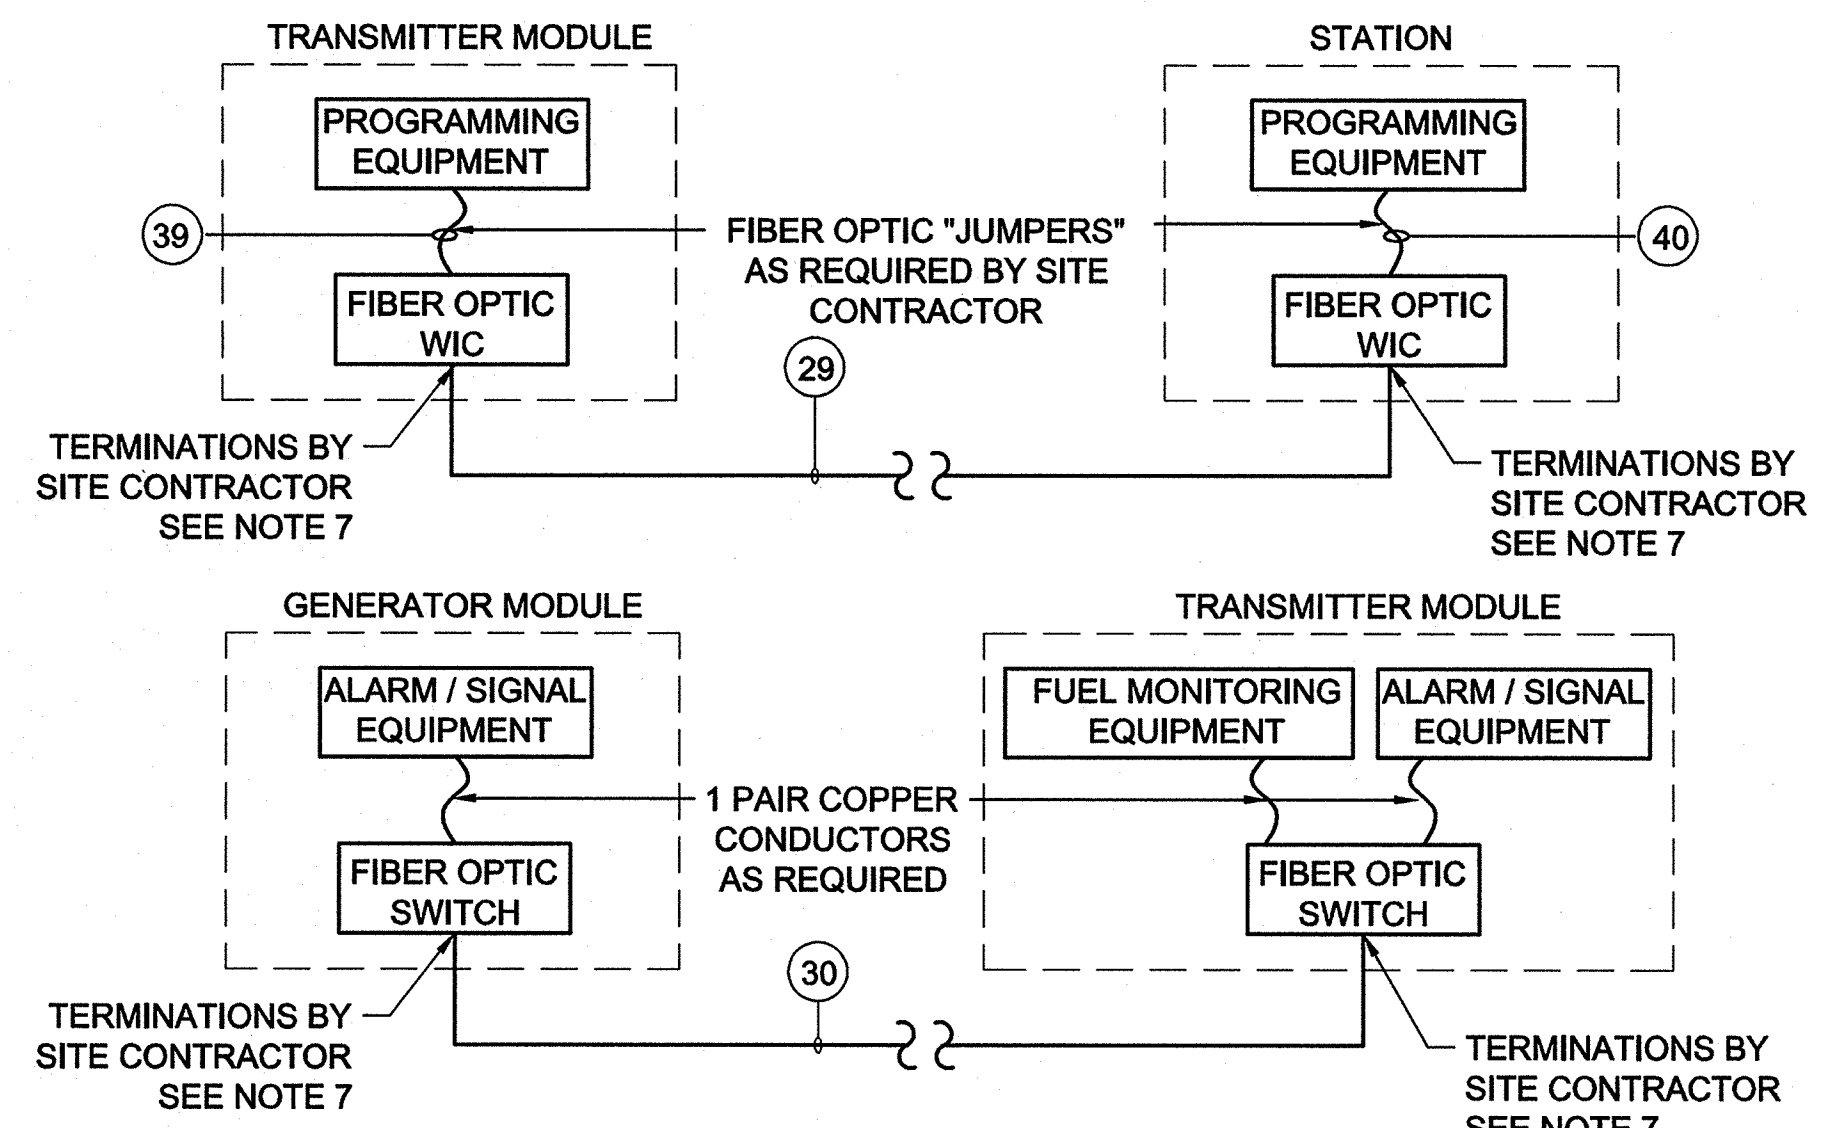

LEGEND:

- * DENOTES WIRE / CABLE ONLY WITHIN CONTROLLER / ENCLOSURE
- CABLE SHIELD TERMINATED TO GROUNDING POINT
- CABLE SHIELD SHOWN CUT AND TAPED NOT TERMINATED

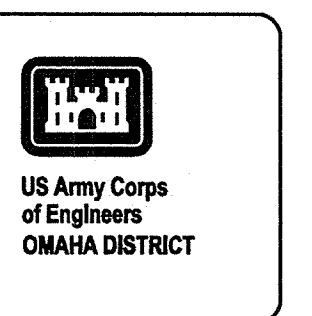


Project Manager	
IC Reviewer	
Structural	
Mechanical	
Electrical	

ISSUED FOR CONSTRUCTION	11/7/12	Approved
Mark		

Designed by: SDJ
 Drawn by: SDJ
 Checked by: TCG
 Reviewed by: SDJ
 Date: 2012

FEMA
KBR
 43 SOUTH ROYAL STREET SUITE 200
 MOBILE, AL 36682
 PHONE (251) 465-7880
 FAX (251) 465-7880


KBR
 Engineering Services by
 KBR Engineering Co., LLC

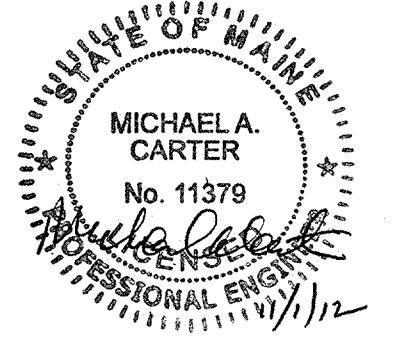


TRANSMITTER / GENERATOR ELECTRICAL RISER DIAGRAMS

Drawing Number:
E-402

CABLING TO TIME DELAY "OFF" RELAY TRIGGER (38)

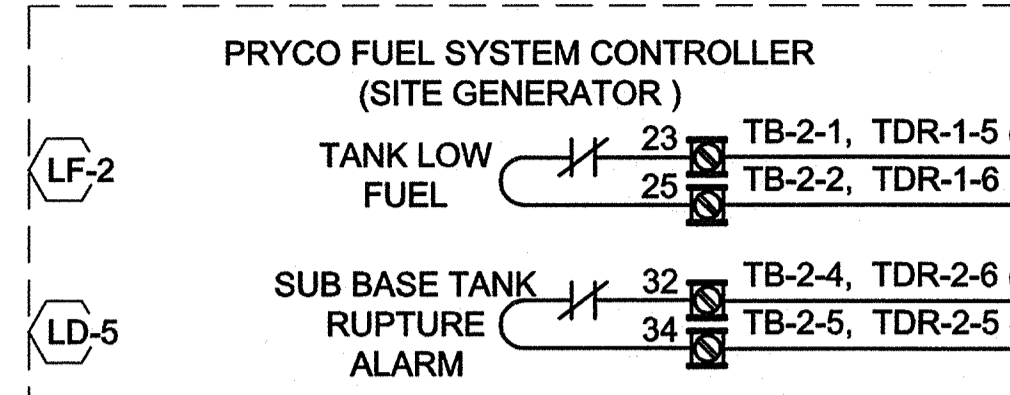

FROM NEW EATON 5130 UPS (CORD SET)

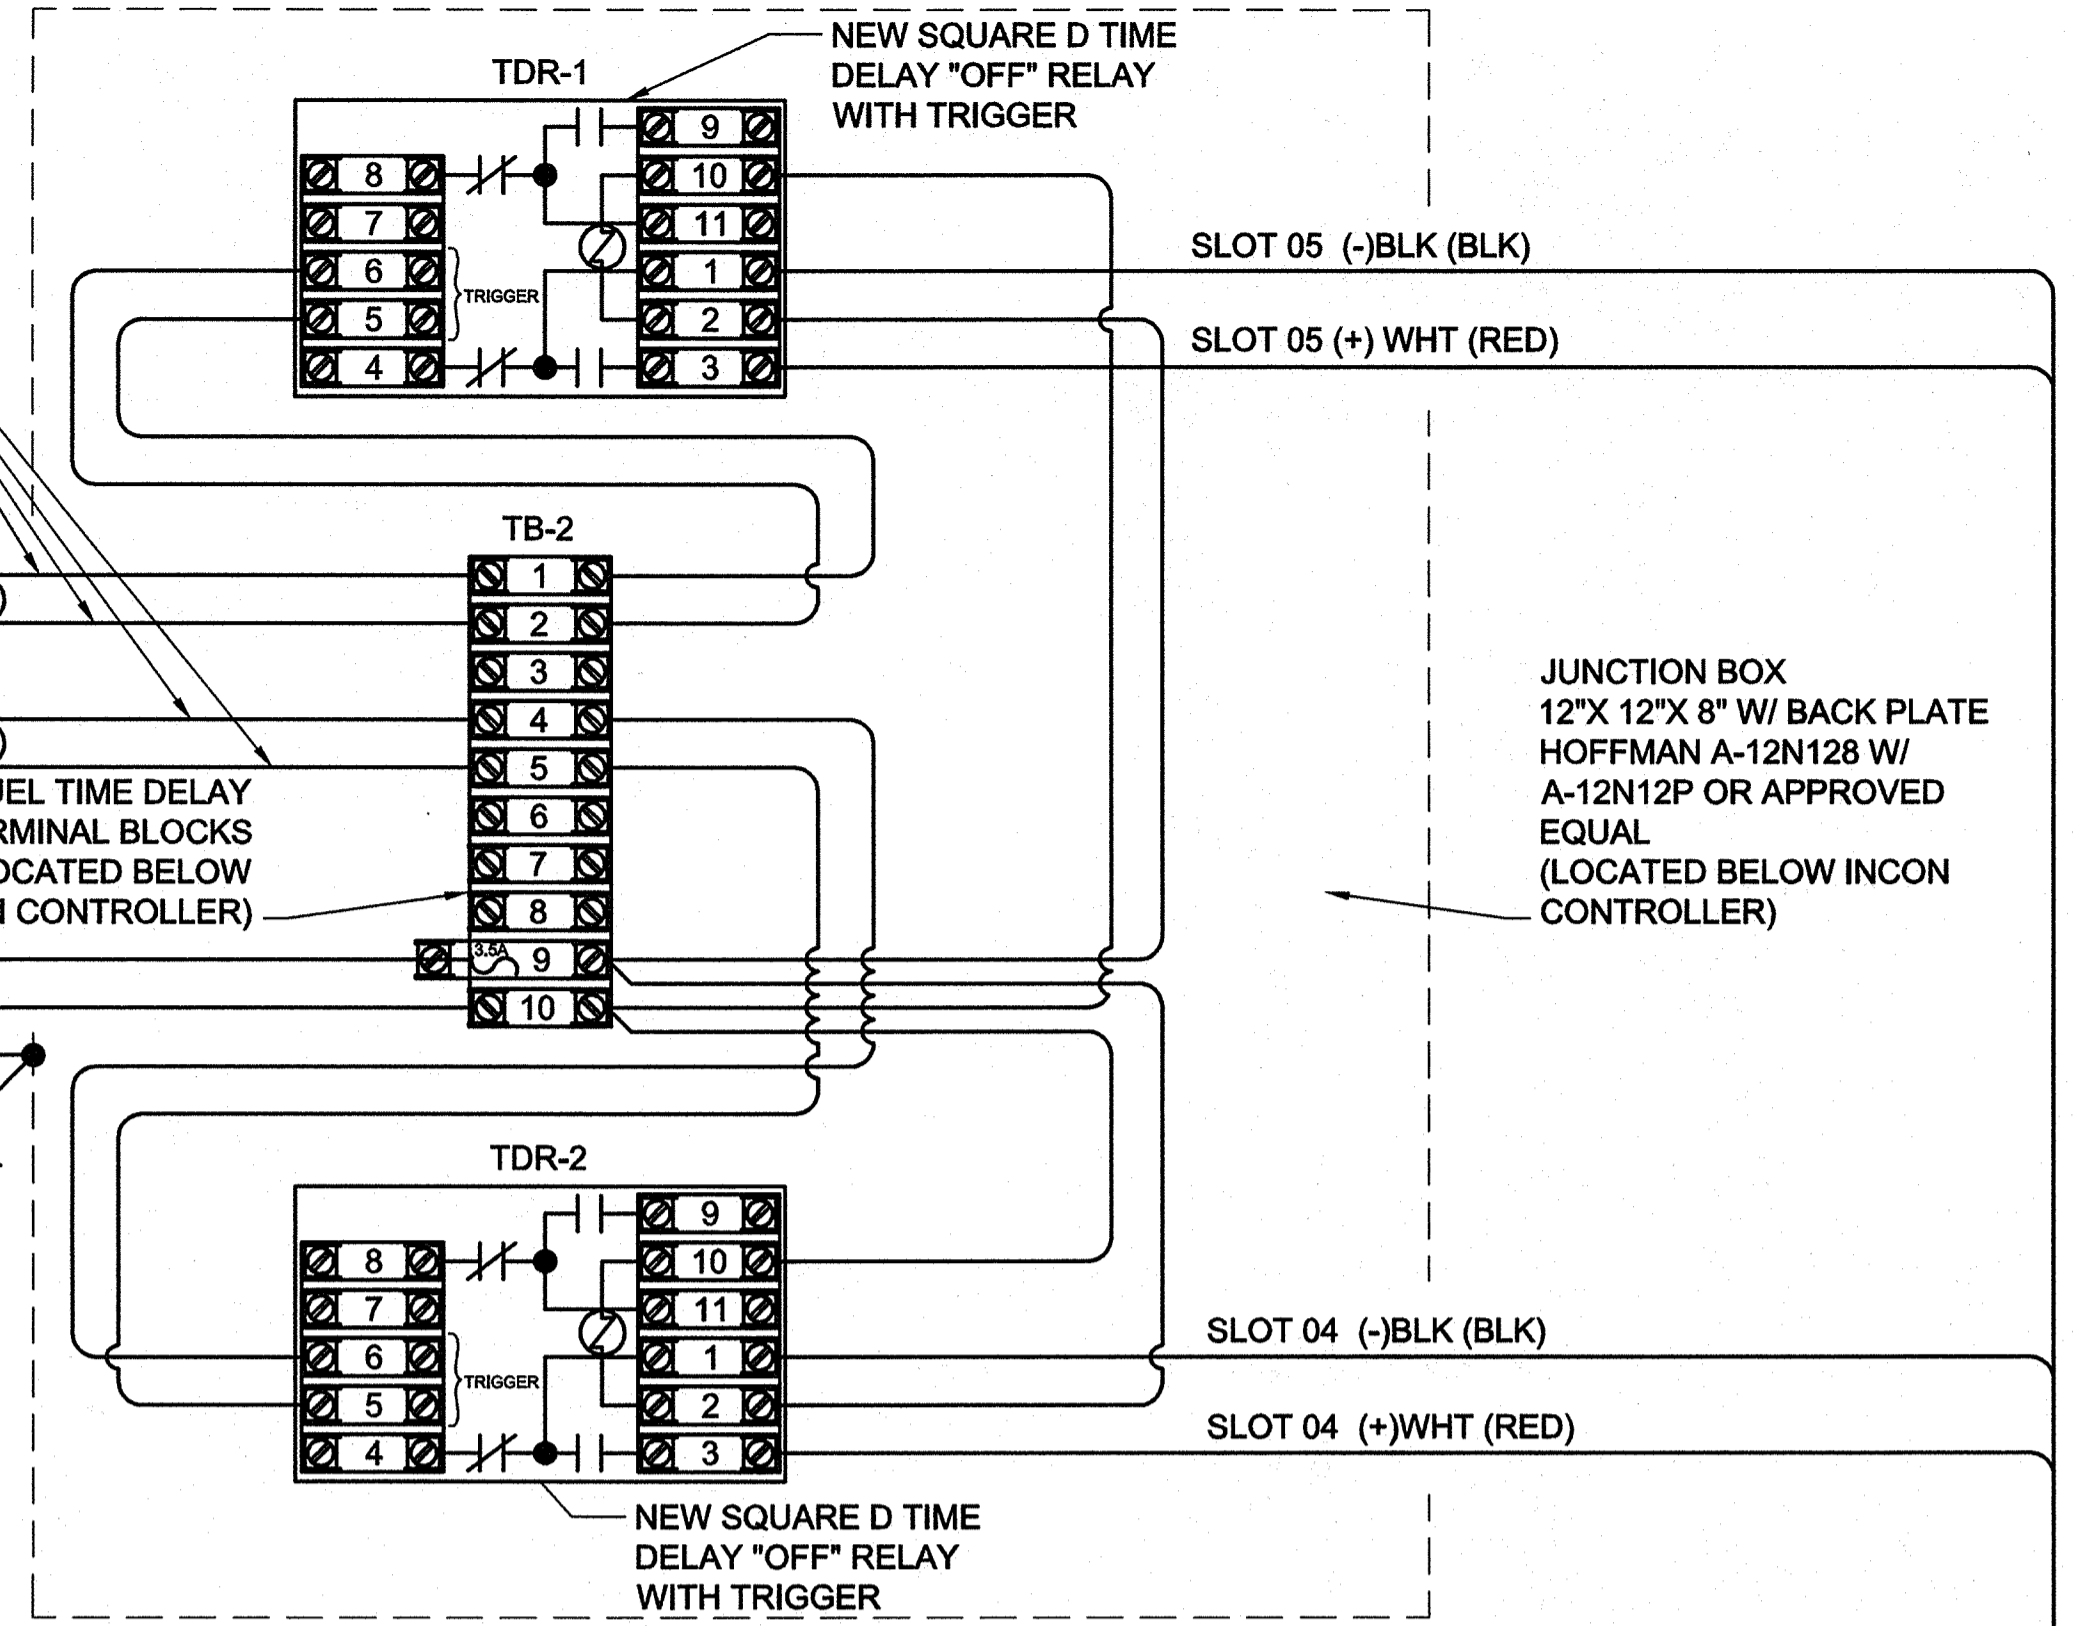



FUEL SYSTEM / ALARM RELAY CONNECTION DIAGRAM

DEVICE DATA:

- ELECTRONIC TIMING RELAY - OFF DELAY SWITCH - CLASS 9050 TYPE JCK2 2 V20 SQUARE D
- SNAPMOUNT SOCKETS -SCREW TERMINAL - 11 PIN TUBULAR SINGLE TIER - 8501NR61 SQUARE D
- 35 mm DIN 3 TRACK MOUNTING RAIL
- TERMINAL BLOCKS - 300VAC RATED - #12AWG - #18AWG DIN RAIL MOUNTING
- FUSED TERMINAL - 300VAC RATED - 10 AMP MAX RATING

RELAY OPERATIONAL DATA:

INPUT VOLTAGE MUST BE APPLIED CONTINUOUSLY. WHEN THE TRIGGER SWITCH CLOSES, THE RELAY CONTACTS CHANGE STATE. WHEN THE TRIGGER SWITCH OPENS, THE TIME DELAY BEGINS. WHEN THE DELAY IS COMPLETE, THE CONTACTS RETURN TO THEIR SHELF STATE. IF THE TRIGGER SWITCH CLOSES BEFORE THE TIME DELAY IS COMPLETE, THEN THE TIMING IS RESET. WHEN THE TRIGGER SWITCH OPENS, THE DELAY BEGINS AGAIN, AND THE RELAY CONTACTS REMAIN IN THE ENERGIZED STATE. IF THE INPUT VOLTAGE IS REMOVED, THE RELAY CONTACTS RETURN TO THEIR SHELF STATE.

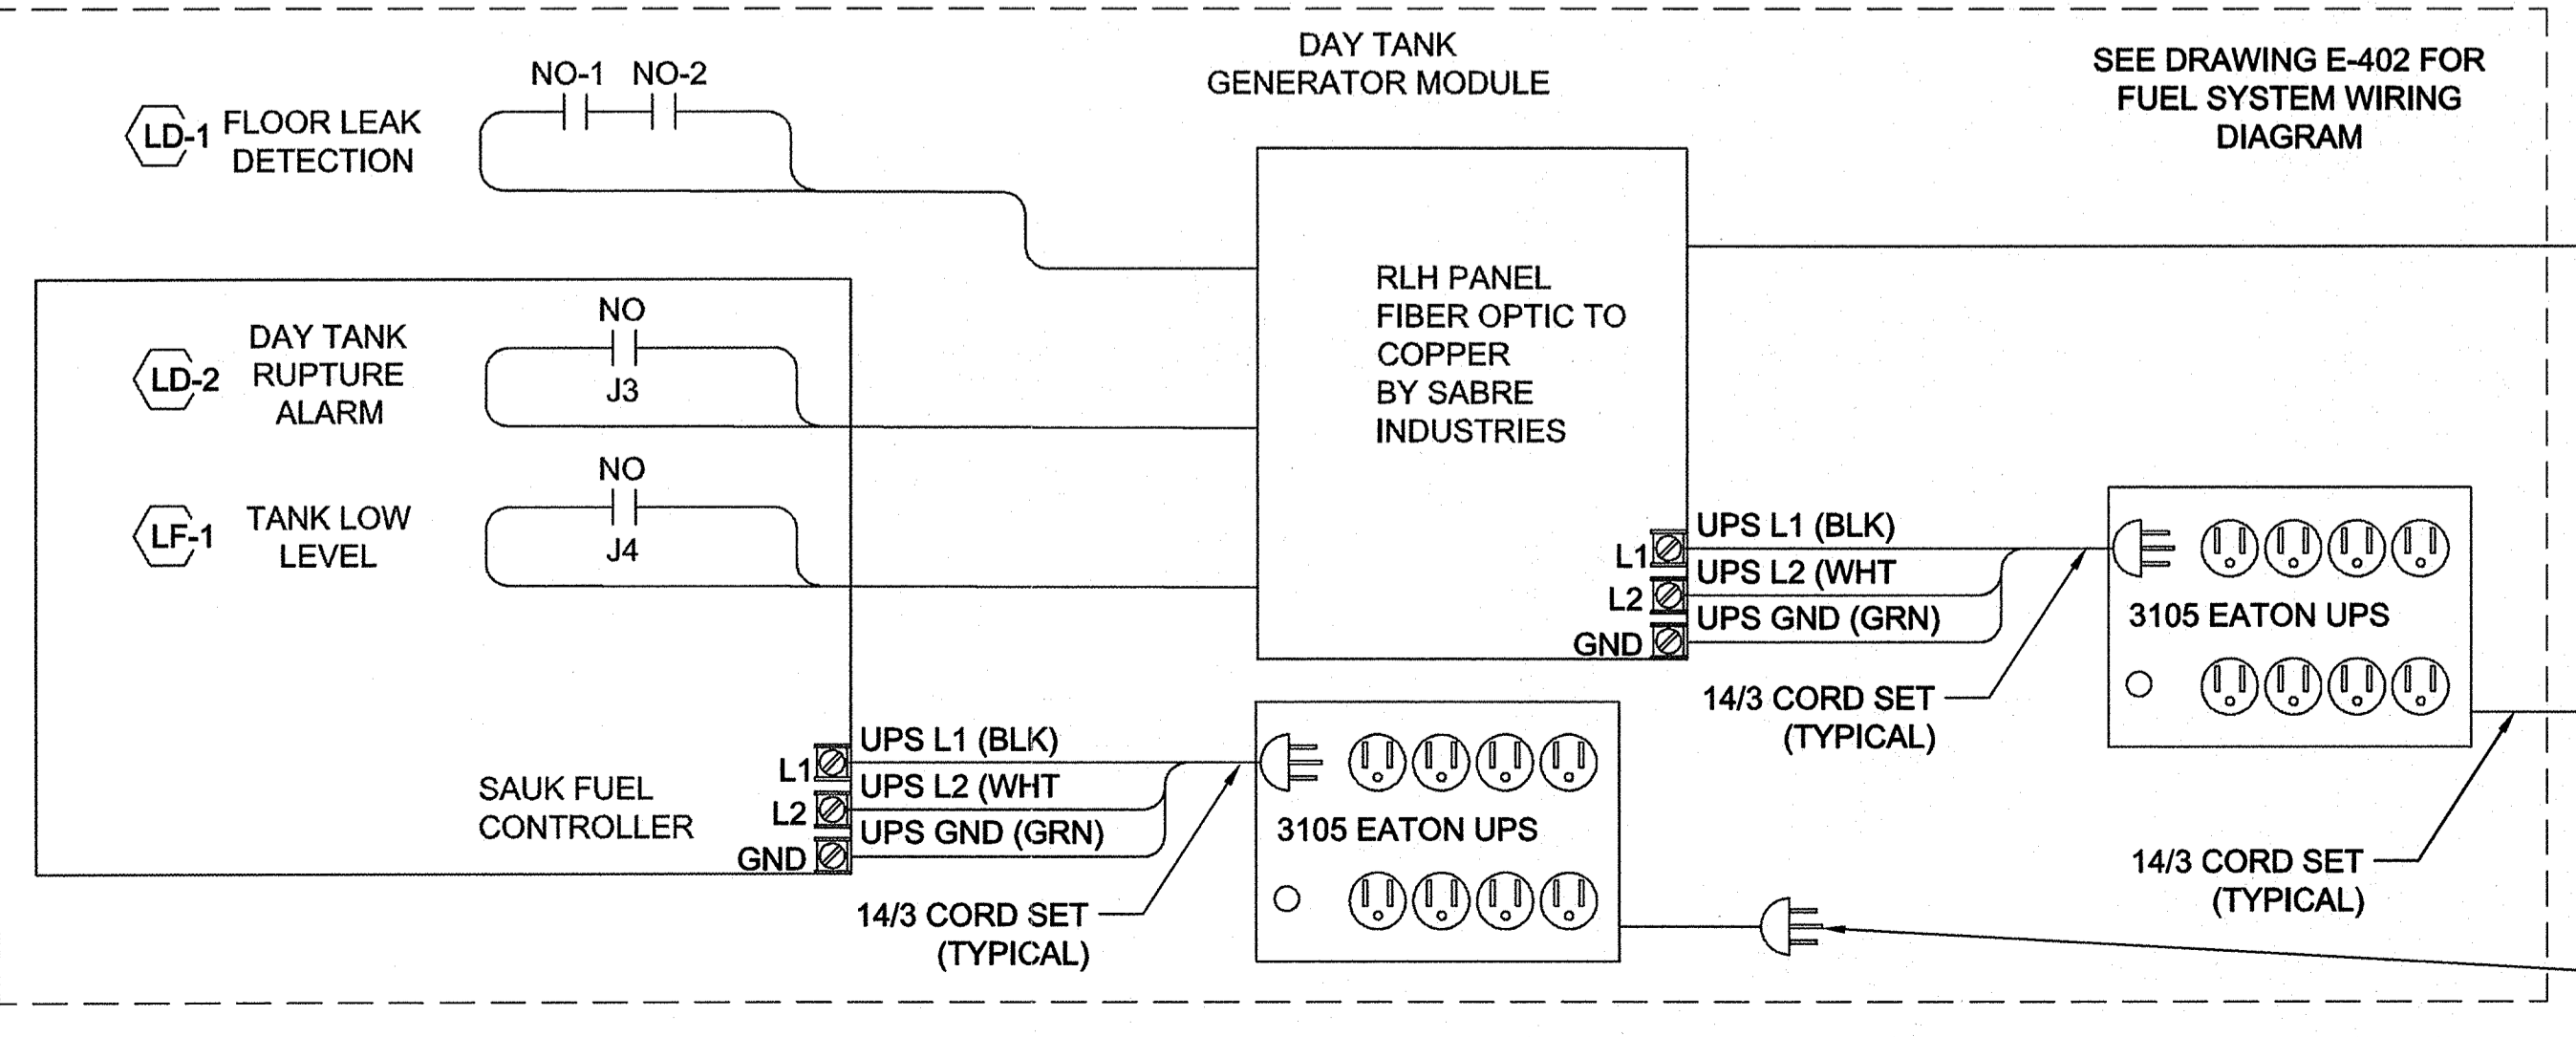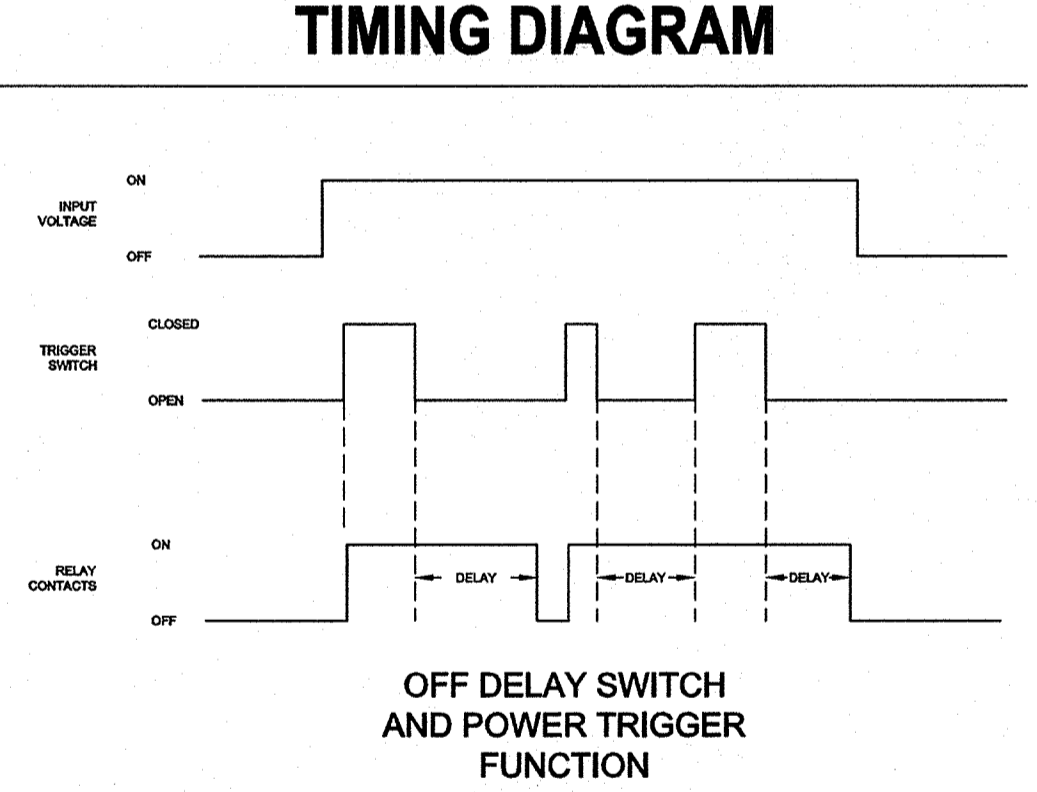

FUEL SYSTEM / ALARM RISER DIAGRAM

NOTES:


- ALL ELECTRICAL INSTALLATIONS SHALL BE IN ACCORDANCE WITH THE 2011 EDITION OF THE NATIONAL ELECTRICAL CODE (NEC NFPA 70) AND THE OCCUPATIONAL SAFETY AND HEALTH ACT (OSHA) AND ALL SPECIFICATIONS AND APPLICABLE CODES AND STANDARDS.
- ALL INSTRUMENT / CONTROL CABLES SHALL BE INDIVIDUALLY SHIELDED DUE TO HIGH RF SIGNALS. SHIELDS SHALL BE BONDED AT THE CONTROLLER AND TAPED AT THE DEVICES UNLESS SHOWN DIFFERENTLY BY MANUFACTURER TERMINATION DRAWINGS.
- SEE CONTROLLER SUPPLIER DRAWINGS FOR WIRING TERMINATIONS AND WIRING REQUIREMENTS. FUEL SYSTEM RISER DIAGRAM IS DIAGRAMMATIC. CABLING SIZE AND QUANTITY MAY VARY DEPENDING ON FURNISHED EQUIPMENT REQUIREMENTS.
- ALL CONTACTS ARE SHOWN IN DE-ENERGIZED POSITIONS CONSIDERED "FAIL SAFE" WHICH WILL ALSO INDICATE AN ALARM STATE OF THE DEVICE.
- REMOTE ALARM CIRCUITS WILL BE ROUTED THROUGH TIME DELAY RELAYS, THIS WILL ALLOW TIME FOR THE SITE GENERATOR TO COME ON LINE AND RESTORE POWER PREVENTING NUISANCE ALARMS DUE TO POWER OUTAGES. TIME DELAY OFF RELAYS SHALL BE SET AT 30 SECONDS TO ALLOW THE SITE POWER GENERATOR TO COME ON LINE AND PROVIDE POWER.
- THE FOLLOWING PANELS WILL BE BACKED UP UTILIZING UPS:
 - GENERATOR MODULE - RLH FIBER OPTIC TRANSMITTER PANEL
 - GENERATOR FUEL SYSTEM CONTROLLER "SAUK"
 - TRANSMITTER MODULE - RLH FIBER OPTIC RECEIVER PANEL
 - INCON FUEL SYSTEM CONTROL PANEL FSCP-001
 - VIKING ALARM AUTO DIALER
- UPS INSTALLATION IS BY SABRE INDUSTRIES AND IS SHOWN FOR REFERENCE.

LEGEND:




- * DENOTES WIRE / CABLE ONLY WITHIN CONTROLLER / ENCLOSURE
- CABLE SHIELD TERMINATED TO GROUNDING POINT
- CABLE SHIELD SHOWN CUT AND TAPED NOT TERMINATED
- INSTALLATION (BY SABRE INDUSTRIES)
- NEW INSTALLATION (BY SITE CONTRACTOR)

NEW CABLES ROUTED FROM RELAYS TO INCON TERMINALS SEE DRAWING E-402 (38)

TRANSMITTER MODULE FUEL SYSTEM CONTROL PANEL FSCP-001 PARTIAL CONNECTION DIAGRAM (SEE SUPPLIER DRAWING FOR COMPLETE WIRING CONNECTION)

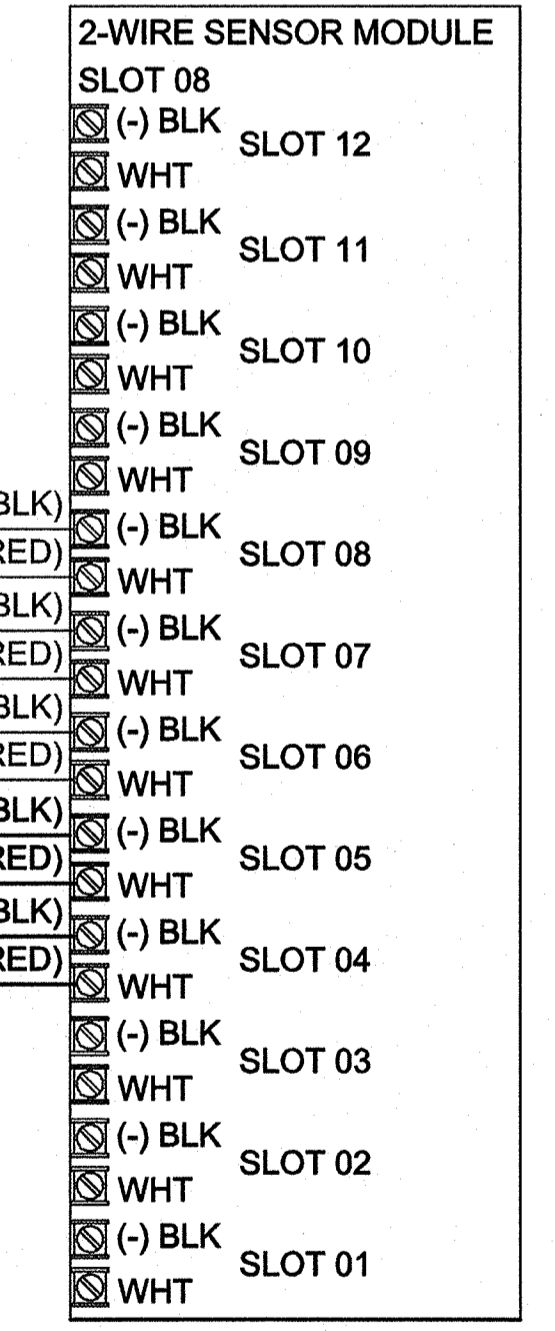

WIRING TERMINATIONS ARE FOR REFERENCE ONLY. IESI TECH WILL COMPLETE ALL TERMINATIONS AND POINT ASSIGNMENTS ALL WIRING SHALL BE INSTALLED, CHECKED, AND LABELED IN ACCORDANCE WITH SPECIFICATIONS

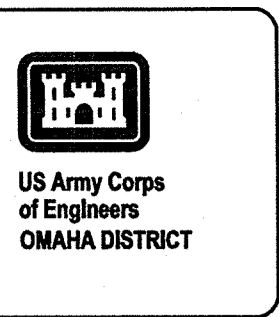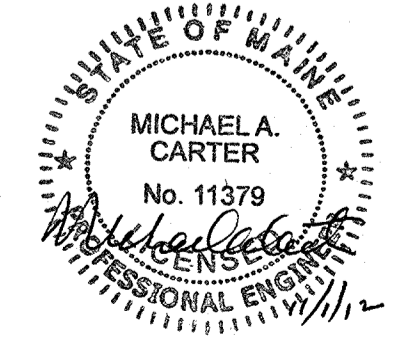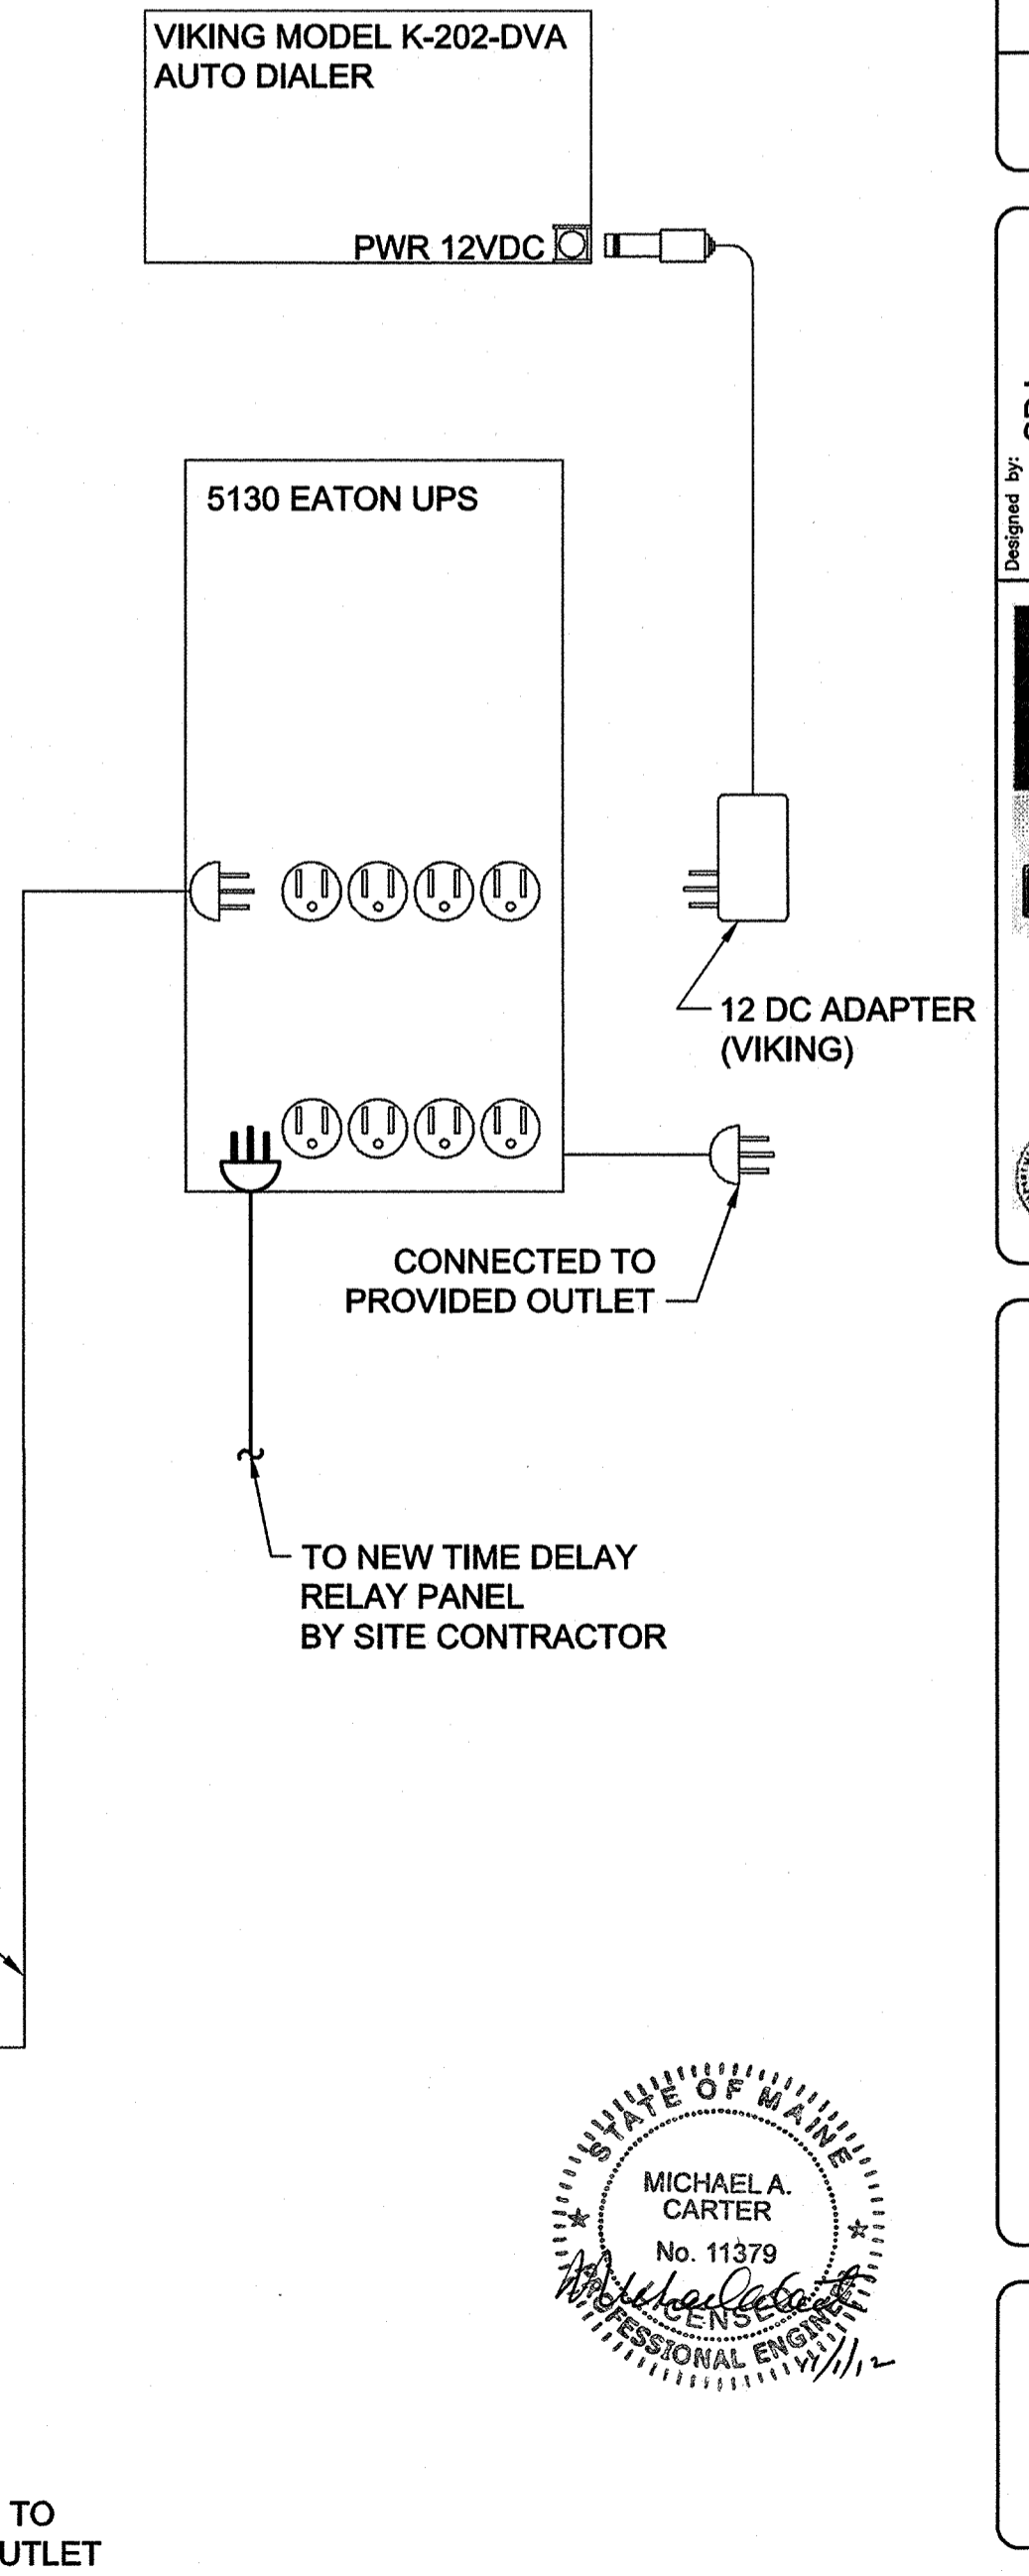

Project Manager	
QC Reviewer	
Architectural	
Mechanical	
Plumbing	
Electrical	
Mark	

Issued For Construction	11/1/12	Approved
Description		

Designed by	SDJ	Checked by	SDJ
Drawn by	SDJ	Reviewed by	
Date	2012		

63 SOUTH ROYAL STREET SUITE 200
MOBILE, AL 36607
PHONE (251) 466-7888
FAX (251) 466-7888


KBR
Engineering Services by
KBR Engineering Co., LLC

FEMA
EMERGENCY RADIO NETWORK
ON WIGAN PORTLAND, MAINE

TRANSMITTER / GENERATOR UPS / TIME DELAY DIAGRAM

Drawing Number:
E-404

MATERIAL DESCRIPTION			
ITEM NO.	QTY.	UNIT	DESCRIPTION
1	1	EA	CABLE TO CABLE TAP, #4/0 TO #2/0, TAP CADWELD CAT. #TAC-202G
2	1	EA	WELD METAL CARTRIDGE #90
3	1	EA	CABLE TO CABLE TAP, #4/0 TO #2, TAP CADWELD CAT. #TAC-201V
4	1	EA	WELD METAL CARTRIDGE #90
5	1	EA	CABLE TO CABLE TAP, #4/0 TO #4/0, TAP CADWELD CAT. #TAC-202Q
6	1	EA	WELD METAL CARTRIDGE #150
7	1	EA	CABLE TO CABLE TAP, #2 TO #2, SPLICE CADWELD CAT. #SSC-2Q
8	1	EA	WELD METAL CARTRIDGE #90
9	1	EA	CABLE TO CABLE TAP, #4/0 TO #4/0, SPLICE CADWELD CAT. #TAC-202Q
10	1	EA	WELD METAL CARTRIDGE #90

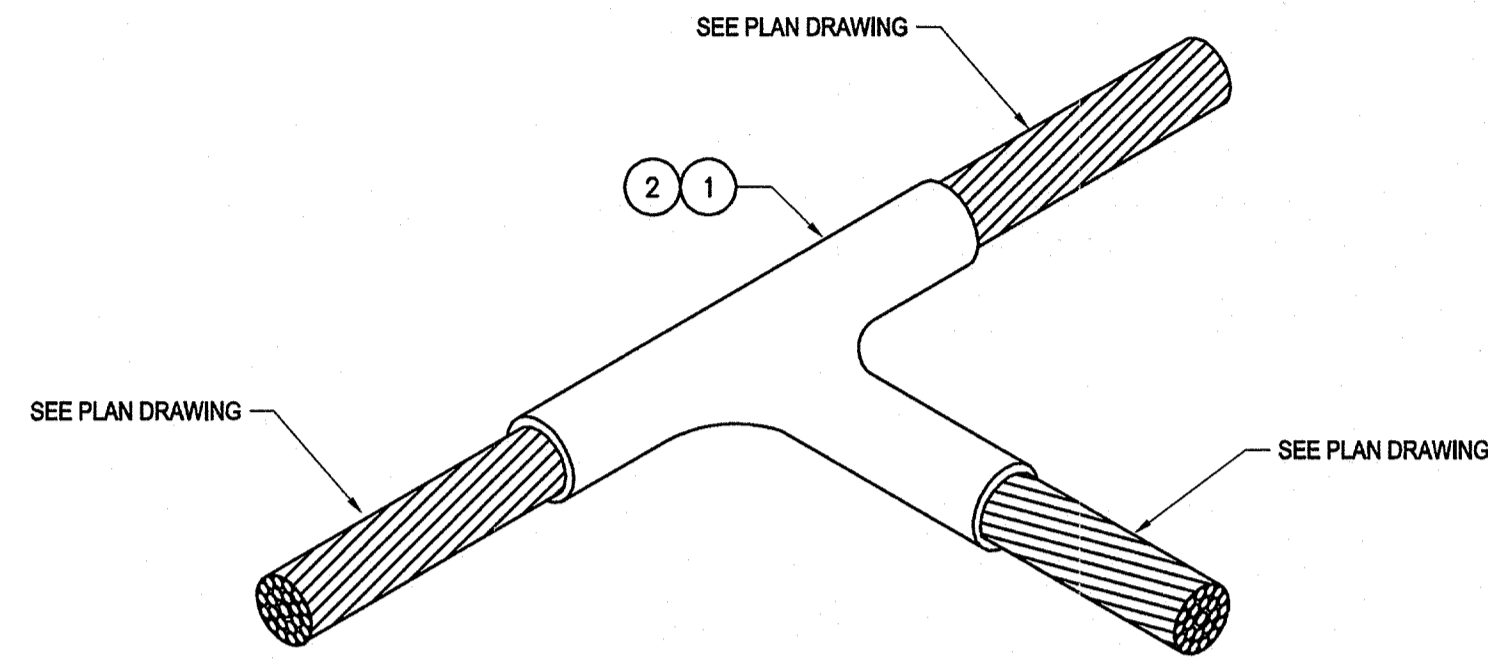


1 GROUND CONNECTION - CABLE TO CABLE
SCALE: NONE

MATERIAL DESCRIPTION			
ITEM NO.	QTY.	UNIT	DESCRIPTION
1	1	EA	3/4" COPPER CLAD GROUND ROD 10'-0" LONG BLACKBURN #75105
2	1	EA	#4/0 TO 3/4" GROUND ROD, THRU FEED, WELDED CADWELD CAT. #GTC-182Q
3	1	EA	WELD METAL CARTRIDGE #115 MODEL NO. #115
4	1	EA	GROUND ROD COUPLING BLACKBURN # 70C


NOTE:

1. ALL MATERIALS CAN BE SUBSTITUTED WITH A CLIENT APPROVED EQUAL.

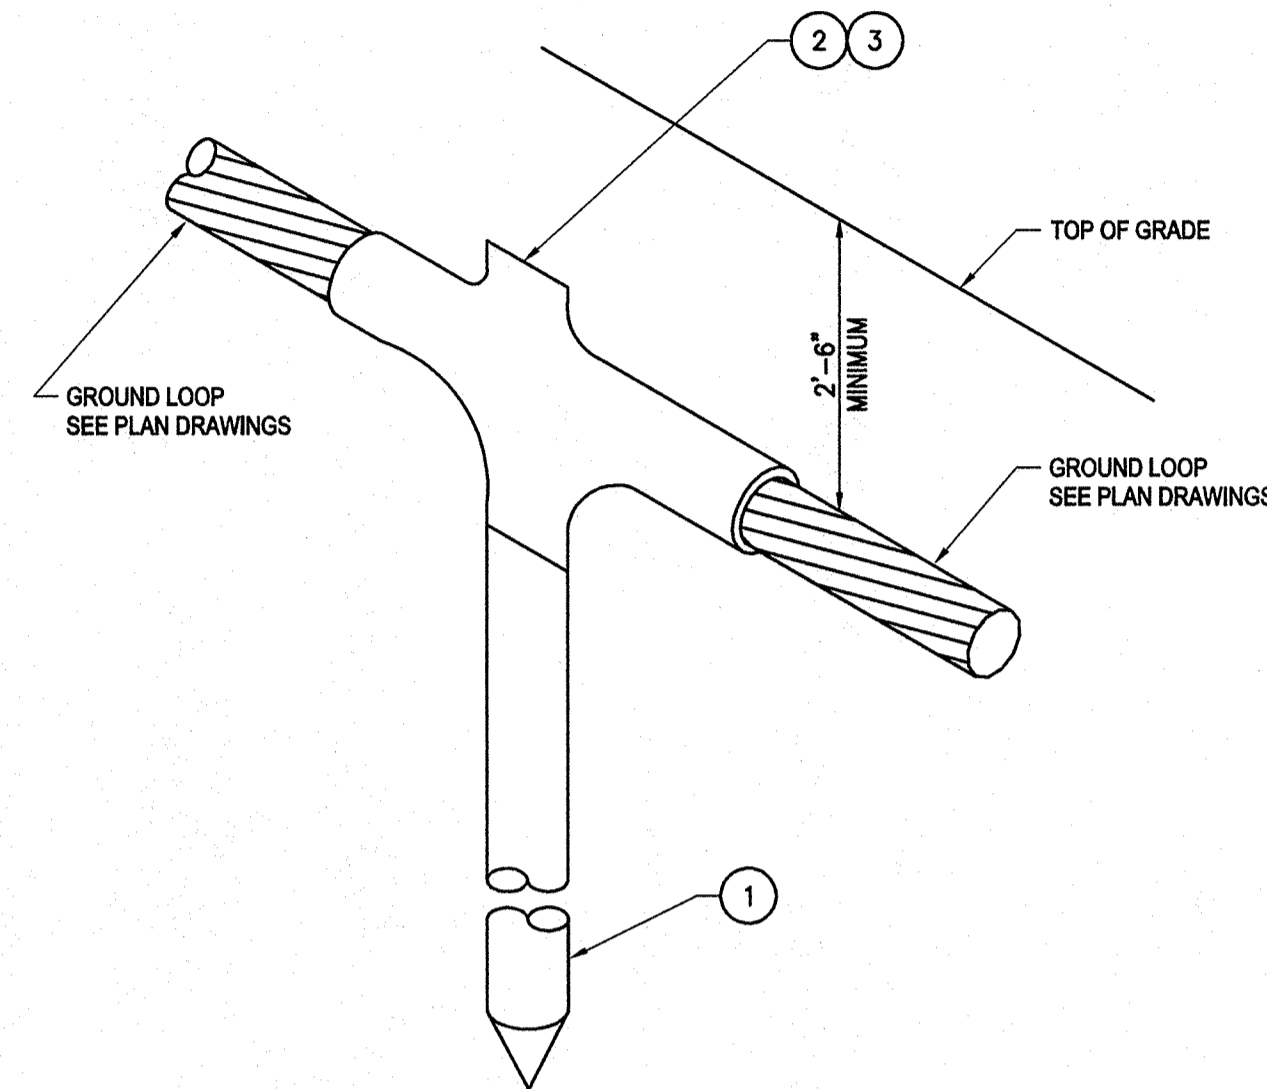

2 GROUND CONNECTION - CABLE TO GROUND ROD
SCALE: NONE

CADWELD MATERIAL DESCRIPTION				
REBAR TO BE WELDED TO	WELD SIZE	WELD PART NO.	WELD METAL	PACKING PART NO.
4	4	RRR-521L	32	B-143A
	2	RRR-521V	45	B-143A
	2/0	RRR-522G	90	B-141A
	4/0	RRR-522Q	115	B-141A
5	4	RRR-531L	32	B-143A
	2	RRR-531V	45	B-143A
	2/0	RRR-532G	90	B-141A
	4/0	RRR-532Q	115	B-141A
6	4	RRR-541L	32	B-143B
	2	RRR-541V	45	B-143B
	2/0	RRR-542G	90	B-144C
	4/0	RRR-542Q	115	B-144C
7	4	RRR-551L	32	B-143B
	2	RRR-551V	45	B-143B
	2/0	RRR-552G	90	B-144C
	4/0	RRR-552Q	115	B-144A
8	2	RRR-561V	45	B-143B
	2/0	RRR-562G	90	B-144C
	4/0	RRR-562Q	115	B-144A

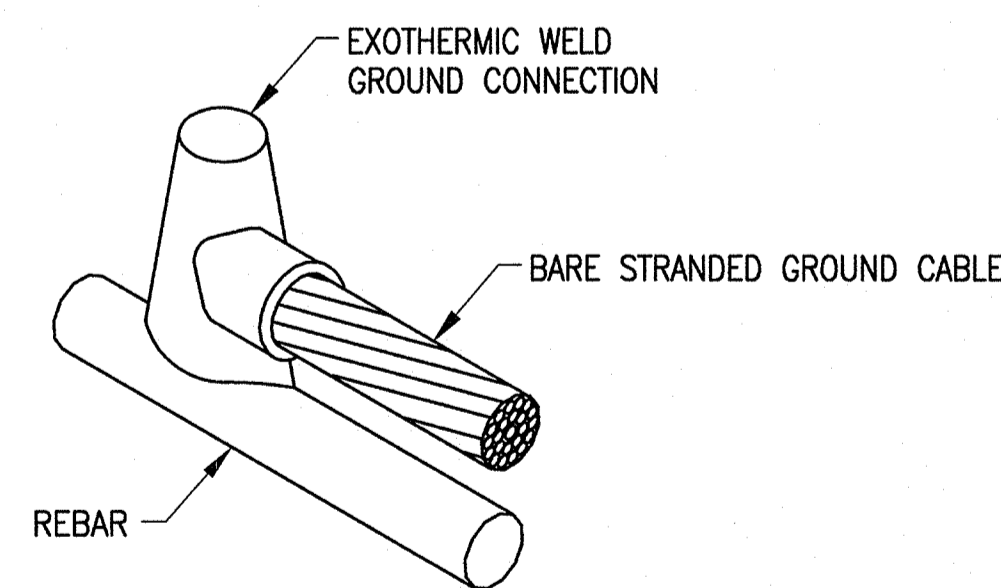


NOTES:

1. ALL MATERIALS CAN BE SUBSTITUTED WITH AN APPROVED EQUAL.

3 GROUND CONNECTION - CABLE TO REBAR
SCALE: NONE

MATERIAL DESCRIPTION			
ITEM NO.	QTY.	UNIT	DESCRIPTION
1	2	EA	EVERDUR BOLT 3/8" x 1" LONG
2	2	EA	3/8" SHAKEPROOF OUTSIDE STAR LOCKWASHERS
3	1	EA	COMPRESSION LUG BURNDY TYPE CAT #YGH42C-2N
4	A/R	LF	#2 THIN GREEN COPPER GND. WIRE
5	1	EA	STRUCTURAL STEEL GROUND CLAMP THOMAS & BETTS CAT #10109

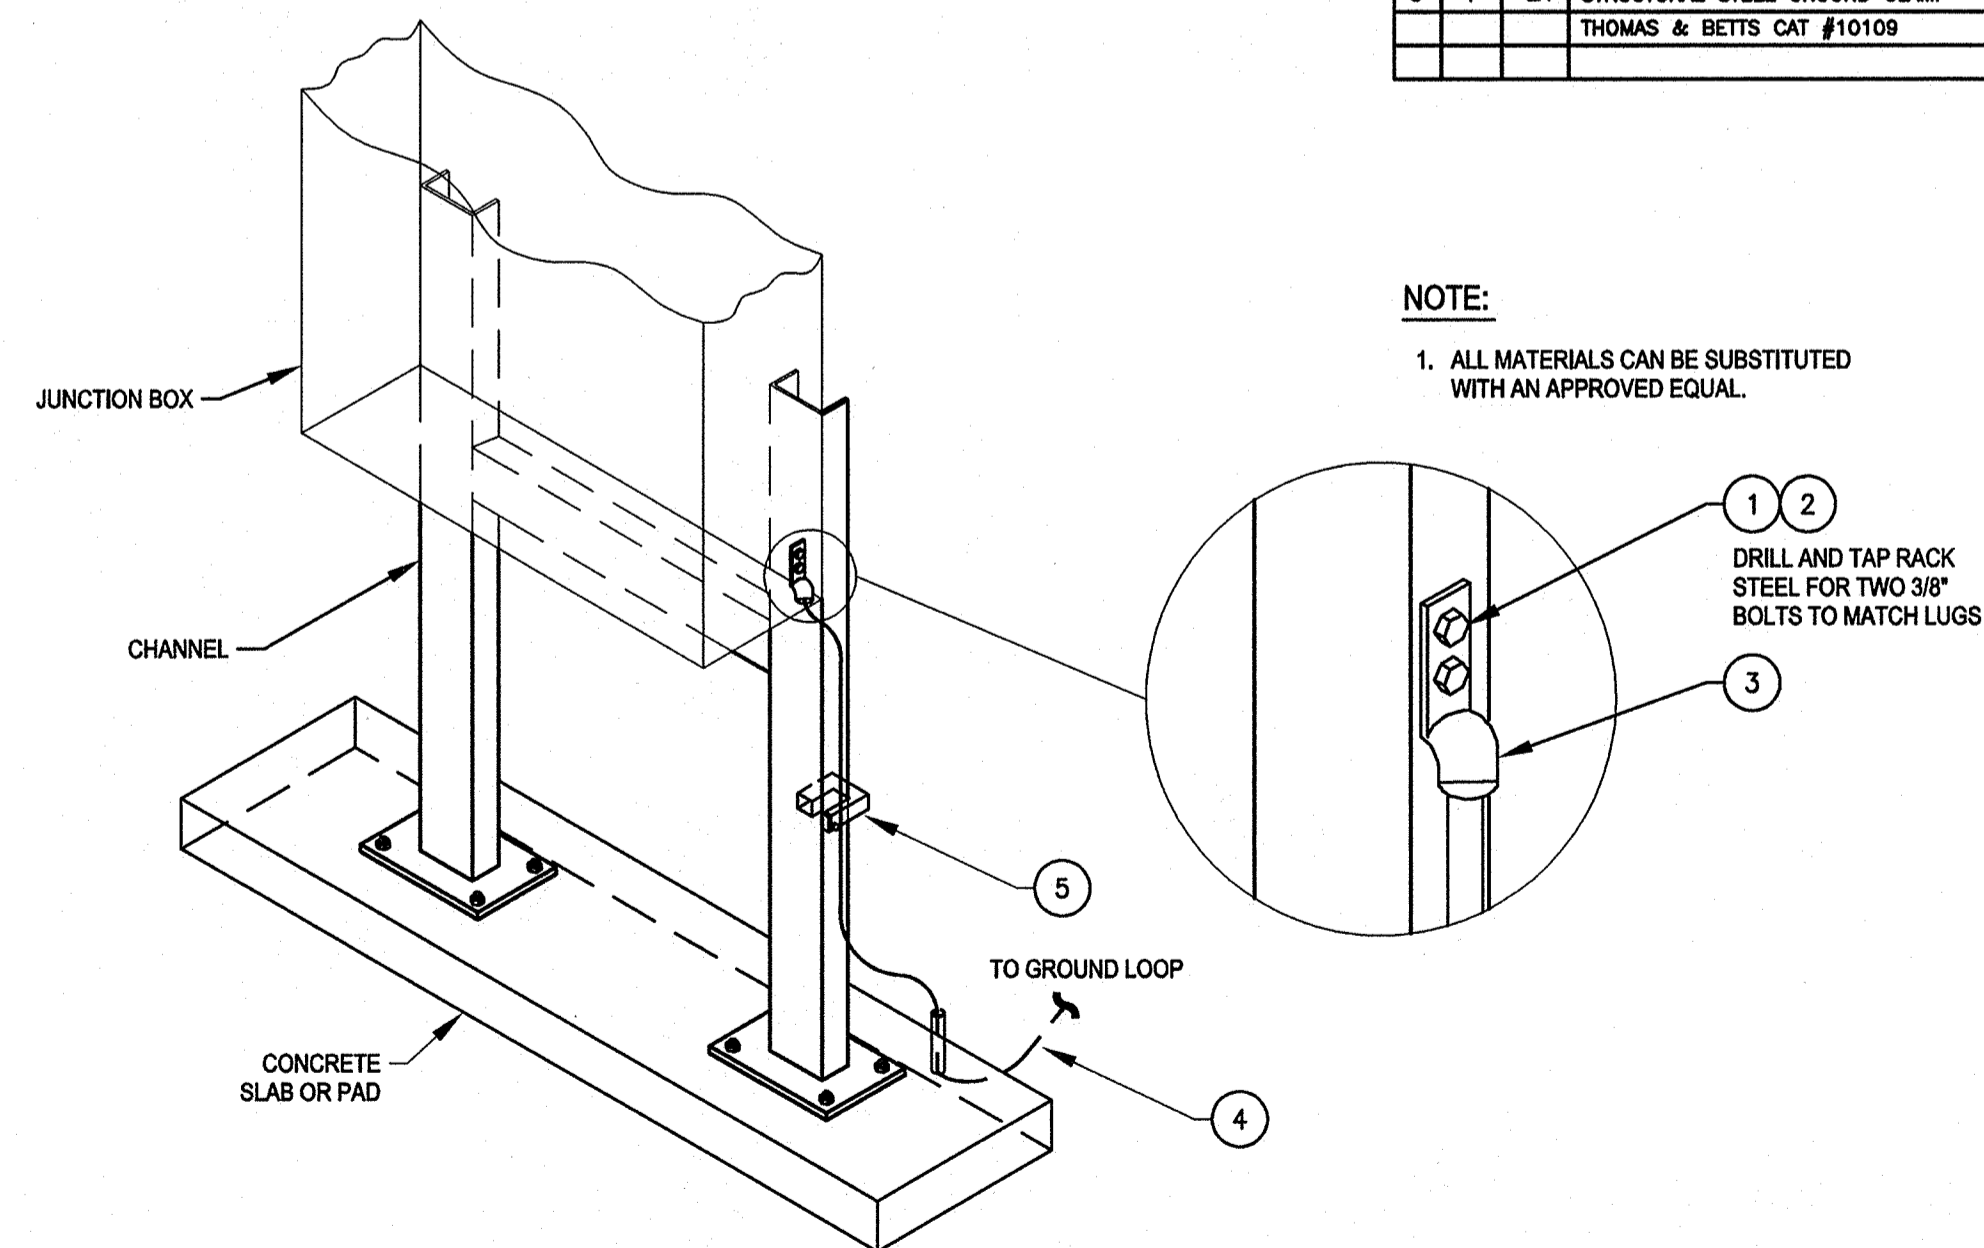


NOTE:

1. ALL MATERIALS CAN BE SUBSTITUTED WITH AN APPROVED EQUAL.

4 GROUND CABLE TO JUNCTION BOXES
SCALE: NONE

NOTES:

1. ALL ELECTRICAL INSTALLATIONS SHALL BE IN ACCORDANCE WITH THE 2011 EDITION OF THE NATIONAL ELECTRICAL CODE (NEC NFPA 70) AND THE OCCUPATIONAL SAFETY AND HEALTH ACT (OSHA) AND PROJECT SPECIFICATIONS AND APPLICABLE CODES AND STANDARDS.



Project Manager	
QC Reviewer	
Structural	
Mechanical	
Plumbing	
Electrical	
Civil	

0	Mark
11/1/12	Date
	App'd

Designed by: SDJ	Checked by: TCG
Drawn by: SDJ	Reviewed by: MAC
Issued for Construction	Date: 2012


FEMA
KBR
63 SOUTH BOWAL STREET, SUITE 200
MOBILE, AL 36602
PHONE: (251) 457-7600
FAX: (251) 457-7604

KBR
Engineering Services by
KBR Engineering Co., LLC

STATE OF MAINE
MICHAEL A. CARTER
No. 11379
PROFESSIONAL ENGINEER

FEMA EMERGENCY RADIO NETWORK
ON WIGAN PORTLAND, MAINE
INSTALLATION DETAILS


Drawing Number:
E-501

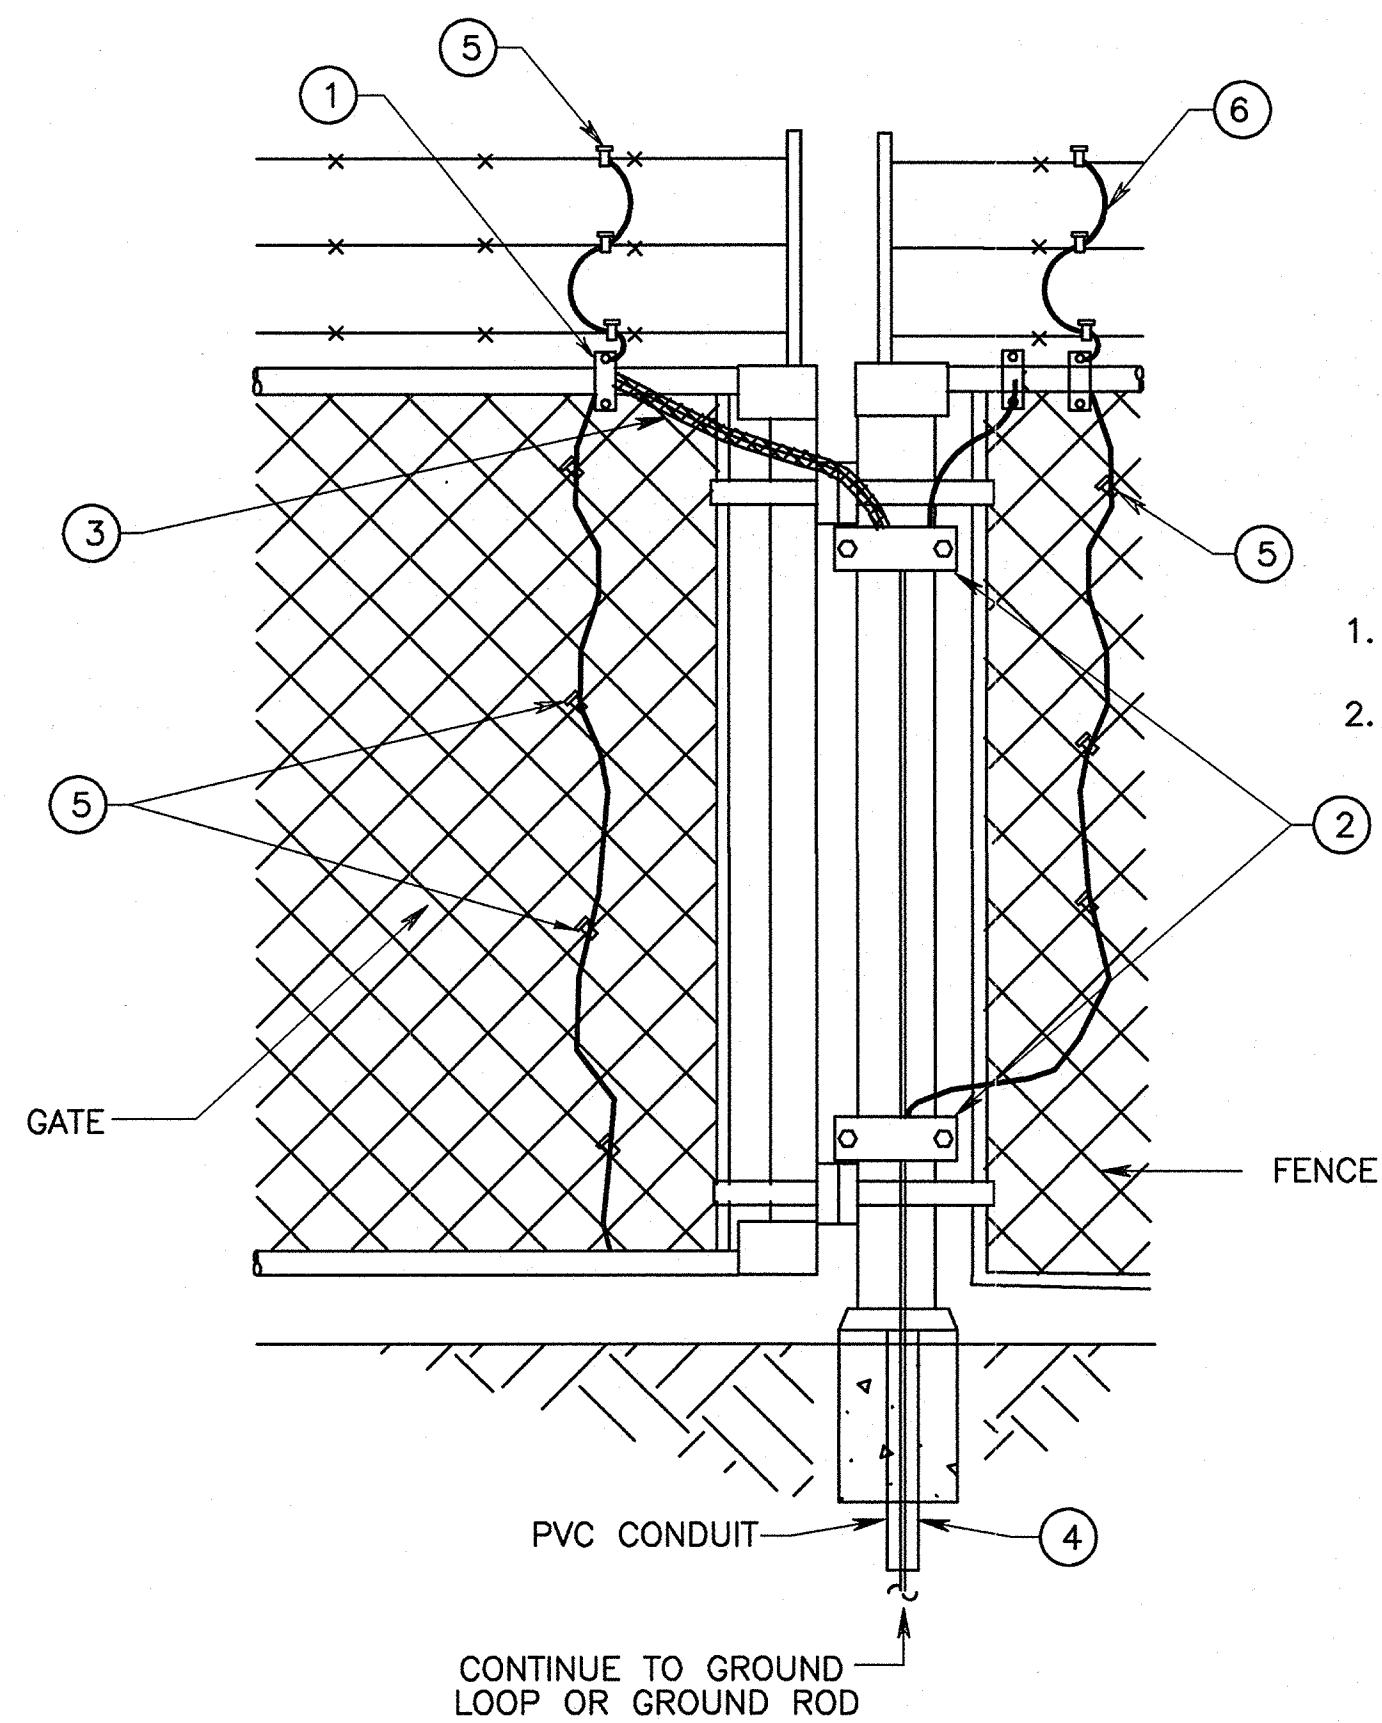

ITEM NO.	QTY.	UNIT	MATERIAL DESCRIPTION
1	1	EA	GROUND CONNECTOR SIZE TO FENCE TUBE O.D., BURNDY TYPE GD
2	2	EA	POST CLAMP SIZE TO POST O.D., BURNDY TYPE
3	1	EA	BURNDY TYPE BD18, COPPER BRAID JUMPER AT ALL GATES, INSTALL W/SKACK WHEN GATE IS FULLY CLOSED, 18" LONG
4	AR	LF	1" PVC CONDUIT, SCHD 80
5	AR	EA	SERVIT CONNECTOR (SPLIT BOLT)
6	AR	LF	WIRE, #2 AWG STRANDED COPPER BARE

- NOTES:
1. ALL MATERIALS CAN BE SUBSTITUTED WITH AN APPROVED EQUAL.
 2. ALL WIRE & CONNECTIONS SHALL BE PAINTED WITH A GALVANIZE PAINT FOR CONCEALMENT


5 GROUND CABLE TO GATE POST
SCALE: NONE

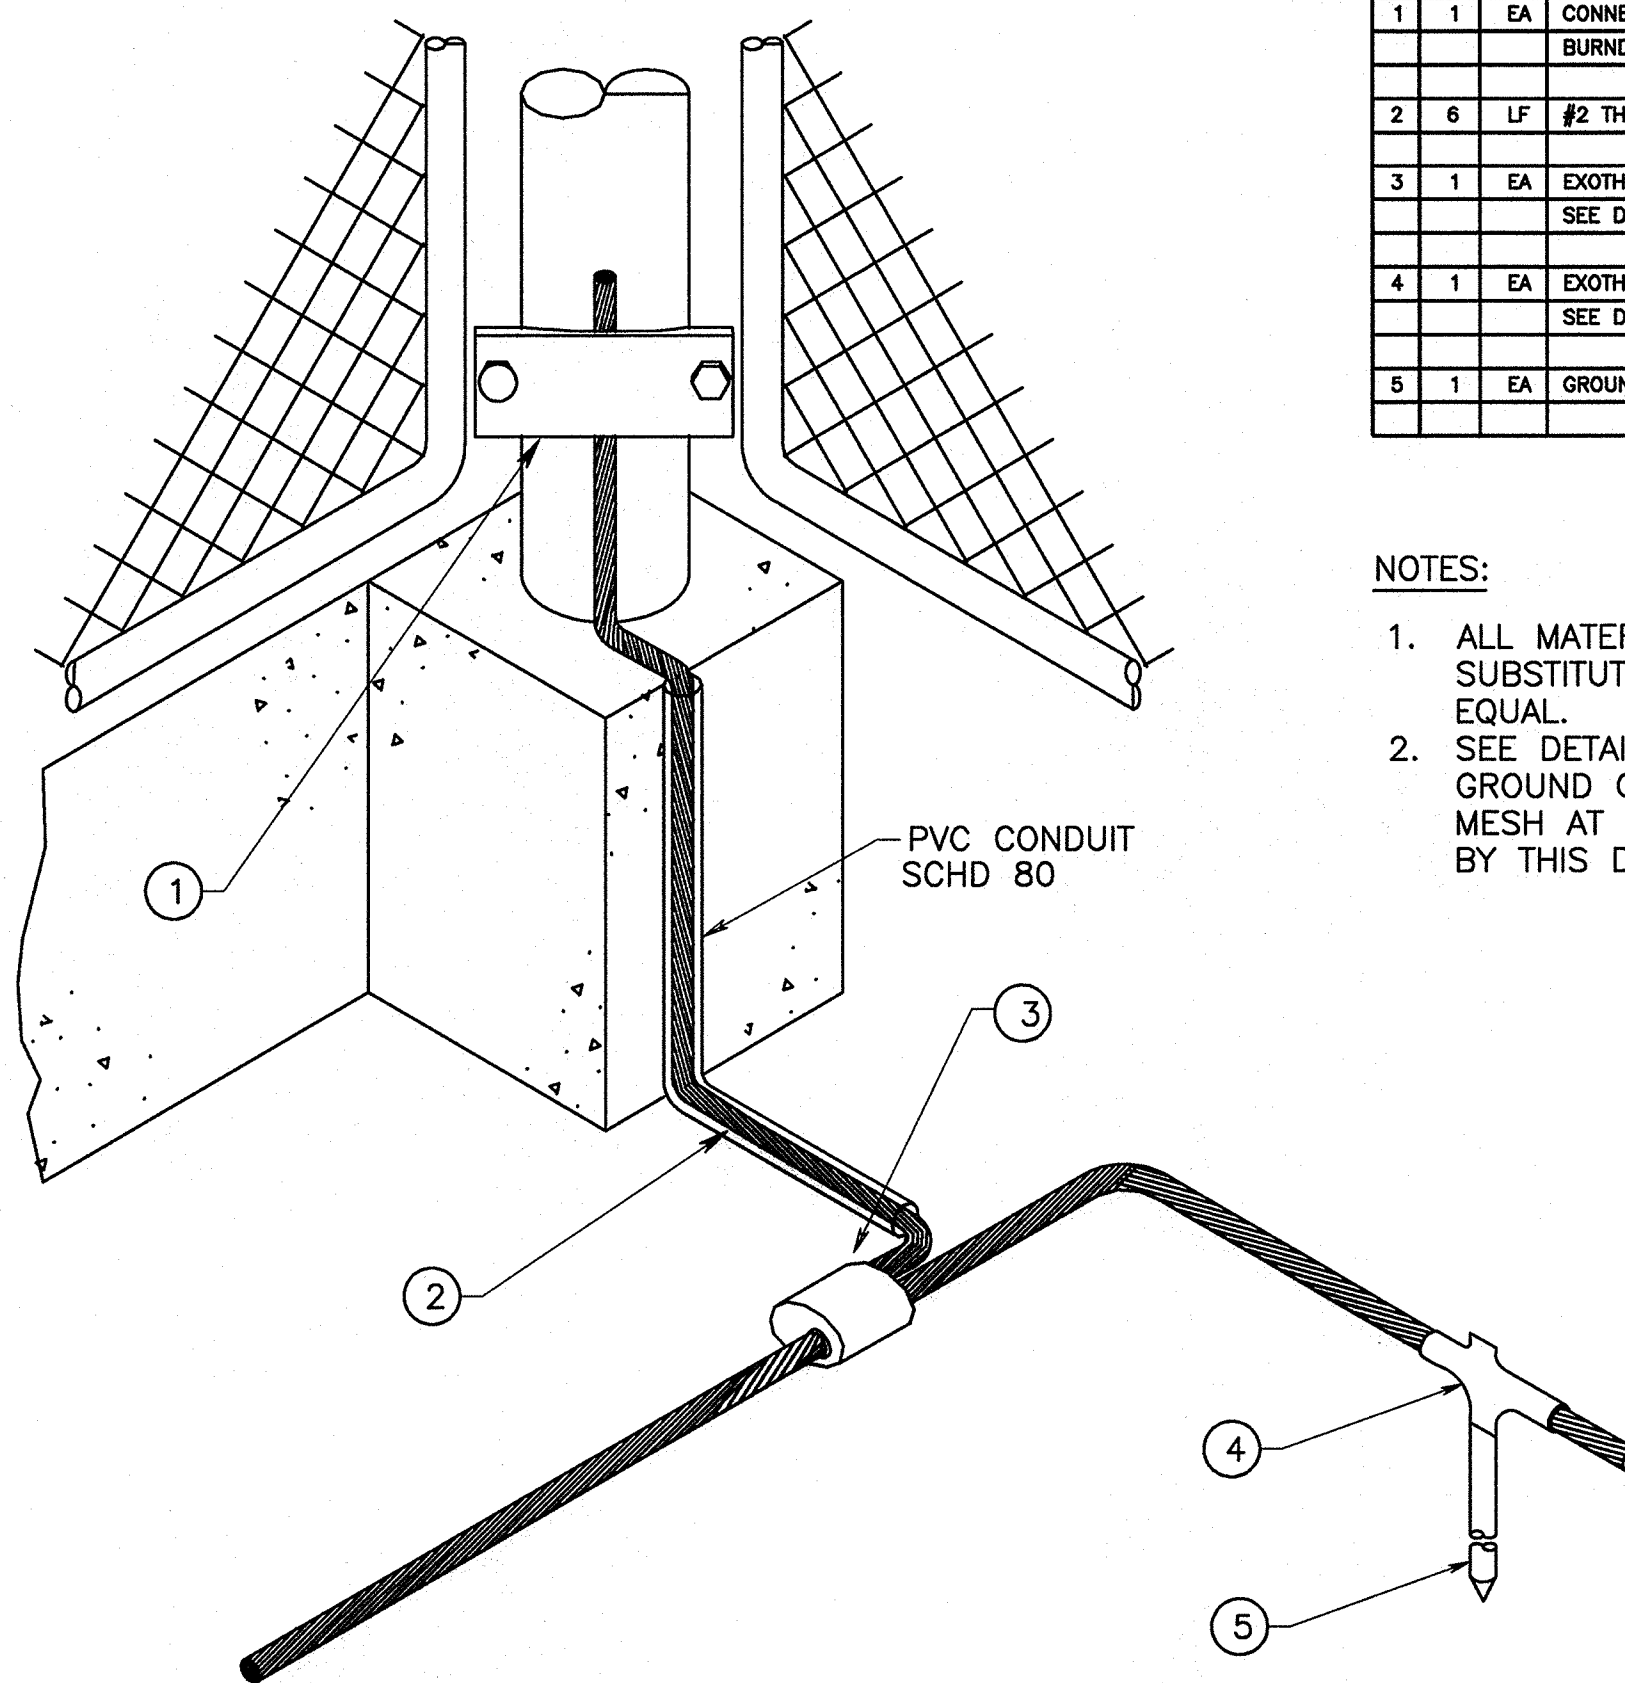

ITEM NO.	QTY.	UNIT	MATERIAL DESCRIPTION
1	1	EA	CONNECTOR-SIZE TO FIT FENCE POST O.D., BURNDY TYPE GD
2	6	LF	#2 THIN GREEN COPPER GND. WIRE
3	1	EA	EXOTHERMIC CONNECTION, SEE DETAIL 1
4	1	EA	EXOTHERMIC CONNECTION, SEE DETAIL 2
5	1	EA	GROUND ROD, COPPERWELD 10'-0" LONG

- NOTES:
1. ALL MATERIALS CAN BE SUBSTITUTED WITH AN APPROVED EQUAL.
 2. SEE DETAIL 5 FOR WOVEN GROUND CONDUCTOR IN FENCING MESH AT LOCATIONS INDICATED BY THIS DETAIL


6 GROUNDING FENCE POST
SCALE: NONE

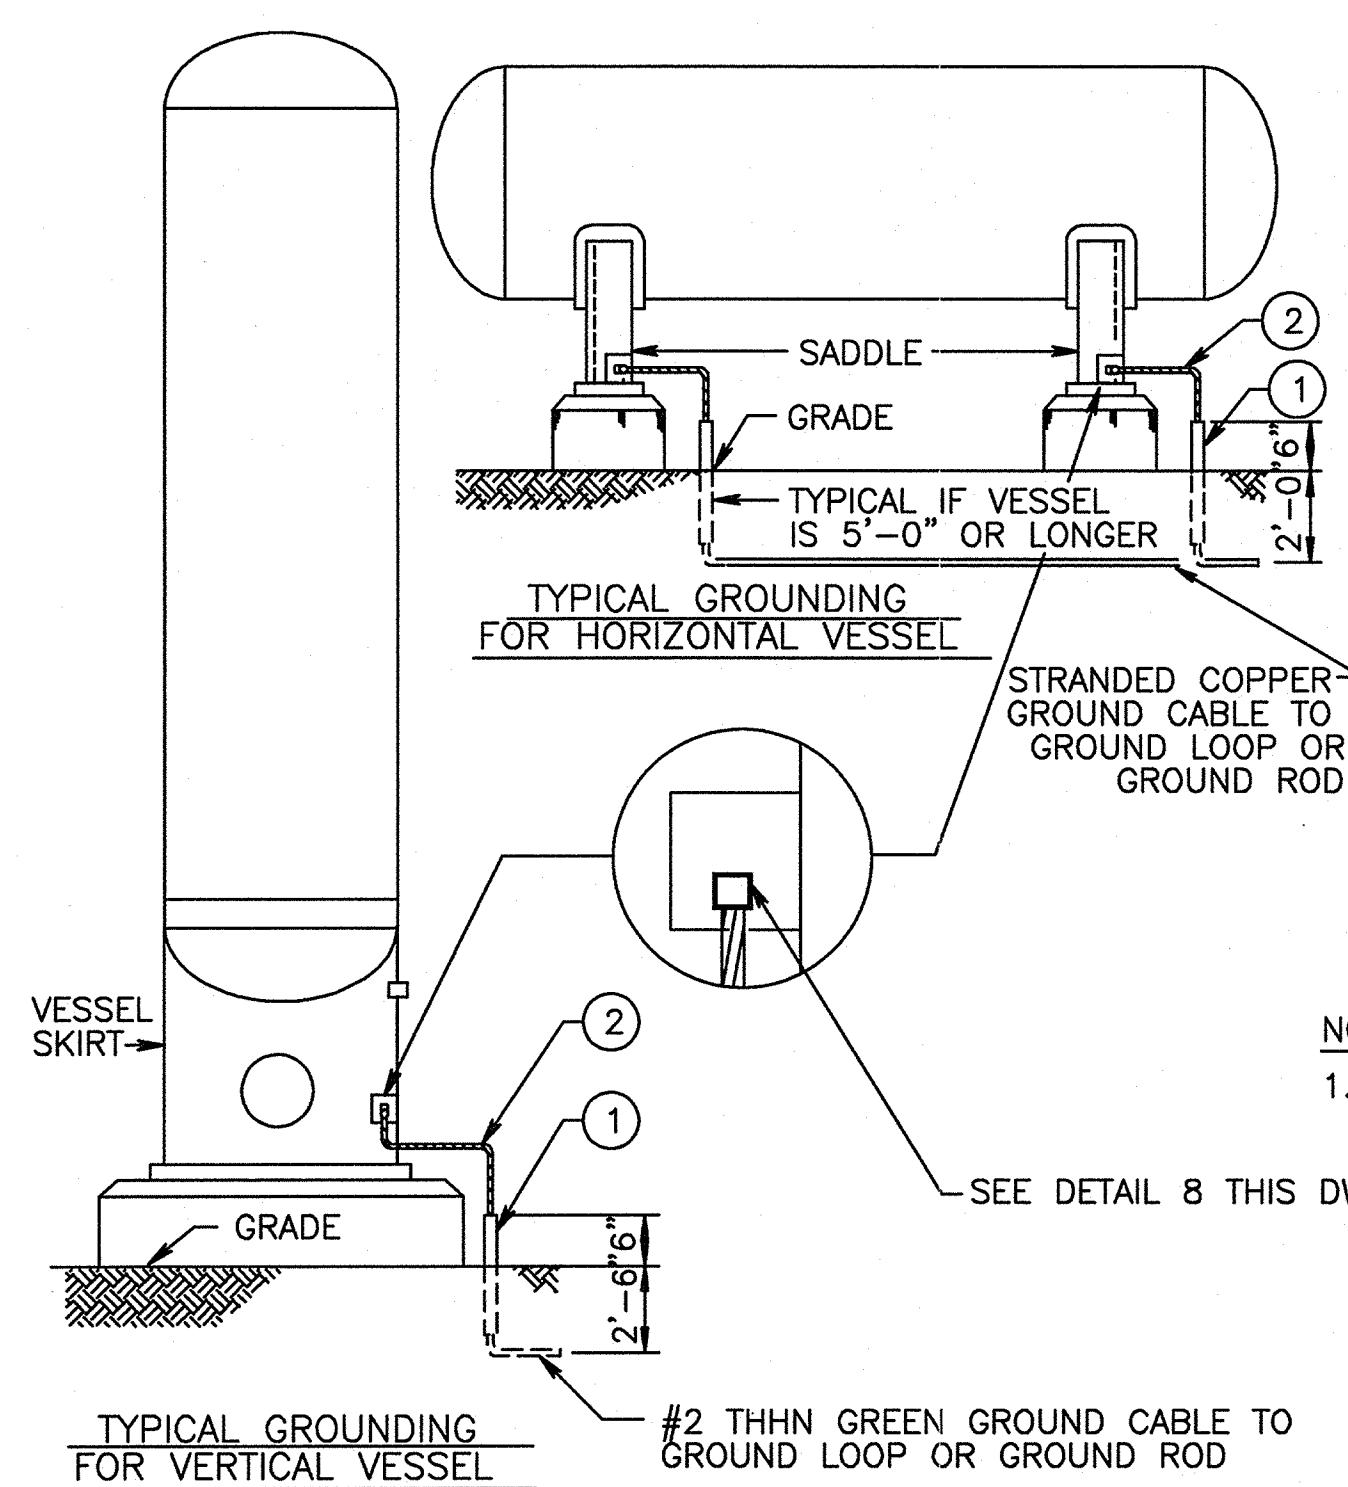

ITEM NO.	QTY.	UNIT	MATERIAL DESCRIPTION
1	-	LF	1" PVC CONDUIT, SCHD 80
2	-	LF	#2 THIN STRANDED COPPER GROUND CABLE

- NOTE:
1. ALL MATERIALS CAN BE SUBSTITUTED WITH AN APPROVED EQUAL.

7 TYPICAL VESSEL GROUND FROM BELOW
SCALE: NONE

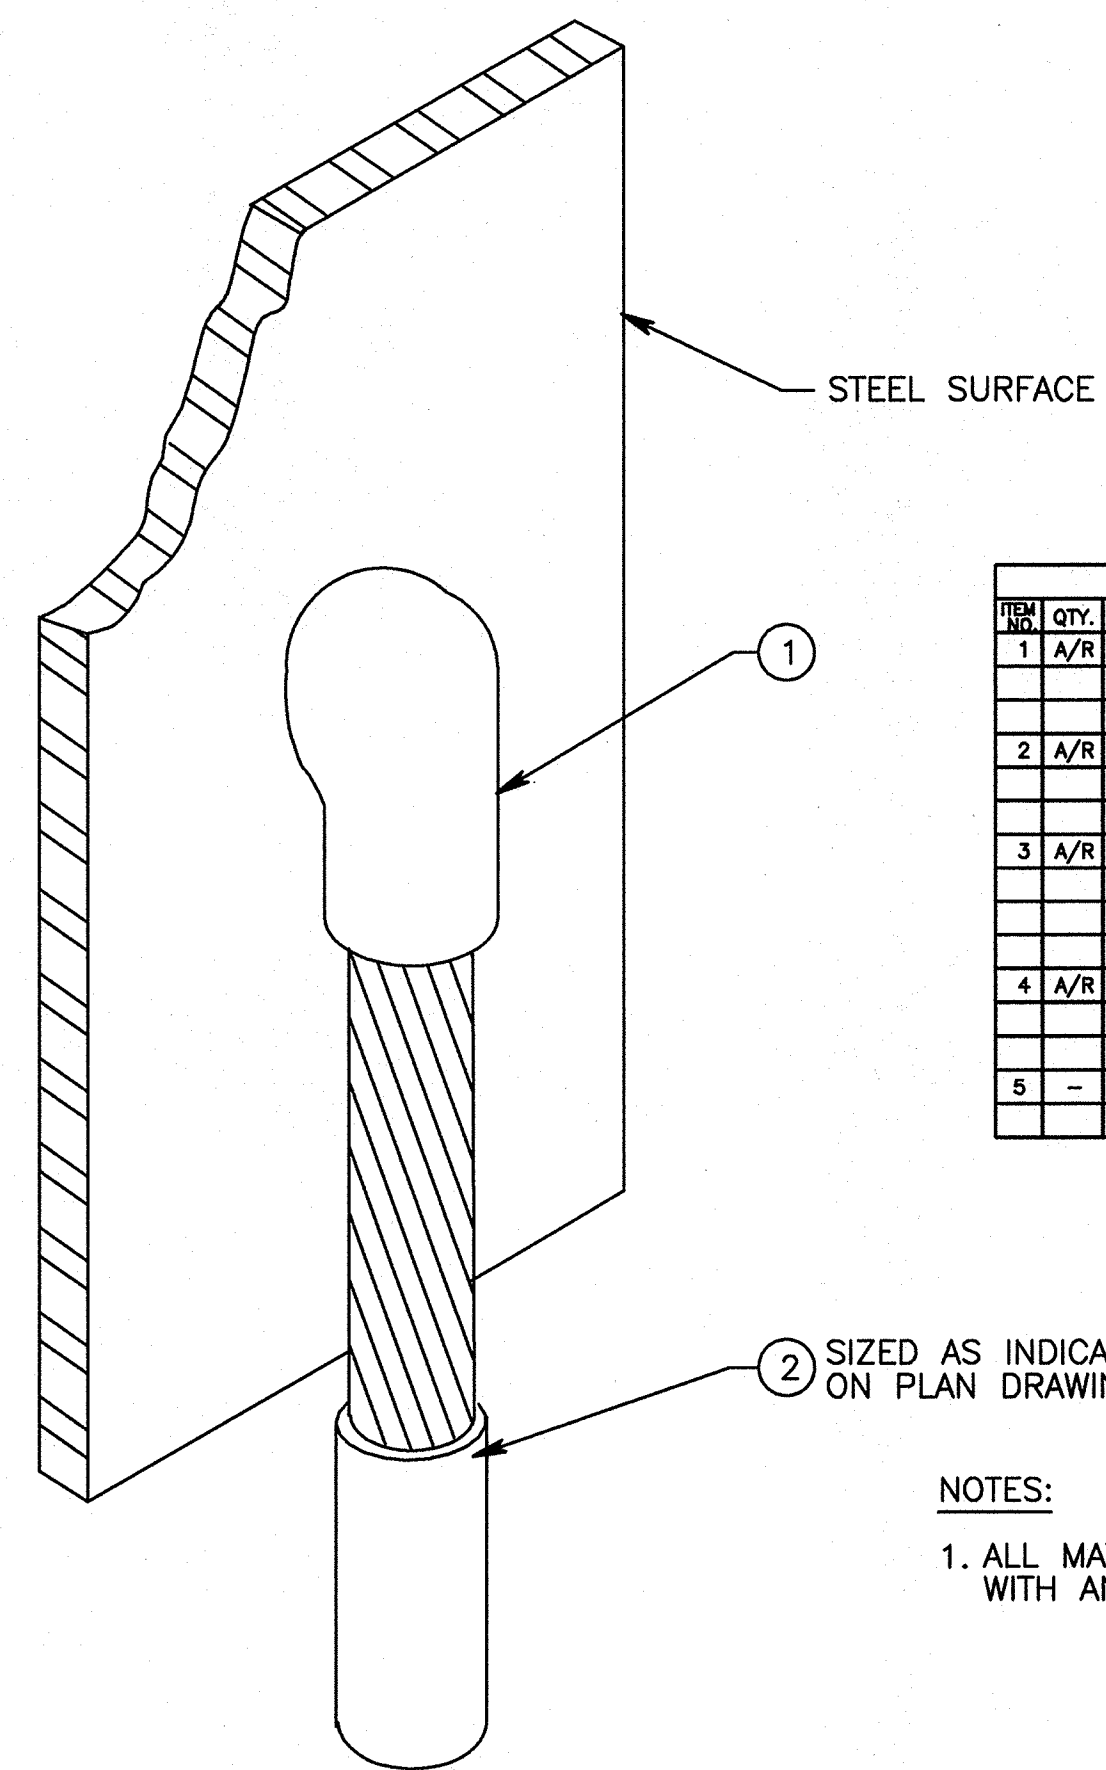


ITEM NO.	QTY.	UNIT	MATERIAL DESCRIPTION
1	A/R	EA	#2 AWG - CADWELD # VBC-1V WELD METAL # 65
2	A/R	EA	#1/0 AWG - CADWELD # VBC-2C WELD METAL 115
3	A/R	EA	#2/0 AWG - CADWELD # VBC-2G WELD METAL 115
4	A/R	EA	#4/0 AWG - CADWELD # VSB-2G WELD METAL 150
5	-	LF	THIN INSULATED GREEN GROUND WIRE

- NOTES:
1. ALL MATERIALS CAN BE SUBSTITUTED WITH AN APPROVED EQUAL.

8 MISC. EQUIPMENT GROUND
SCALE: NONE

NOTES:

1. ALL ELECTRICAL INSTALLATIONS SHALL BE IN ACCORDANCE WITH THE 2011 EDITION OF THE NATIONAL ELECTRICAL CODE (NEC NFPA 70) AND THE OCCUPATIONAL SAFETY AND HEALTH ACT (OSHA) AND PROJECT SPECIFICATIONS AND APPLICABLE CODES AND STANDARDS.



Project Manager	
DC Designer	
Structural	
Mechanical	
Plumbing	
Electrical	
Civil	


ISSUED FOR CONSTRUCTION	11/7/12	Date	Agreed
Mark			

Designed by	SDJ
Drawn by	SDJ
Checked by	TCG
Reviewed by	MAC
Date	2012


KBR
63 SOUTH ROYAL STREET SUITE 200
MOBILE, AL 36602
PHONE (205) 462-7800
FAX (205) 462-7878

FEMA
Engineering Services by
KBR Engineering Co., LLC

FEMA EMERGENCY RADIO NETWORK
ON WIGAN PORTLAND, MAINE
**INSTALLATION
DETAILS**

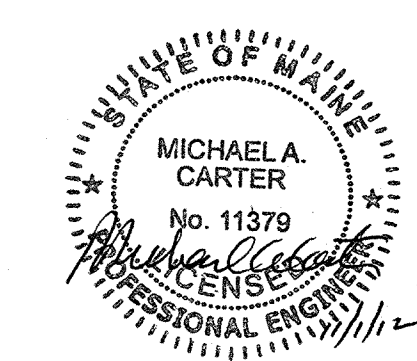


Drawing Number:
E-502

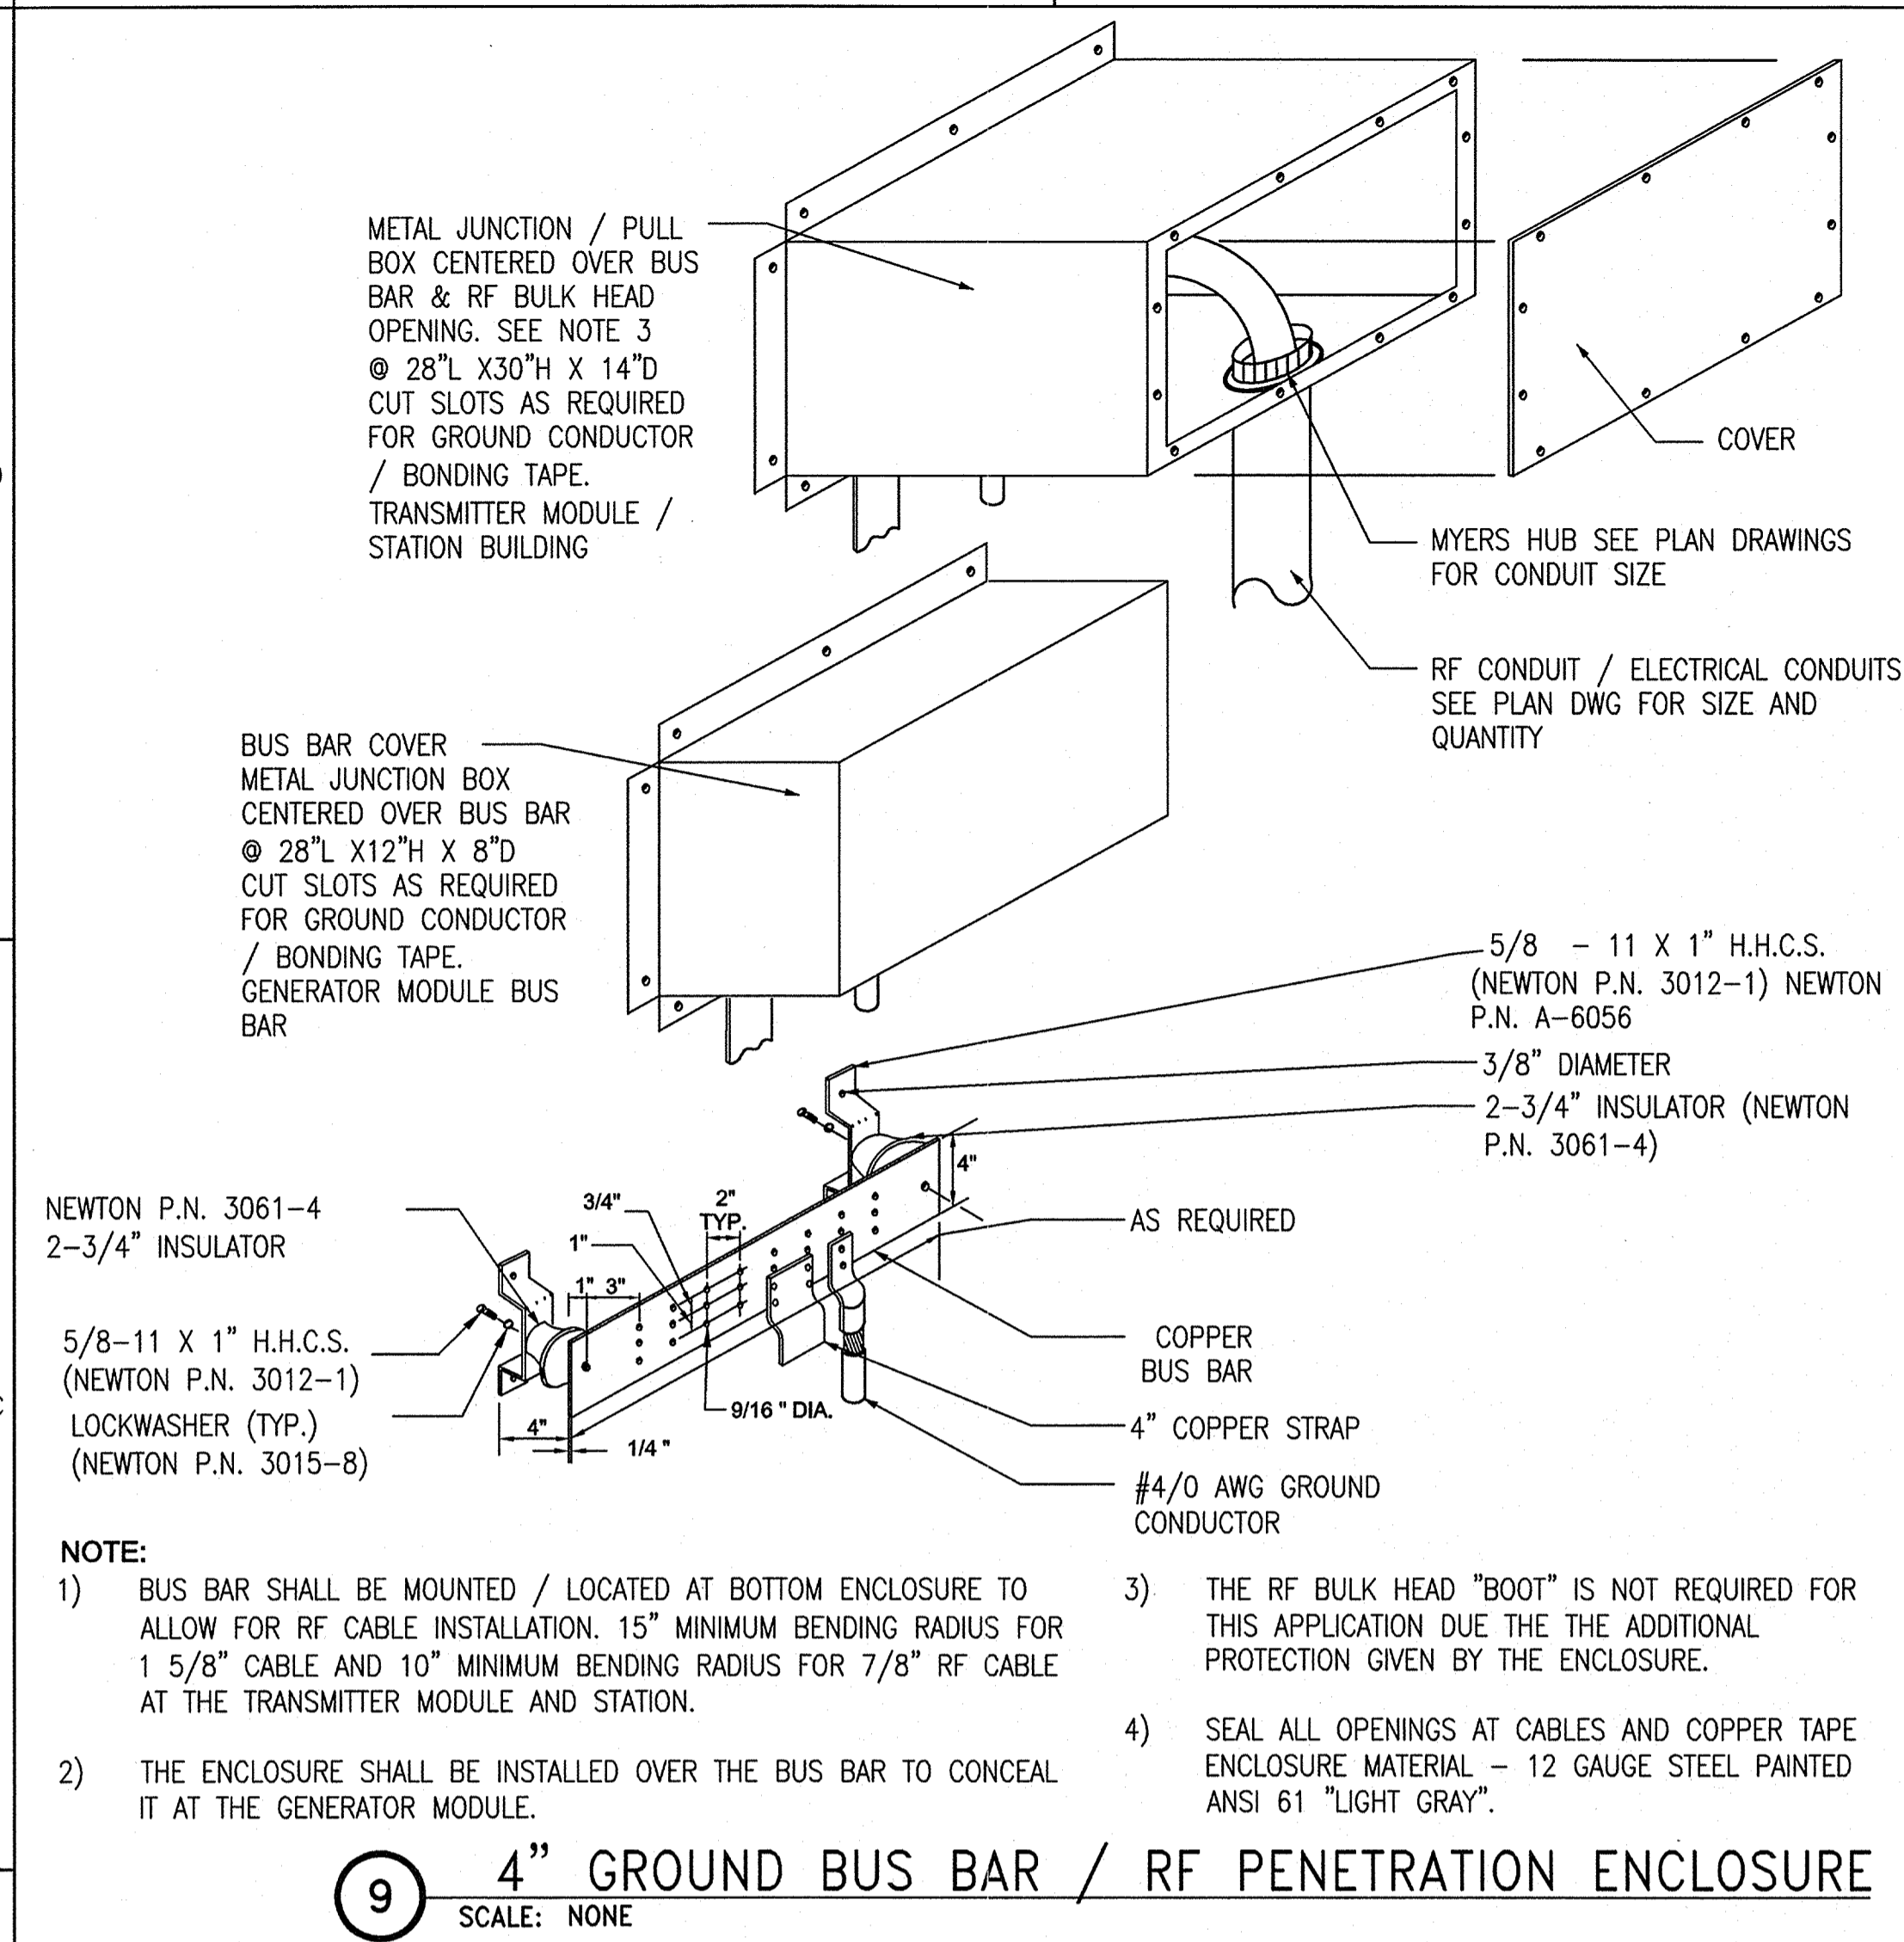


- NOTE:**
- BUS BAR SHALL BE MOUNTED / LOCATED AT BOTTOM ENCLOSURE TO ALLOW FOR RF CABLE INSTALLATION. 15" MINIMUM BENDING RADIUS FOR 1 5/8" CABLE AND 10" MINIMUM BENDING RADIUS FOR 7/8" RF CABLE AT THE TRANSMITTER MODULE AND STATION.
 - THE ENCLOSURE SHALL BE INSTALLED OVER THE BUS BAR TO CONCEAL IT AT THE GENERATOR MODULE.
 - THE RF BULK HEAD "BOOT" IS NOT REQUIRED FOR THIS APPLICATION DUE THE THE ADDITIONAL PROTECTION GIVEN BY THE ENCLOSURE.
 - SEAL ALL OPENINGS AT CABLES AND COPPER TAPE ENCLOSURE MATERIAL - 12 GAUGE STEEL PAINTED ANSI 61 "LIGHT GRAY".


9 4" GROUND BUS BAR / RF PENETRATION ENCLOSURE
SCALE: NONE

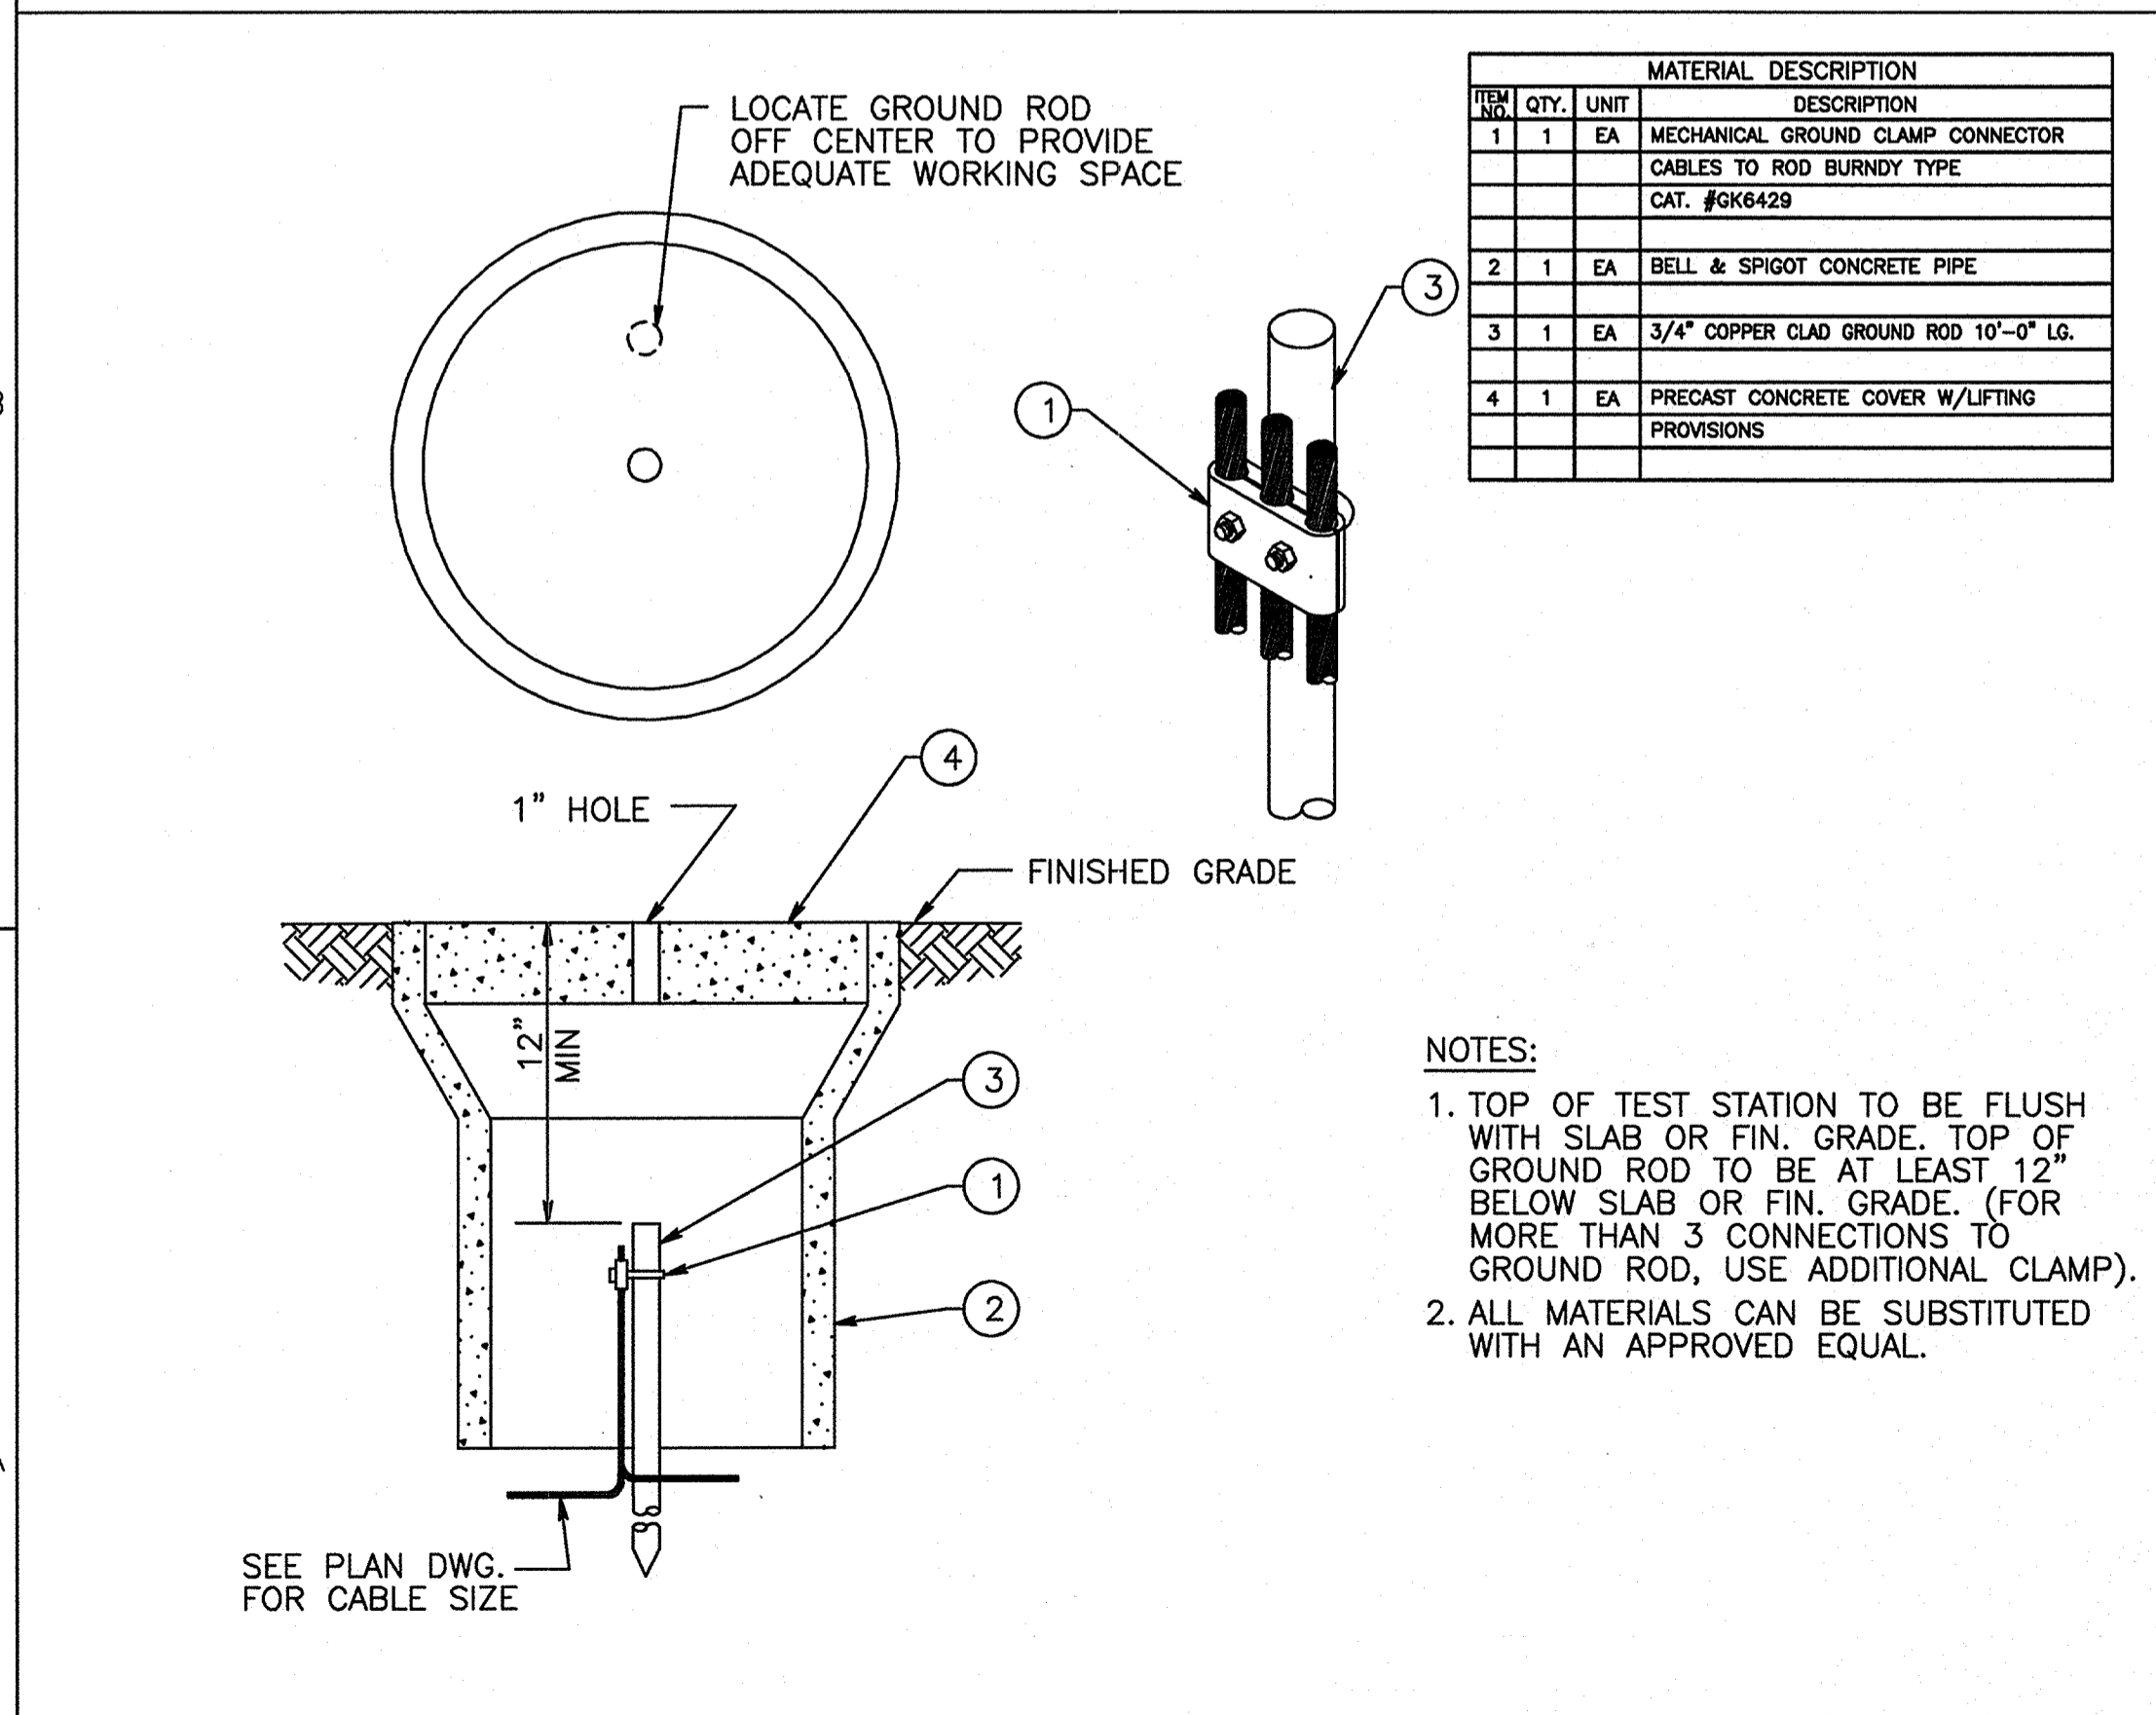

11 GROUND TEST WELL
SCALE: NONE

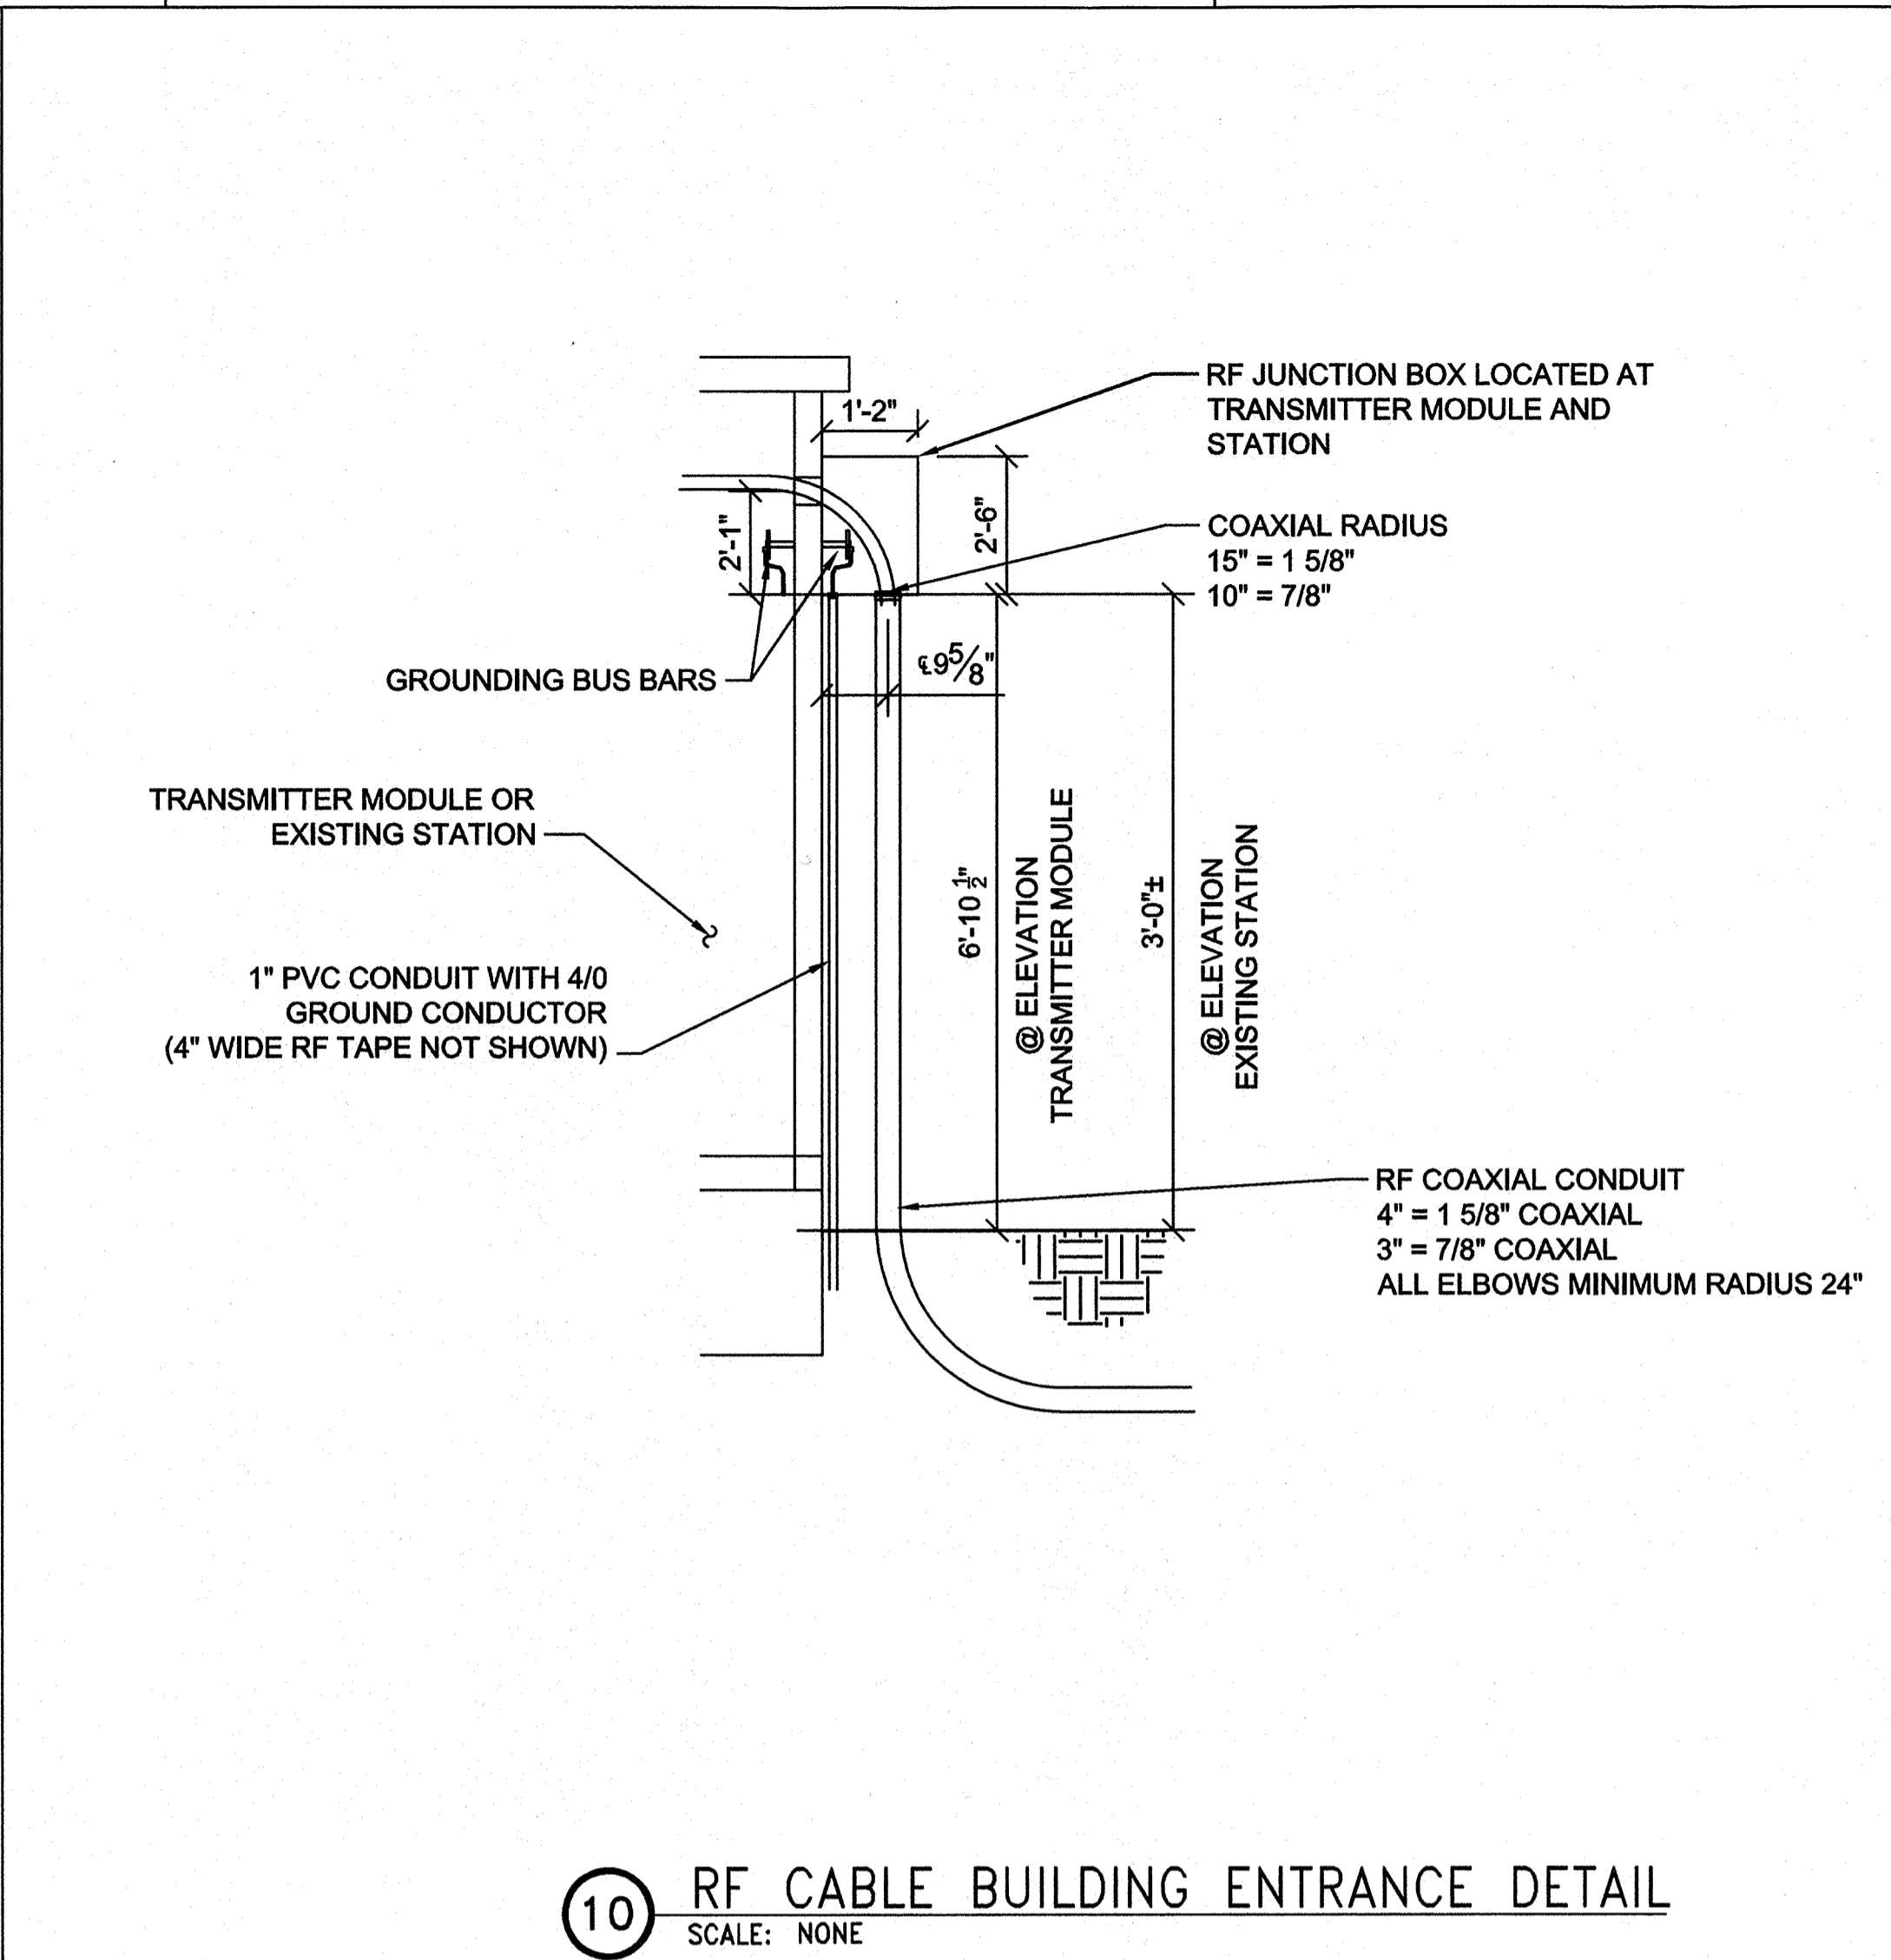


10 RF CABLE BUILDING ENTRANCE DETAIL
SCALE: NONE

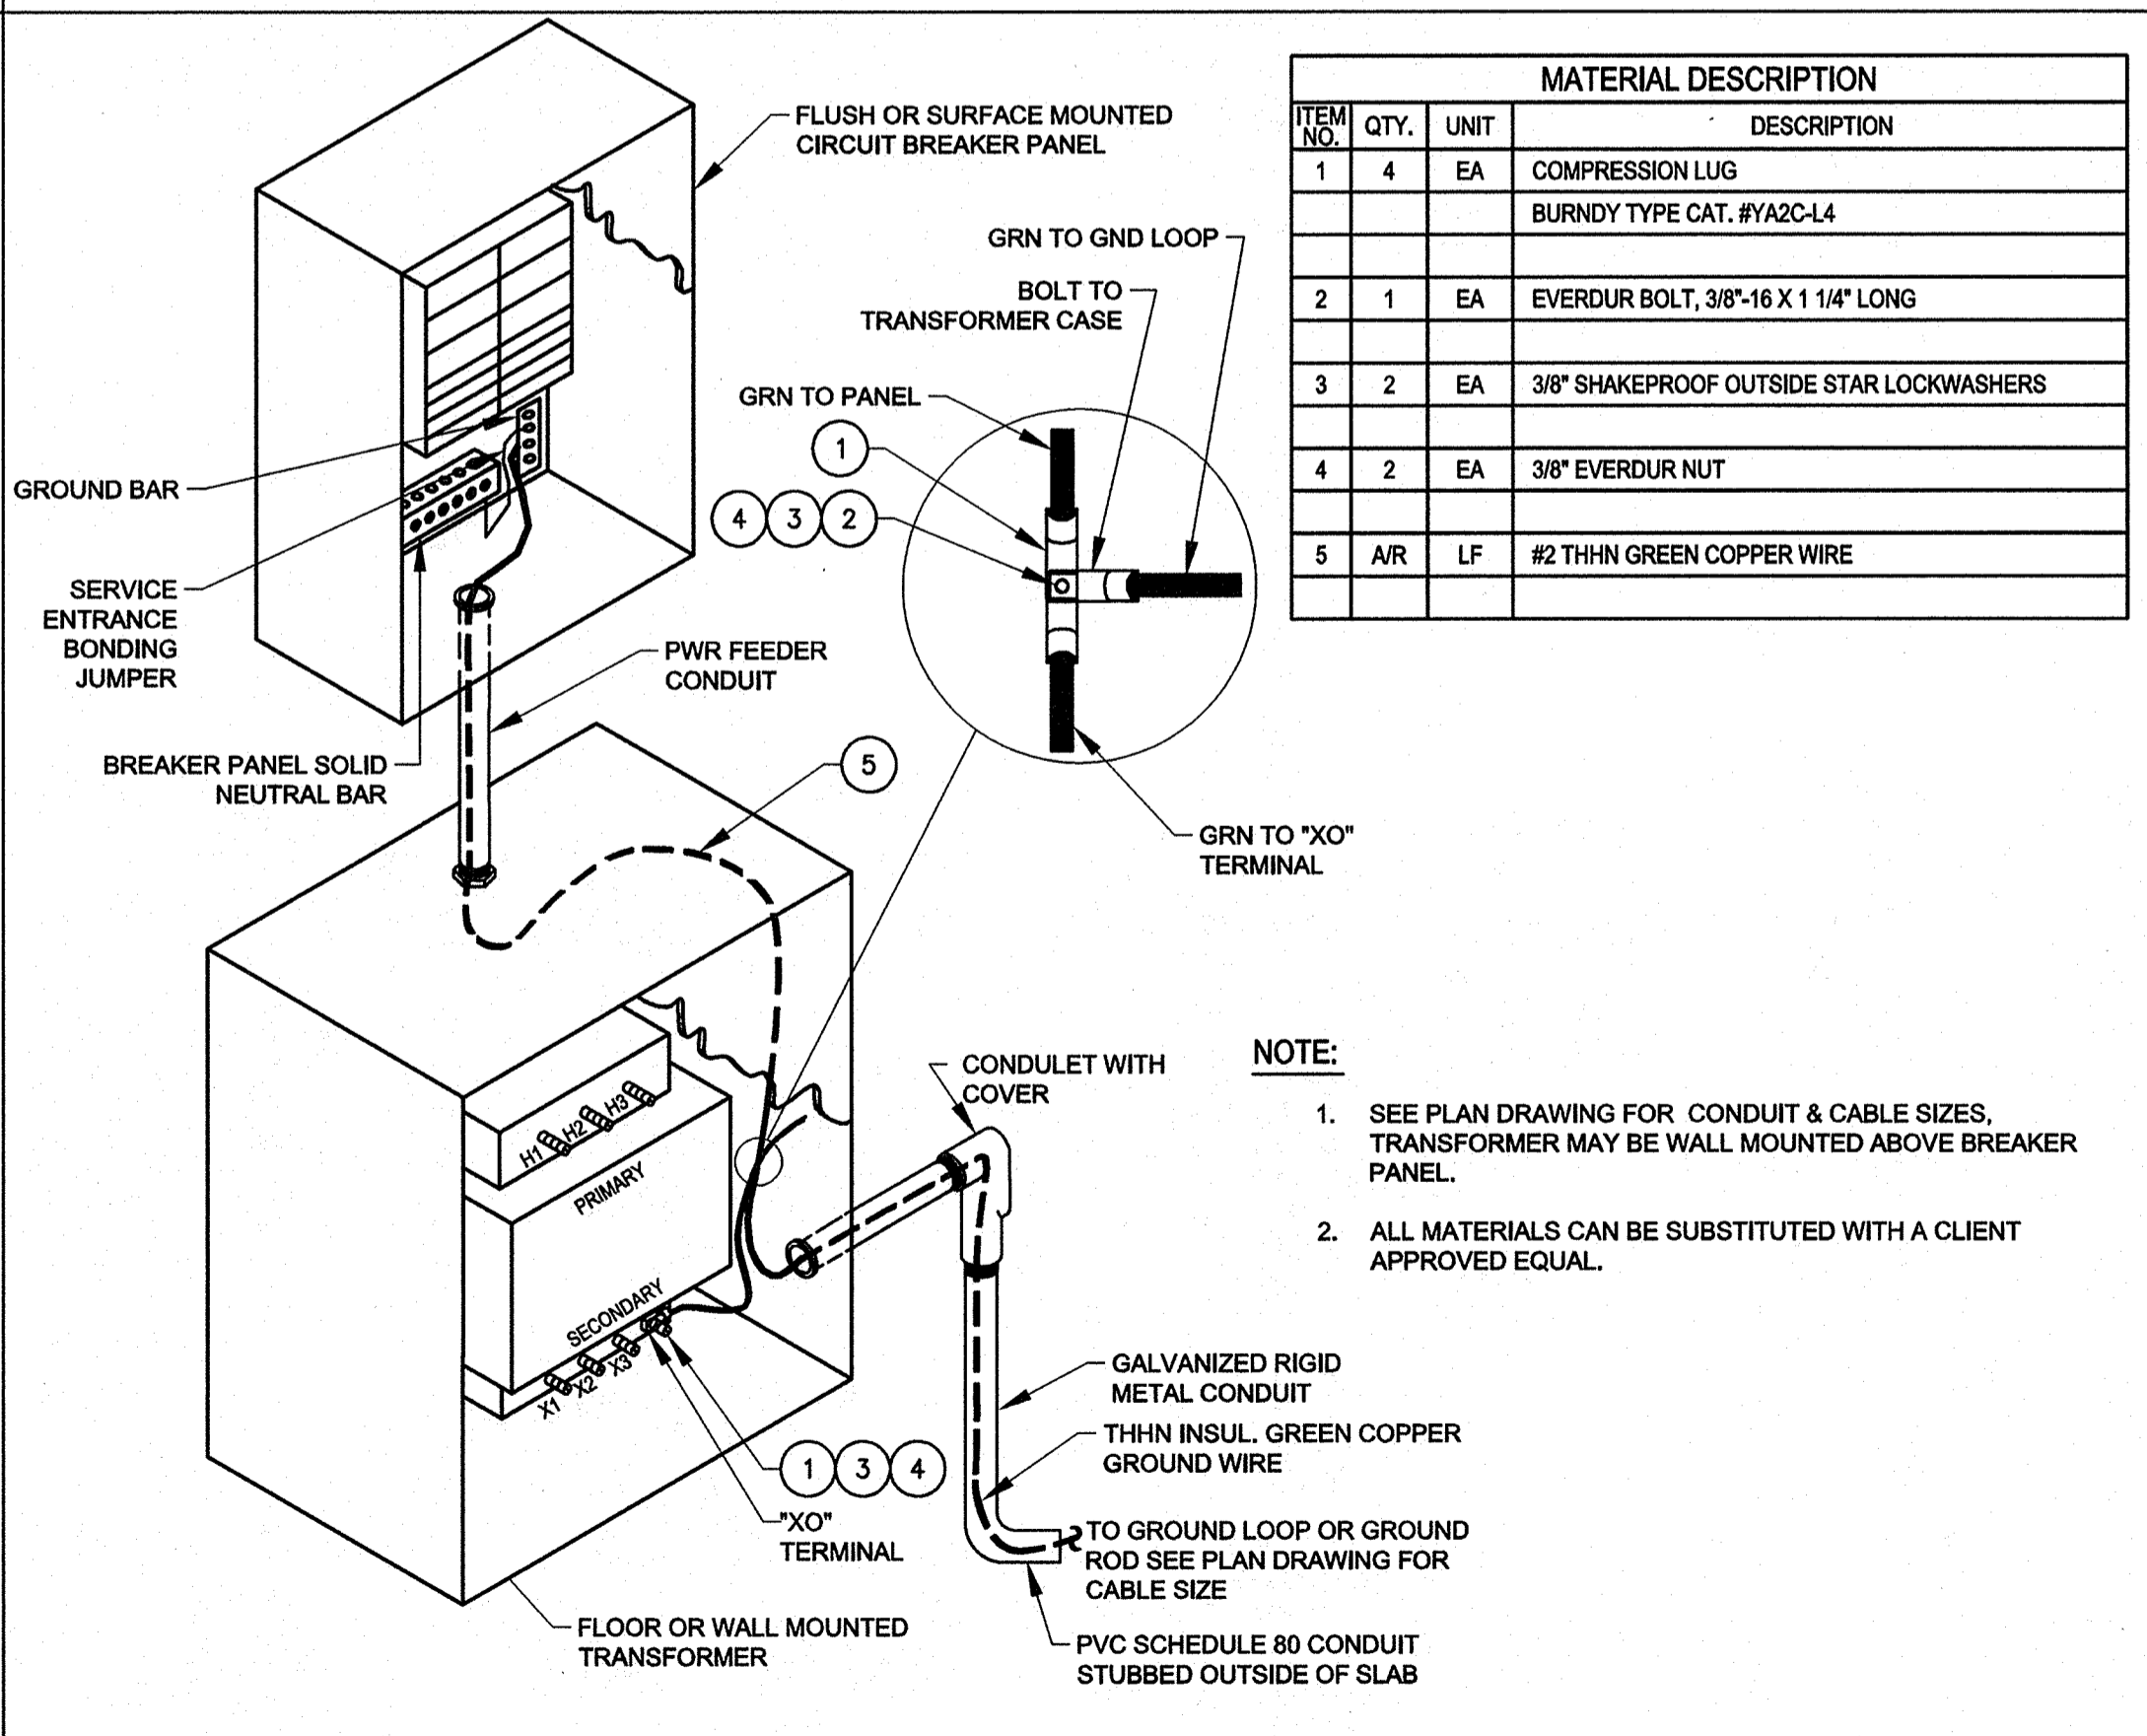

12 TRANSFORMER & PWR PANEL GROUNDING
SCALE: NONE

NOTES:

- ALL ELECTRICAL INSTALLATIONS SHALL BE IN ACCORDANCE WITH THE 2011 EDITION OF THE NATIONAL ELECTRICAL CODE (NEC NFPA 70) AND THE OCCUPATIONAL SAFETY AND HEALTH ACT (OSHA) AND PROJECT SPECIFICATIONS AND APPLICABLE CODES AND STANDARDS.

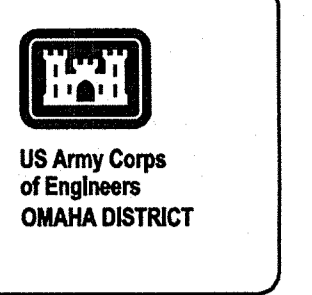


Project Manager	
DC Reviewer	
Structural	
Mechanical	
Plumbing	
Electrical	
Civil	

ISSUED FOR CONSTRUCTION	0	11/7/12	Agend
Description	Mark	Date	Agend


Designed by	SDJ
Checked by	TCG
Drawn by	SDJ
Reviewed by	TCG
Date:	2012

FEMA
KBR
63 SOUTH NOVA STREET, SUITE 200
MOBILE, AL 36602
PHONE: (251) 462-7000
FAX: (251) 462-7000
Engineering Services by
KBR Engineering Co., LLC


FEMA EMERGENCY RADIO NETWORK
ON WIGAN PORTLAND, MAINE
**INSTALLATION
DETAILS**

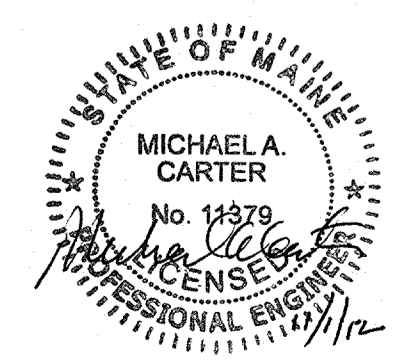


Drawing Number:
E-503

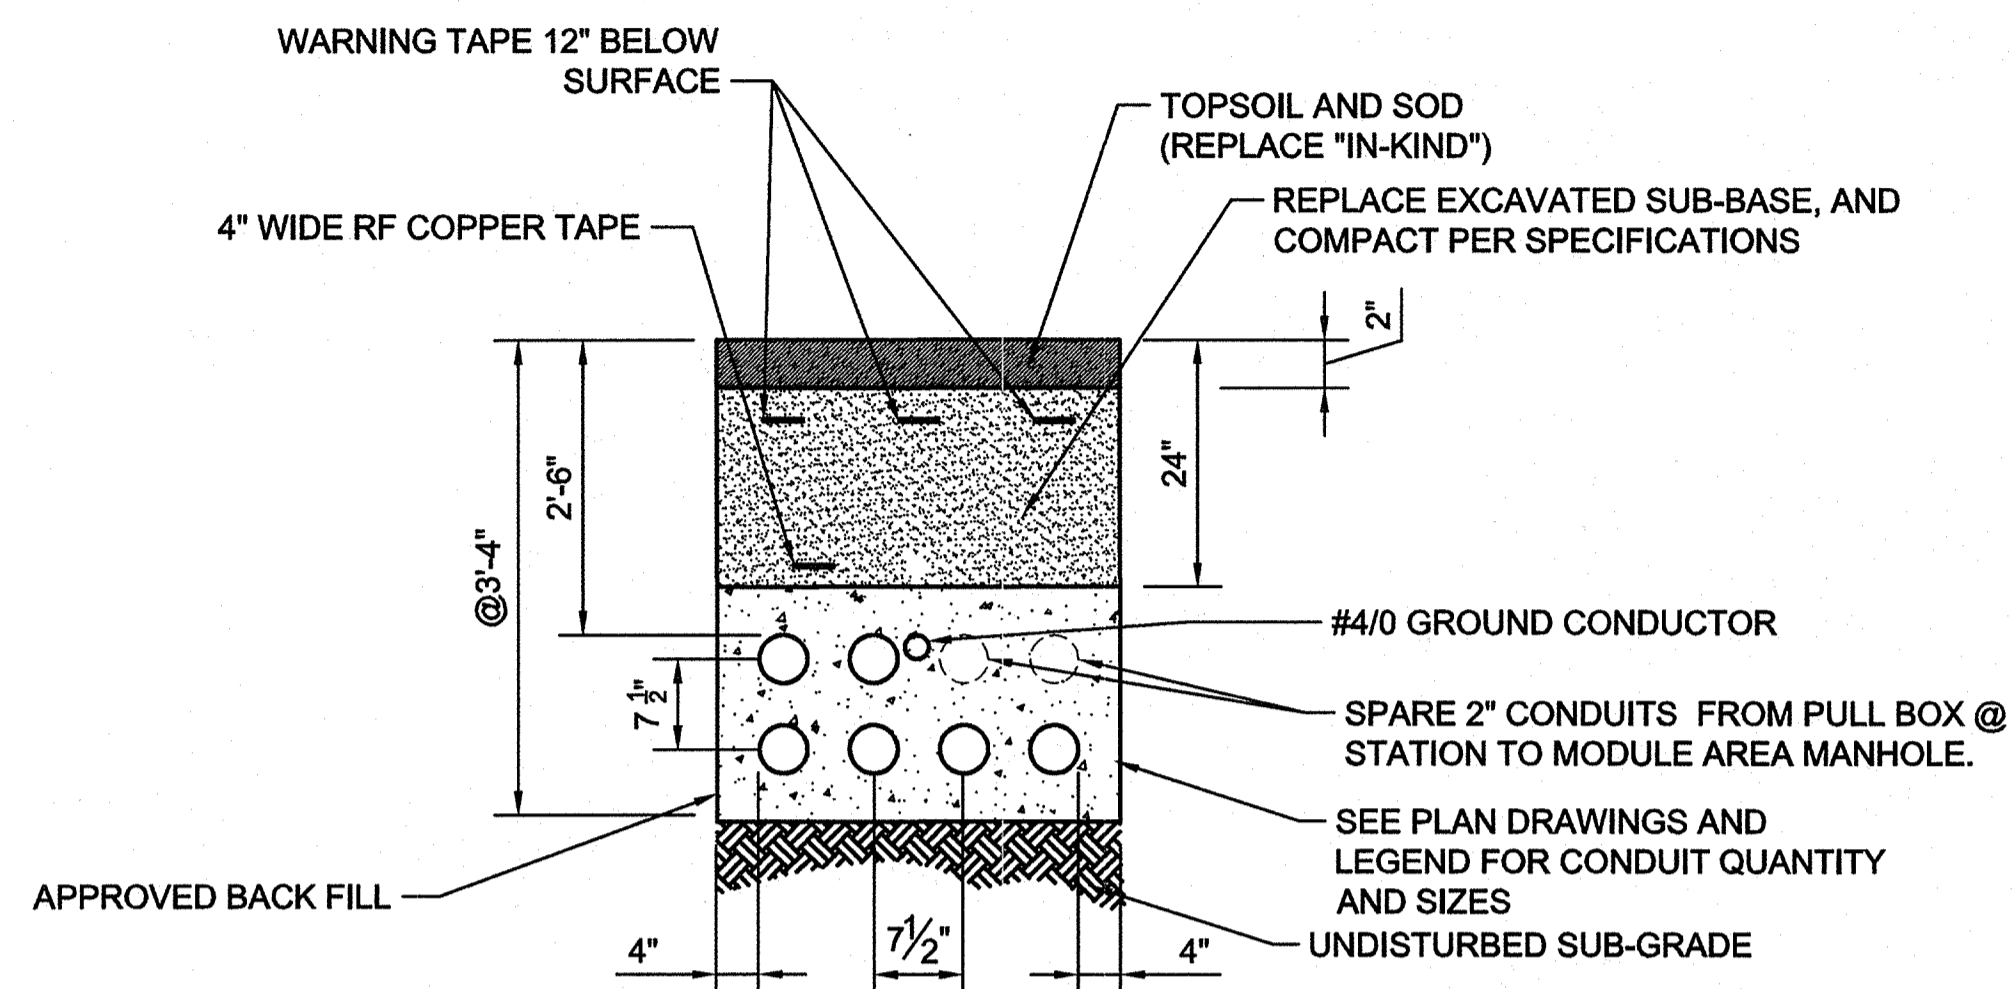


13 TYPICAL ELECTRICAL DUCT SECTION
SCALE: NONE

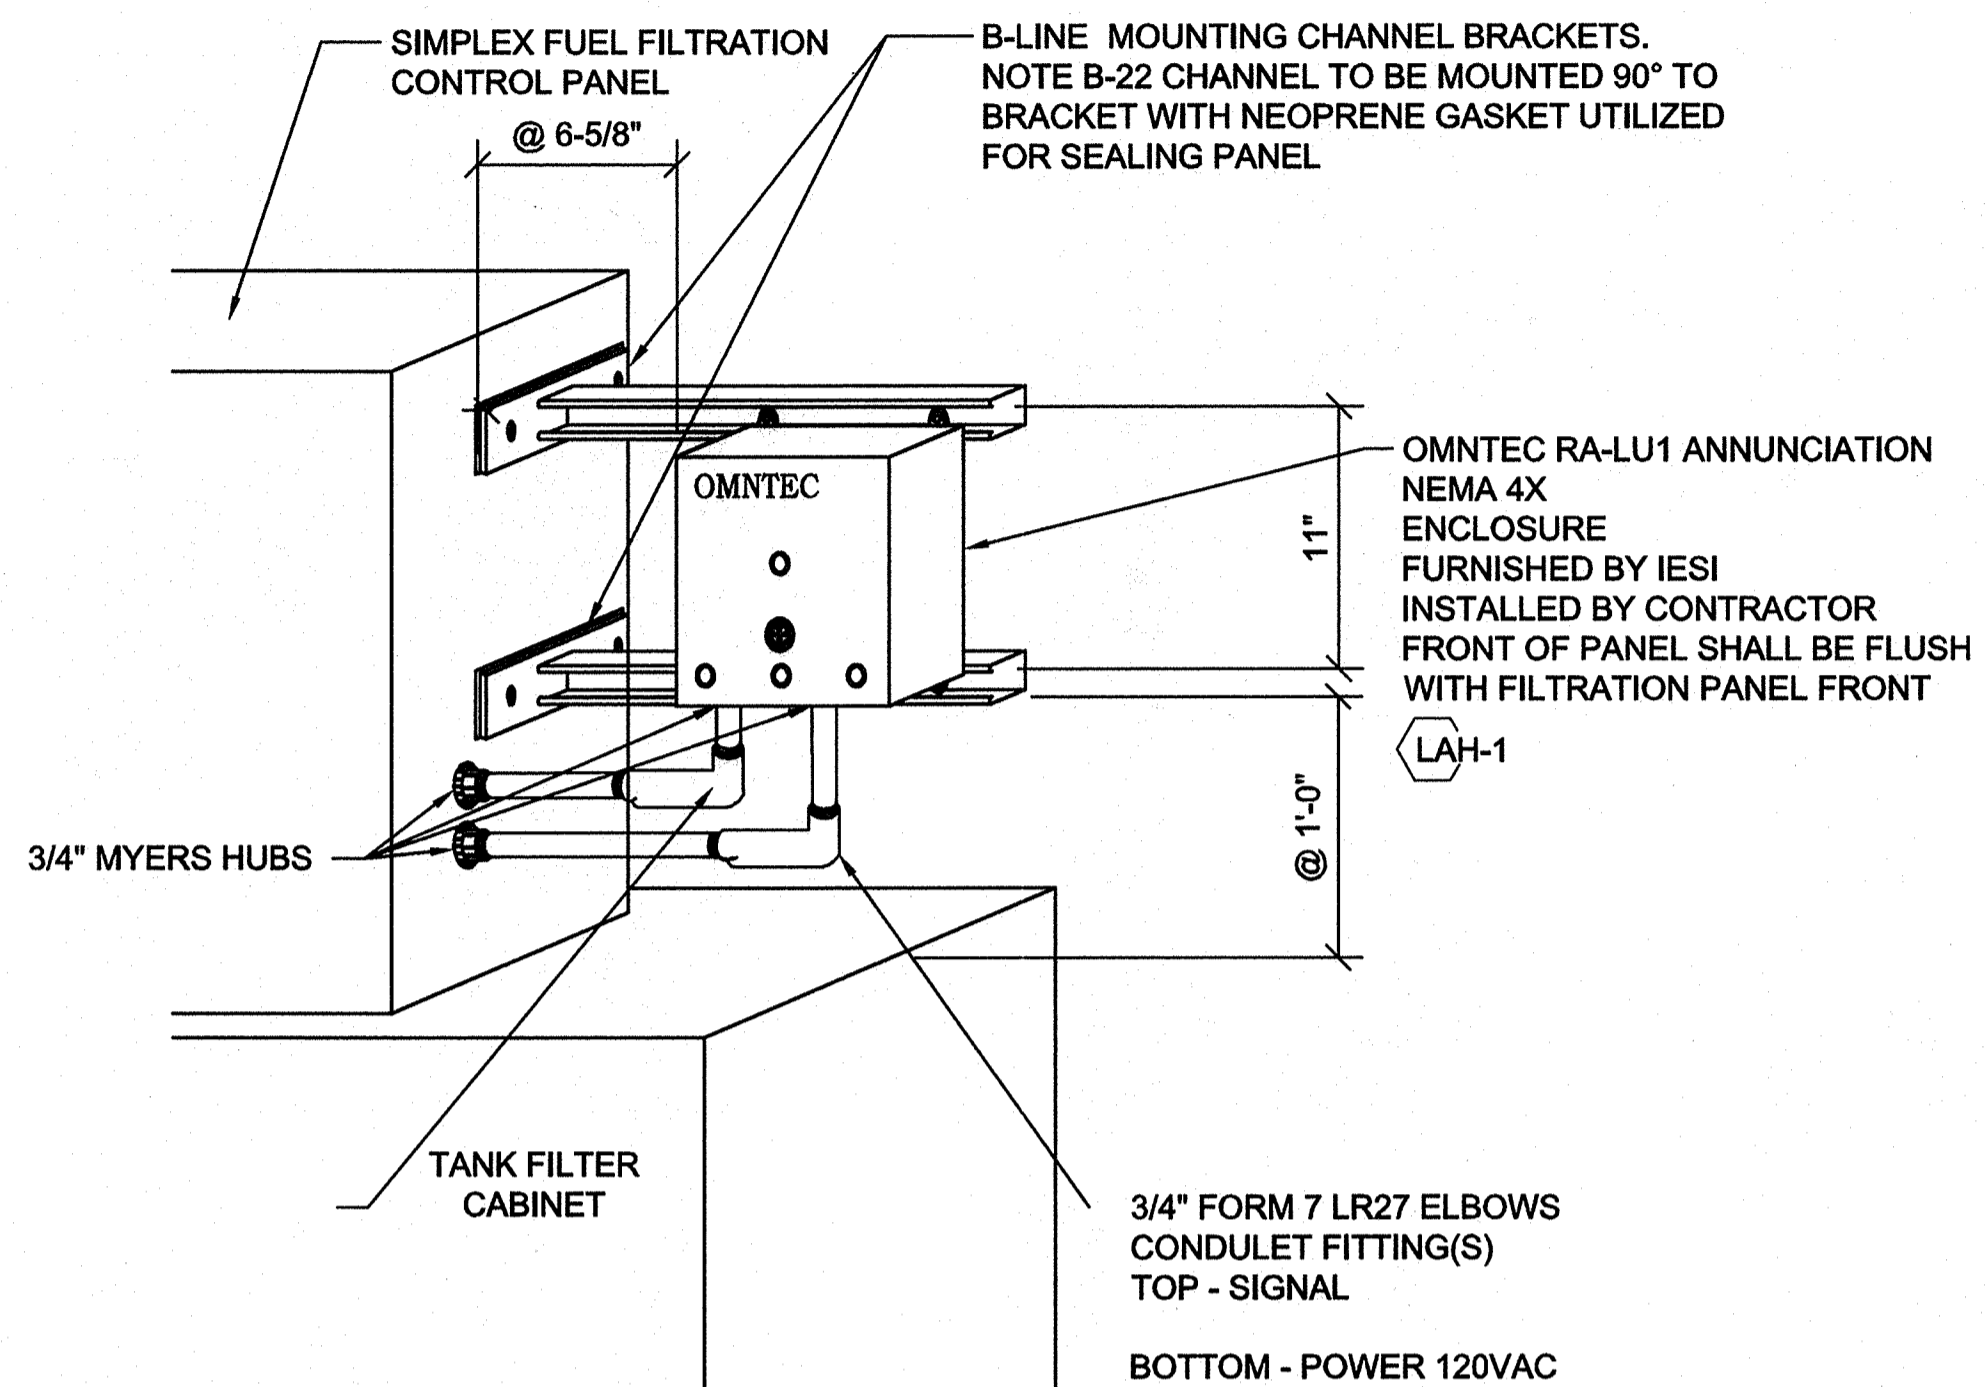

14 LOCAL ANNUNCIATOR MOUNTING
SCALE: NONE

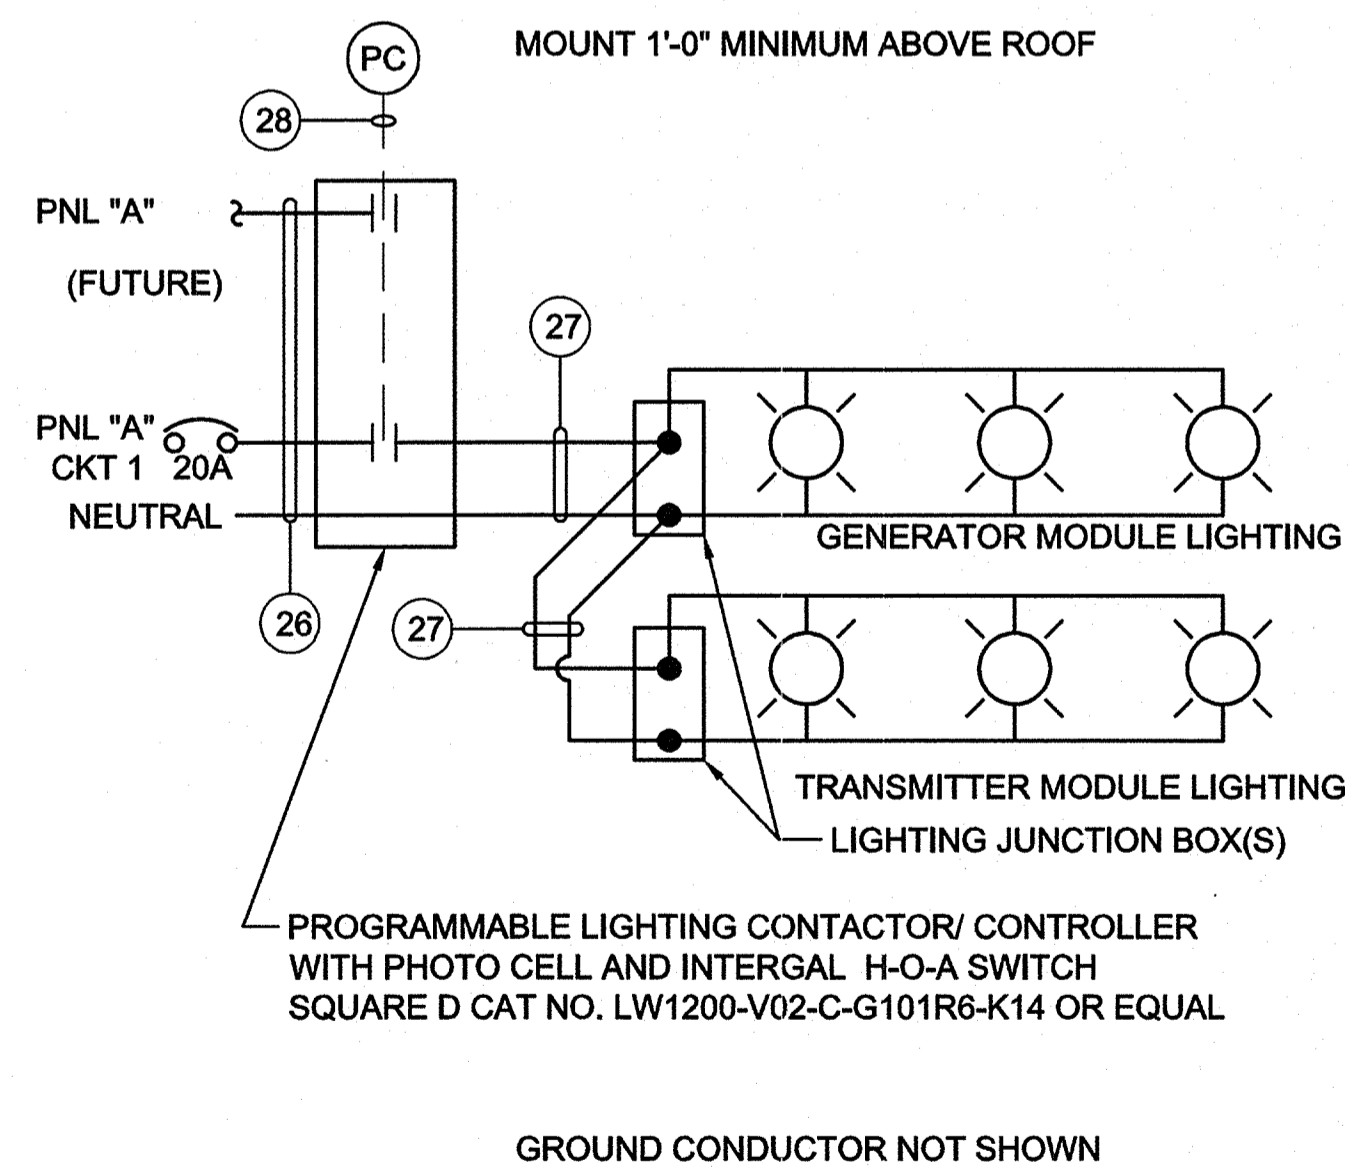

15 LIGHTING CONTACTOR DETAIL
SCALE: NONE

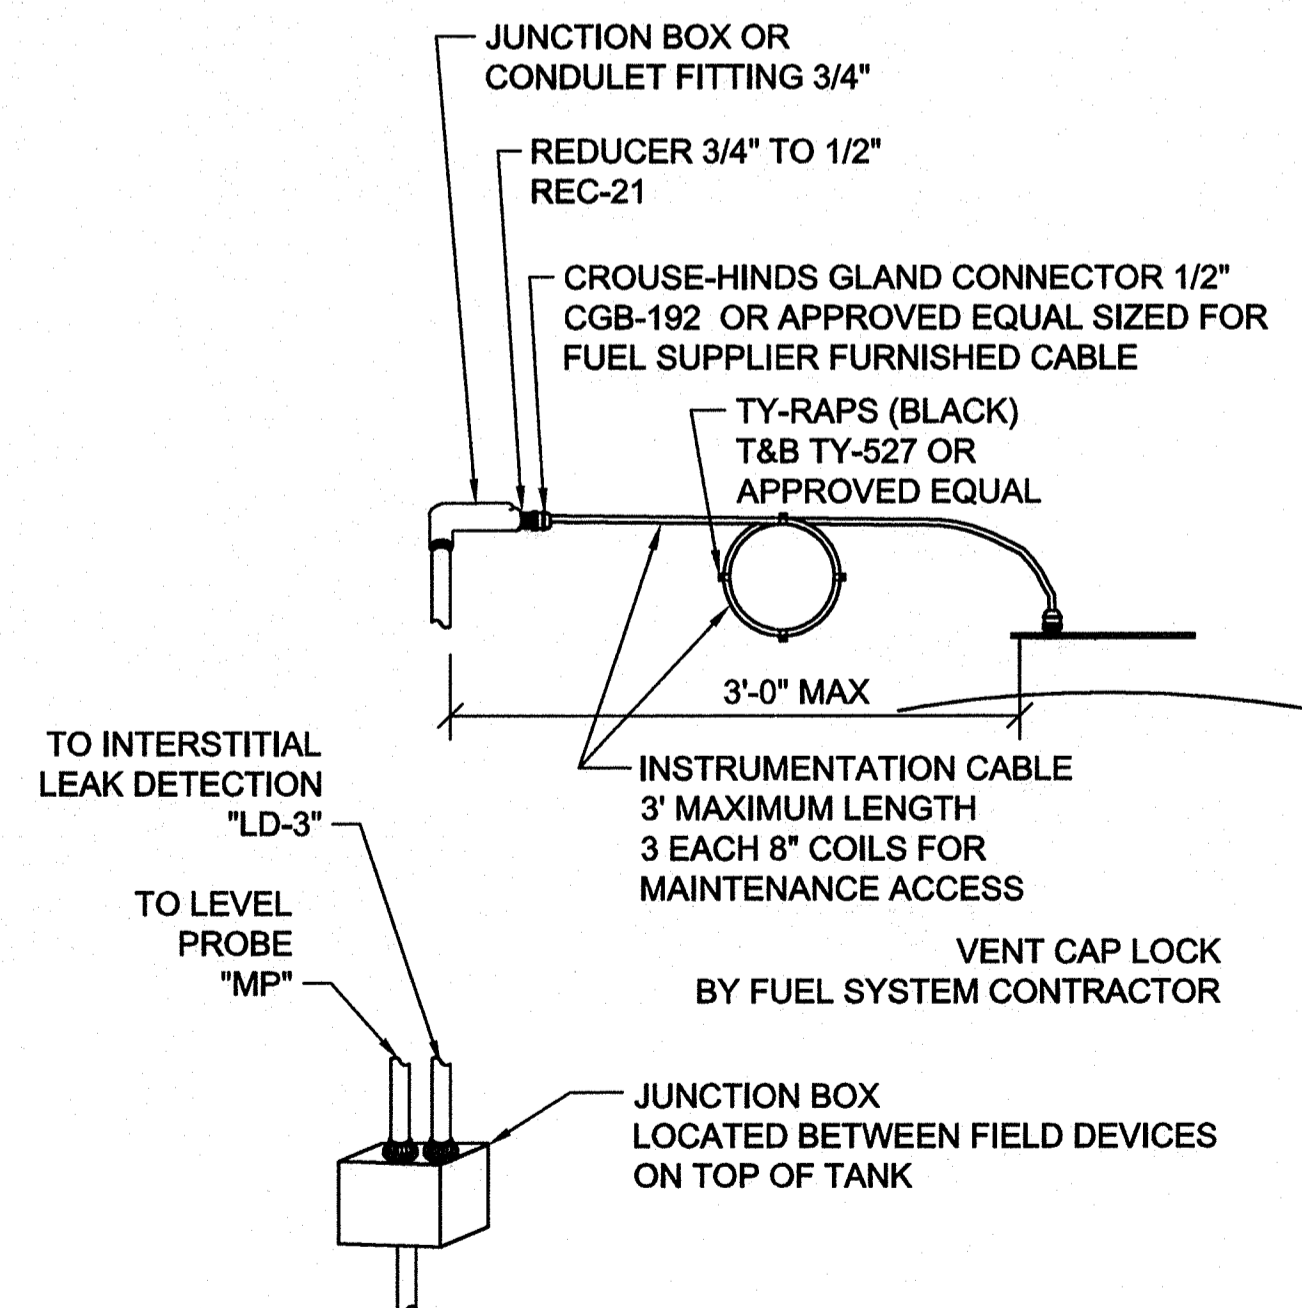

16 TANK DEVICE CONNECTION
SCALE: NONE

NOTES:

- ALL ELECTRICAL INSTALLATIONS SHALL BE IN ACCORDANCE WITH THE 2011 EDITION OF THE NATIONAL ELECTRICAL CODE (NEC NFPA 70) AND THE OCCUPATIONAL SAFETY AND HEALTH ACT (OSHA) AND PROJECT SPECIFICATIONS AND APPLICABLE CODES AND STANDARDS.



Project Manager	
DC Designer	
Structural	
Mechanical	
Electrical	
Other	

ISSUED FOR CONSTRUCTION	11/7/12	Date	Approved
Mark			


Designed by	SDJ
Checked by	TCG
Drawn by	SDJ
Reviewed by	MAC
Date	2012

KBR
63 SOUTH ROYAL STREET, SUITE 200
MOBILE, AL 36602
PHONE (251) 452-7600
FAX (251) 452-7424

FEMA
Engineering Services by
KBR Engineering Co., LLC

FEMA EMERGENCY RADIO NETWORK
ON WIGAN PORTLAND, MAINE

**INSTALLATION
DETAILS**

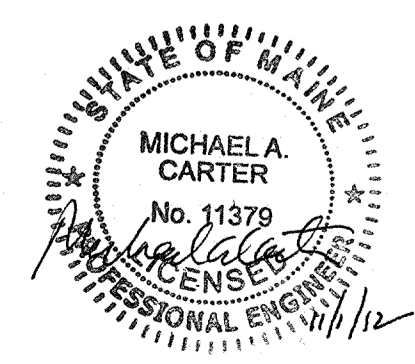

Drawing Number:
E-504