



GRAVEL WETLAND #1 PLAN VIEW
SCALE: 1" = 20'

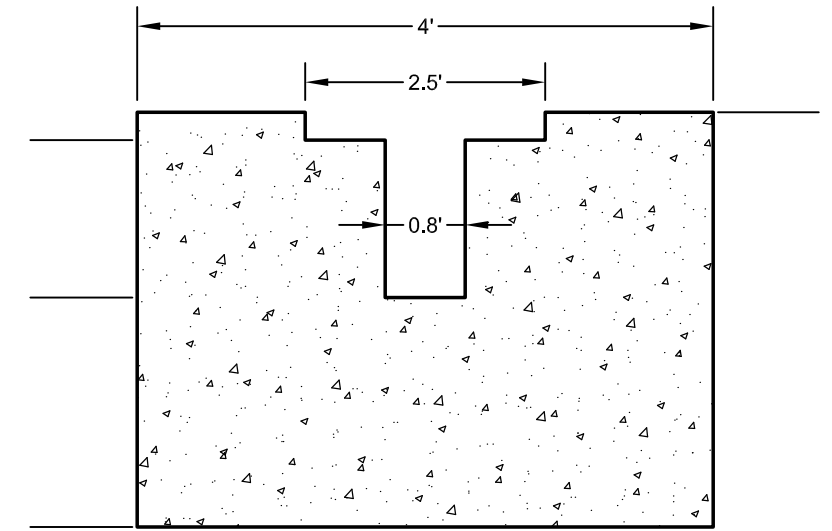

NOTES:
THIS FLOW CONTROL PANEL IS TO BE INSTALLED WITHIN AN OUTLET CONTROL STRUCTURE. SEE SHEET C-4 FOR OUTLET CONTROL STRUCTURE DETAIL.

(A) CAST IN PLACE FLOW CONTROL PANEL
N.T.S.

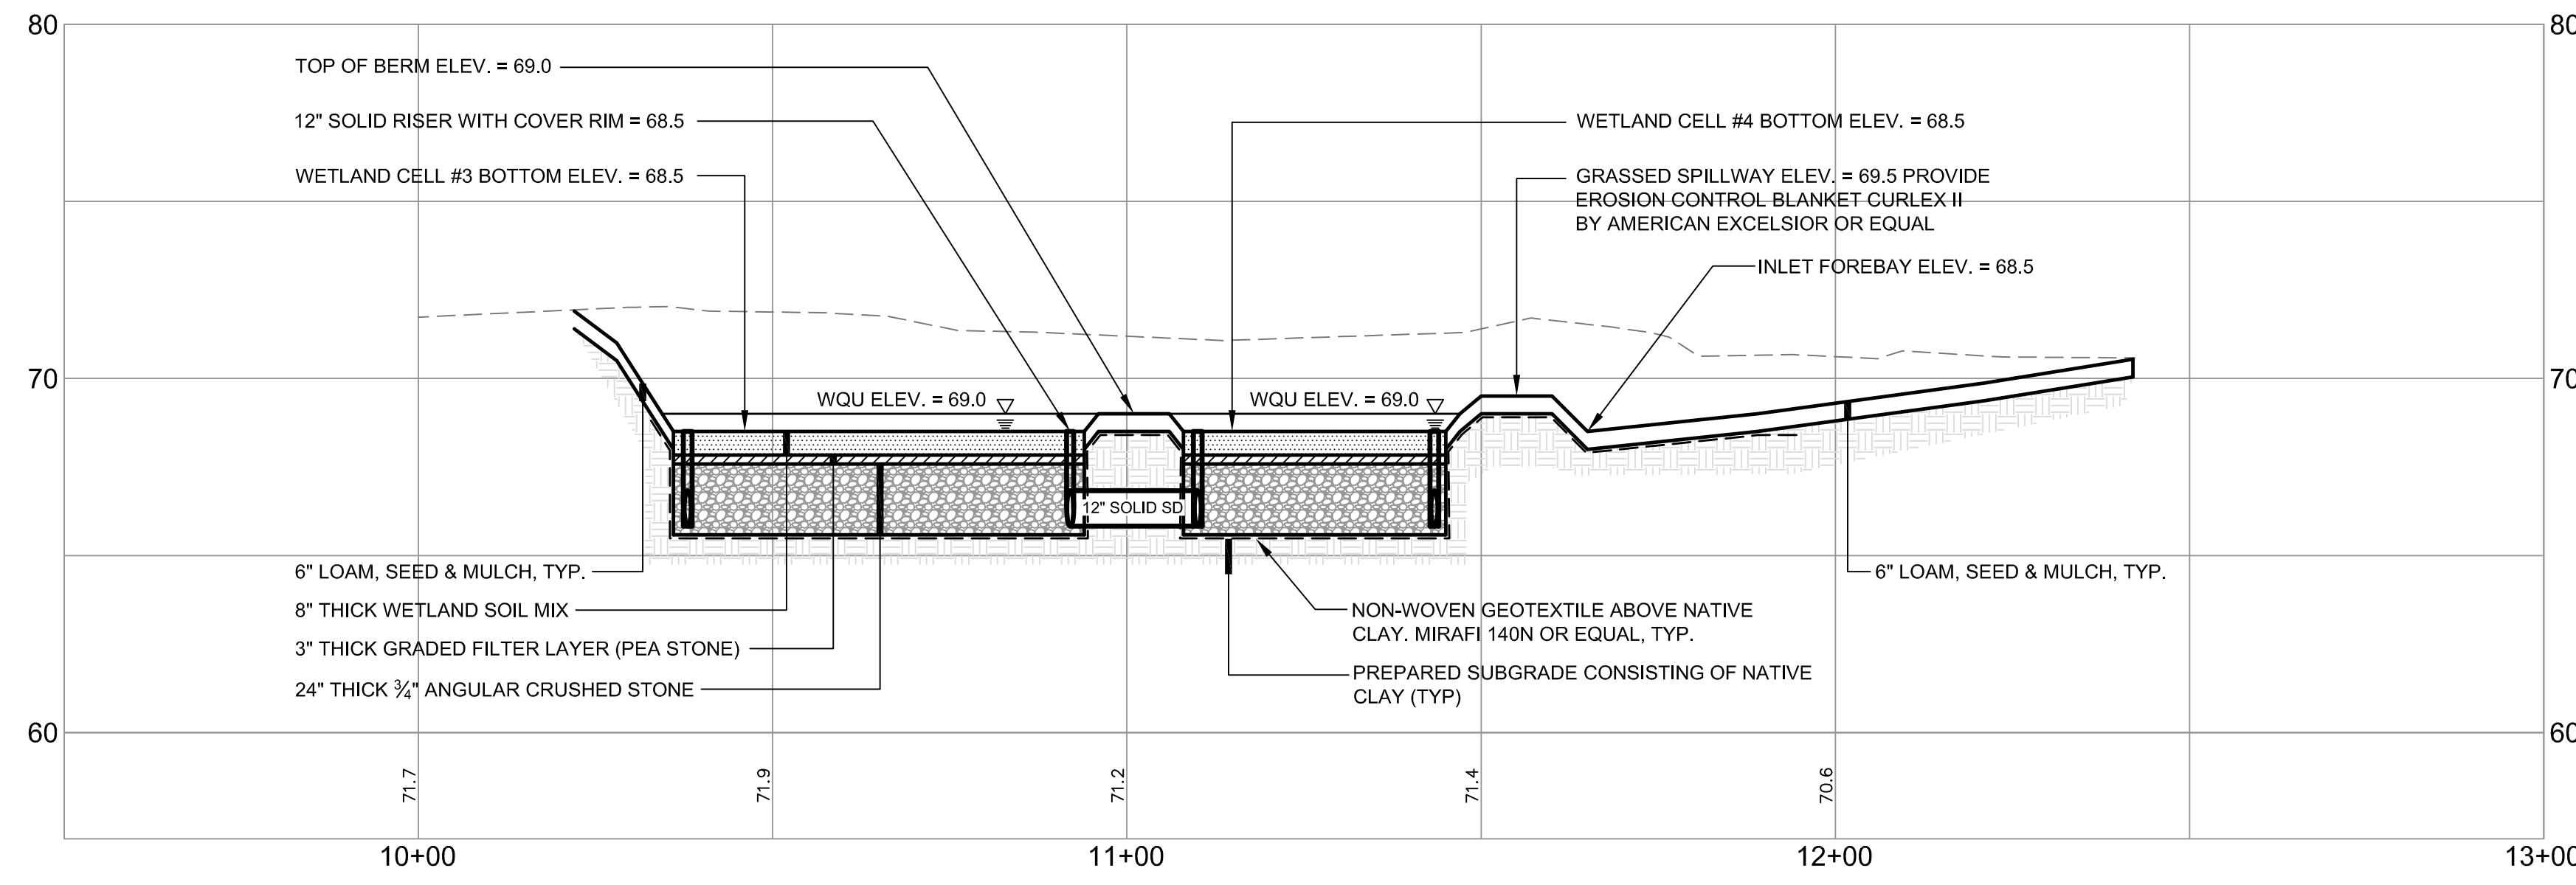

GRAVEL WETLAND #1 SECTION B-B
SCALE: H: 1" = 20'; V: 1" = 4'

NOTES

- SUBSURFACE GRAVEL WETLANDS WERE DESIGNED PER THE UNIVERSITY OF NEW HAMPSHIRE STORMWATER CENTER'S (UNHSC) DESIGN SPECIFICATIONS, DATED JUNE 2009.
- WETLAND SOIL: THE WETLAND SOIL SHOULD BE SIMILAR TO A NATIVE WETLAND SOIL WITH LOW HYDRAULIC CONDUCTIVITY. THIS SOIL CAN BE MANUFACTURED USING COMPOST, SAND, AND SOME FINE SOILS. SURFACE INFILTRATION RATES SHOULD BE BETWEEN 3.5 X 10-4 CM/SEC AND 3.5 X 10-6 CM/SEC. ORGANIC CONTENT SHOULD BE >15%, AND CLAY CONTENT SHOULD BE <15% TO PREVENT THE MIGRATION OF FINES INTO THE SUBSURFACE GRAVEL LAYER. THE EXISTING HYDRIC SOILS REMOVED FROM IMPACTED WETLAND AREAS MAY ALSO BE USED.
- THE 3" THICK GRADED FILTER OR CHOKER COURSE IS INTENDED TO PREVENT THE WETLAND SOIL FROM MIGRATING DOWN INTO THE CRUSHED STONE SUB-LAYER. MATERIAL COMPATIBILITY MUST MEET THE FOLLOWING FHWA CRITERIA:
D15 (COARSE SUB-LAYER) ≤ 5 X D85 (GRADED FILTER)
D50 (COARSE SUB-LAYER) ≤ 25 X D50 (GRADED FILTER)
- THE COARSE SUB-LAYER MATERIAL SHALL BE AN ANGULAR CRUSHED STONE MEETING THE REQUIREMENTS OF MDOT 703.22 TYPE C.
- GEOTEXTILES SHOULD NOT BE USED BETWEEN HORIZONTAL LAYERS OF THIS SYSTEM, AS THEY MAY CLOG DUE TO FINES AND MAY RESTRICT ROOT GROWTH
- THE SEASONAL HIGH GROUNDWATER ELEVATION IN THE AREA OF GRAVEL WETLAND #1 IS APPROXIMATELY 67.0 BASED ON TEST PIT TP-ST-1.
- CONSTRUCTION OVERSIGHT: THE OWNER WILL RETAIN THE SERVICES OF A PROFESSIONAL ENGINEER TO INSPECT THE CONSTRUCTION AND STABILIZATION OF ALL STORMWATER MANAGEMENT STRUCTURES. IF NECESSARY, THE INSPECTING ENGINEER WILL INTERPRET THE POND'S CONSTRUCTION PLAN FOR THE CONTRACTOR. ONCE ALL STORMWATER MANAGEMENT STRUCTURES ARE CONSTRUCTED AND STABILIZED, THE INSPECTING ENGINEER WILL NOTIFY THE DEPARTMENT IN WRITING WITHIN 30 DAYS TO STATE THAT THE POND HAS BEEN COMPLETED. ACCOMPANYING THE ENGINEER'S NOTIFICATION MUST BE A LOG OF THE ENGINEER'S INSPECTIONS GIVING THE DATE AND TIME OF EACH INSPECTION AND THE ITEMS INSPECTED ON EACH VISIT AND INCLUDING ANY TESTING DATA OR SIEVE ANALYSIS DATA OF EVERY MINERAL SOIL AND SOIL MEDIA SPECIFIED IN THE PLANS AND USED ON SITE.
- CONSTRUCTION SEQUENCE: THE SUBSURFACE GRAVEL WETLAND MUST NOT BE INSTALLED UNTIL THE AREA THAT DRAINS TO THE WETLAND HAS BEEN PERMANENTLY STABILIZED WITH PAVEMENT OR OTHER STRUCTURE, 90% VEGETATION COVER, OR OTHER PERMANENT STABILIZATION UNLESS THE RUNOFF FROM THE CONTRIBUTING DRAINAGE AREA IS DIVERTED AROUND THE STRUCTURE UNTIL STABILIZATION IS COMPLETE.
- COMPACTION: WETLAND SOIL AND SUBSURFACE MATERIAL MUST BE COMPACTED TO BETWEEN 90% AND 95% STANDARD PROCTOR.
- TEST PIT TP-ST-1 REVEALED GLACIOMARINE SOILS AT DEPTHS BELOW 4.0'. A PERMEABILITY TEST CONFORMING TO ASTM D2434 MAY BE COMPLETED ON THIS MATERIAL TO DETERMINE IF IT MEETS THE REQUIREMENTS FOR LOW PERMEABILITY CLAY LINER MATERIAL. IF THE NATIVE CLAY IS FOUND TO HAVE A PERMEABILITY OF LESS THAN 1 X 10-6 CM/SEC, NO ADDITIONAL CLAY LINER IS NECESSARY.
- CONSTRUCTION OVERSIGHT: INSPECTION BY A PROFESSIONAL ENGINEER WILL OCCUR AT A MINIMUM:
AFTER THE PRELIMINARY CONSTRUCTION OF THE STRUCTURE'S GRADES AND ONCE THE SUBSURFACE DRAIN PIPES ARE INSTALLED BUT NOT BACKFILLED.
AFTER THE CRUSHED STONE LAYER IS CONSTRUCTED AND PRIOR TO THE INSTALLATION OF THE WETLAND SOIL.
AFTER THE WETLAND SOIL HAS BEEN INSTALLED AND SEEDED.
AFTER ONE YEAR TO INSPECT HEALTH OF THE VEGETATION AND MAKE CORRECTIONS.
ALL THE MATERIAL USED FOR THE CONSTRUCTION OF THE FILTER BASIN MUST BE CONFIRMED AS SUITABLE BY THE DESIGN ENGINEER. TESTING MUST BE DONE BY A CERTIFIED LABORATORY TO SHOW THAT THEY ARE PASSING DESIGN SPECIFICATIONS.
- TESTING AND SUBMITTALS: THE CONTRACTOR SHALL IDENTIFY THE LOCATION OF THE SOURCE OF EACH COMPONENT OF THE SUBSURFACE GRAVEL WETLAND SYSTEM. ALL RESULTS OF FIELD AND LABORATORY TESTING SHALL BE SUBMITTED TO THE DESIGN ENGINEER FOR CONFIRMATION. THE CONTRACTOR SHALL:
PERFORM A SIEVE ANALYSIS CONFORMING TO ASTM C136 (STANDARD TEST METHOD FOR SIEVE ANALYSIS OF FINE AND COURSE AGGREGATES 1996A) ON EACH MATERIAL USED IN THE SUBSURFACE GRAVEL WETLAND SYSTEM.
PERFORM A HYDROMETER GRAIN SIZE ANALYSIS ON THE WETLAND SOIL.
DETERMINE ORGANIC CONTENT OF THE WETLAND SOIL PER ASTM D2974.
PERFORM A PERMEABILITY TEST ON THE WETLAND SOIL CONFORMING TO ASTM D2434 WITH THE MIXTURE COMPACTED TO 90% TO 95% OF MAXIMUM DRY DENSITY BASED ON ASTM D698.
- THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR ALL MATERIALS AND CONSTRUCTION PROCEDURES UTILIZED IN THE CONSTRUCTION OF THE SUBSURFACE GRAVEL WETLAND SYSTEM AND FOR MAINTENANCE AND PROTECTION OF THE CONSTRUCTED SYSTEM UNTIL APPROVAL AND ACCEPTANCE BY THE DESIGN ENGINEER.
- UPON COMPLETION OF INSTALLATION OF THE WETLAND SOIL LAYER AND ESTABLISHMENT OF 90% OF VEGETATION WITHIN THE STRUCTURE, THE CONTRACTOR SHALL FLOOD THE BASIN TO THE WATER QUALITY ELEVATION WITH CLEAN WATER AND ADJUST THE BALL VALVE INSTALLED ON THE UNDERDRAIN OUTLET TO ACHIEVE A 24-48 HOUR DRAIN TIME.

	PROJECT	PH WARREN AVENUE, LLC COMMERCIAL SITE 421 WARREN AVENUE	ENGINEERS	FST FAY, SPOFFORD & THORNDIKE, INC. ENGINEERS · PLANNERS · SCIENTISTS 778 MAIN ST, SUITE B, SOUTH PORTLAND, ME 04106
	SHEET TITLE	GRAVEL WETLAND #1 PLAN VIEW AND SECTIONS		DRAWN: CMW DESIGNED: SRB CHECKED: SRB FILE NAME: SP-M104-GRAVEL WETLAND SECTIONS SHEET C-4.1
CLIENT	PH WARREN AVENUE, LLC C/O PETER HOLMES 12 WILDWOOD LANE SCARBOROUGH, ME 04074	DATE	NOVEMBER 2013	SCALE: AS NOTED
REV	DATE	DESCRIPTION	JOB NO. SP-M104	
		REVISIONS	JOB NO. SP-M104	
			JOB NO. SP-M104	
			JOB NO. SP-M104	