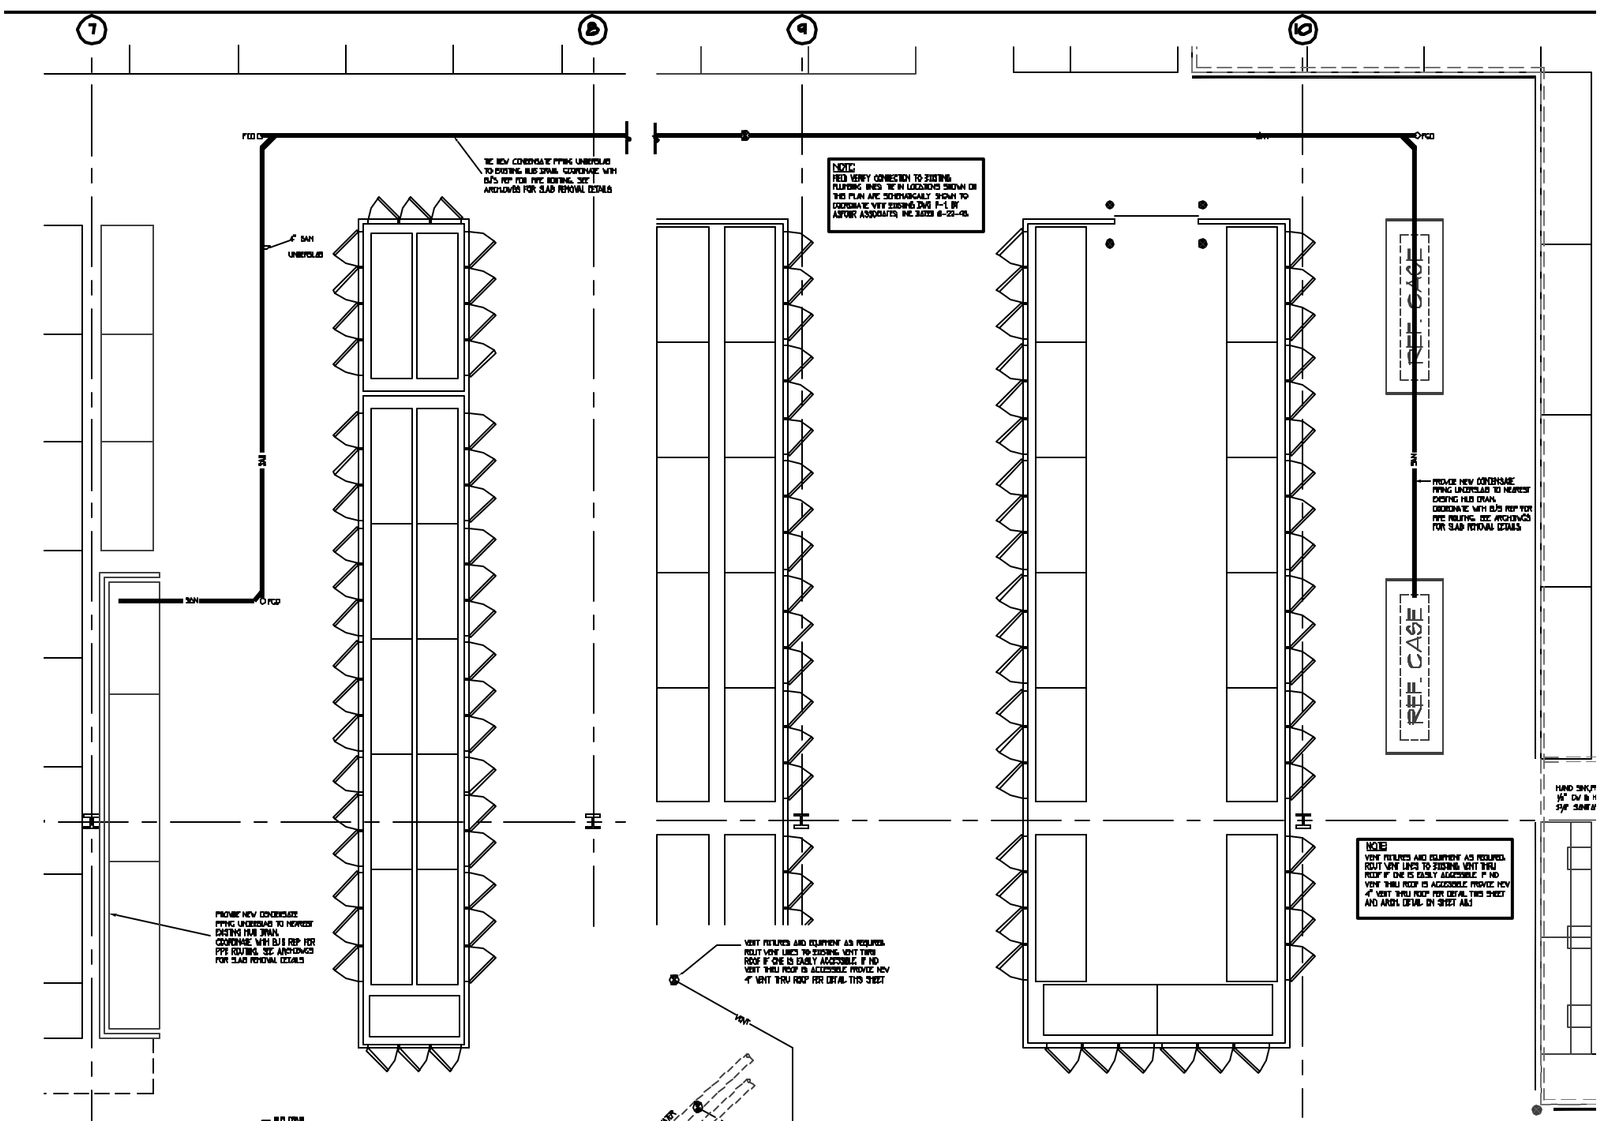

HUB DRAIN DETAIL

-- NOT TO SCALE --

TYPICAL FLOOR DRAIN DETAIL

-- NOT TO SCALE --

TYPICAL HAND SINK RISER DIAGRAM

-- NOT TO SCALE --

VENT THRU ROOF DETAIL

NOTES:
1. MINIMUM SIZE OF VENT EXTENSION THROUGH ROOF TO BE 4".
2. CHANGE OF DIAMETER TO BE MADE AT LEAST 18" BELOW ROOF.
3. VENT PIPE TO EXTEND 24" ABOVE ROOF AND TO BE SEALED WATERTIGHT BY PROPER FLASHING.
4. COORDINATE WITH ARCHITECTURAL DETAIL ON A8.1

PARTIAL FLOO

SCALE 1/4" = 1'-0"

GENERAL NOTES:

1. ALL PLUMBING SHALL BE DONE IN ACCORDANCE WITH STATE AND LOCAL CODES AND ORDINANCES INCLUDING BUT NOT LIMITED TO:
   - CODES, RULES AND REGULATIONS OF THE STATE OF MAINE.
   - AMERICANS WITH DISABILITIES ACT (ADA)
2. COORDINATE EXACT LOCATION OF GAS CONNECTIONS FOR ALL GAS FIRED EQUIPMENT WITH MANUFACTURER PRIOR TO INSTALLATION.
3. RUN GAS PIPING MAINS AND BRANCHES IN TRUSS SPACE.
4. IN GENERAL PLANS AND DIAGRAMS OF PLUMBING RUNS ARE SCHEMATIC AND SHOULD NOT BE SCALED. COORDINATE AT SITE ALL PLUMBING WORK SO AS NOT TO CONFLICT IN LOCATION WITH OTHER WORK. SHELVES CONFLICT AREAS, NOTIFY ARCHITECT IMMEDIATELY BEFORE INSTALLING PIPING.
5. PROVIDE VALVES FOR DRAINAGE OF WATER LINES FOR ALL APPLICABLE PLUMBING CODES. PROVIDE VALVES FOR HOT AND COLD WATER SUPPLY RISERS FOR ALL APPLICABLE PLUMBING BOARDS.
6. PLUMBING CONTRACTOR SHALL PROVIDE EXPANSION LOOPS AS REQUIRED BY ALL APPLICABLE PLUMBING BOARDS.
7. PLUMBING CONTRACTOR SHALL OFFSET PIPING AS REQUIRED DUE TO FIELD CONDITI