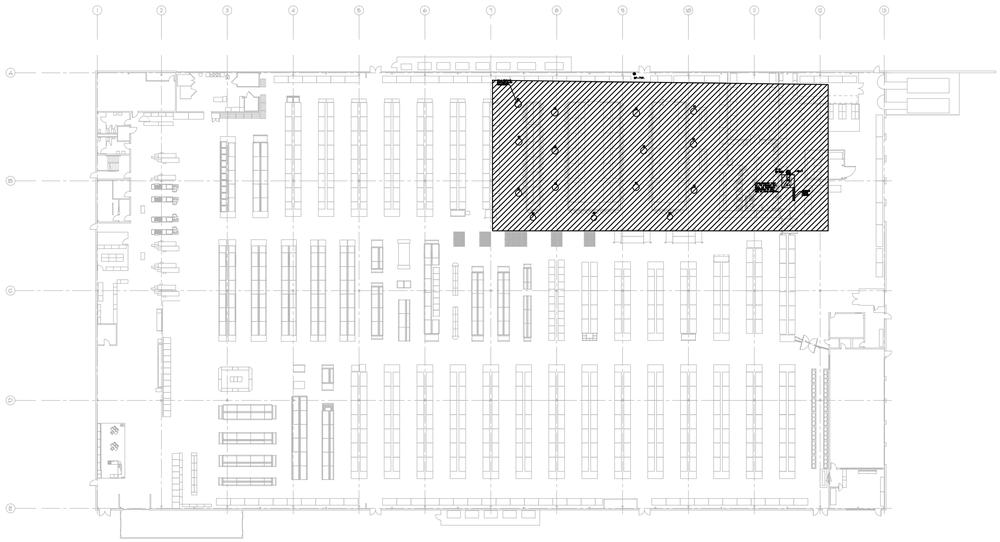

3 **KEY PLAN**

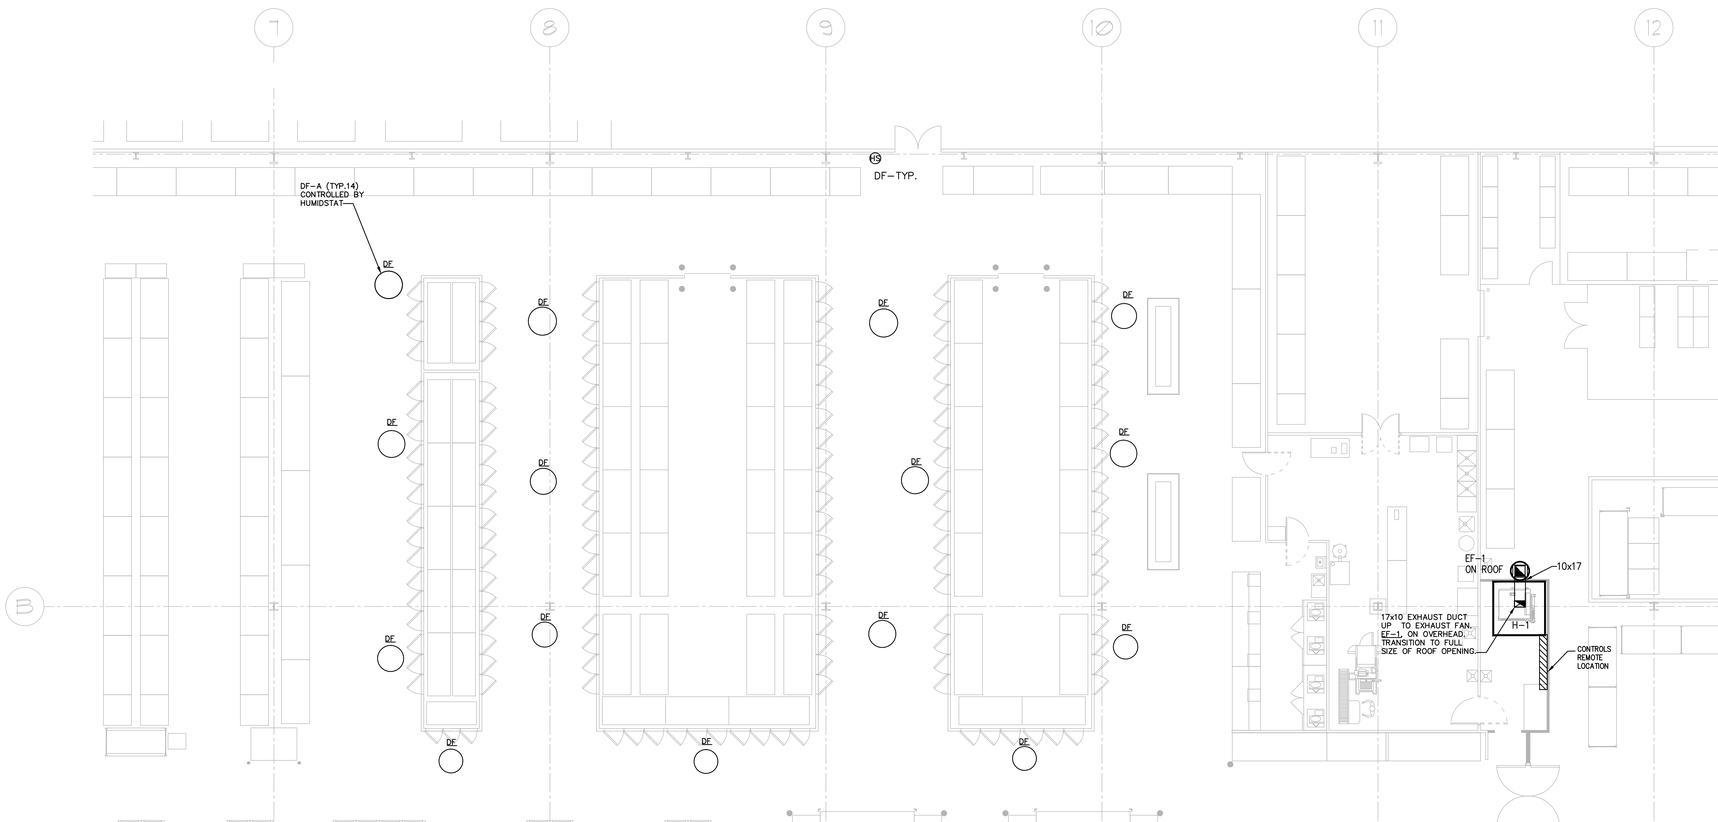

2 **NEW HVAC FLOOR PLAN**
SCALE: 1/8" = 1'-0"

GENERAL NEW WORK NOTES:

A. EF-10, H-1 AND AUTOMATIC FIRE EXTINGUISHING SYSTEM SHALL BE CONSTRUCTED AND INSTALLED IN ACCORDANCE WITH SECTIONS 506, 507, 508 AND 509 OF THE INTERNATIONAL MECHANICAL CODE, 2012. DETAILED PLANS SHALL BE SUBMITTED TO THE CITY MECHANICAL INSPECTOR FOR REVIEW AND APPROVAL AND A MECHANICAL PERMIT SECURED PRIOR TO INSTALLATION.

B. THE TERMINATION THROUGH WALLS AND ROOFS FOR EXHAUST OUTLETS SERVING TYPE 1 HOODS SHALL MEET THE REQUIREMENTS OF SECTION 506.3.12 THROUGH 506.3.12.3 OF THE INTERNATIONAL MECHANICAL CODE, 2012.

C. TO ENSURE PROPER OPERATION AND ACCESSIBILITY MAINTAIN 36" IN FRONT OF CONTROLS AFTER INSTALLATION.

D. VERIFY AND BALANCE EXISTING AHU'S TO HAVE A MINIMUM OF 10 PERCENT OUTSIDE AIR.

E. HOOD AND HOOD SKIRT TO BE PROVIDED BY BJ'S WHOLE SALE CLUB, REMAINING HVAC EQUIPMENT TO BE FURNISHED BY MECHANICAL CONTRACTOR.

ARCHITECTURAL GROUP INTERNATIONAL
15 West Seventh Street, Covington, KY 41011
P: 859.261.5400 F: 859.261.5530
www.agi-us.com
designing where you want to go.

KOHRS LONNEMANN HEIL ENGINEERS, PSC
MECHANICAL/ELECTRICAL ENGINEERS
1538 ALEXANDRIA PIKE, STE. 11
FT. THOMAS, KENTUCKY 41075
800-324-9763
859-442-8050
859-442-8058 FAX

Revisions

#	Date	Title
	03/14/2016	OWNER REVIEW
	03/17/2016	PERMIT/BID

STATE OF MAINE ROBERT A LONNEMANN 11370 REGISTERED PROFESSIONAL ENGINEER
MAR 22 2016

Client: BJ'S WHOLESALE CLUB

BJS WHOLESALE CLUB
#029
PORTLAND, ME

DATE 03/21/2016
PROJECT NO. 17879

SHEET TITLE
HVAC FLOOR PLAN

SHEET NUMBER
M101