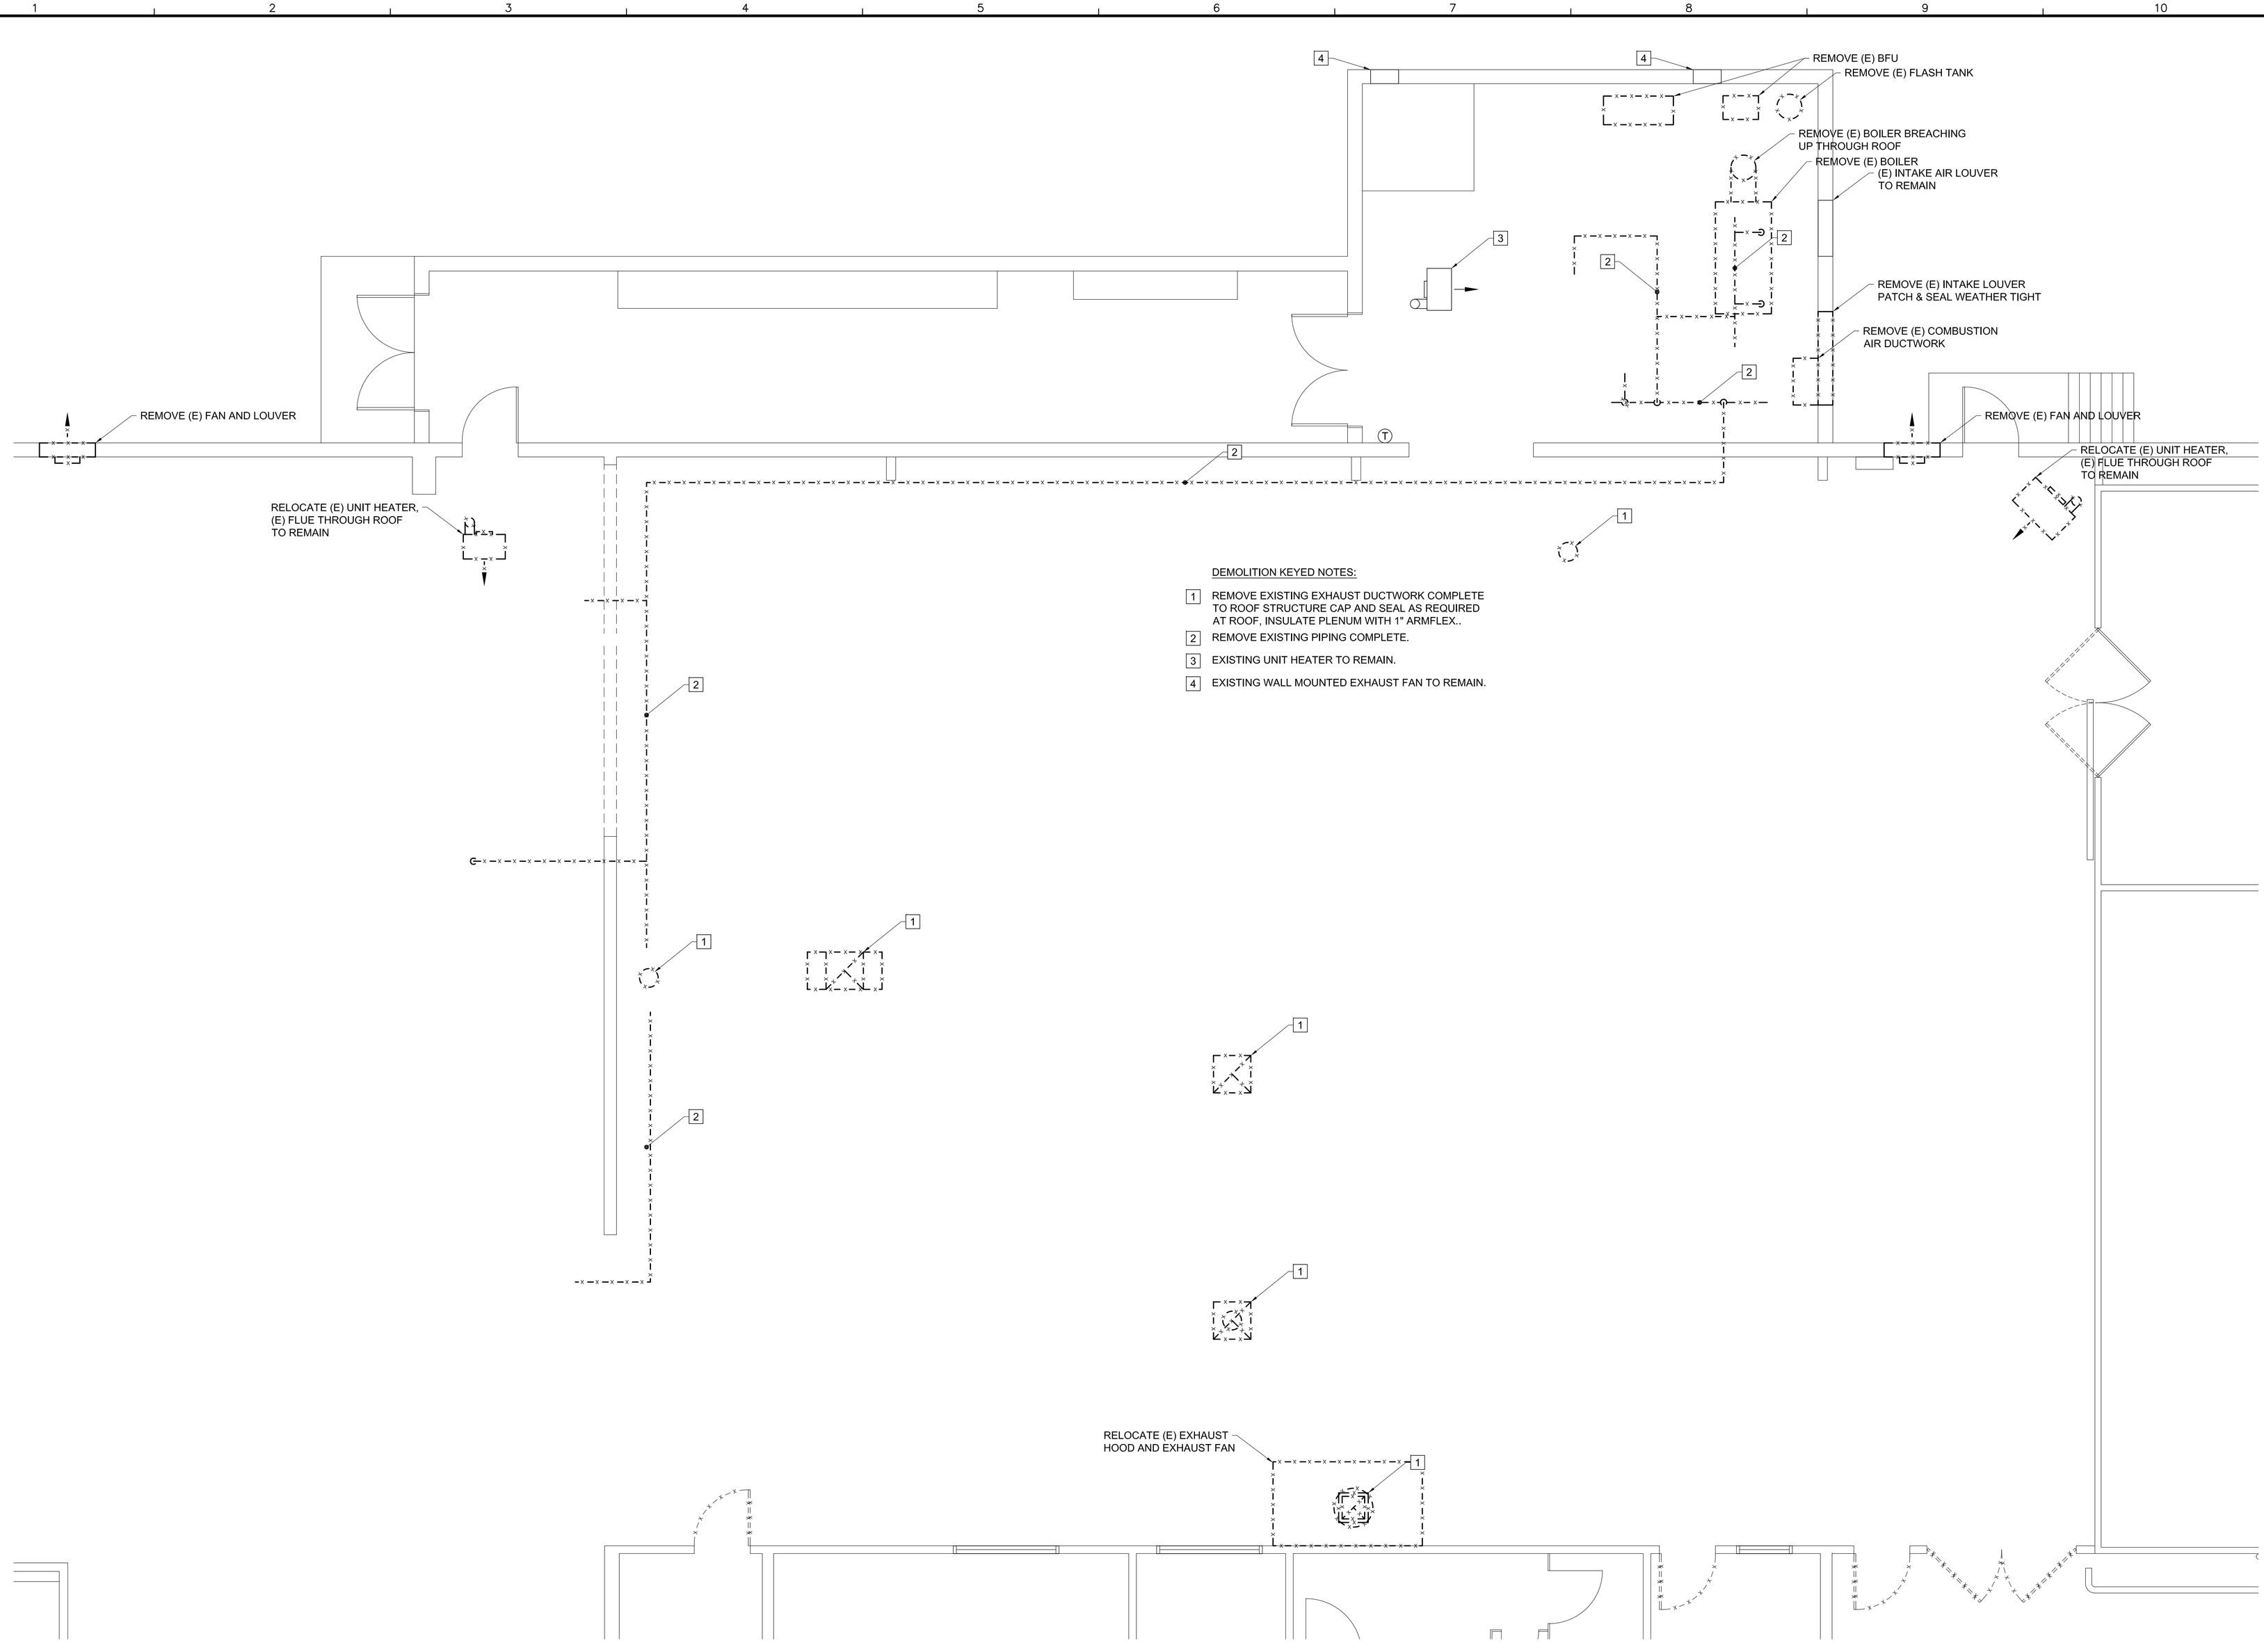

DEMOLITION KEYED NOTES:

1. REMOVE EXISTING EXHAUST DUCTWORK COMPLETE TO ROOF STRUCTURE CAP AND SEAL AS REQUIRED AT ROOF, INSULATE PLENUM WITH 1" ARMFLEX..
2. REMOVE EXISTING PIPING COMPLETE.
3. EXISTING UNIT HEATER TO REMAIN.
4. EXISTING WALL MOUNTED EXHAUST FAN TO REMAIN.

A1 MECHANICAL DEMOLITION PART PLAN
1/4" = 1'-0"

160 Veranda Street
Portland, Maine 04103
T: 207.221.2260
F: 207.221.2266
Web: www.allied-eng.com

Allied Engineering
Structural Mechanical Electrical Commissioning

STATE OF MAINE IAN A. MACDONALD No. 9980 REGISTERED PROFESSIONAL ENGINEER

REVISIONS

NUMBER	DATE	BY	DESCRIPTION

Date: 03/20/2013
Drawn By: SCL
Checked By: IAM
Project Mgr: IAM
Project No: 13001
Cad File: 13001M.DWG
Graphic Scale: 0 1"

MECHANICAL DEMOLITION PART PLAN

CITY OF PORTLAND
PORTLAND PUBLIC SCHOOLS - CENTRAL KITCHEN
92 WALDRON WAY, PORTLAND, MAINE

© COPYRIGHT 2013 ALLIED ENGINEERING, INC.

MD-100

N:\Projects\2013\13001 – Portland Public Schools - Central Kitchen\00 Drawing Files\13001M.dwg Mar 19, 2013 - 3:58pm