APPLICABLE CODES: IBC 2009 & NFPA 2009

OCCUPANCY: BUSINESS CONSTRUCTION TYPE: III B (FULLY SPRINKLED) TRAVEL DISTANCE TO FIRE EXTENGUISHER IS NOT TO EXCEED 75 FEET MAXIMUM TRAVEL DISTANCE = 300 FEET MAXIMUM COMMON PATH = 100 FEET

MODIFY AND EXTEND EXISTING SPRINKLER SYSTEM AS REQUIRED TO PROVIDE FULL FIRE SUPPRESSION COVERAGE TO ALL SPACES, IN ACCORDANCE WITH NFPA 13, STATE FIRE MARSHAL'S OFFICE, AND CITY OF PORTLAND, MAINE REQUIREMENTS.

FIRE EXTINGUISHER




WALL MOUNTED EXIT SIGN


BATTERY PACK WITH EMERGENCY LAMPS AS SHOWN

P REMOTE EMERGENCY LAMP LIGHT FIXTURES

F WALL MOUNTED FIRE ALARM SYSTEM MANUAL **PULL STATION**

FIRE ALARM SYSTEM WALL ₽d MOUNTED AUDIO/VISUAL DEVICE

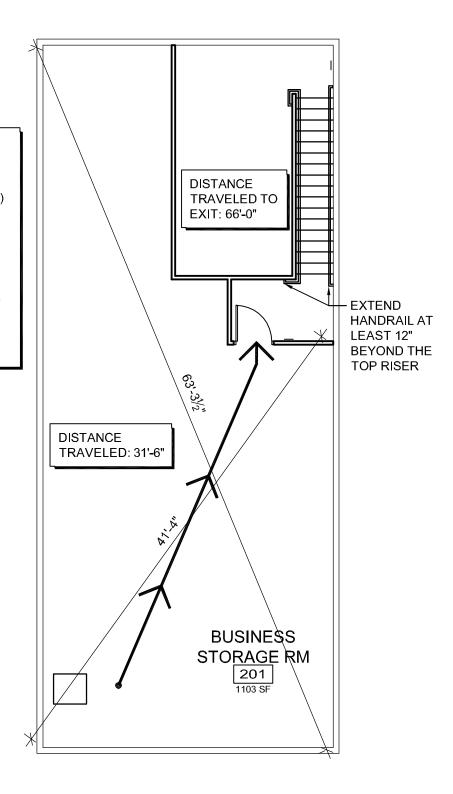

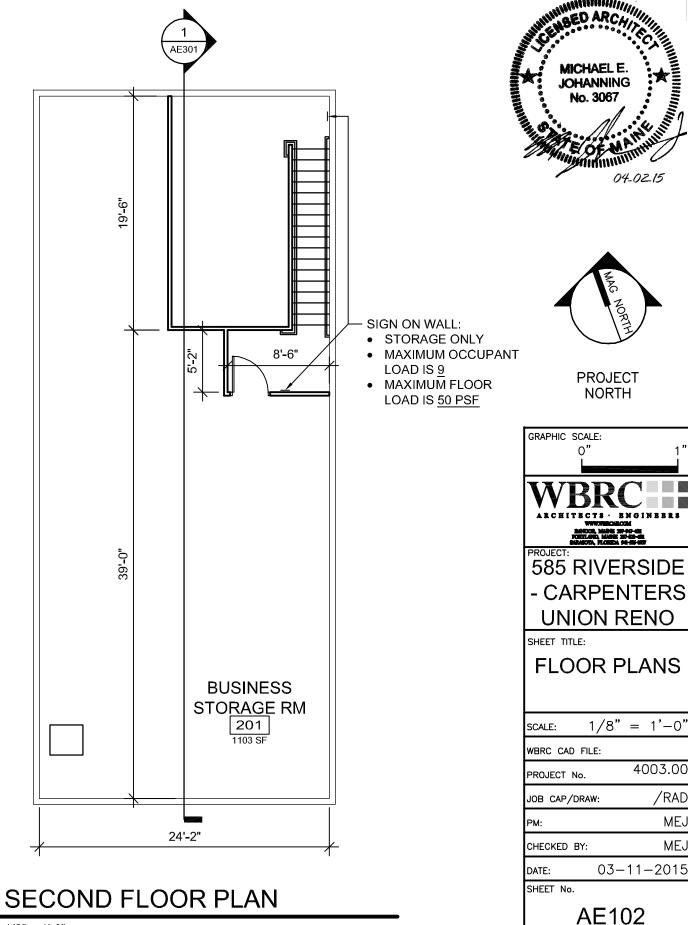

SECOND FLOOR CODE PLAN

ME

MΕ