

Job 682763	Truss 001	Truss Type ATTIC	Qty 13	Ply 1	Job Reference (optional)
---------------	--------------	---------------------	-----------	----------	--------------------------

Boise Cascade, Biddeford, ME 04005, Chipper Roberts

7.640 s Feb 22 2016 MiTek Industries, Inc. Tue Nov 15 09:34:22 2016 Page 1
ID:8EuYsDVMCmtk7cqXA4N8XkzMabY-cNB67KIYH0QkIPewbC1QdJephleUIMYI566o8yJ_0F

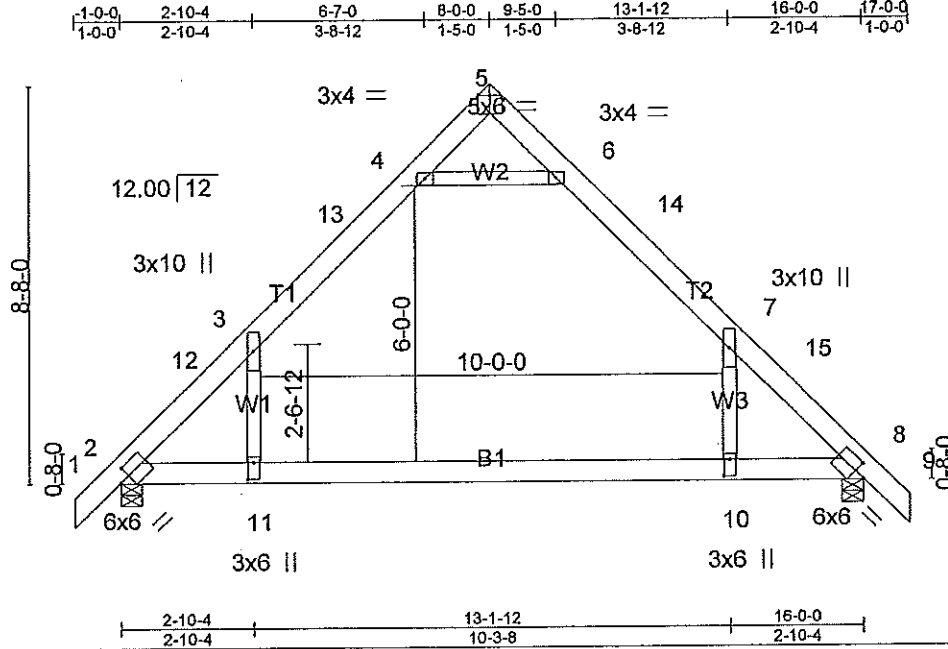


Plate Offsets (X,Y)-- [2:0-2-13,0-2-13], [5:0-3-0,Edge], [8:0-2-13,0-2-13], [10:0-4-8,0-1-8], [11:0-4-8,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 46.2 (Ground Snow=60.0)	Plate Grip DOL	1.15	TC 0.73	Vert(LL)	-0.48 10-11	>391	240	MT20	169/123
TCDL 10.0	Lumber DOL	1.15	BC 0.77	Vert(TL)	-0.76 10-11	>246	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.37	Horz(TL)	0.02 8	n/a	n/a		
BCDL 10.0	Code IBC2009/TPI2007		(Matrix)	Attic	-0.32 10-11	385	360	Weight: 84 lb	FT = 0%

LUMBER-
 TOP CHORD 2x6 SPF 1650F 1.5E
 BOT CHORD 2x6 SPF 1650F 1.5E
 WEBS 2x4 SPF-S No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 4-6-15 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 2=1711/0-5-8 (min. 0-2-11), 8=1711/0-5-8 (min. 0-2-11)
 Max Horz 2=415(LC 7)
 Max Uplift 2=-260(LC 8), 8=-260(LC 9)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-12=-2137/98, 3-12=-1939/104, 3-13=-1181/241, 4-13=-913/270, 4-5=-71/550,
 5-6=-72/550, 6-14=-913/270, 7-14=-1181/241, 7-15=-1939/104, 8-15=-2137/97
 BOT CHORD 2-11=-42/1033, 10-11=-40/1038, 8-10=-40/1033
 WEBS 4-6=-1735/413, 3-11=0/1139, 7-10=0/1139

NOTES- (12-13)

- 1) Wind: ASCE 7-05; 110mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) gable end zone and C-C Exterior(2) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 5-0-0, Exterior(2) 5-0-0 to 8-0-0, Interior(1) 11-0-0 to 14-0-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-05; Pg= 60.0 psf (ground snow); Pf=46.2 psf (flat roof snow); Category II; Exp C; Partially Exp.; Ct=1.1
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 46.2 psf on overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Ceiling dead load (5.0 psf) on member(s). 3-4, 6-7, 4-6; Wall dead load (5.0psf) on member(s).3-11, 7-10
- 8) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 10-11
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 260 lb uplift at joint 2 and 260 lb uplift at joint 8.
- 10) This truss is designed in accordance with the 2009 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- 11) ATTIC SPACE SHOWN IS DESIGNED AS UNINHABITABLE.
- 12) Dimensions are in feet-inches-sixteenths
- 13) Drawing prepared exclusively for manufacturing by Boise Cascade.

LOAD CASE(S) Standard