

STRUCTURAL GENERAL NOTES

Riverside Self Storage Containers
Portland, ME

SI Job #: 16-0264

DESIGN LOADS: International Building Code, IBC 2009 Edition, except as noted
Occupancy Category I, Table 1604.5

Roofs:	Ground Snow, Pg	60 psf (used for drifting calculations)
	Sloped Roof Snow, Ps	70 psf
	Snow Exposure Factor, Ce	Table 1608.3.1 1.0
	Snow importance Factor, Is	Table 1604.5 1.0
	Snow Thermal Factor, Ct	Table 1608.3.2 1.0
Floors:	Storage	125 psf

Lateral	Wind	ASCE 7-02 Simplified Method	
		3 Second Gust Velocity	100 mph
		Importance Factor	0.87
		Exposure	C

Seismic	ASCE 7-02 Equivalent Lateral Force Procedure	
	Design Category	B
	Soils Site Class	D
	Importance Factor	0.8
Response Modification Coefficient	R=3, Steel Systems Not Specifically Detailed for Seismic Resistance	

REINFORCED CONCRETE:

We encourage the use of blast furnace slag Design is based on "Building Code Requirements for Reinforced Concrete"(ACI 318). Concrete work shall conform to "Standard Specifications for Structural Concrete" (ACI 3019).
Structural concrete shall have the following properties:

Intended Use	F _c , psi 28day	Max W/C Ratio	Maximum Aggregate	Slump inches	Entrained Air Percent ±1.5%	Cement Type	Admixtures, Comments
Footings	4,500	.45	¾" Stone	4	---	I/II	Fibermesh

Detailing, fabrication, and placement of reinforcing steel shall be in accordance with the Manual of Standard Practice for Detailing Reinforced Concrete Structures (ACI 315).

Welded wire fabric shall conform to ASTM A185.

Reinforcing bars shall conform to ASTM A615, Grade 60,

except ties or bars shown to be field-bent, which shall be Grade 40.

Epoxy coated reinforcing bars shall conform to ASTM 775.

Zinc coated (galvanized) reinforcing bars shall conform to ASTM 767.

Bars to be welded shall conform to ASTM 706.

At splices, lap bars 50 diameters unless noted otherwise.

At corners and intersections, make horizontal bars continuous or provide matching corner bars.

Around openings in walls and slabs, provide 2-#5, extending 2'-0" beyond edge of opening.

In continuous members, splice top bars at mid-span and splice bottom bars over supports.

Provide intermittent shear keys at all construction joints and elsewhere as shown on the drawings.

Except as noted on the drawings, concrete protection for reinforcement in cast-in-place concrete shall be as follows:

- Cast against and permanently exposed to earth 3"
- Exposed to earth or weather:
 - #6 through #18 bars 2"
 - #5 bar, W31 or D31 wire, and smaller 1-1/2"
- Not exposed to weather or in contact with ground:
 - Slabs, walls, joists: #11 bar and smaller 3/4"
 - Beams, columns:
 - Primary reinforcement 1-1/2"
 - Stirrups, ties, spirals 1-1/2"

Fibermesh admixture shall be 100% virgin polypropylene, fibrillated fibers as manufactured by Fibermesh Co. per ASTM C-1116 type 111 4.1.3 and ASTM C-1116 performance level one, 1.5 lbs per cubic yard of concrete.

Anchor bolts and rods for beam and column-bearing plates shall be placed with setting templates.

Permanent corrugated steel forms for concrete floor slabs shall be manufactured and erected according to the "Specifications and Code of Standard Practice" of the Steel Deck Institute.

All concrete work is subject to inspection by a qualified special inspector employed by the owner in accordance with IBC Section 1704.4.

STRUCTURAL STEEL:

Structural steel shall be detailed, fabricated, and erected in accordance with latest AISC Specifications, and Code of Standard Practice. Structural steel wide flange beams shall conform to ASTM A992.

Except as noted, framed beam connections shall be bearing-type with 3/4" diameter, snug tight, A325-N bolts, detailed in conformance with Part 4, Tables II and III, for 0.6 times the allowable uniform loads tabulated in Part 2 of the AISC Manual, 9th Edition. Install bolts in accordance with AISC "Specification for Structural Joints Using ASTM A325 or A490 Bolts".

All beams shall have full depth web stiffeners each side of webs above and below columns

Anchor rods shall conform to ASTM F1554, Grade 55), with weldability supplement S1.

Headed anchor studs (HAS) shall be attached to structural steel with equipment approved by the stud manufacturer according to the stud manufacturer's recommendations.

Welding shall be done by a certified welder in accordance with AISC and AWS specifications and recommendations using E70-electrodes. Where not specifically noted, minimum weld shall be 3/16" fillet by length of contact edge.

All post-installed anchors shall have current ICC Evaluation Report, and shall be installed in accordance with the manufacturer's requirements.

Expansion anchors shall be approved "wedge" type unless specifically noted to be "sleeve" type.
Chemical anchors shall be approved epoxy or similar adhesive type and shall have current ICC Evaluation Report.
Where base material is not solid, approved screen tubes shall be used.
Grout beneath column base and beam-bearing plates shall be minimum 28-day compressive strength of 7,500 psi, approved pre-bagged, non-metallic, non-gaseous, bleed free, non-shrink, when tested in accordance with ASTM C1107 Grade B or C at a flow cone fluid consistency of 20 to 30 seconds

SHOP DRAWINGS:


Construction Documents are copyrighted and shall not be copied for use as erection plans or shop details.
Use of SI Inc.'s electronic files as base for shop drawings requires prior approval by SI Inc., signed release of liability by subcontractor,
payment of an administration fee of \$100 per drawing sheet to SI Inc, and deletion of SI Inc's name and Logo from all sheets so used.
The General Contractor and his subcontractors shall submit in writing any requests to modify the plans or specifications.
All shop and erection drawings shall be checked and stamped by the General Contractor prior to submission for Engineer's review.
Unchecked submittals will be returned without review.
Furnish one (1) reproducible and two (2) prints of shop and erection drawings to the Structural Engineer for review prior to fabrication for, reinforcing steel, structural steel, decking, P.E.M.B. anchor bolt plan, P.E.M.B. shop drawings, and P.E.M.B. reactions
Submit in a timely manner to permit ten (10) working days for review.
Shop drawings submitted for review do not constitute "in writing" unless specific suggested changes are clearly marked.
In any event, such changes by means of the shop drawing submittal process become the responsibility of the one initiating such change.

ABBREVIATIONS KEY

AB Anchor Rod (Bolt)	EF Each Face	MACH Machine	RO Rough Opening
ADDD Additional	EJ Expansion Joint	MASY Masonry	SC Slip Critical
ADJ Adjustable	ELEV Elevation	MATL Material	SCH Schedule
AF Above Finished Floor	ELEC Electric (Electrical)	MAX Maximum	SDST Self Drilling Self Tapping
ALT Alternate	ENGR Engineer	MB Machine Bolt	SECT Section
AMT Amount	EQ Equal	MECH Mechanical	SF Square Feet
ANCH Anchor, Anchorage	EQUIP Equipment	MEZZ Mezzanine	SFT Sheet
APPROX Approximate	EQUIV Equivalent	MFR Manufacture, -er, -ed	SFTG Sheathing
ARCH Architect, -ural	ES Each Side	MIN Minimum	SIM Similar
ATR All Thread Rod	EST Estimate	ML Microlam (Trus-joist brand LVL)	SLH Short Leg Horizontal
AVG Average	E-W East to West	MO Masonry Opening	SLV Short Leg Vertical
BC Bottom of Concrete	EXC Excavate	MTL Metal	SOG Slab on Grade
BL Brick Ledge	EXP Expansion	NF Near Face	SP Spaces
BLK Block	EXT Exterior	NIC Not In Contract	SPEC Specifications
BLKG Blocking	FND Foundation	NS Near Side	SQ Square
BM Beam	FF Far Face, Finished Floor	N-S North to South	ST Snug Tight
BOT Bottom	F-F Face to Face	NTS Not to Scale	STD Standard
BRG Bearing	FIG Figure	OCJ OSHA Column Joist	STIFF Stiffener
BW Bottom of Wall	FL Flush	OD Outside Diameter	STL Steel
CB Corner/Bore	FLG Flange	OF Outside Face	STRUCT Structure, -al
CF Cubic Foot	FLR Floor	OH Opposite Hand	SUP Support
CG Center of Gravity	FO Face of	OPNG Opening	SY Square Yard
CIP Cast in Place	FP Full Penetration	OPP Opposite	SYM Symmetrical
CJ Construction Joint (Control Joint)	FS Far Side	OSB Oriented Strand Board	T&B Top and Bottom
CLG Ceiling	FTG Footing	PAF Powder Actuated Fast'n	T&G Tongue and Groove
CLR Clear	GA Gage (Gauge)	PC Precast	TB Top of Beam
CM Construction Manager (Management)	GALV Galvanized	PCF Pounds Per Cubic Foot	TC Top of Concrete
CMU Concrete Masonry Unit	GEN General Contractor	PEN Penetration	TD Top of Deck
COL Column	GL Glue laminated (Glulam)	PERP Perpendicular	THD Thread
COM Common	GND Ground	PL Property Line	THK Thick, -ness
COMB Combination	GR Grade	PLF Pounds per Linear Foot	TJ Top of Joist
CONC Concrete	GT Girder Truss	PNL Panel	TL Total Load
CONN Connection	GYP BD Gypsum Board	PP Panel Point	TPG Topping
CONT Continue (Continuous)	HAS Headed Anchor Stud	PS Prestressed	TRANS Transverse
COORD Coordinate, -tion	HORIZ Horizontal	PSF Pounds per Square Foot	TW Top of Wall
CS Countersink	HT Height	PSI Pounds per Square Inch	TYP Typical
CTR Center	ID Inside Diameter	PSL Parallel Strand Lumber (generic term)	ULT Unless Noted Otherwise
CY Cubic Yard	IF Inside Face	PT (1) Post Tensioned	VERT Vertical
DAB Deformed Anchor Bar	INT Interior (Intermediate)	PT (2) Pressure Treated	VIF Verify in Field
DET Detail	JB Joist Bearing	PTN Partition	WA Wedge Anchor
DEV Develop	JST Joist	PWD Plywood	WP Work Point
DIAG Diagonal	JT Joint	QTY Quantity	WT Weight
DIM Dimension	K Kip (1,000 lbs.)	R Radius	WWF Welded Wire Fabric
DL Dead Load	LD Load	RD Roof Drain	XS Extra Strong
DN Down	LL Live Load	RE Reference (refer to)	XSECT Cross-section
DP Drilled Pier	LLH Long Leg Horizontal	RECT Rectangle	XXS Double Extra Strong
DWG Double Tee	LLV Long Leg Vertical	REINF Reinforce, -ed, -ing	(E) Existing
DWL Dowel	LOC Location	REQ Required	(N) New
EA Each	LSL Laminated Strand Lumber (generic term)	REQMT Requirement	(R) Remove
ECC Eccentric	LT Light	RET Retaining	
E-E End to End	LVL Laminated Veneer Lumber (generic term)	RM Room	
		RMO Rough Masonry Opening	

Structural Drawing Index

S1.0	General Notes, Etc.
S1.1	Foundation Plan
S1.2	Details / Sections

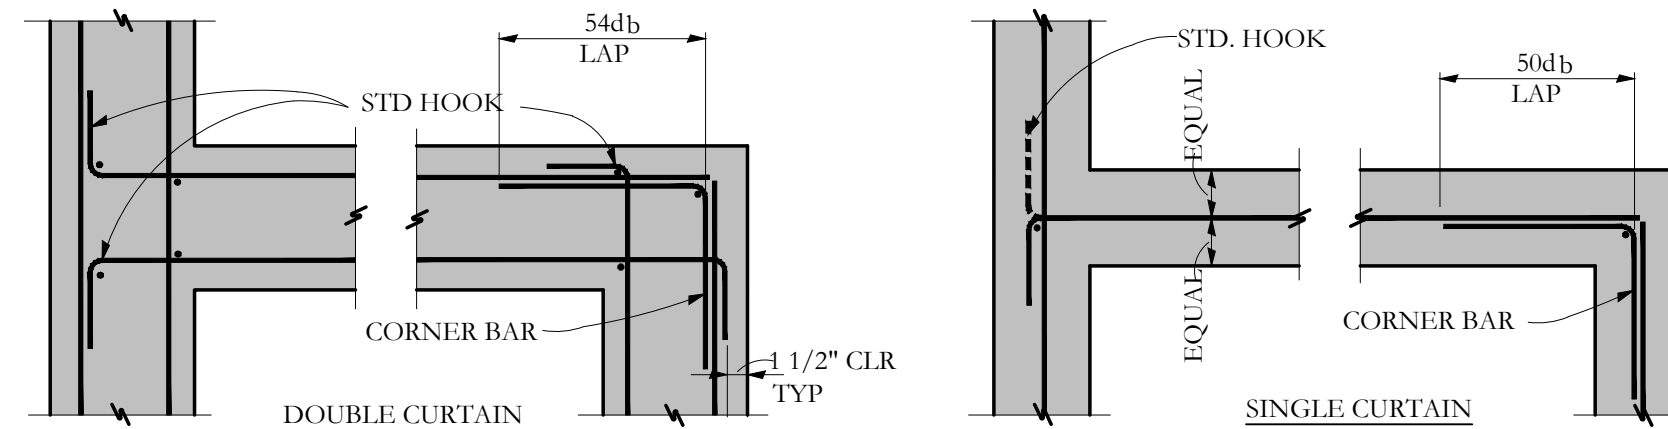

TYPICAL CONCRETE WALL INTERSECTIONS
NO SCALE

Structural Integrity
Consulting Engineers, Inc.
77 Oak Street
Portland, ME, 04101
p. 207-774-4634
f. 866-793-7835
www.structuralintegrity.com
BUILD WITH CONFIDENCE
© 2002 Structural Integrity Consulting Engineers, Inc.
SI Job# 16-0264

RIVERSIDE SELF STORAGE CONTAINERS
Portland, Maine

Document Title:
Shipping Container
Storage Foundation
Drawings

Sheet Title:
**GENERAL
NOTES**

Scale: AS NOTED

Date: 6/6/2017

Revisions

Sheet

S1.0

