


RIVERSIDE ST.

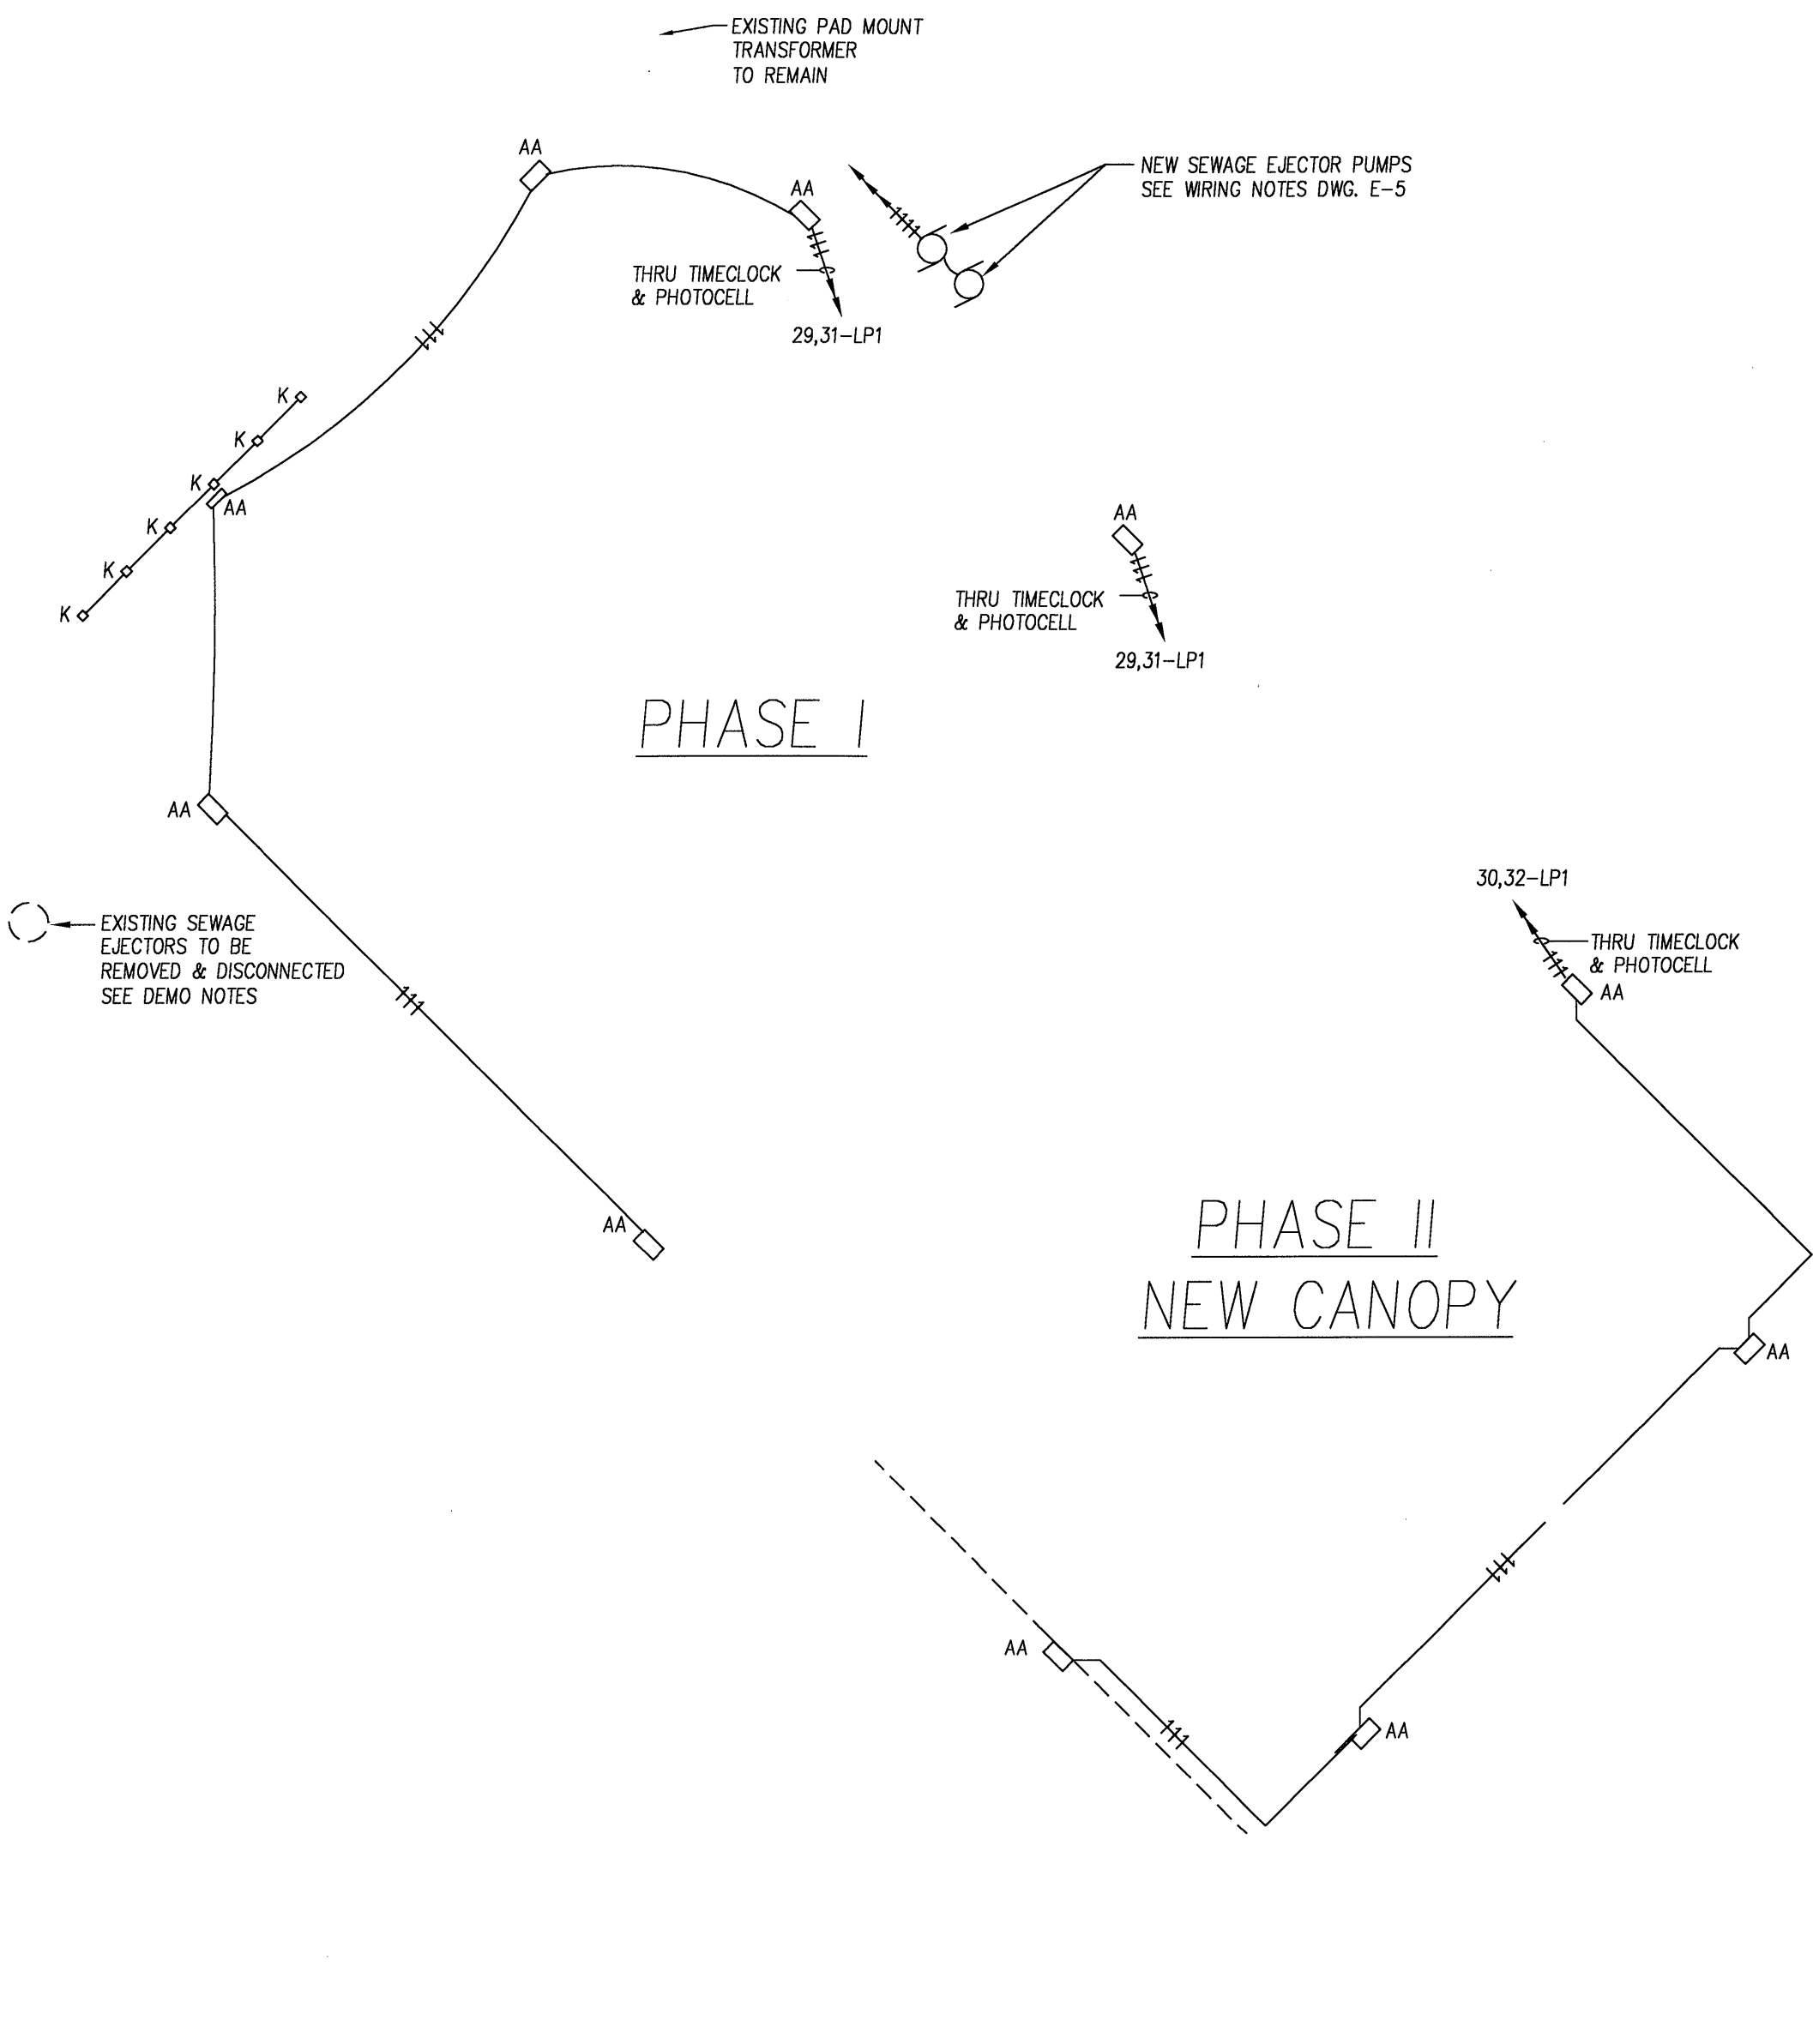

SITE LIGHTING PLAN
1"=30'-0"

LIGHTING FIXTURE SCHEDULE							
TYPE	DESCRIPTION	MANUFACTURER	MODEL NO.	LAMPS	MOUNTING	VOLTS	REMARKS
AA	CUT OFF WALL PACK	GUTH	SN019-250MH-1	(1) 250W MH	WALL @ 20'+	120	NO EQUAL

ELECTRICAL LEGEND

NOTE: SOME ITEMS IN THIS LEGEND MAY NOT BE USED, SEE PLANS FOR APPLICABLE ITEMS.

- ⊕ DUPLEX RECEPTACLE
- ⊙ SPECIAL RECEPTACLE VOLTAGE AS NOTED
- ⊖ DUPLEX RECEPTACLE WITH ISOLATED GROUND
- SINGLE RECEPTACLE
- ⊕/⊖ DUPLEX RECEPTACLE 1/2 SWITCHED
- ⊗ DIRECT CONNECTION
- ⊗ OCCUPANCY SENSOR & SWITCH
- ⊗ WHITE 20AMP 120VOLT
- ⊗/⊕ DAYLIGHT SENSOR
- ⊕ SINGLE POLE SWITCH
- ⊕/⊕ THREE WAY SWITCH
- ⊕/⊕ SWITCH WITH PILOT LIGHT
- DATA OUTLET
- ⊕/⊕ COMBINATION DATA & TEL OUTLET
- ⊕ TELEPHONE OUTLET
- ⊕ DISCONNECT SWITCH SIZE AS NOTED
- ⊕ WALL MOUNTED FIXTURE
- ⊕ 2'X4' LIGHT FIXTURE SEE SCHEDULE
- ⊕ FLUORESCENT STRIP SEE SCHEDULE
- ⊕ ROUND LIGHT FIXTURE PENDANT OR RECESSED
- ⊕ EXIT FIXTURE SEE SCHEDULE
- ⊕ REMOTE EMERGENCY LIGHT
- ⊕ EMERGENCY BATTERY UNIT
- ⊕ TELE-POWER-POLE
- ⊕ TELEPHONE OUTLET
- ⊕ RECESSED ELECTRIC PANEL
- ⊕ SURFACE MOUNT ELECTRIC PANEL
- ⊕ NIGHT LIGHT
- ⊕/⊕ BRANCH CIRCUIT WIRING HOMERUN "LA" INDICATES DESIGNATED PANEL, "2,4" INDICATES CIRCUIT NUMBERS, NUMBER OF ARROW HEADS INDICATES NUMBER OF CIRCUITS
- ⊕/⊕ BRANCH CIRCUIT WIRING, ROMEX, BX, EMT OR CONDUIT AS NOTED, RUN ABOVE CEILING OR CONCEALED IN WALLS, NUMBER OF SLASHES INDICATES NUMBER OF WIRES
- ⊕ LINE VOLTAGE THERMOSTAT
- ⊕/⊕ MOTOR, NUMBER INDICATES HORSEPOWER
- ⊕ EXHAUST FAN
- ⊕ SMOKE DETECTOR
- ⊕ HEAT DETECTOR, FIXED TEMPERATURE
- ⊕ HEAT DETECTOR, RATE OF RISE
- ⊕ FIRE ALARM PULL STATION
- ⊕ FIRE ALARM HORN & LIGHT
- ⊕ FIRE ALARM MASTER BOX
- ⊕ FIRE ALARM CONTROL PANEL
- ⊕ CLOCK
- ⊕ ELECTRICAL CONTRACTOR
- ⊕ GENERAL CONTRACTOR
- ⊕ KITCHEN EQUIPMENT SUPPLIER
- ⊕ ARCHITECT
- ⊕ HEATING VENTILATING AND AIR CONDITIONING
- ⊕ ABOVE FINISHED FLOOR
- ⊕ LIGHTING
- ⊕ EMERGENCY
- ⊕ WATERPROOF
- ⊕ TRUCK BLOCK HEATER
- ⊕ FAN TERMINAL BOX
- ⊕ ELECTRIC WATER COOLER
- ⊕ EXISTING TO BE REMOVED
- ⊕ CHILD SAFE DUPLEX RECEPTACLE
- ⊕ WALL FURNITURE FEED
- ⊕ CARBON MONOXIDE DETECTOR

S.S.E. | SOUTH SHORE ENGINEERING TEAM INC.
ELECTRICAL & MECHANICAL ENGINEERS - Phone: 781-331-4660 - Fax: 781-829-4405 - E-mail: SSETINC@AOL.COM
720 WASHINGTON STREET - HANOVER, MA - COLLEGE PARK - YALE BUILDING

DION & SOKOL INC ○ ARCHITECTS

SUDBURY MA

Project no.	Drawn	Checked	Dated
	GMP	JPS/CJW	01-21-2003

E1

SITE LIGHTING
PLAN

HARVEY INDUSTRIES
PORTLAND, ME

revisions