


**1 ELECTRIC POWER PLAN**  
1/4" = 1'-0"

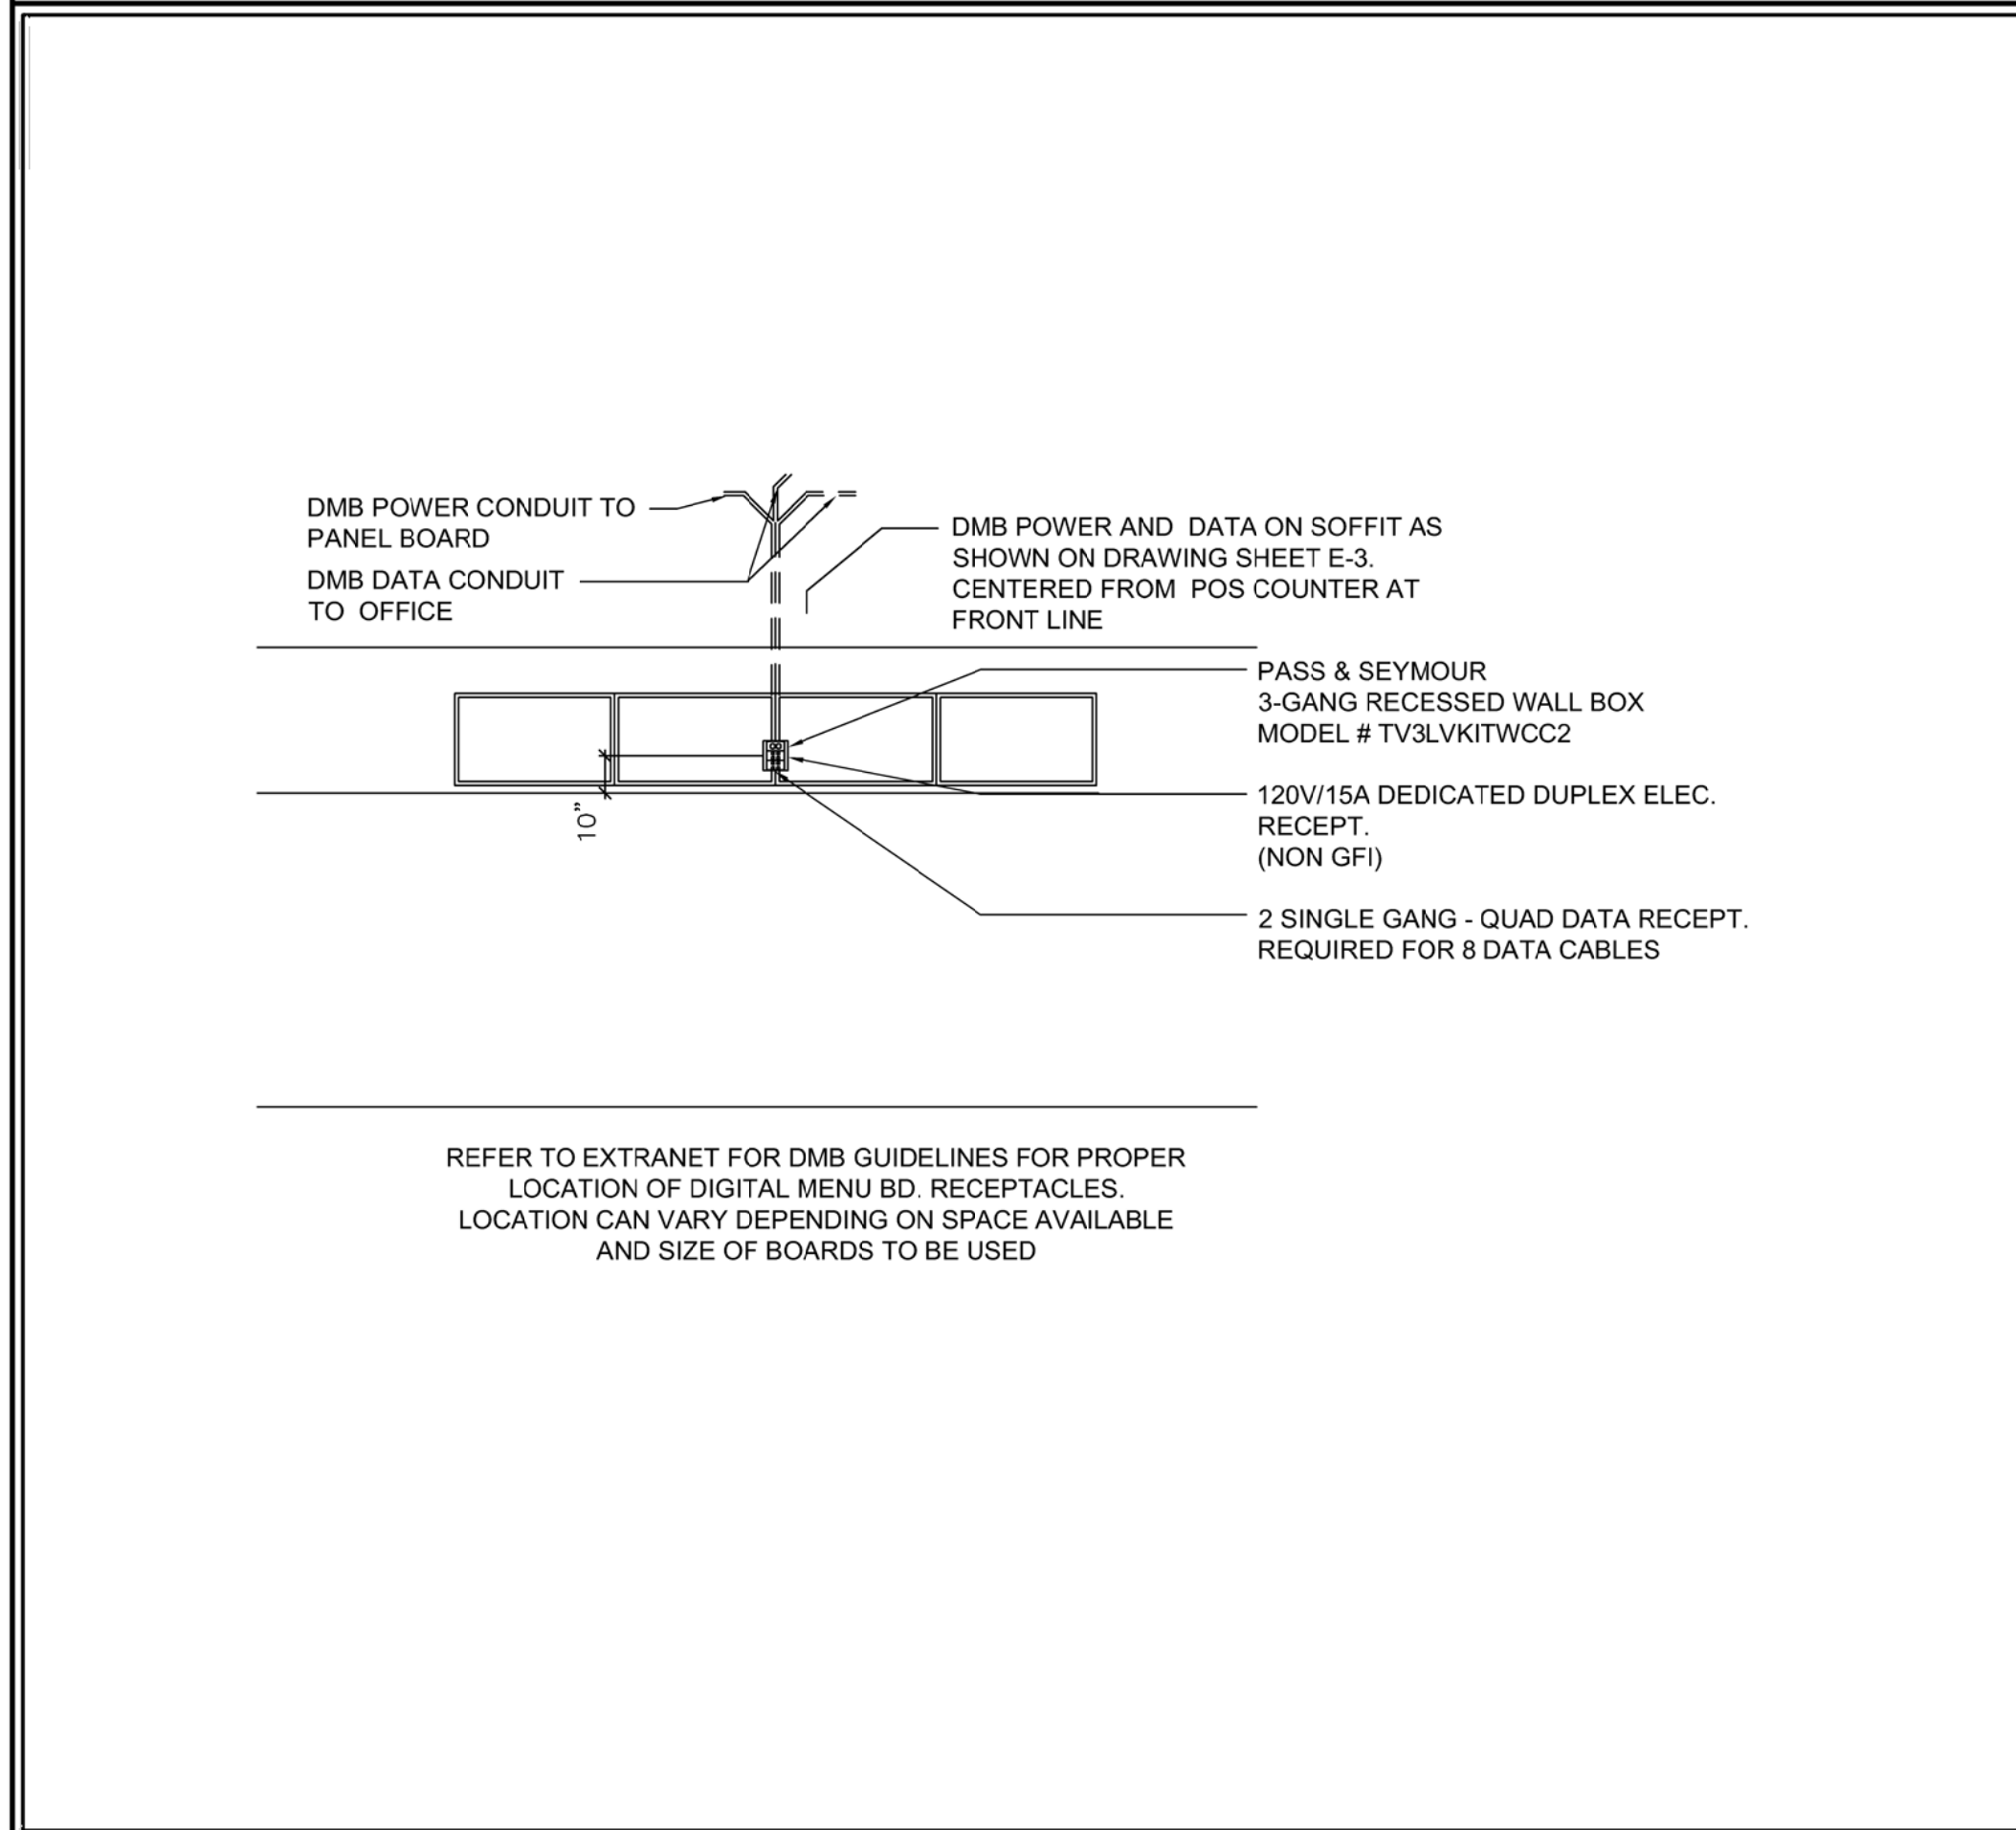

**2 INTERIOR ELEVATION AT SERVICE AREA**  
1/4" = 1'-0" NOTE:

**SANDWICH STATION POWER SCHEDULE**

ITEM	DESCRIPTION	QTY	VOLTS	AMPS	LOAD	PHASE	CORR. PLUG	RECEPTACLE	MTG. HGT.	REMARKS
1	EXHAUST FAN	1	115V	1.5	15A/1P	NO	NO			JBOK @ CEILING/ROOF LOCATION
2	MAKE-UP AIR UNIT	1	115V	5.9	15A/1P	NO	NO			JBOK @ CEILING/ROOF LOCATION
3	HASH BROWN FREEZER	1	115V	7.2	15A/1P	YES	NEMA 5-15R			
4	COOK REFRIGERATOR w/ OVERSHELF	1	115V	7.2	15A/1P	YES	NEMA 5-15R			
5	ASSEMBLY REFRIGERATOR w/ OVERSHELF	1	115V	7.2	15A/1P	YES	NEMA 5-15R			
6	HOT HOLDING	1	208V	11.2	15A/2P	YES	NEMA 6-15R			
7	TURBO CHEF OVEN	1	208V	3.0	20A/2P	YES	NEMA 6-30R			
8	SINGLE LANE SMART TOASTER	1	208V	12.1	20A/2P	YES	NEMA 6-30R			
9	DUAL LANE SMART TOASTER	1	208V	23.8	20A/2P	YES	NEMA 6-30R			
10	BAGEL TOASTER	1	208V	15.9	20A/2P	YES	NEMA 6-30R			
<b>LOW VOLTAGE EQUIPMENT</b>										
ITEM	DESCRIPTION	QTY	VOLTS	AMPS	LOAD	PHASE	CORR. PLUG	RECEPTACLE	MTG. HGT.	REMARKS
11	VDU	1	120V	1.5	20A/1P	NO	N/A			**4 LOCATED ABOVE CLG. (1) PLUGS INTO ITEM #5
12	VDU CONTROLLER	1	120V	1.0	20A/1P	YES	R4S			**4 LOCATED ABOVE CLG. (1) PLUGS INTO ITEM #5
13	PRINTER	1	120V	1.0	20A/1P	YES	R4S			**PLUGS INTO ITEM #5

**POWER SCHEDULE NOTES:**

- MODIFY EXISTING ELECTRICAL PANELS TO ACCOMMODATE EQUIPMENT CIRCUITS AS REQ'D.
- THE ELECTRICAL CONTRACTOR IS REQUIRED TO VERIFY ALL ELECTRICAL REQUIREMENTS OF EQUIPMENT. COORD FINAL SPECS W/ DUNKIN' BRANDS.
- ALL RECEPTACLE MOUNTING HEIGHTS REFER TO CENTER OF RECEPTACLE.

**3 SANDWICH STATION EQUIPMENT SCHEDULE**  
NOTE:

**KEYED NOTES: #**

- SEE POS AND COMMUNICATIONS PLAN FOR FURTHER INFORMATION REGARDING POS AND UNDER COUNTER ELECTRICAL SERVICE.
- ELECTRICAL CONTRACTOR TO PROVIDE 25 FT. PITGAL FOR DONUT CASE WIRING.
- PROVIDE RED ILLUMINATED SWITCH FOR HOOD EXHAUST FAN CONTROL AND LIGHTS. PROVIDE TAG ABOVE SWITCH IDENTIFYING HOOD USE.
- PROVIDE JUNCTION BOXES AT TOILETS, SINKS AND OPTIONAL URINAL IF ALTERNATE "HANDS FREE" TOILET FIXTURES ARE BEING PROVIDED
- REFER TO POS COMMUNICATIONS FLOOR PLAN FOR LOCATIONS AND ELEVATIONS OF OFFICE RECEPTACLES.
- CONTRACTOR TO MOUNT RECEPTACLE IN THE EXISTING SOFFIT BEHIND THE MENUBOARD. VERIFY ACTUAL LOCATION WITH MENUBOARD MANUF. PRIOR TO INSTALLING.
- MOUNT RECEPTACLE FOR FRONTLINE BEVERAGE REFRIGERATOR ADJACENT WALL. PROVIDE MANUFACTURER APPROVED CORD AND PLUG FROM WALL TO RECEPTACLE. COORDINATE AS REQUIRED.



RECEPTACLES TAGGED WITH "USB" IN THE SALES & SEATING AREAS SHALL BE HUBBELL #USB15X2I (IVORY) / NP26I (IVORY) COMBO USB CHARGER WITH TAMPER-RESISTANT RECEPTACLE.


SEATING AREA RECEPTACLES SHALL BE IVORY WITH IVORY COVER PLATE AND ARE TO BE MOUNTED AT 3'-2-1/2" AFF.

**ELECTRIC LEGEND**

- DUPLEX OUTLET 12" A.F.F. UNLESS NOTED OTHERWISE  
G=G.F.I. C=ABOVE COUNTER WP=WATERPROOF  
X = NUMBER OF GANGED DUPLEXES IF MORE THAN ONE
- POWER OUTLET - 208 VOLT, X = AMPERE
- TRANSIENT VOLTAGE SURGE SUPPRESSOR  
DUPLEX OUTLET
- JUNCTION BOX
- FUSED DISCONNECT SWITCH
- WALL CLOCK - EDWARDS #1882,  
MOUNTED 8'-0" A.F.F.
- TIME CLOCK (BY OTHERS)
- HAND DRYER (BY OTHERS)
- DOOR BUZZER - EDWARDS #115-4 WITH SWITCH
- BUZZER ALARM - EDWARDS #1065-65 W/592  
24 VOLT TRANSFORMER UNDER COMMON PLATE
- DOOR BELL - EDWARDS #55-465, MOUNTED 8'-0" A.F.F.
- BUZZER SWITCH - EDWARDS #44 DOOR CONTACT
- DOOR BELL BUTTON - EDWARDS #852

**CONVENIENCE POWER NOTE**

NOTE: CONVENIENCE POWER IS PROVIDED ON THIS PLAN. LOCATIONS FOR CONVENIENCE POWER TO BE REVIEWED W/ FRANCHISEE. TYPICAL LOCATIONS FOR ADDITIONAL OUTLETS: FRONT AND BACK LINE COUNTERS, OFFICE, ABOVE CEILING IN SALES AREA AND VESTIBULE, ROOF FOR HOLIDAY LIGHTING.

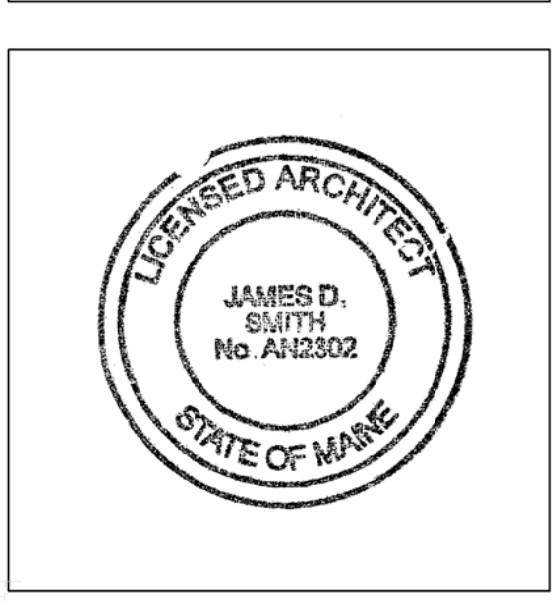

**JAMES D. SMITH, ARCHITECT, AIA**  
35 LOTHROP'S LANE  
WEST BARNSTABLE, MA 02668  
PHONE: 508-367-8820  
JAMESDSMITH11@COMCAST.NET

DATE	SCALE	NOTED	DRAWN	JOB #	C.M.
02-29-16			ARL	D15098	R. MAHONEY

STORE LOCATION:  
**PORTLAND, ME**  
599 WARREN AVE.

**ELECTRIC POWER PLAN**

FRESH BREW IMAGE: DARK ROAST

P.C. #: 339010