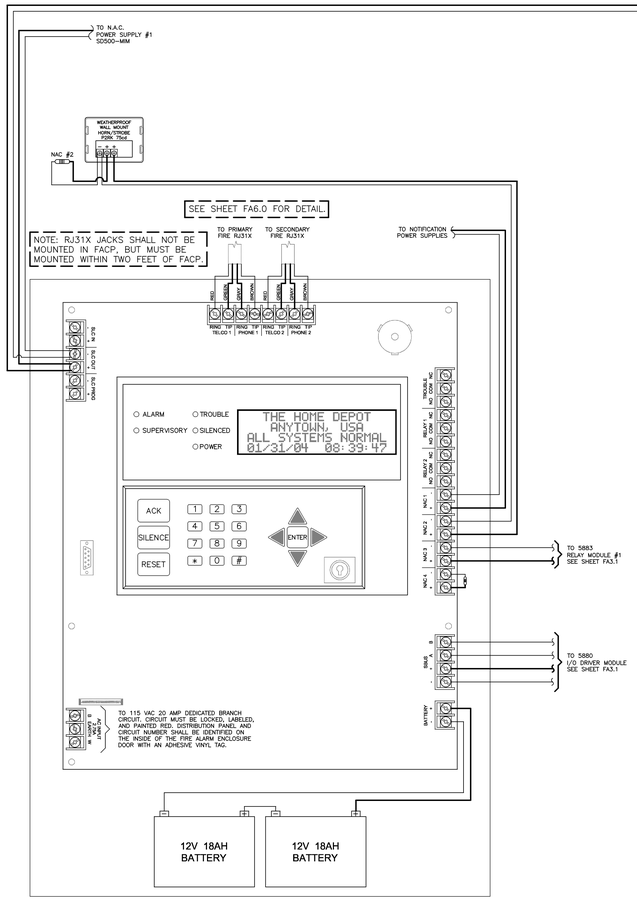

AC REQUIREMENTS

EACH DEDICATED 20AMP CIRCUIT BREAKER SHALL NOT EXCEED 16AMPS OF DRAW FROM THE FIRE ALARM CONTROL PANEL AND ALL ASSOCIATED EQUIPMENT. IT IS THE INSTALLING CONTRACTOR'S RESPONSIBILITY TO CALCULATE THE AMOUNT OF AC CIRCUITS REQUIRED.

5808 – 2.75A
5499 – 3.0A
AL300ULXR – 1.45A

SCOPE OF WORK

THIS IS AN EXISTING STORE THAT IS OPEN FOR BUSINESS.

THE EXISTING FIRE ALARM SYSTEM WILL BE REPLACED WITH NEW TO ENSURE RELIABLE PERFORMANCE.

NOTE:

THE INTERNET DIALER IS INSTALLED FOR FUTURE USE ONLY. NOT TO BE ACTIVATED AT THIS TIME. RESISTOR OUT MONITOR MODULE

NOTE: AL300ULXR TO BE INSTALLED AS CLOSE TO FACP AS POSSIBLE.

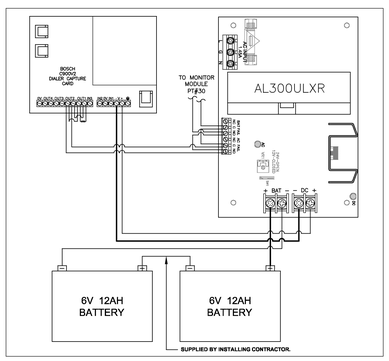

FIRE ALARM INITIATING RISER DIAGRAM
SCALE: NO SCALE

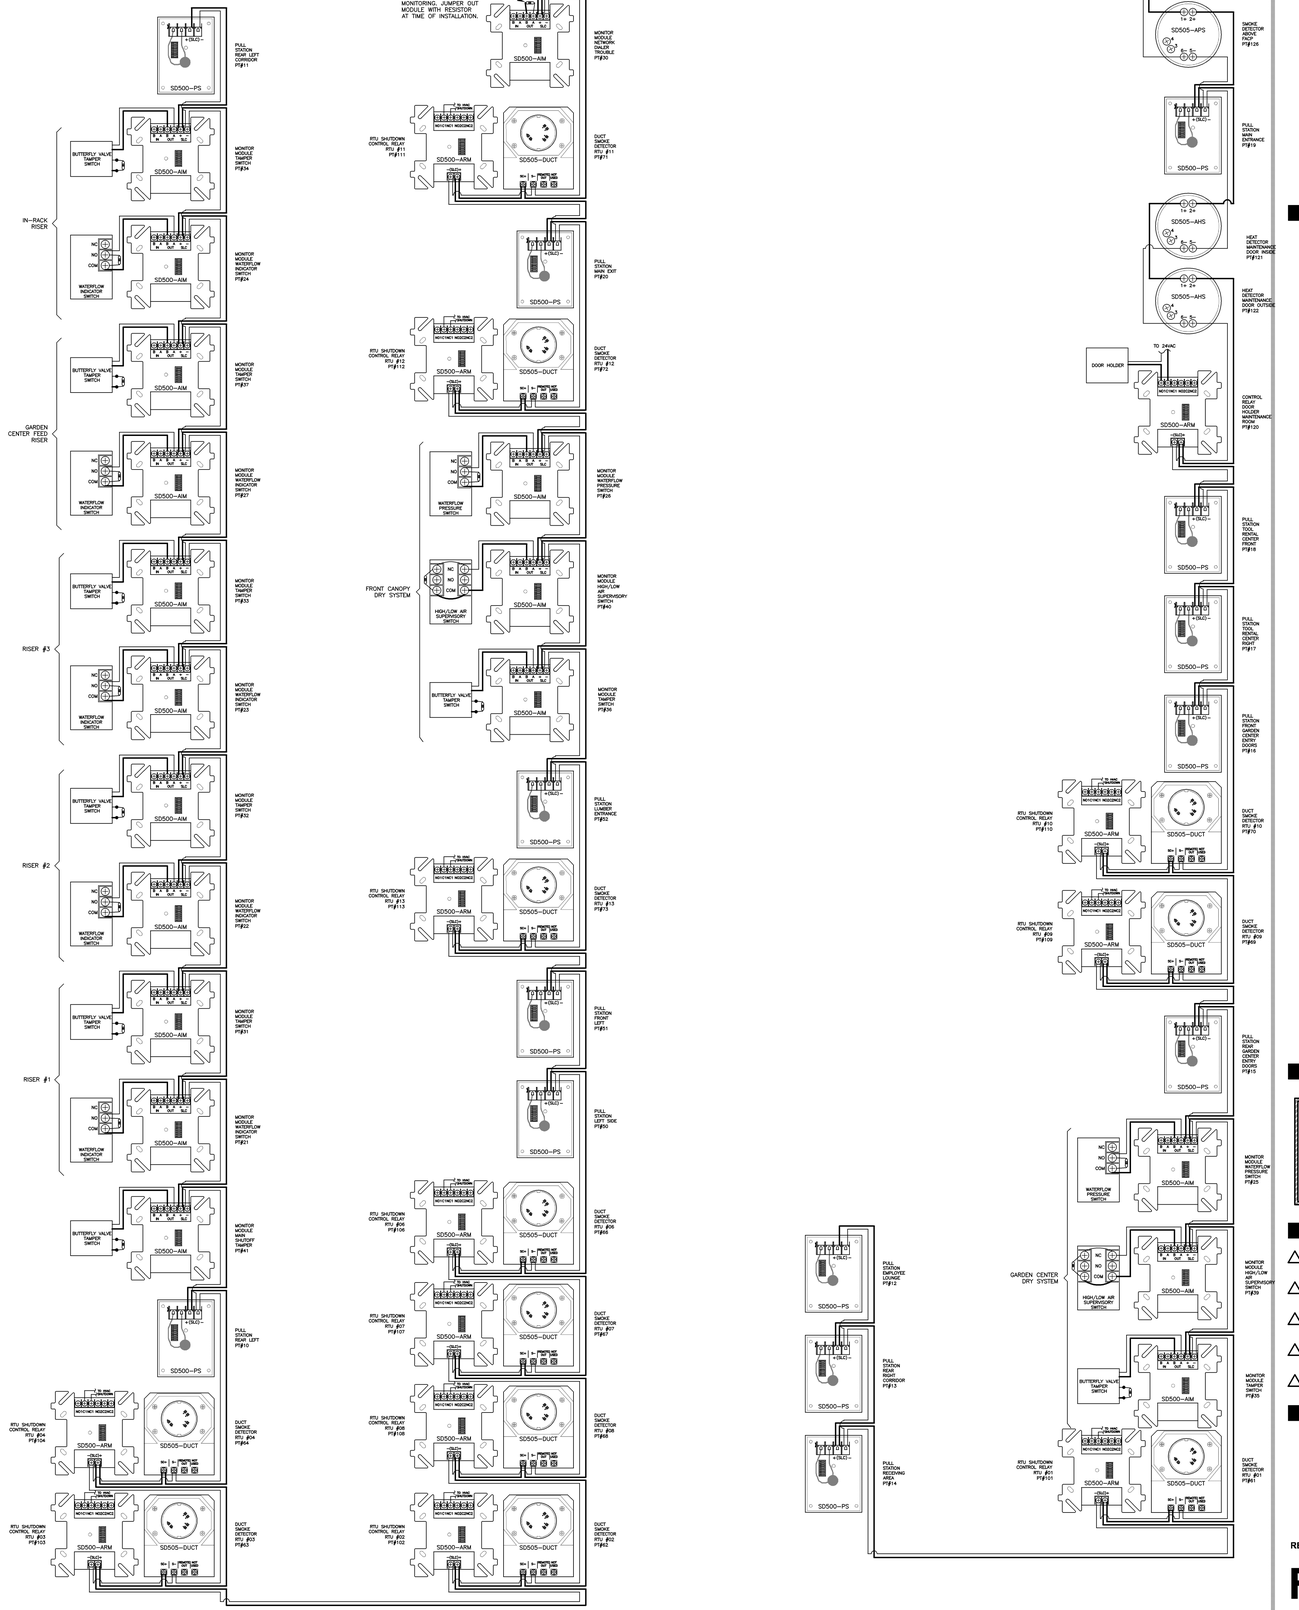

FA3.0 FIRE ALARM INITIATING RISER DIAGRAM

telgian
Telgian # 83MED001
Sometimes D/B/A Fire Materials Group LLC or TFA Fire & Life Safety, Inc.

CONSULTANT:
Ray Dotts

DESIGNER:
Bill Cummings

QUALITY CONTROL:
Brian Scudder

THE HOME DEPOT
Portland, ME

STORE#2401
THE HOME DEPOT
245 Riverside St.
Portland, ME

NICET LEVEL IV
BRIAN SCUDDER, SET
FIRE ALARM SYSTEMS
CERTIFICATION NUMBER
96297

DATE

REVISIONS

△
△
△
△
△

DESIGN COMPLETE:
05/16/11

HOME DEPOT
REPLACEMENT PROGRAM