NOTES:

1. PROVIDE CIRCUITING TO ALL EXTERIOR LIGHTING.

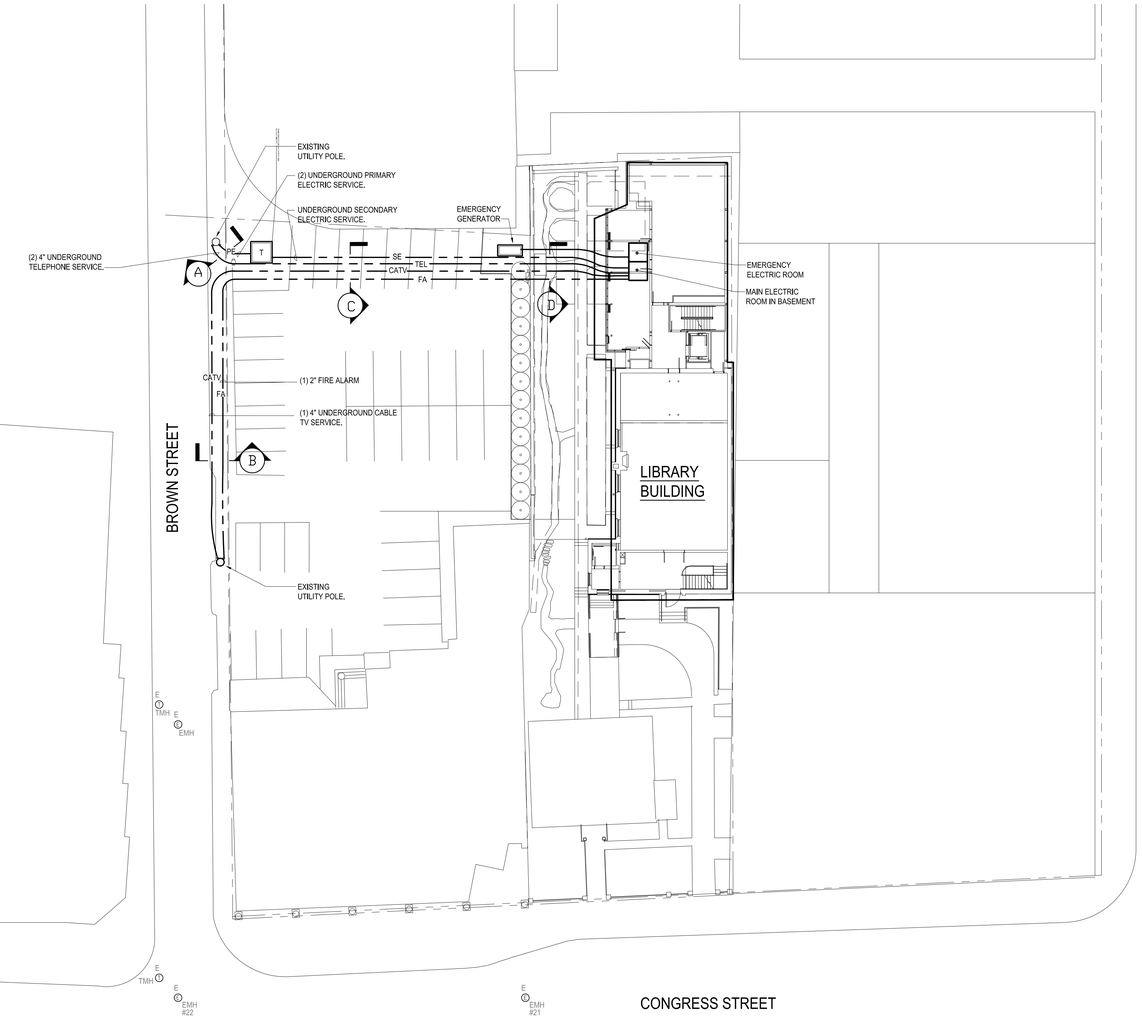

SITE PLAN

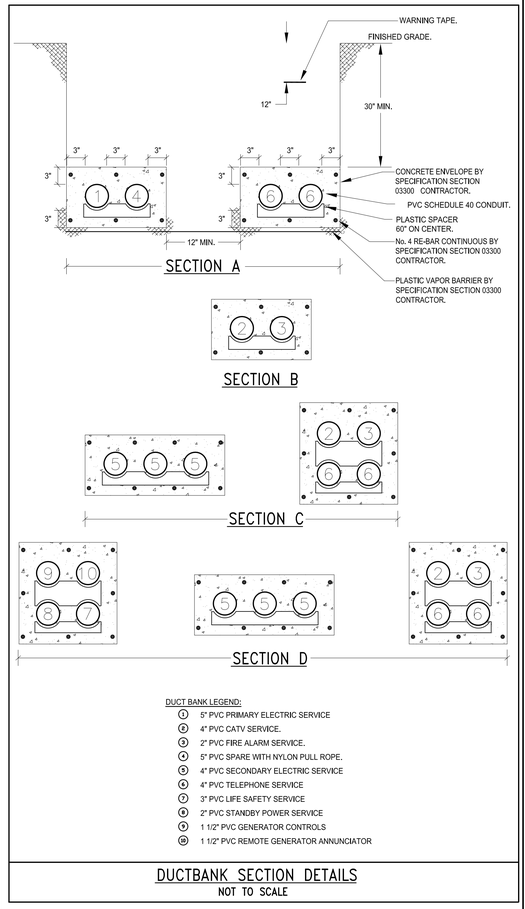

DUCT BANK LEGEND:

1. 5" PVC PRIMARY ELECTRIC SERVICE
2. 4" PVC CATV SERVICE.
3. 2" PVC FIRE ALARM SERVICE.
4. 5" PVC SPARE WITH NYLON PULL ROPE.
5. 4" PVC SECONDARY ELECTRIC SERVICE
6. 4" PVC TELEPHONE SERVICE
7. 3" PVC LIFE SAFETY SERVICE
8. 2" PVC STANDBY POWER SERVICE
9. 1 1/2" PVC GENERATOR CONTROLS
10. 1 1/2" PVC REMOTE GENERATOR ANNUNCIATOR

DUCTBANK SECTION DETAILS
NOT TO SCALE

CONSULTANTS

TMP Consulting Engineers Inc.
52 Temple Place
Boston, Massachusetts
02111-1308
TEL 617-357-6060
FAX 617-357-6188
@2007 TMP Consulting Engineers

SCHWARTZ / SILVER ARCHITECTS INC.
75 Kneeland Street
Boston, Massachusetts 02111
Telephone 617/542-6650
Facsimile 617/951-0779

PROJECT

MAINE HISTORICAL SOCIETY
489 CONGRESS ST.
PORTLAND, MAINE

DATE	REVISIONS		
05/01/07	60% CD SET		
07/02/07	100% CD REVIEW SET		
07/16/07	100% CD SET		
09/7/07	REVISION 1		
Date	Description	Number	

GL	##/##/##	Date
Drawn By		
MDC	##/##/##	Date
Reviewed By		
J.M.		Date
Approved By		

DRAWING TITLE

SITE PLAN
ELECTRICAL

1"=20'-0"
Scale

DRAWING NUMBER

E-2

Sheet 2 of 10

Plotted: 10 Oct, 2007 - 1:23pm smorgan
P:\projects\2006\06-047\cad\arch\E1.dwg
THE FOLLOWING ARCHITECTURAL FILES WERE UPDATED ON 07/02/07 (from files received on 06/27/07)
THE FOLLOWING ARCHITECTURAL FILES WERE UPDATED ON 07/18/07 2270roof (from files received on 07/11/07)
THE FOLLOWING ARCHITECTURAL FILES WERE UPDATED ON 07/19/07 2270c3F - Roof2C1 (from files received on 07/09/07)
THE FOLLOWING ARCHITECTURAL FILES WERE UPDATED ON 07/05/07 2270c1B (from files received on 07/05/07)
THE FOLLOWING ARCHITECTURAL FILES WERE UPDATED ON 06/27/07 2270site (from files received on 06/27/07)